

Bay Area Clean Water Agencies
Nutrient Reduction Study

Group Annual Report

Nutrient Watershed Permit Annual Report
2019

February 1, 2020



Contents

1	Introduction	1
2	Background	3
3	Approach	7
3.1	Data Sources	7
3.2	Measurement Methodologies	9
3.3	Data Confirmation	9
3.4	Seasonality	10
3.5	Trend Analysis	10
3.6	Influent Data	11
4	Results	13
4.1	Dataset Limitations	13
4.2	Flow	14
4.3	Ammonia	20
4.4	Nitrate + Nitrite (NOx)	26
4.5	Total Inorganic Nitrogen (TIN)	32
4.6	Total Phosphorus (TP)	38
4.7	Flows and Nutrient Loads Distribution by Subembayment	44
4.7.1	Suisun Bay	45
4.7.2	San Pablo Bay	47
4.7.3	Central Bay	49
4.7.4	South Bay	51
4.7.5	Lower South Bay	53
5	Discussion	55
5.1	Trending Statistics	56
5.2	Flow Analysis	56
5.3	Ammonia Analysis	57
5.4	NOx Analysis	57
5.5	Total Inorganic Nitrogen Analysis	58
5.6	Total Phosphorus Analysis	58
6	Summary	61

Tables

Table 2-1. Municipal Wastewater Dischargers Included in the Nutrient Watershed Permit	3
Table 3-1. Comparison of Sampling Requirements for the Section 13267 Letter Data and Nutrient Watershed Permits.....	7
Table 3-2. List of Parameters, Methodology, and Sample Type Required for both Datasets	9
Table 4-1. Annual Average Daily Discharge Flows by Discharger (mgd).....	15
Table 4-2. Dry Season Average Daily Flows by Discharger (mgd)	17
Table 4-3. Annual Average Daily Discharges by Subembayment, Flow (mgd).....	19
Table 4-4. Dry Season Average Daily Discharges by Subembayment, Flow (mgd)	19
Table 4-5. Annual Average Daily Discharges by Discharger, Ammonia (kg N/d).....	21
Table 4-6. Dry Season Average Daily Discharges by Discharger, Ammonia (kg N/d).....	23
Table 4-7. Annual Average Daily Discharges by Subembayment, Ammonia (kg N/d).....	25
Table 4-8. Dry Season Average Daily Discharges by Subembayment, Ammonia (kg N/d)	25
Table 4-9. Annual Average Daily Discharges by Discharger, NOx (kg N/d).....	27
Table 4-10. Dry Season Average Daily Discharges by Discharger, NOx (kg N/d)	29
Table 4-11. Annual Average Daily Discharges by Subembayment, NOx (kg N/d).....	31
Table 4-12. Dry Season Average Daily Discharges by Subembayment, NOx (kg N/d)	31
Table 4-13. Annual Average Daily Discharges by Discharger, TIN (kg N/d).....	33
Table 4-14. Dry Season Average Daily Discharges by Discharger, TIN (kg N/d)	35
Table 4-15. Annual Average Daily Discharges by Subembayment, TIN (kg N/d)	37
Table 4-16. Dry Season Average Daily Discharges by Subembayment, TIN (kg N/d)	37
Table 4-17. Annual Average Daily Discharges by Discharger, TP (kg P/d)	39
Table 4-18. Dry Season Average Daily Discharges by Discharger, TP (kg P/d).....	41
Table 4-19. Annual Average Daily Discharges by Subembayment, TP (kg P/d).....	43
Table 4-20. Dry Season Average Daily Discharges by Subembayment, TP (kg P/d).....	43
Table 6-1. Summary of Average Annual Flow and Load Discharges to the Bay.....	62
Table 6-2. Summary of Dry Season Flow and Load Discharges to the Bay	62
Table 6-3. Summary of Average Annual Flow and Constituent Concentrations Discharged to the Bay	63
Table 6-4. Summary of Dry Season Flow and Constituent Concentrations Discharged to the Bay.....	63

Figures

Figure 2-1. Location of Dischargers	5
Figure 4-1. Historical Average Monthly Daily Discharge Flow Values	14
Figure 4-2. Historical Average Monthly Daily Discharge Ammonia Load Values	20
Figure 4-3. Historical Average Monthly Daily Discharge NOx Load Values	26
Figure 4-4. Historical Average Monthly Daily Discharge TIN Load Values	32
Figure 4-5. Historical Average Monthly Daily Discharge TP Load Values	38
Figure 4-6. Flow Contribution by Discharger to Suisun Bay	45
Figure 4-7. Ammonia Load Contribution by Discharger to Suisun Bay	45
Figure 4-8. TIN Load Contribution by Discharger to Suisun Bay	46
Figure 4-9. TP Load Contribution by Discharger to Suisun Bay	46
Figure 4-10. Flow Contribution by Discharger to San Pablo Bay	47
Figure 4-11. Ammonia Load Contribution by Discharger to San Pablo Bay	47
Figure 4-12. TIN Load Contribution by Discharger to San Pablo Bay	48
Figure 4-13. TP Load Contribution by Discharger to San Pablo Bay	48
Figure 4-14. Flow Contribution by Discharger to Central Bay	49
Figure 4-15. Ammonia Load Contribution by Discharger to Central Bay	49
Figure 4-16. TIN Load Contribution by Discharger to Central Bay	50
Figure 4-17. TP Load Contribution by Discharger to Central Bay	50
Figure 4-18. Flow Contribution by Discharger to South Bay	51
Figure 4-19. Ammonia Load Contribution by Discharger to South Bay	51
Figure 4-20. TIN Load Contribution by Discharger to South Bay	52
Figure 4-21. TP Load Contribution by Discharger to South Bay	52
Figure 4-22. Flow Contribution by Discharger to Lower South Bay	53
Figure 4-23. Ammonia Load Contribution by Discharger to Lower South Bay	53
Figure 4-24. TIN Load Contribution by Discharger to Lower South Bay	54
Figure 4-25. TP Load Contribution by Discharger to Lower South Bay	54
Figure 5-1. Historical Average Monthly Daily Discharge Flows and Loads	55

Appendices

Appendix – Discharge Evaluation for Individual Dischargers

1 Introduction

On May 8, 2019, the San Francisco Bay Regional Water Quality Control Board (Regional Water Board) adopted the Nutrient Watershed Permit, also known as National Pollutant Discharge Elimination System (NPDES) Permit No. CA0038873, Regional Water Board Order No. R2-2019-0017. This permit replaces the previous permit under Order No. R2-2014-0014, which expired on June 30, 2019. The updated Nutrient Watershed Permit became effective on July 1, 2019, and covers each municipal Publicly Owned Treatment Works (POTW) that discharges to the San Francisco Bay and its tributaries. The purpose of this Nutrient Watershed Permit is to track and evaluate treatment plant performance, fund nutrient research and monitoring programs, support load response modeling, and conduct treatment plant optimization and upgrade studies for nutrient removal.

One of the requirements of the Nutrient Watershed Permit is the reporting and analysis of influent and effluent nutrient monitoring data, and concentration and loading trends. Each agency's nutrient loads must also be compared to total POTW loads in their respective subembayment, as defined in the permit. An annual report is required to provide an ongoing record of these data and analyses.

The purpose of this Group Annual Report is to fulfill the reporting and analysis requirement of the Nutrient Watershed Permit for the participating agencies for the period between Oct 1, 2012 and Sep 30, 2019. This report includes the following sections:

- ▲ **Section 2 – Background.** This section includes relevant background information on the requirements of the Nutrient Watershed Permit.
- ▲ **Section 3 – Approach.** This section presents the approach to obtain data, the constituents of interest, data confirmation, seasonality analysis, and statistical trending.
- ▲ **Section 4 – Results.** This section presents the data for each discharger as well as the annual and seasonal averages for the Discharge Flow, Ammonia, Nitrite plus Nitrate, Total Inorganic Nitrogen, and Total Phosphorus. In addition, the contributing flows and loads for each discharger are presented in comparison to the other dischargers in its respective subembayment.
- ▲ **Section 5 – Discussion.** This section includes a discussion of the data presented in Section 4.
- ▲ **Section 6 – Summary.** This section provides a brief summary of the findings, discussion, and recommendations that will improve the data collection and analysis in future years.
- ▲ **Appendix.** A separate section is provided in the appendix to present the data and analysis for each of the thirty-four dischargers.

This page is intentionally blank.

2 Background

The Nutrient Watershed Permit applies to the municipal wastewater dischargers and specific facilities identified in Table 2-1. In addition, the location of each discharger is shown in Figure 2-1.

Table 2-1. Municipal Wastewater Dischargers Included in the Nutrient Watershed Permit

Discharger Name (Abbreviation)	POTW Facility Name	Minor / Major ^(a)
American Canyon, City of (American Canyon)	Wastewater Treatment and Reclamation Facility	Major
Benicia, City of (Benicia)	Benicia Wastewater Treatment Plant	Major
Burlingame, City of (Burlingame)	Burlingame Wastewater Treatment Plant	Major
Central Contra Costa Sanitary District (CCCSD)	Central Contra Costa Sanitary District Wastewater Treatment Plant	Major
Central Marin Sanitation Agency (CMSA)	Central Marin Sanitation Agency Wastewater Treatment Plant	Major
Crockett Community Services District (Port Costa)	Port Costa Wastewater Treatment Plant	Minor
Delta Diablo (Delta Diablo)	Wastewater Treatment Plant	Major
East Bay Dischargers Authority (EBDA): Cities of Hayward and San Leandro; Oro Loma Sanitary District; Castro Valley Sanitary District; Union Sanitary District; East Bay Regional Parks District; Livermore-Amador Valley Water Management Agency; Dublin San Ramon Services District; and City of Livermore	EBDA Common Outfall	Major
	Hayward Water Pollution Control Facility	
	San Leandro Water Pollution Control Plant	
	Oro Loma/Castro Valley Sanitary Districts Water Pollution Control Plant	
	Raymond A. Boege Alvarado Wastewater Treatment Plant	
	Hayward Marsh	
	Livermore-Amador Valley Water Management Agency Export and Storage Facilities	
	Dublin San Ramon Services District Wastewater Treatment Plant	
	City of Livermore Water Reclamation Plant	
East Bay Municipal Utility District (EBMUD)	East Bay Municipal Utility District, Special District No. 1 Wastewater Treatment Plant	Major
Fairfield-Suisun Sewer District (FSSD)	Fairfield-Suisun Wastewater Treatment Plant	Major
Las Gallinas Valley Sanitary District (Las Gallinas)	Las Gallinas Valley Sanitary District Sewage Treatment Plant	Major
Marin County (Paradise Cove), Sanitary District No. 5 of	Paradise Cove Treatment Plant	Minor
Marin County (Tiburon), Sanitary District No. 5 of	Wastewater Treatment Plant	Minor
Millbrae, City of (Millbrae)	Water Pollution Control Plant	Major
Mt. View Sanitary District (Mt View)	Mt View Sanitary District Wastewater Treatment Plant	Major
Napa Sanitation District (Napa)	Soscol Water Recycling Facility	Major
Novato Sanitary District (Novato)	Novato Sanitary District Wastewater Treatment Plant	Major
Palo Alto, City of (Palo Alto)	Palo Alto Regional Water Quality Control Plant	Major

Discharger Name (Abbreviation)	POTW Facility Name	Minor / Major ^(a)
Petaluma, City of (Petaluma)	Municipal Wastewater Treatment Plant	Major
Pinole, City of (Pinole)	Pinole-Hercules Water Pollution Control Plant	Major
Rodeo Sanitary District (Rodeo)	Rodeo Sanitary District Water Pollution Control Facility	Major
San Francisco (San Francisco International Airport), City and County of (SFO Airport)	Mel Leong Treatment Plant, Sanitary Plant	Major
San Francisco (Southeast Plant), City and County of (SFPUC Southeast)	Southeast Water Pollution Control Plant	Major
San Jose/Santa Clara Water Pollution Control Plant and Cities of San Jose and Santa Clara (San Jose)	San Jose/Santa Clara Water Pollution Control Plant	Major
San Mateo, City of (San Mateo)	City of San Mateo Wastewater Treatment Plant	Major
Sausalito-Marin City Sanitary District (SMCSD)	Sausalito-Marin City Sanitary District Wastewater Treatment Plant	Major
Sewerage Agency of Southern Marin (SASM)	Sewerage Agency of Southern Marin Wastewater Treatment Plant	Major
Silicon Valley Clean Water (SVCW)	Silicon Valley Clean Water Wastewater Treatment Plant	Major
Sonoma Valley County Sanitary District (Sonoma Valley)	Municipal Wastewater Treatment Plant	Major
South San Francisco and San Bruno, Cities of (South SF)	South San Francisco and San Bruno Water Quality Control Plant	Major
Sunnyvale, City of (Sunnyvale)	Sunnyvale Water Pollution Control Plant	Major
U.S. Department of Navy (Treasure Island)	Treasure Island Wastewater Treatment Plant	Major
Vallejo Flood and Wastewater District (Vallejo)	Vallejo Wastewater Treatment Plant	Major
West County Agency (West County) (West County Wastewater District and City of Richmond Municipal Sewer District)	West County Agency Combined Outfall	Major
	West County Wastewater District Treatment Plant	
	Richmond Municipal Sewer District Water Pollution Control Plant	

(a) As defined in the Nutrient Watershed Permit.

The Nutrient Watershed Permit has specific influent and effluent monitoring requirements. Each agency covered by the Permit is required to monitor and report the following constituents in their effluent:

1. Ammonia as Nitrogen
2. Nitrate/Nitrite as Nitrogen
3. Total Inorganic Nitrogen as Nitrogen (Calculated Value)
4. Total Phosphorus

Each agency with a facility design flow of more than 10 million gallons per day is required to monitor and report the following constituents in their influent:

1. Ammonia as Nitrogen
2. Total Kjeldahl Nitrogen
3. Nitrate/Nitrite as Nitrogen
4. Total Phosphorus



Figure 2-1. Location of Dischargers

Major municipal dischargers having a permitted or design flow greater than 10 million gallons per day (mgd) are required to sample effluent twice per month, and influent once per quarter. Major

municipal dischargers having a flow greater than 1 mgd but less than or equal to 10 mgd are required to sample effluent once per month. Minor municipal discharges, defined as those with a flow less than 1 mgd, are required to monitor effluent twice per year. In addition, dischargers are required to sample only during the months of the year when they are discharging. The data collected must be submitted monthly on the Regional Water Board's California Integrated Water Quality System (CIWQS) online data reporting tool.

Prior to the sampling required under the Nutrient Watershed Permit, the dischargers were required to perform similar sampling and data collection. This early data collection was required under the Regional Water Board's Section 13267 Letter data, dated March 2, 2012.¹

Together, the Nutrient Watershed Permit data and the Section 13267 Letter data, form the dataset for the analysis and reporting in this Group Annual Report. Additional information regarding the data sources and data confirmation is included in Section 3.

Per Attachment E, Section IV.B.1.b., of the Nutrient Watershed Permit the Group Annual Report must include the following:

- ii. Summary tables depicting the Discharger's annual and monthly flows, nutrient concentrations, and nutrient mass loads, calculated as described in Attachment G section VIII.A (Arithmetic Calculations) of individual NPDES permits. The summary tables shall cover October 1 before the preceding year through September 30 of the preceding year and at least the previous five years of available data. Each Discharger shall document its nutrient loads relative to other facilities covered by this Order that discharge into the same subembayment (i.e., Suisun Bay, San Pablo Bay, Central Bay, South Bay, and Lower South Bay). These subembayment delineations may be refined through Provision VI.C.4 of the Order, in which case each Discharger shall document loads relative to the most recent delineation. Nutrient data from other Dischargers may be obtained from the State Water Board's California Integrated Water Quality System (CIWQS) website (<https://www.waterboards.ca.gov/ciwqs/index.html>).
- iii. Analysis of nutrient trends and load variability, and assessment as to whether nutrient mass discharges are increasing or decreasing.
- iv. Status and plans for investigation if the trend analysis shows a significant change in nutrient loading. In such cases, the Discharger shall investigate the cause. In the annual reports, the Discharger shall set forth its plans for investigation and report its results, providing necessary updates in subsequent annual reports. The investigation shall include, at a minimum, whether treatment process changes, increasing or decreasing water reclamation, or changes in total influent flow related to water conservation, population growth, transient work community, new industry, or wet weather flows have reduced or increased nutrient discharges.

¹ Wolfe, Bruce. (2012) Letter: Water Code Section 13267 Technical Report Order Requiring Submittal of Information on Nutrients in Wastewater Discharges. March 2, 2012.
https://www.waterboards.ca.gov/sanfranciscobay/board_decisions/adopted_orders/2019/R2-2019-0017.pdf

3 Approach

The sources of data, as well as the approach for data confirmation, analysis of seasonality, and statistical trending are presented in the subsections below.

3.1 Data Sources

Data from Oct 2012 to Sep 2019 was compiled from two different sources: the Section 13267 Letter Data requirements and the subsequent Nutrient Watershed Permits. The Section 13267 Letter data includes the initial two years (Oct 2012 through June 2014) and the Nutrient Watershed Permits data includes the subsequent years (July 2014 through Sep 2019). The sampling requirements and frequency differ between the two datasets. The Nutrient Watershed Permit data collection requirements were updated as of July 1, 2019 per the second Nutrient Watershed Permit. The updated NPDES permit (R2-2019-0017) included the following significant changes:

- 1) The yearly reporting period has been changed from Jul-Jun to Oct-Sep. This was done to more accurately reflect the seasonal changes from year to year (see Section 3.4 for more discussion on Seasonality). As a result, the initial few months of the Section 13267 Letter data (July 2012 through September 2013) were excluded from further analysis.
- 2) Soluble Reactive Phosphorus (Ortho-P) and TKN effluent data is no longer required.
- 3) Total Inorganic Nitrogen (TIN) will be calculated as the basis for effluent nitrogen concentration, as opposed to Total Nitrogen (TN).
- 4) Quarterly influent nutrient reporting is required for dischargers with a permitted or design flow of greater than 10 million gallons per day.

A comparison for the sampling requirements for each dataset is summarized in Table 3-1.

Table 3-1. Comparison of Sampling Requirements for the Section 13267 Letter Data and Nutrient Watershed Permits

Parameter	Section 13267 Letter Data	Nutrient Watershed Permit Data (2014; R2-2014-0014)	Nutrient Watershed Permit Data (2019; R2-2019-0017)
Major Dischargers and Sampling Frequency	<ol style="list-style-type: none"> 1) Flows ≥ 5 mgd permitted capacity <ol style="list-style-type: none"> a. Year round dischargers: Sample twice per month and two additional samples each wet season during peak wet weather flow conditions b. Seasonal dischargers: Sample twice per month during discharge (wet) season; sample once during non-discharge (dry) season 2) Flows between 1 and 5 mgd permitted capacity 	<ol style="list-style-type: none"> 1) Flows >10 mgd permitted capacity must sample effluent twice per month 2) Flows between 1 and 10 mgd permitted capacity must sample effluent once per month 	<ol style="list-style-type: none"> 1) Flows >10 mgd permitted capacity must sample effluent twice per month, and influent once per quarter. 2) Flows between 1 and 10 mgd permitted capacity must sample effluent once per month.

Parameter	Section 13267 Letter Data	Nutrient Watershed Permit Data (2014; R2-2014-0014)	Nutrient Watershed Permit Data (2019; R2-2019-0017)
	<ul style="list-style-type: none"> a. Year round dischargers: Sample twice per month and two additional samples each wet season during peak wet weather flow conditions b. Seasonal dischargers: Sample twice per month during discharge (wet) season; sample once during non-discharge (dry) season 		
Minor Dischargers and Sampling Frequency	<ul style="list-style-type: none"> 1) Flows <1 mgd permitted capacity <ul style="list-style-type: none"> a. Year round dischargers: Sample once per month b. Seasonal dischargers: Sample once per month during discharge (wet) season; sample once during non-discharge (dry) season 	<ul style="list-style-type: none"> 1) Flows <1 mgd permitted capacity must sample twice per year 	<ul style="list-style-type: none"> 1) Flows <1 mgd permitted capacity must sample twice per year
Non-Nutrient Sampling Parameters	Flow pH Temperature	Flow	Flow
Nitrogen Species and Sample Type	<ul style="list-style-type: none"> 1) Total Ammonia (NH₃ plus NH₄⁺, reported as N) – Composite Sample 2) Total Dissolved Nitrogen (TDN, reported as N) – Composite Sample 3) Total Kjeldahl Nitrogen (TKN, reported as N) – Composite Sample 4) Soluble Kjeldahl Nitrogen (SKN, reported as N) – Composite Sample 5) Nitrate (NO₃⁻, reported as N) – Composite Sample 6) Nitrite (NO₂⁻, reported as N) – Composite Sample 7) Urea (limited to 5 largest dischargers, reported as N) – Composite Sample 	<ul style="list-style-type: none"> 1) Total Ammonia (NH₃ plus NH₄⁺, reported as N) – Composite Sample 2) Total Kjeldahl Nitrogen (TKN) – Composite Sample 3) Nitrate (NO₃⁻) plus Nitrite (NO₂⁻) (NO_x, reported as N) – Composite Sample 4) Total Nitrogen (TN, calculated) – Composite Sample 	<p>Influent and Effluent:</p> <ul style="list-style-type: none"> 1) Total Ammonia (NH₃ plus NH₄⁺, reported as N) – Composite Sample 2) Nitrate (NO₃⁻) plus Nitrite (NO₂⁻) (NO_x, reported as N) – Composite Sample <p>Influent Only:</p> <ul style="list-style-type: none"> 1) Total Kjeldahl Nitrogen (TKN) – Composite Sample <p>Effluent Only:</p> <ul style="list-style-type: none"> 1) Total Inorganic Nitrogen (TIN) – Calculated, Total Ammonia + Nitrate and Nitrite

Parameter	Section 13267 Letter Data	Nutrient Watershed Permit Data (2014; R2-2014-0014)	Nutrient Watershed Permit Data (2019; R2-2019-0017)
Phosphorus Species and Sample Type	1) Total Phosphorus (TP) – Composite Sample 2) Soluble Total Phosphorus (STP; reported as P) – Composite Sample 3) Dissolved Orthophosphate (reported as P) – Composite or Grab Sample 4) Total Orthophosphate (reported as P) – Composite Sample	1) Soluble Reactive Phosphorus (SRP, reported as P) – Grab Sample 2) Total Phosphorus (TP) – Composite Sample	1) Total Phosphorus (TP) – Composite Sample

3.2 Measurement Methodologies

A list of the measurement methodologies is presented in Table 3-2.

Table 3-2. List of Parameters, Methodology, and Sample Type Required for both Datasets

Parameter	Location	Measured or Calculated	Sample Type	Method ^(a,b)	Calculation
Flow	Influent & Effluent	Both (plant specific)	Continuous		$Flow (mgd) = \frac{Load (\frac{kg}{d})}{Conc (\frac{mg}{L}) *}$
Total Ammonia	Influent/Effluent	Measured ^(c)	24-hr Composite	4500-NH3	
TKN	Influent Only	Both (plant specific) ^(c)	24-hr Composite	4500-N(org)	
NOx	Influent/Effluent	Measured ^(c)	24-hr Composite	4500-N	
TIN	Effluent Only	Calculated ^(c)	24-hr Composite	Calculated	$TIN = Ammonia + NOx$
TP	Influent/Effluent	Measured ^(c)	24-hr Composite	4500-P	

- Standard Methods for the Examination of Water and Wastewater 2017-23rd Edition, American Public Health Association/American Water Works Association/Water Environment Federation, Washington, D.C.
- Dischargers may propose other U.S. EPA-approved analytical methods, if available, with detection limits low enough to quantify concentrations in wastewater.
- For plants with only flow and concentration values available, loads were manually calculated for daily values and/or using average monthly flow and concentration values.

3.3 Data Confirmation

Once the datasets were collected and compiled, the data for each plant was summarized and provided to each participating discharger for review and confirmation. Effluent data was selected that only includes discharge flows and loads to the Bay (i.e., effluent flows and loads diverted to other locations, such as irrigation, were excluded). The data presented in this Group Annual Report reflects additions and corrections provided by the participating agencies.

3.4 Seasonality

The seasonal variations in the data were examined by dividing the data into a dry and wet season. Understanding seasonality is critical for the analysis of nutrient discharges because of the following factors:

- ◆ The dry season is reflective of the base sanitary flows and loads from residential population and industrial contributions to wastewater. In contrast, the increased flows during wet weather events is attributed to inflow and infiltration (I&I) during such events which can bias the discharge results.
- ◆ Wastewater treatment facilities are better able to remove nutrient loads (if deemed necessary) during the warmer, dry season when the biological treatment kinetics are more favorable and there are fewer (if any) peak flow events.
- ◆ A Nutrient Management Study led by the San Francisco Estuary Institute (SFEI) is currently underway to evaluate San Francisco Bay's resilience to nutrients. It is expected to be less sensitive to nutrients during the wet season because the water is cooler, light irradiance in the Bay is reduced, turbidity in the Bay is elevated, and the hydraulic residence time in the Bay is reduced.

Seasonality is defined in the participating agencies' NPDES permits in different ways; furthermore, not all the permits have a seasonal definition. In order to provide a consistent basis for the purposes of this Group Annual Report, the seasonal definition presented in the approved Scoping and Evaluation Plan² was used. The wet and dry seasons are defined as follows:

- ◆ Dry season: May 1 through September 30
- ◆ Wet season: October 1 through April 30

3.5 Trend Analysis

The discharge data was evaluated to identify evidence of trends over the past seven years. Due to the change in sampling frequency between the Section 13267 Letter data and both Watershed Permit requirements, there is an inconsistency in the reporting of flows and loads during the wet season. Specifically, the Section 13267 Letter data required that in addition to normal monthly sampling, two additional samples be taken in the wet season during peak wet weather events. This requirement is not included in either Watershed Permits. As a result, an artificial bias has been introduced which was expected to overestimate the wet season load. A sensitivity analysis was performed for each Subembayment to confirm this bias. Based on that analysis, it was confirmed that the peak wet weather events do impact the trend analysis because the dataset is not large enough to offset such a load. For example, there are a few instances (e.g., Lower South Bay ammonia loading) with the Section 13267 Letter data that are several times greater than the average annual values and can skew the trending analysis. As a result, the trend analysis was limited to the

² Bay Area Clean Water Agencies (2015) Scoping and Evaluation Plan for Potential Nutrient Reduction by Treatment Optimization and Treatment Upgrades. Order No. R2-2014-0014, NPDES Permit No. CA0038873.

dry season, which best represents the actual base sanitary wastewater flows and loads for each plant.

The approach used to evaluate trend significance was the slope of a regression line. The slope was determined using the method of least squares.³ The sample set size was 5 samples per year ($n = 35$ in total for the seven years of discharge data). An alpha of 0.05 was assumed which denotes that a 5 percent risk of concluding that a difference exists when there is no actual difference. A trend was denoted significant if the p-value was less than alpha. Furthermore, the percent change with respect to the initial three years of data was included to serve as a reference or baseline for the extent of change over time.

3.6 Influent Data

Influent monitoring data are not included in this 2020 Group Annual Report. The decision to exclude such data is predicated on the fact that only a single data point is available for the nutrient parameters of interest. The future 2020 Group Annual Report (submittal by February 1, 2021) will include a full year of influent data and related discussion.

³ Montgomery, D.C.; Peck, E.A.; Vining, G.G. (2012) Introduction to Linear Regression Analysis. Published by John Wiley and Sons, Inc. Hoboken, NJ. Pages 12-66.

This page is intentionally blank.

4 Results

This section presents a data discussion for the following discharge parameters:

1. Flow
2. Total Ammonia (reported as N)
3. Nitrate plus Nitrite (NO_x, reported as N)
4. Total Inorganic Nitrogen (reported as N)
5. Total Phosphorus

Data are summarized for each discharger, as well as for each of the five subembayments. The data are also presented for both the annual average and dry season average. Data are presented based on the period of collection; for example, 2012/2013 represents the period between October 1, 2012 and September 30, 2013.

In addition, the relative contribution of flow and loads for each discharger is provided for each subembayment.

4.1 Dataset Limitations

There are several limitations in the overall dataset for the period between October 2012 and September 2019. The sampling frequency requirements vary by size of discharger, ranging from once per dry season for minor plants to twice per month for plants larger than 10 mgd. It is further complicated by the earlier Section 13267 Letter data requirement to sample twice per wet season during peak wet weather events. This variation in data collection creates inconsistencies in the datasets and presents limitations on statistical analysis for the purposes of trending. Given the relatively small dataset ($n = 84$ for most dischargers), a few additional samples from wet weather events can artificially exaggerate the average monthly load values during the wet period as previously discussed in Section 3.5.

As previously described, the trend analysis presented in the following subsections is based on the Dry Season ($n = 35$ for most dischargers).

Since the first Group Annual Report submitted in 2015, there have been several data amendments within CIWQS as well as the Group Annual Reports as follows:

- Data from the City of Palo Alto, the City of San Mateo, and Napa Sanitation District submitted under the 2015 Group Annual Report Submittal was initially updated in the 2016 Report with updated data that is reflected in this report.
- Data from the Rodeo Sanitary District 2014-2016 datasets were updated with values that are reflected in this report.
- Ammonia data for June 2017 from Sausalito Marin City Sanitation District were updated with values that are reflected in this report.
- Flow data from Tiburon for the 2014/2015 and 2015/2016 were inaccurately reported in the 2017 Group Annual Report. This report reflects the accurate data from CIWQS.

4.2 Flow

The annual average and dry season average monthly discharge flows are presented in Table 4-1 and Table 4-2, respectively. The annual average and dry season discharge flows discharged to each subembayment are presented in Table 4-3 and Table 4-4, respectively.

The total average annual discharge flows (Table 4-3) were decreasing in the initial 3 years of data, but gradually increased in 2015/2016, increasing significantly in the 2016/2017 season due to a relatively wet year in terms of precipitation. The 2016/2017 and 2018/2019 flows had the highest and second-highest recorded flows in the seven year period.

The 2018/2019 total dry season discharge flows (Table 4-4) were similar to the previous two years. The total dry season discharge flows were decreasing in the initial 3 years of data, but increased during the 2015/2016 season and have remained relatively steady since the 2016/2017 season. No Subembayments or total flows showed any statistically significant trending for the discharge dry season flows. This trending is based on the least squares correlation test selected as the basis for trends analysis (see Section 3.5).

The historical average monthly daily discharge flows are presented in Figure 4-1. The South Bay and Lower South Bay Subembayments account for over half of the flow discharged to the San Francisco Bay (see Table 4-3). The dry season discharge flows show an overall decrease compared to the wet season for all subembayments.

A discussion of the results is provided in Section 5.2.

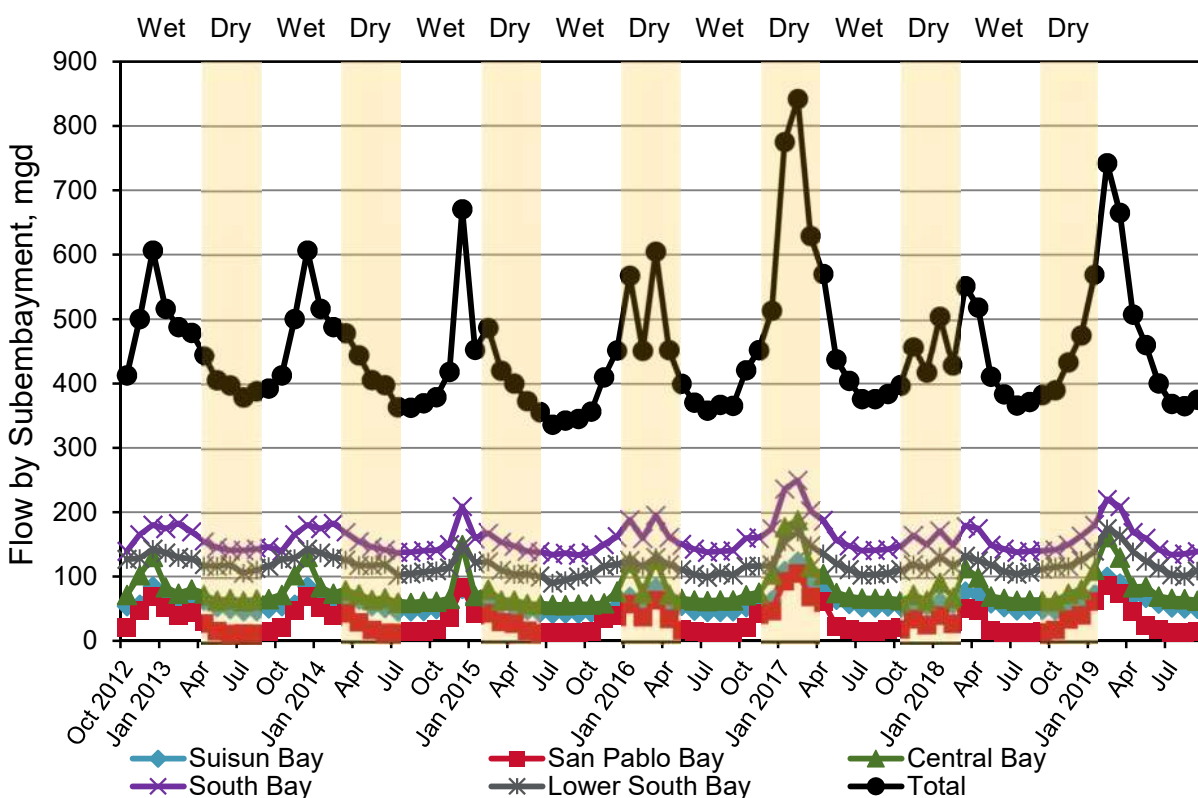


Figure 4-1. Historical Average Monthly Daily Discharge Flow Values

Table 4-1. Annual Average Daily Discharge Flows by Discharger (mgd)

Discharger	Subembayment	Permitted Capacity ^(a)	2012/13 ^(b)	2013/14 ^(b)	2014/15 ^(b)	2015/16 ^(b)	2016/17 ^(b)	2017/18 ^(b)	2018/19 ^(b)
American Canyon	San Pablo Bay	2.5	1.47	1.36	1.45	1.44	1.77	1.39	1.58
Benicia	San Pablo Bay	4.5	2.18	2.04	1.98	2.00	2.46	1.99	2.23
Burlingame	South Bay	5.5	3.03	2.91	2.96	2.84	3.62	2.74	2.99
CCCSD	Suisun Bay	53.8	37.5	35.5	32.8	33.7	43.5	34.9	38.6
CMSA	Central Bay	10	7.66	5.84	6.97	8.05	13.4	9.16	12.0
Port Costa	San Pablo Bay	0.033	0.00682	0.00630	0.0102	0.0165	0.0308	0.0197	0.0240
Delta Diablo	Suisun Bay	19.5	6.83	6.12	7.38	7.21	9.88	9.04	8.74
EBDA	South Bay	107.8	62.2	58.5	59.1	61.0	68.1	60.5	65.0
EBMUD	Central Bay	120	58.3	56.2	51.5	53.4	66.1	52.0	58.0
FSSD	Suisun Bay	23.7	13.2	12.4	12.1	13.0	17.0	13.4	15.4
Las Gallinas ^(c)	San Pablo Bay	2.92	1.37	1.19	1.25	1.66	2.86	1.35	2.62
Paradise Cove	Central Bay	0.04	0.0144	0.0138	0.0135	0.0129	0.0148	0.0159	0.0166
Tiburon	Central Bay	0.98	0.587	0.592	0.665	0.551	0.791	0.641	0.670
Millbrae	South Bay	3	1.58	1.65	1.35	1.49	1.87	1.48	1.73
Mt. View	Suisun Bay	3.2	1.34	1.27	1.26	1.20	1.53	1.29	1.88
Napa ^(c)	San Pablo Bay	15.4	5.05	4.60	5.30	6.04	8.94	4.55	7.42
Novato ^(c)	San Pablo Bay	7	3.18	2.89	3.33	2.94	5.08	2.98	4.78
Palo Alto	Lower South Bay	39	21.5	19.2	18.9	22.4	23.2	19.1	21.9
Petaluma ^(c)	San Pablo Bay	6.7	3.67	4.32	3.18	2.83	4.63	3.18	4.02
Pinole	San Pablo Bay	4.06	2.57	2.60	2.39	2.40	2.98	2.50	2.78
Rodeo	San Pablo Bay	1.14	0.650	0.593	0.603	0.601	0.805	0.587	0.680
SFO Airport	South Bay	2.2	1.13	1.17	1.02	1.10	1.25	1.15	1.22
SFPUC Southeast	South Bay	85.4	56.9	58.9	55.3	56.6	63.0	56.5	55.5
San Jose	Lower South Bay	167	91.5	84.3	81.3	80.3	90.4	87.5	93.8
San Mateo	South Bay	15.7	10.8	9.73	10.2	10.3	12.3	10.4	11.6
SMCSD	Central Bay	1.8	1.52	1.25	1.19	1.27	1.52	1.14	1.30
SASM	Central Bay	3.6	2.19	2.69	2.35	2.49	3.09	2.26	2.67
SVCW	South Bay	29	12.9	12.2	12.8	14.1	16.0	13.9	15.6
Sonoma Valley ^(c)	San Pablo Bay	3	1.59	1.29	0.317	0.567	2.22	0	1.48
South SF	South Bay	13	8.99	8.68	8.43	8.25	8.98	7.60	8.55
Sunnyvale	Lower South Bay	29.5	10.8	10.8	10.2	10.2	11.9	10.5	11.6
Treasure Island	Central Bay	2	0.312	0.323	0.324	0.330	0.375	0.313	0.412

Discharger	Subembayment	Permitted Capacity ^(a)	2012/13 ^(b)	2013/14 ^(b)	2014/15 ^(b)	2015/16 ^(b)	2016/17 ^(b)	2017/18 ^(b)	2018/19 ^(b)
Vallejo	San Pablo Bay	15.5	10.4	9.14	10.0	9.70	12.6	9.06	10.1
West County	Central Bay	28.5	8.32	8.27	7.40	10.1	13.1	9.93	13.3
Total ^(d)		827	451	428	415	430	515	433	480

- a. Based on ADWF permitted capacity.
- b. Data is presented in detail and summarized for each plant in the Appendix. A “-“ indicates data was not available, whereas a “0” indicates a value of zero.
- c. No discharge during a portion or all of the dry season months, except with authorization under emergency conditions.
- d. The total values might vary from the sum of the listed values by plant due to rounding.

Table 4-2. Dry Season Average Daily Flows by Discharger (mgd)

Discharger	Subembayment	Permitted Capacity ^(a)	2012/2013 ^(b)	2013/2014 ^(b)	2014/2015 ^(b)	2015/2016 ^(b)	2016/2017 ^(b)	2017/2018 ^(b)	2018/2019 ^(b)
American Canyon	San Pablo Bay	2.5	1.19	1.18	1.14	1.04	1.12	1.09	1.17
Benicia	San Pablo Bay	4.5	1.99	1.85	1.68	1.83	1.92	1.82	1.90
Burlingame	South Bay	5.5	2.82	2.55	2.57	2.54	2.84	2.49	2.49
CCCSD	Suisun Bay	53.8	34.1	32.6	28.1	30.1	33.9	31.2	32.8
CMSA	Central Bay	10	5.59	4.97	4.71	5.72	7.49	6.93	7.96
Port Costa	San Pablo Bay	0.033	0.00496	0.00400	0.00868	0.0157	0.0147	0.0208	0.0149
Delta Diablo	Suisun Bay	19.5	6.19	5.72	5.89	6.24	8.81	7.43	8.28
EBDA	South Bay	107.8	55.6	50.8	51.3	53.3	53.0	54.9	56.4
EBMUD	Central Bay	120	50.0	47.1	43.5	45.4	48.1	45.9	48.3
FSSD	Suisun Bay	23.7	10.3	10.2	9.12	10.2	12.2	11.7	12.8
Las Gallinas ^(c)	San Pablo Bay	2.92	0	0	0	0	0.407	0	0.750
Paradise Cove	Central Bay	0.04	0.0140	0.0130	0.0126	0.0129	0.0125	0.0183	0.0149
Tiburon	Central Bay	0.98	0.532	0.542	0.545	0.551	0.558	0.547	-
Millbrae	South Bay	3	1.53	1.25	1.19	1.40	1.42	1.30	1.48
Mt. View	Suisun Bay	3.2	1.14	1.21	1.12	1.22	1.25	1.23	1.67
Napa ^(c)	San Pablo Bay	15.4	0	1.20	0	0	0	0	0
Novato ^(c)	San Pablo Bay	7	0.806	0.743	0.736	0.763	2.28	0.779	2.30
Palo Alto	Lower South Bay	39	22.5	19.6	18.5	21.6	18.9	19.5	17.4
Petaluma ^(c)	San Pablo Bay	6.7	0	0	0	0	0	0	0
Pinole	San Pablo Bay	4.06	2.50	2.33	2.09	2.20	2.36	2.27	2.50
Rodeo	San Pablo Bay	1.14	0.572	0.551	0.491	0.523	0.552	0.526	0.550
SFO Airport	South Bay	2.2	1.07	1.13	0.949	1.06	1.14	1.12	1.17
SFPUC Southeast	South Bay	85.4	53.3	56.0	52.8	54.6	57.1	52.9	49.6
San Jose	Lower South Bay	167	83.6	77.2	72.1	74.6	80.1	81.9	83.4
San Mateo	South Bay	15.7	10.0	9.18	8.52	9.18	9.63	9.68	9.97
SMCSD	Central Bay	1.8	1.22	1.06	1.03	1.11	1.13	1.02	1.06
SASM	Central Bay	3.6	1.95	1.87	1.74	1.77	1.94	1.79	1.70
SVCW	South Bay	29	11.8	11.0	11.9	12.5	13.1	12.5	13.3
Sonoma Valley ^(c)	San Pablo Bay	3	0	0	0	0	0.0549	0	0
South SF	South Bay	13	8.43	8.34	7.46	7.41	7.13	7.21	7.50
Sunnyvale	Lower South Bay	29.5	9.02	8.94	7.71	8.04	9.34	8.54	9.06
Treasure Island	Central Bay	2	0.281	0.296	0.275	0.273	0.277	0.306	0.307
Vallejo	San Pablo Bay	15.5	8.75	8.73	8.21	8.40	8.70	7.94	8.10

Discharger	Subembayment	Permitted Capacity ^(a)	2012/2013 ^(b)	2013/2014 ^(b)	2014/2015 ^(b)	2015/2016 ^(b)	2016/2017 ^(b)	2017/2018 ^(b)	2018/2019 ^(b)
West County	Central Bay	28.5	6.55	6.09	5.61	8.74	8.65	8.67	10.2
Total ^(d)		827	393	374	351	372	396	383	394

- Based on ADWF permitted capacity.
- Data is presented in detail and summarized for each plant in the Appendix. A “-“ indicates data was not available, whereas a “0” indicates a value of zero.
- No discharge during a portion or all of the dry season months, except with authorization under emergency conditions.
- The total values might vary from the sum of the listed values by plant due to rounding.

Table 4-3. Annual Average Daily Discharges by Subembayment, Flow (mgd)

Subembayment	Permitted Capacity ^(a)	2012/13	2013/14	2014/15	2015/16	2016/17	2017/18	2018/19
Suisun Bay	100	58.9	58.1	53.5	55.1	71.9	58.6	64.6
San Pablo Bay	62.8	32.1	32.0	29.8	30.2	44.4	27.6	37.7
Central Bay	167	78.9	77.6	70.3	75.9	98.3	75.3	87.8
South Bay	262	157	156	151	156	175	154	162
Lower South Bay	236	124	122	110	113	125	117	127
Total	827	451	446	415	430	515	433	480

a. Based on ADWF permitted capacity.

Table 4-4. Dry Season Average Daily Discharges by Subembayment, Flow (mgd)

Subembayment	Permitted Capacity ^(a)	2012/13	2013/14	2014/15	2015/16	2016/17	2017/18	2018/19	Trend ^(b,c)
Suisun Bay	100	51.7	49.8	44.2	47.8	56.1	51.6	55.6	None
San Pablo Bay	62.8	15.8	15.5	14.4	14.8	17.4	14.5	17.3	None
Central Bay	167	66.1	63.1	57.3	63.5	68.2	64.9	69.5	None
South Bay	262	145	141	137	142	145	142	142	None
Lower South Bay	236	115	111	98.3	104	108	110	110	None
Total	827	393	380	351	372	396	383	394	None

a. Based on ADWF permitted capacity.

b. Trend analysis is based on average monthly values. Discernible trends were identified based on the slope of a regression line determined using the method of least squares to fit the data (alpha = 0.05). Sample size is 35. Where "None" is stated, the limited dataset does not indicate a statistically relevant trend.

c. The percent change represents the change per year as a percentage of the average value over the entire dataset (2012-2019).

4.3 Ammonia

The annual average and dry season average monthly discharge ammonia loads are presented in Table 4-5 and Table 4-6, respectively. The annual average and dry season loadings to each subembayment are presented in Table 4-7 and Table 4-8, respectively.

The average monthly 2016/2017 dry season and average annual total loads were the highest since nutrient sampling began in 2012. The monthly average for both average annual and dry season total loads have remained steady for the past three years, with a slight decrease in the 2018/2019 period. On a dry season basis, ammonia loads appear to be trending upwards for Suisun Bay, San Pablo Bay, Central Bay, and South Bay Subembayments based on the least squares correlation analysis. Further, the Baywide dry season loads suggest an upwards trending (see Section 3.5).

The historical average monthly daily discharge ammonia loads are presented in Figure 4-2. The South Bay Subembayment accounts for over half of the load discharged to the San Francisco Bay (see Table 4-7).

A discussion of the results is provided in Section 5.3.

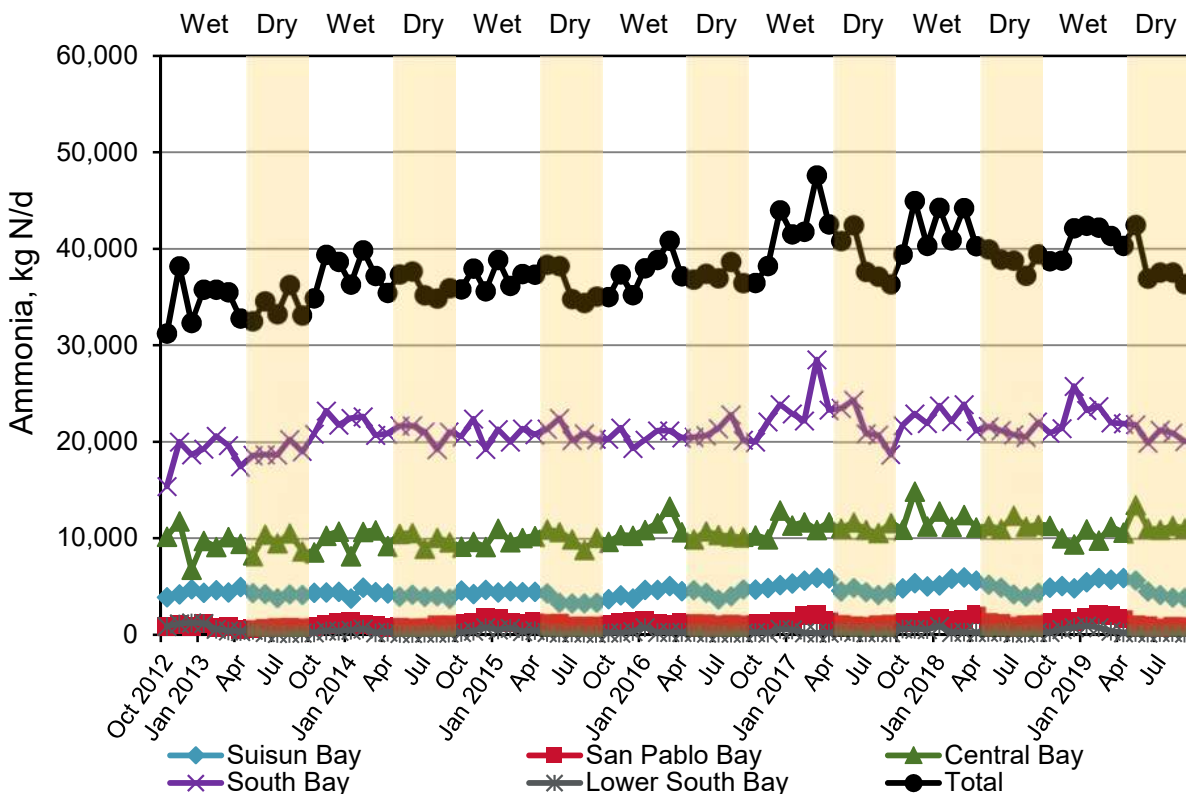


Figure 4-2. Historical Average Monthly Daily Discharge Ammonia Load Values

Table 4-5. Annual Average Daily Discharges by Discharger, Ammonia (kg N/d)

Discharger	Subembayment	2012/13 ^(a)	2013/14 ^(a)	2014/15 ^(a)	2015/16 ^(a)	2016/17 ^(a)	2017/18 ^(a)	2018/19 ^(a)
American Canyon	San Pablo Bay	1.77	5.43	3.25	1.54	2.31	4.83	4.12
Benicia	San Pablo Bay	190	159	186	194	175	216	187
Burlingame	South Bay	305	251	259	274	323	320	351
CCCSD	Suisun Bay	3,610	3,510	3,210	3,490	3,610	3,560	3,530
CMSA	Central Bay	720	779	603	753	1,010	861	1,060
Port Costa	San Pablo Bay	0.255	0.337	0.344	0.431	0.716	0.885	0.565
Delta Diablo	Suisun Bay	757	740	903	873	1,420	1,500	1,480
EBDA	South Bay	6,820	7,010	7,320	7,330	7,320	7,830	7,680
EBMUD	Central Bay	8,070	8,350	8,630	9,010	9,390	10,100	8,810
FSSD	Suisun Bay	1.45	1.68	1.56	1.91	2.67	7.66	9.09
Las Gallinas ^(b)	San Pablo Bay	10.7	14.8	11.6	23.4	34.7	34.6	54.1
Paradise Cove	Central Bay	0.443	0.249	0.0102	1.35	0.0386	0.0197	0.0452
Tiburon	Central Bay	40.2	48.3	53.0	55.0	33.6	55.1	48.7
Millbrae	South Bay	237	233	237	265	292	260	284
Mt. View	Suisun Bay	3.09	0.824	2.08	3.80	2.61	2.53	5.90
Napa ^(b)	San Pablo Bay	44.1	17.0	6.35	16.5	103	38.1	158
Novato ^(b)	San Pablo Bay	7.25	10.0	17.5	6.92	40.6	16.5	57.1
Palo Alto	Lower South Bay	13.4	12.8	17.7	17.6	12.0	15.8	10.6
Petaluma ^(b)	San Pablo Bay	3.22	7.17	2.82	5.43	2.57	3.15	7.47
Pinole	San Pablo Bay	187	202	229	258	242	273	115
Rodeo	San Pablo Bay	3.47	5.05	3.76	6.96	9.30	3.84	4.78
SFO Airport	South Bay	227	242	132	141	212	115	82.4
SFPUC Southeast	South Bay	7,280	9,580	8,630	8,400	9,780	8,460	8,380
San Jose	Lower South Bay	280	204	197	232	183	206	215
San Mateo	South Bay	1,320	1,300	1,210	1,110	1,250	1,320	1,520
SMCSD	Central Bay	51.0	41.6	50.2	44.7	73.7	94.8	72.8
SASM	Central Bay	49.5	45.5	39.0	62.2	26.7	67.2	107
SVCW	South Bay	1,900	1,980	2,240	2,540	2,390	2,670	2,610
Sonoma Valley ^(b)	San Pablo Bay	1.53	2.45	0.178	0.130	0.788	0	0.411
South SF	South Bay	772	828	863	746	1,030	1,000	1,010
Sunnyvale	Lower South Bay	305	86.5	163	30.0	101	171	196
Treasure Island	Central Bay	0.883	2.61	8.36	8.51	5.09	4.76	4.44
Vallejo	San Pablo Bay	426	622	854	749	784	845	849

Discharger	Subembayment	2012/13 ^(a)	2013/14 ^(a)	2014/15 ^(a)	2015/16 ^(a)	2016/17 ^(a)	2017/18 ^(a)	2018/19 ^(a)
West County	Central Bay	650	651	620	812	720	705	877
Total ^(c)		34,300	37,000	36,700	37,500	40,600	40,800	39,800

- Data is presented in detail and summarized for each plant in the Appendix. A “-” indicates data was not available, whereas a “0” indicates a value of zero.
- No discharge during a portion or all of the dry season months, except with authorization under emergency conditions.
- The total values might vary from the sum of the listed values by plant due to rounding.

Table 4-6. Dry Season Average Daily Discharges by Discharger, Ammonia (kg N/d)

Discharger	Subembayment	2012/2013 ^(a)	2013/2014 ^(a)	2014/2015 ^(a)	2015/2016 ^(a)	2016/2017 ^(a)	2017/2018 ^(a)	2018/2019 ^(a)
American Canyon	San Pablo Bay	1.56	2.21	2.06	1.13	1.74	2.93	1.93
Benicia	San Pablo Bay	190	149	143	192	195	195	140
Burlingame	South Bay	311	209	241	246	220	366	224
CCCSD	Suisun Bay	3,540	3,390	2,960	3,510	3,240	3,250	3,170
CMSA	Central Bay	740	780	619	915	1,020	815	1,020
Port Costa	San Pablo Bay	0.319	0.0381	0.133	-	0.290	0.296	0.461
Delta Diablo	Suisun Bay	709	674	650	858	1,320	1,360	1,310
EBDA	South Bay	6,290	6,500	7,210	6,620	6,250	7,320	7,260
EBMUD	Central Bay	8,020	8,490	8,770	8,480	9,340	9,770	9,460
FSSD	Suisun Bay	0.938	1.27	1.02	1.26	1.84	6.83	7.41
Las Gallinas ^(b)	San Pablo Bay	0	0	0	0	2.32	0	11.2
Paradise Cove	Central Bay	0.0284	0.249	0.0119	1.35	0.0169	0.0197	0.0677
Tiburon	Central Bay	32.2	48.3	46.2	55.0	29.4	57.2	-
Millbrae	South Bay	243	206	235	292	290	249	305
Mt. View	Suisun Bay	1.31	0.754	2.21	3.66	1.19	3.49	6.10
Napa ^(b)	San Pablo Bay	0	0.415	0	0	0	0	0
Novato ^(b)	San Pablo Bay	0.305	2.39	1.20	0.902	18.0	2.40	20.5
Palo Alto	Lower South Bay	15.1	13.1	17.3	25.8	13.3	26.1	8.29
Petaluma ^(b)	San Pablo Bay	0	0	0	0	0	0	0
Pinole	San Pablo Bay	210	203	220	332	191	266	60.9
Rodeo	San Pablo Bay	0.780	3.66	2.14	5.44	5.24	1.26	3.80
SFO Airport	South Bay	234	263	142	192	337	48.9	146
SFPUC Southeast	South Bay	7,910	9,580	8,930	9,300	10,100	8,670	7,980
San Jose	Lower South Bay	229	158	182	162	197	211	222
San Mateo	South Bay	1,530	1,480	1,200	1,290	1,190	1,420	1,550
SMCSD	Central Bay	49.3	50.2	45.8	59.3	105	132	126
SASM	Central Bay	54.4	32.7	25.1	49.8	22.1	100	132
SVCW	South Bay	1,760	1,900	2,310	2,470	2,390	2,300	2,480
Sonoma Valley ^(b)	San Pablo Bay	0	0	0	0	0.0182	0	0
South SF	South Bay	781	827	775	716	852	882	864
Sunnyvale	Lower South Bay	16.8	11.8	12.5	15.6	60.8	9.43	2.97
Treasure Island	Central Bay	1.23	4.55	10.5	4.16	4.05	6.65	3.41
Vallejo	San Pablo Bay	435	645	795	705	752	767	791
West County	Central Bay	653	639	665	815	725	678	871

Discharger	Subembayment	2012/2013 ^(a)	2013/2014 ^(a)	2014/2015 ^(a)	2015/2016 ^(a)	2016/2017 ^(a)	2017/2018 ^(a)	2018/2019 ^(a)
Total ^(c)		34,000	36,300	36,200	37,300	38,900	38,900	38,200

- Data is presented in detail and summarized for each plant in the Appendix. A “-“ indicates data was not available, whereas a “0” indicates a value of zero.
- No discharge during a portion or all of the dry season months, except with authorization under emergency conditions.
- The total values might vary from the sum of the listed values by plant due to rounding.

Table 4-7. Annual Average Daily Discharges by Subembayment, Ammonia (kg N/d)

Subembayment	2012/13	2013/14	2014/15	2015/16	2016/17	2017/18	2018/19
Suisun Bay	4,380	4,250	4,120	4,370	5,030	5,080	5,030
San Pablo Bay	874	1,040	1,320	1,260	1,390	1,440	1,440
Central Bay	9,570	9,870	9,960	10,700	11,200	11,800	10,900
South Bay	18,900	21,400	20,900	20,800	22,600	22,000	21,900
Lower South Bay	598	303	378	280	296	393	421
Total	34,300	36,900	36,700	37,400	40,500	40,700	39,700

Table 4-8. Dry Season Average Daily Discharges by Subembayment, Ammonia (kg N/d)

Subembayment	2012/13	2013/14	2014/15	2015/16	2016/17	2017/18	2018/19	Trend ^(a,b)
Suisun Bay	4,250	4,070	3,610	4,380	4,570	4,620	4,500	Up (2.4%/yr)
San Pablo Bay	835	1,000	1,160	1,240	1,160	1,230	1,030	Up (3.4%/yr)
Central Bay	9,540	10,000	10,200	10,300	11,200	11,500	11,600	Up (3.5%/yr)
South Bay	19,100	21,000	21,000	21,100	21,600	21,300	20,800	Up (1.1%/yr)
Lower South Bay	260	183	212	203	271	246	233	Up (1.6%/yr)
Total	34,000	36,200	36,200	37,300	38,900	38,900	38,200	Up (2.0%/yr)

- a. Trend analysis is based on average monthly values. Discernible trends were identified based on the slope of a regression line determined using the method of least squares to fit the data (alpha = 0.05). Sample size is 35. Where "None" is stated, the limited dataset does not indicate a statistically relevant trend.
- b. The percent change represents the change per year as a percentage of the average value over the entire dataset (2012-2019).

4.4 Nitrate + Nitrite (NO_x)

The annual average and dry season average monthly discharge NO_x loads are presented in Table 4-9 and Table 4-10, respectively. The annual average and dry season discharge loads to each subembayment are presented in Table 4-11 and Table 4-12, respectively.

The average monthly 2018/2019 average annual total loads were the second lowest since nutrient sampling began in 2012, following the previous year's low. The 2018/2019 average dry season total loads were the lowest since nutrient sampling began. On a dry season basis, NO_x loads appear to be trending downwards for Suisun Bay, San Pablo Bay, Central Bay, South Bay, and Baywide based on the least squares correlation trend analysis (see Section 3.5). The Lower South Bay Subembayment does not show any significant trending.

The average monthly daily discharge NO_x loads since the 2012/13 season are presented in Figure 4-3. The Lower South Bay Subembayment accounts for over half of the load discharged to the San Francisco Bay (see Table 4-10). The reason for this is all the dischargers in the Lower South Bay fully nitrify (i.e., convert ammonia to NO_x) year-round.

A discussion of the results is provided in Section 5.4.

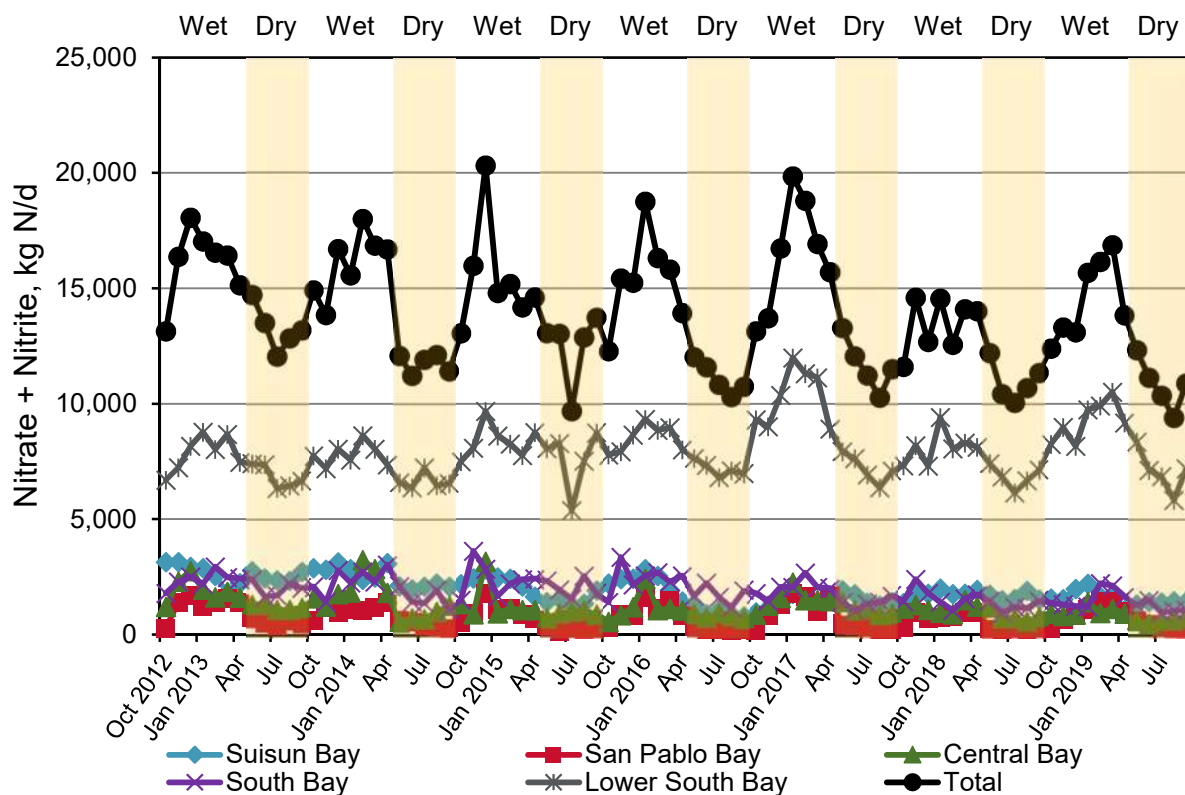


Figure 4-3. Historical Average Monthly Daily Discharge NO_x Load Values

Table 4-9. Annual Average Daily Discharges by Discharger, NOx (kg N/d)

Discharger	Subembayment	2012/13 ^(a)	2013/14 ^(a)	2014/15 ^(a)	2015/16 ^(a)	2016/17 ^(a)	2017/18 ^(a)	2018/19 ^(a)
American Canyon	San Pablo Bay	68.6	74.9	41.2	30.6	39.1	31.9	33.2
Benicia	San Pablo Bay	35.1	45.5	47.5	39.3	67.9	35.2	34.5
Burlingame	South Bay	92.9	182	33.2	18.0	43.0	39.2	115
CCCSD	Suisun Bay	270	293	461	309	392	284	255
CMSA	Central Bay	124	67.2	158	115	171	125	58.4
Port Costa	San Pablo Bay	0	0	0	1.30	1.13	0.700	0.143
Delta Diablo	Suisun Bay	936	774	382	450	31.4	34.1	48.2
EBDA	South Bay	1,050	822	994	1,070	1,000	852	818
EBMUD	Central Bay	1,120	1,090	763	521	517	573	517
FSSD	Suisun Bay	1,310	1,330	1,030	874	914	1,290	1,120
Las Gallinas ^(b)	San Pablo Bay	118	104	85.9	97.7	104	101	114
Paradise Cove	Central Bay	1.64	0	2.53	0.180	2.21	2.11	1.77
Tiburon	Central Bay	18.6	7.78	4.81	7.60	11.5	0.382	1.04
Millbrae	South Bay	3.37	1.30	2.14	2.14	2.28	0.766	2.10
Mt. View	Suisun Bay	118	128	117	119	139	122	154
Napa ^(b)	San Pablo Bay	129	158	165	154	156	123	149
Novato ^(b)	San Pablo Bay	137	126	150	132	157	114	124
Palo Alto	Lower South Bay	2,340	2,150	2,110	2,630	2,550	2,160	2,300
Petaluma ^(b)	San Pablo Bay	22.0	4.61	20.4	10.1	13.8	1.72	16.7
Pinole	San Pablo Bay	114	93.1	48.4	51.4	78.1	44.1	104
Rodeo	San Pablo Bay	32.9	25.6	29.5	23.4	35.1	28.7	33.5
SFO Airport	South Bay	23.6	15.4	22.0	20.6	13.6	23.8	24.6
SFPUC Southeast	South Bay	645	757	963	648	484	401	399
San Jose	Lower South Bay	4,520	4,570	5,390	4,760	5,610	4,720	5,290
San Mateo	South Bay	129	102	94.8	190	105	112	12.7
SMCSD	Central Bay	77.4	76.2	76.8	87.6	62.3	41.4	62.3
SASM	Central Bay	162	158	134	172	138	110	92.7
SVCW	South Bay	75.7	67.3	62.3	53.0	68.8	23.3	25.9
Sonoma Valley ^(b)	San Pablo Bay	27.9	6.76	23.1	10.5	81.2	0	29.5
South SF	South Bay	211	104	76.8	151	44.1	34.0	32.7
Sunnyvale	Lower South Bay	589	611	563	562	852	707	769
Treasure Island	Central Bay	9.96	11.2	10.6	8.91	11.2	7.22	8.73
Vallejo	San Pablo Bay	341	224	106	153	122	95.0	105
West County	Central Bay	114	150	56.0	144	434	169	121

Discharger	Subembayment	2012/13 ^(a)	2013/14 ^(a)	2014/15 ^(a)	2015/16 ^(a)	2016/17 ^(a)	2017/18 ^(a)	2018/19 ^(a)
Total ^(c)		15,000	14,300	14,200	13,600	14,500	12,400	13,000

- Data is presented in detail and summarized for each plant in the Appendix. A “-“ indicates data was not available, whereas a “0” indicates a value of zero.
- No discharge during a portion or all of the dry season months, except with authorization under emergency conditions.
- The total values might vary from the sum of the listed values by plant due to rounding.

Table 4-10. Dry Season Average Daily Discharges by Discharger, NO_x (kg N/d)

Discharger	Subembayment	2012/2013 ^(a)	2013/2014 ^(a)	2014/2015 ^(a)	2015/2016 ^(a)	2016/2017 ^(a)	2017/2018 ^(a)	2018/2019 ^(a)
American Canyon	San Pablo Bay	109	77.5	28.7	19.0	23.0	28.6	27.3
Benicia	San Pablo Bay	36.0	50.0	54.8	39.3	45.8	41.0	56.5
Burlingame	South Bay	125	78.2	31.6	27.9	50.6	22.7	227
CCCSD	Suisun Bay	181	243	417	196	368	302	247
CMSA	Central Bay	104	60.5	103	48.8	196	139	68.5
Port Costa	San Pablo Bay	-	0	-	-	-	-	0.203
Delta Diablo	Suisun Bay	925	807	219	69.0	27.0	47.2	51.0
EBDA	South Bay	880	696	656	821	685	712	616
EBMUD	Central Bay	888	581	614	478	418	472	421
FSSD	Suisun Bay	1,360	968	806	653	1,080	1,230	1,010
Las Gallinas ^(b)	San Pablo Bay	0	0	0	0	6.67	0	42.9
Paradise Cove	Central Bay	2.49	0.0374	2.60	0.180	2.60	2.11	2.09
Tiburon	Central Bay	14.5	7.78	6.99	7.60	15.6	0.339	
Millbrae	South Bay	4.31	1.20	1.58	0.672	0.887	0.923	2.32
Mt. View	Suisun Bay	99.6	112	101	118	115	107	141
Napa ^(b)	San Pablo Bay	0	49.7	0	0	0	0	0
Novato ^(b)	San Pablo Bay	39.6	39.9	36.3	37.3	80.1	40.7	62.0
Palo Alto	Lower South Bay	2,530	2,130	2,210	2,620	2,110	2,190	1,940
Petaluma ^(b)	San Pablo Bay	0	0	0	0	0	0	0
Pinole	San Pablo Bay	133	103	47.2	9.16	44.2	55.8	109
Rodeo	San Pablo Bay	25.6	24.4	24.8	22.8	26.3	28.2	32.0
SFO Airport	South Bay	23.1	21.8	23.3	13.1	6.26	40.3	23.1
SFPUC Southeast	South Bay	738	688	1,100	581	455	381	267
San Jose	Lower South Bay	3,990	4,180	5,100	4,250	4,530	4,290	4,540
San Mateo	South Bay	6.26	5.81	77.9	78.9	94.1	61.4	4.83
SMCSD	Central Bay	83.8	72.5	88.9	81.6	42.4	15.2	32.5
SASM	Central Bay	136	130	126	140	132	79.0	43.7
SVCW	South Bay	121	40.6	74.1	45.3	55.2	18.4	26.6
Sonoma Valley ^(b)	San Pablo Bay	0	0	0	0	4.20	0	0
South SF	South Bay	135	79.3	104	198	66.4	49.2	43.4
Sunnyvale	Lower South Bay	344	359	312	325	569	382	614
Treasure Island	Central Bay	8.69	9.76	10.4	9.86	10.6	6.94	10.7
Vallejo	San Pablo Bay	317	206	104	131	118	86.5	110
West County	Central Bay	9.57	23.9	18.2	102	315	128	84.2

Discharger	Subembayment	2012/2013 ^(a)	2013/2014 ^(a)	2014/2015 ^(a)	2015/2016 ^(a)	2016/2017 ^(a)	2017/2018 ^(a)	2018/2019 ^(a)
Total ^(c)		13,400	11,800	12,500	11,100	11,700	11,000	10,900

- Data is presented in detail and summarized for each plant in the Appendix. A “-” indicates data was not available, whereas a “0” indicates a value of zero.
- No discharge during a portion or all of the dry season months, except with authorization under emergency conditions.
- The total values might vary from the sum of the listed values by plant due to rounding.

Table 4-11. Annual Average Daily Discharges by Subembayment, NOx (kg N/d)

Subembayment	2012/13	2013/14	2014/15	2015/16	2016/17	2017/18	2018/19
Suisun Bay	2,630	2,530	1,990	1,750	1,480	1,730	1,580
San Pablo Bay	986	828	718	702	853	575	748
Central Bay	1,630	1,560	1,200	1,050	1,340	1,030	861
South Bay	2,230	2,050	2,250	2,150	1,770	1,490	1,430
Lower South Bay	7,450	7,330	8,070	7,960	9,010	7,590	8,350
Total	14,900	14,300	14,200	13,600	14,400	12,400	13,000

Table 4-12. Dry Season Average Daily Discharges by Subembayment, NOx (kg N/d)

Subembayment	2012/13	2013/14	2014/15	2015/16	2016/17	2017/18	2018/19	Trend ^(a,b)
Suisun Bay	2,560	2,130	1,540	1,040	1,590	1,690	1,450	Down (-8.7%/yr)
San Pablo Bay	572	479	296	259	348	281	440	Down (-6.9%/yr)
Central Bay	1,240	879	965	862	1,120	841	661	Down (-6.3%/yr)
South Bay	2,030	1,610	2,070	1,770	1,410	1,290	1,210	Down (-8.3%/yr)
Lower South Bay	6,870	6,660	7,620	7,190	7,210	6,860	7,090	None
Total	13,300	11,800	12,500	11,100	11,700	11,000	10,900	Down (-2.9%/yr)

a. Trend analysis is based on average monthly values. Discernible trends were identified based on the slope of a regression line determined using the method of least squares to fit the data ($\alpha = 0.05$). Sample size is 35. Where "None" is stated, the limited dataset does not indicate a statistically relevant trend.

b. The percent change represents the change per year as a percentage of the average value over the entire dataset (2012-2019).

4.5 Total Inorganic Nitrogen (TIN)

The annual average and dry season average monthly discharge TIN loads are presented in Table 4-13 and Table 4-14, respectively. The annual average and dry season discharge TIN loads by subembayment are presented in Table 4-15 and Table 4-16, respectively.

The 2016/2017 dry season and average annual total loads were the highest since nutrient sampling began in 2012. The 2017/2018 and 2018/2019 data for both average annual and dry season total loads shows a decrease in TIN discharge compared to the high in 2016/2017, but are still significantly higher than pre-2016/2017. On a dry season basis, TIN loads appear to be trending upwards for the Central Bay Subembayment based on the least squares correlation trend analysis (see Section 3.5). The overall Bay is showing an increase in TIN discharge loads.

The average monthly daily discharge TIN loads since the 2012/13 season are presented in Figure 4-4. The South Bay Subembayment accounts for nearly half of the load discharged to the San Francisco Bay (see Table 4-15).

A discussion of the results is provided in Section 5.5.

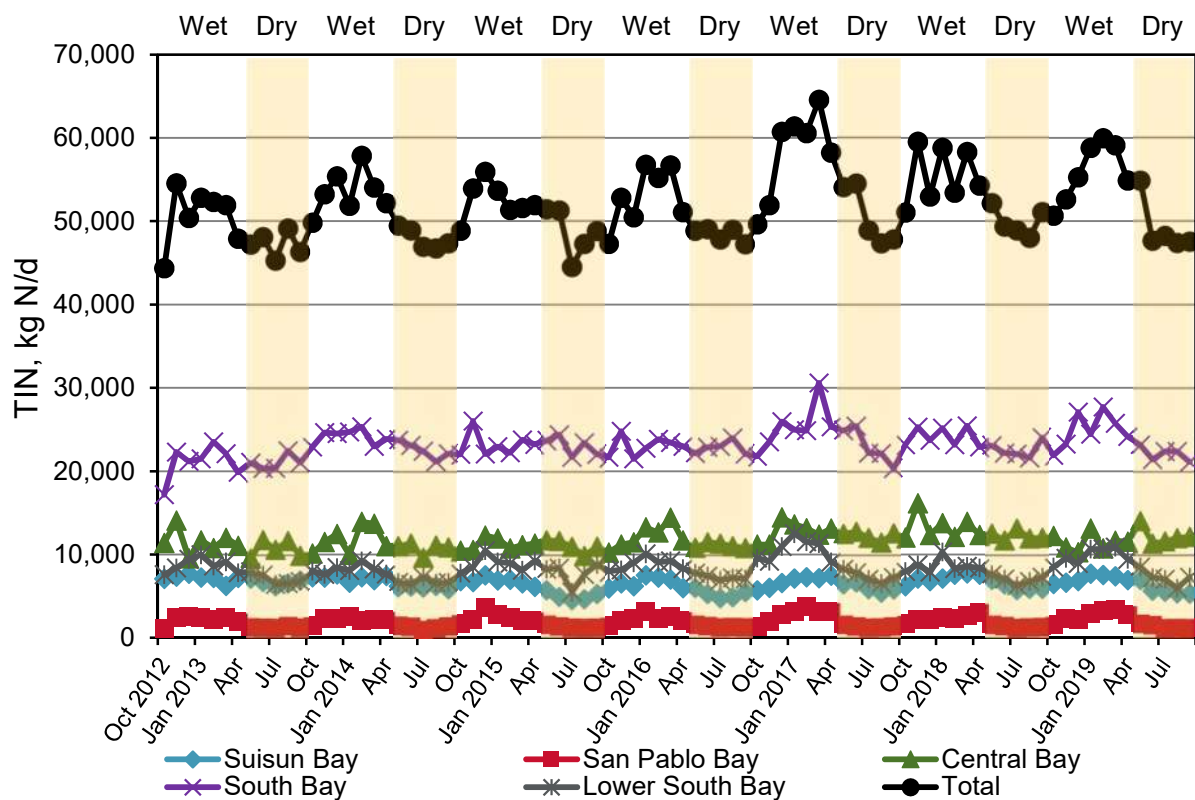


Figure 4-4. Historical Average Monthly Daily Discharge TIN Load Values

Table 4-13. Annual Average Daily Discharges by Discharger, TIN (kg N/d)

Discharger	Subembayment	2012/13 ^(a)	2013/14 ^(a)	2014/15 ^(a)	2015/16 ^(a)	2016/17 ^(a)	2017/18 ^(a)	2018/19 ^(a)
American Canyon	San Pablo Bay	70.4	80.3	44.4	32.2	41.4	36.8	37.3
Benicia	San Pablo Bay	225	205	234	233	243	251	222
Burlingame	South Bay	397	433	292	292	366	359	466
CCCSD	Suisun Bay	3,880	3,810	3,680	3,800	4,000	3,840	3,790
CMSA	Central Bay	844	846	761	869	1,180	986	1,120
Port Costa	San Pablo Bay	0	0	0	1.52	2.06	1.99	0.705
Delta Diablo	Suisun Bay	1,690	1,510	1,290	1,320	1,450	1,520	1,500
EBDA	South Bay	7,880	7,830	8,320	8,400	8,320	8,700	8,570
EBMUD	Central Bay	9,190	9,440	9,390	9,530	9,910	10,700	9,340
FSSD	Suisun Bay	1,310	1,330	1,030	876	916	1,320	1,130
Las Gallinas ^(b)	San Pablo Bay	129	118	97.5	121	138	135	153
Paradise Cove	Central Bay	2.08	0.287	2.54	1.53	2.25	2.11	1.80
Tiburon	Central Bay	58.8	56.1	57.8	62.6	45.1	55.5	49.7
Millbrae	South Bay	241	234	239	267	294	261	286
Mt. View	Suisun Bay	121	129	119	122	142	125	160
Napa ^(b)	San Pablo Bay	173	175	172	170	259	161	309
Novato ^(b)	San Pablo Bay	144	136	167	139	197	130	198
Palo Alto	Lower South Bay	2,360	2,160	2,130	2,650	2,560	2,180	2,310
Petaluma ^(b)	San Pablo Bay	25.3	11.8	24.8	15.6	16.3	4.87	24.2
Pinole	San Pablo Bay	301	289	278	309	320	317	227
Rodeo	San Pablo Bay	36.4	30.6	33.3	30.4	45.4	32.6	38.3
SFO Airport	South Bay	250	257	154	162	226	139	107
SFPUC Southeast	South Bay	7,920	10,300	9,590	9,050	10,300	8,860	8,850
San Jose	Lower South Bay	4,800	4,770	5,590	5,000	5,790	4,920	5,500
San Mateo	South Bay	1,450	1,400	1,310	1,300	1,350	1,430	1,530
SMCSD	Central Bay	128	118	127	132	136	137	134
SASM	Central Bay	212	204	173	234	164	187	211
SVCW	South Bay	1,970	2,050	2,300	2,590	2,460	2,690	2,640
Sonoma Valley ^(b)	San Pablo Bay	29.5	9.21	23.3	10.6	82.0	0	29.9
South SF	South Bay	983	933	940	897	1,070	1,060	1,310
Sunnyvale	Lower South Bay	894	697	726	592	952	878	964
Treasure Island	Central Bay	10.8	13.9	19.0	17.4	16.3	12.0	13.9
Vallejo	San Pablo Bay	768	846	961	901	906	931	928

Discharger	Subembayment	2012/13 ^(a)	2013/14 ^(a)	2014/15 ^(a)	2015/16 ^(a)	2016/17 ^(a)	2017/18 ^(a)	2018/19 ^(a)
West County	Central Bay	764	801	676	956	1,150	873	997
Total ^(c)		49,300	51,300	50,900	51,100	55,000	53,200	53,100

- Data is presented in detail and summarized for each plant in the Appendix. A “-” indicates data was not available, whereas a “0” indicates a value of zero.
- No discharge during a portion or all of the dry season months, except with authorization under emergency conditions.
- The total values might vary from the sum of the listed values by plant due to rounding.

Table 4-14. Dry Season Average Daily Discharges by Discharger, TIN (kg N/d)

Discharger	Subembayment	2013 ^(a)	2014 ^(a)	2015 ^(a)	2016 ^(a)	2017 ^(a)	2018 ^(a)	2019 ^(a)
American Canyon	San Pablo Bay	111	79.7	30.7	20.1	24.7	31.8	29.2
Benicia	San Pablo Bay	226	199	198	231	240	236	197
Burlingame	South Bay	436	288	273	273	271	389	450
CCCSD	Suisun Bay	3,720	3,630	3,380	3,710	3,610	3,550	3,420
CMSA	Central Bay	844	841	721	964	1,220	954	1,090
Port Costa	San Pablo Bay	-	0.0381	-	-	-	-	0.552
Delta Diablo	Suisun Bay	1,630	1,480	869	927	1,350	1,370	1,310
EBDA	South Bay	7,170	7,190	7,870	7,440	6,940	8,080	7,880
EBMUD	Central Bay	8,910	9,070	9,390	8,960	9,760	10,200	9,900
FSSD	Suisun Bay	1,360	969	807	655	1,080	1,270	1,020
Las Gallinas ^(b)	San Pablo Bay	0	0	0	0	8.99	0	51.4
Paradise Cove	Central Bay	2.52	0.287	2.61	1.53	2.62	2.11	2.13
Tiburon	Central Bay	46.8	56.1	53.2	62.6	45.0	57.6	
Millbrae	South Bay	247	207	236	293	291	250	307
Mt. View	Suisun Bay	101	112	103	122	116	110	147
Napa ^(b)	San Pablo Bay	0	50.1	0	0	0	0	0
Novato ^(b)	San Pablo Bay	39.9	42.3	37.5	38.2	98.2	43.1	100.0
Palo Alto	Lower South Bay	2,550	2,140	2,230	2,640	2,120	2,210	1,950
Petaluma ^(b)	San Pablo Bay	0	0	0	0	0	0	0
Pinole	San Pablo Bay	342	287	267	341	235	322	170
Rodeo	San Pablo Bay	26.4	28.1	26.9	28.2	31.9	29.4	35.8
SFO Airport	South Bay	257	285	165	205	343	89.2	169
SFPUC Southeast	South Bay	8,650	10,300	10,000	9,880	10,600	9,050	8,260
San Jose	Lower South Bay	4,220	4,330	5,280	4,410	4,730	4,510	4,760
San Mateo	South Bay	1,540	1,490	1,280	1,370	1,280	1,480	1,560
SMCSD	Central Bay	133	123	135	141	148	148	155
SASM	Central Bay	191	162	151	190	154	203	187
SVCW	South Bay	1,880	1,940	2,380	2,510	2,440	2,320	2,500
Sonoma Valley ^(b)	San Pablo Bay	0	0	0	0	4.21	0	0
South SF	South Bay	916	906	879	915	919	995	1,020
Sunnyvale	Lower South Bay	360	371	324	341	630	392	617
Treasure Island	Central Bay	9.92	14.3	20.9	14.0	14.6	13.6	14.1
Vallejo	San Pablo Bay	751	851	899	837	870	831	900
West County	Central Bay	663	663	683	918	1,040	806	955

Discharger	Subembayment	2013 ^(a)	2014 ^(a)	2015 ^(a)	2016 ^(a)	2017 ^(a)	2018 ^(a)	2019 ^(a)
Total ^(c)		47,300	48,100	48,700	48,400	50,600	50,000	49,200

- Data is presented in detail and summarized for each plant in the Appendix. A “-” indicates data was not available, whereas a “0” indicates a value of zero.
- No discharge during a portion or all of the dry season months, except with authorization under emergency conditions.
- The total values might vary from the sum of the listed values by plant due to rounding.

Table 4-15. Annual Average Daily Discharges by Subembayment, TIN (kg N/d)

Subembayment	2012/13	2013/14	2014/15	2015/16	2016/17	2017/18	2018/19
Suisun Bay	7,010	6,780	6,110	6,120	6,510	6,800	6,580
San Pablo Bay	1,860	1,830	2,030	1,960	2,250	2,000	2,170
Central Bay	11,200	11,400	11,200	11,700	12,600	12,900	11,800
South Bay	21,100	23,500	23,100	23,000	24,400	23,500	23,800
Lower South Bay	8,050	7,630	8,440	8,240	9,310	7,980	8,770
Total	49,200	51,200	50,900	51,000	55,000	53,200	53,100

Table 4-16. Dry Season Average Daily Discharges by Subembayment, TIN (kg N/d)

Subembayment	2012/13	2013/14	2014/15	2015/16	2016/17	2017/18	2018/19	Trend ^(a,b)
Suisun Bay	6,810	6,200	5,160	5,410	6,160	6,300	5,890	None
San Pablo Bay	1,410	1,390	1,460	1,500	1,510	1,490	1,480	Up (1.2%/yr)
Central Bay	10,800	10,900	11,100	11,200	12,300	12,400	12,300	Up (2.7%/yr)
South Bay	21,100	22,600	23,100	22,900	23,100	22,700	22,200	None
Lower South Bay	7,130	6,850	7,840	7,390	7,480	7,110	7,320	None
Total	47,200	47,900	48,700	48,400	50,600	49,900	49,200	Up (0.9%/yr)

- a. Trend analysis is based on average monthly values. Discernible trends were identified based on the slope of a regression line determined using the method of least squares to fit the data ($\alpha = 0.05$). Sample size is 35. Where "None" is stated, the limited dataset does not indicate a statistically relevant trend.
- b. The percent change represents the change per year as a percentage of the average value over the entire dataset (2012-2019).

4.6 Total Phosphorus (TP)

The annual average and dry season average monthly discharge TP loads are presented in Table 4-17 and Table 4-18, respectively. The annual average and dry season discharge TP load discharged by subembayment is presented in Table 4-19 and Table 4-20, respectively.

The 2018/2019 average annual and dry season total loads were the highest since nutrient sampling began in 2012, with a slight increase compared to the previous highs in 2017/2018. The dry season TP loads discharged to the Bay exhibit an increasing trend for the Suisun Bay, Central Bay, South Bay, and Baywide based on the least squares correlation test selected as the basis for trends analysis (see Section 3.5).

The average monthly daily discharge TP loads since the 2012/13 season are presented in Figure 4-5. The South Bay Subembayment received the largest TP load and accounts for approximately one-third of the TP load discharged to the San Francisco Bay (see Table 4-19).

A discussion of the results is provided in Section 5.6.

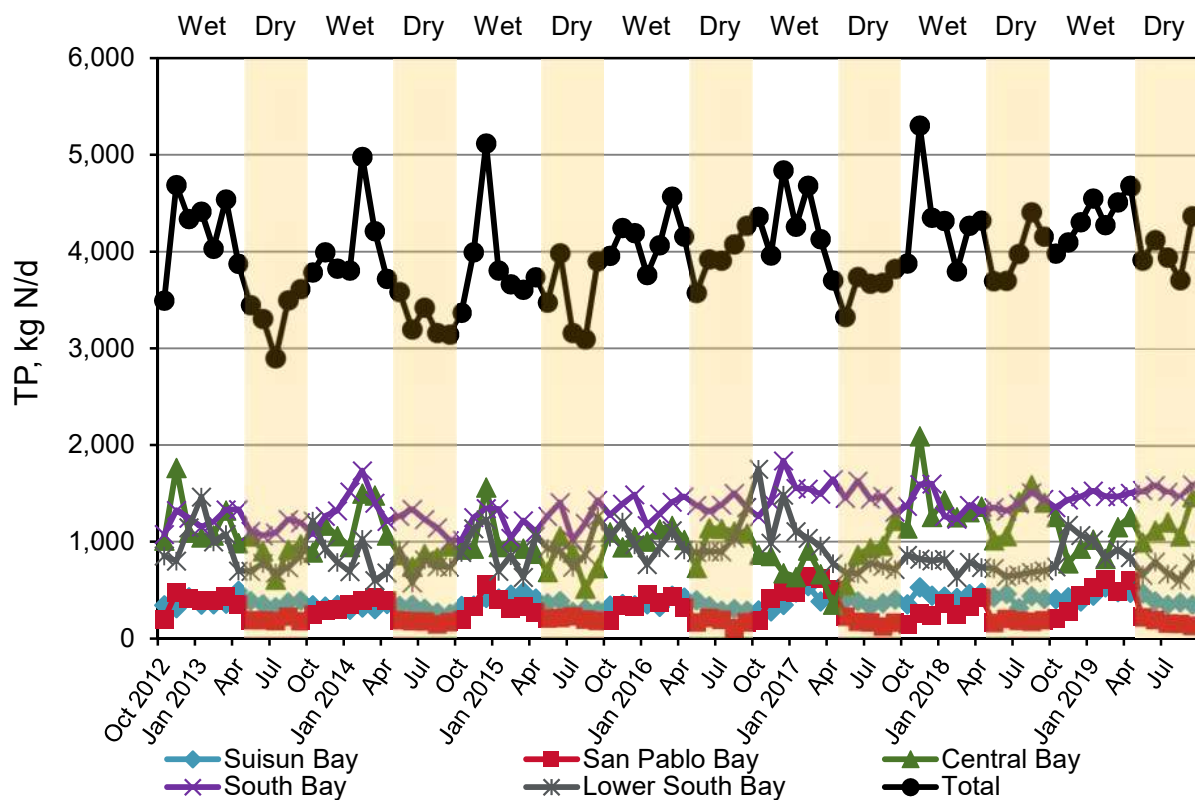


Figure 4-5. Historical Average Monthly Daily Discharge TP Load Values

Table 4-17. Annual Average Daily Discharges by Discharger, TP (kg P/d)

Discharger	Subembayment	2012/13 ^(a)	2013/14 ^(a)	2014/15 ^(a)	2015/16 ^(a)	2016/17 ^(a)	2017/18 ^(a)	2018/19 ^(a)
American Canyon	San Pablo Bay	29.0	17.9	28.7	27.6	24.0	26.0	23.4
Benicia	San Pablo Bay	25.2	25.7	26.2	15.1	16.5	15.7	19.2
Burlingame	South Bay	101	110	25.4	22.2	29.2	32.4	31.0
CCCSD	Suisun Bay	133	87.7	127	109	127	122	137
CMSA	Central Bay	92.4	81.7	94.2	84.5	106	100	108
Port Costa	San Pablo Bay	0	0	0	0.598	0.479	0.352	0.226
Delta Diablo	Suisun Bay	31.1	27.1	36.7	29.4	51.5	60.6	42.6
EBDA	South Bay	544	534	501	551	642	534	534
EBMUD	Central Bay	843	824	718	827	538	1,100	818
FSSD	Suisun Bay	194	190	198	200	197	235	235
Las Gallinas ^(b)	San Pablo Bay	19.7	17.2	14.6	22.6	21.5	16.5	23.8
Paradise Cove	Central Bay	0.270	0	0.358	0.223	0.495	0.490	0.246
Tiburon	Central Bay	8.36	7.88	8.44	9.20	8.56	7.84	6.21
Millbrae	South Bay	16.5	13.5	13.0	12.0	11.9	7.41	17.9
Mt. View	Suisun Bay	18.2	17.0	16.2	15.4	13.5	15.2	13.9
Napa ^(b)	San Pablo Bay	22.5	14.4	25.3	34.6	58.7	22.4	86.1
Novato ^(b)	San Pablo Bay	15.7	10.9	20.6	9.59	12.9	2.74	13.9
Palo Alto	Lower South Bay	346	352	352	445	397	362	372
Petaluma ^(b)	San Pablo Bay	27.5	31.0	24.6	19.1	24.7	16.1	21.3
Pinole	San Pablo Bay	29.6	17.3	15.2	16.4	24.6	29.2	33.4
Rodeo	San Pablo Bay	8.36	8.01	7.95	8.37	8.75	7.58	9.43
SFO Airport	South Bay	17.5	13.4	8.97	9.69	16.2	32.0	35.5
SFPUC Southeast	South Bay	67.2	164	205	271	332	287	389
San Jose	Lower South Bay	354	246	370	368	322	154	243
San Mateo	South Bay	128	127	122	142	125	133	114
SMCSD	Central Bay	23.4	18.5	17.0	17.2	16.5	19.3	14.8
SASM	Central Bay	45.2	45.6	40.5	51.6	38.1	40.5	37.5
SVCW	South Bay	174	172	189	213	218	234	242
Sonoma Valley ^(b)	San Pablo Bay	16.5	10.5	2.83	2.51	21.3	0	5.35
South SF	South Bay	149	160	171	150	133	138	134
Sunnyvale	Lower South Bay	200	214	213	193	257	225	231
Treasure Island	Central Bay	1.57	3.01	3.70	4.10	4.50	3.32	3.08
Vallejo	San Pablo Bay	126	129	123	121	139	110	107

Discharger	Subembayment	2012/13 ^(a)	2013/14 ^(a)	2014/15 ^(a)	2015/16 ^(a)	2016/17 ^(a)	2017/18 ^(a)	2018/19 ^(a)
West County	Central Bay	53.4	60.7	46.6	67.6	88.5	101	110
Total ^(c)		3,860	3,750	3,770	4,070	4,020	4,190	4,210

- Data is presented in detail and summarized for each plant in the Appendix. A “-” indicates data was not available, whereas a “0” indicates a value of zero.
- No discharge during a portion or all of the dry season months, except with authorization under emergency conditions.
- The total values might vary from the sum of the listed values by plant due to rounding.

Table 4-18. Dry Season Average Daily Discharges by Discharger, TP (kg P/d)

Discharger	Subembayment	2013 (a)	2014 (a)	2015 (a)	2016 (a)	2017 (a)	2018 (a)	2019 (a)
American Canyon	San Pablo Bay	47.4	8.23	29.1	15.4	14.5	24.8	29.2
Benicia	San Pablo Bay	23.9	23.9	20.4	16.4	8.96	9.68	197
Burlingame	South Bay	125	32.4	31.5	13.9	18.1	26.4	450
CCCSD	Suisun Bay	125	90.3	112	108	107	116	3,420
CMSA	Central Bay	101	79.6	89.3	87.5	127	112	1,090
Port Costa	San Pablo Bay	-	0	-	-	-	-	0.552
Delta Diablo	Suisun Bay	27.7	27.2	27.8	28.1	51.1	51.2	1,310
EBDA	South Bay	490	494	480	546	533	505	7,880
EBMUD	Central Bay	668	668	576	813	643	1,030	9,900
FSSD	Suisun Bay	201	174	172	175	211	233	1,020
Las Gallinas ^(b)	San Pablo Bay	0	0	0	0	0.844	0	51.4
Paradise Cove	Central Bay	0.334	0.0384	0.377	0.223	0.592	0.490	2.13
Tiburon	Central Bay	7.62	7.88	8.34	9.20	8.18	8.90	
Millbrae	South Bay	19.2	13.0	14.2	11.8	15.1	7.83	307
Mt. View	Suisun Bay	17.8	17.6	18.2	16.8	11.3	14.7	147
Napa ^(b)	San Pablo Bay	0	3.77	0	0	0	0	0
Novato ^(b)	San Pablo Bay	1.06	1.62	0.800	1.24	2.46	0.305	100.0
Palo Alto	Lower South Bay	386	381	381	450	354	382	1,950
Petaluma ^(b)	San Pablo Bay	0	0	0	0	0	0	0
Pinole	San Pablo Bay	30.6	18.7	17.6	16.3	21.1	34.2	170
Rodeo	San Pablo Bay	6.98	7.73	9.24	8.63	6.23	7.07	35.8
SFO Airport	South Bay	25.0	8.95	8.79	4.12	21.6	42.4	169
SFPUC Southeast	South Bay	24.0	184	263	322	395	321	8,260
San Jose	Lower South Bay	185	196	384	397	111	113	4,760
San Mateo	South Bay	128	136	129	137	129	139	1,560
SMCSD	Central Bay	24.8	20.0	18.5	18.9	19.0	19.3	155
SASM	Central Bay	50.3	43.3	40.5	43.0	40.2	40.9	187
SVCW	South Bay	185	161	217	191	211	237	2,500
Sonoma Valley ^(b)	San Pablo Bay	0	0	0	0	0.711	0	0
South SF	South Bay	145	170	163	161	140	127	1,020
Sunnyvale	Lower South Bay	180	183	177	172	256	189	617
Treasure Island	Central Bay	1.27	2.84	3.99	4.46	4.74	3.61	14.1
Vallejo	San Pablo Bay	125	123	133	116	120	110	900
West County	Central Bay	45.5	42.0	46.5	75.2	72.9	94.1	955

Discharger	Subembayment	2013 ^(a)	2014 ^(a)	2015 ^(a)	2016 ^(a)	2017 ^(a)	2018 ^(a)	2019 ^(a)
Total ^(c)		3,400	3,320	3,570	3,960	3,660	4,000	49,200

- Data is presented in detail and summarized for each plant in the Appendix. A “-“ indicates data was not available, whereas a “0” indicates a value of zero.
- No discharge during a portion or all of the dry season months, except with authorization under emergency conditions.
- The total values might vary from the sum of the listed values by plant due to rounding.

Table 4-19. Annual Average Daily Discharges by Subembayment, TP (kg P/d)

Subembayment	2012/13	2013/14	2014/15	2015/16	2016/17	2017/18	2018/19
Suisun Bay	377	322	378	354	389	434	429
San Pablo Bay	307	275	289	277	352	247	343
Central Bay	1,070	1,030	923	1,050	793	1,360	1,090
South Bay	1,200	1,300	1,220	1,370	1,510	1,400	1,500
Lower South Bay	900	811	935	1,010	976	741	846
Total	3,850	3,740	3,740	4,060	4,020	4,180	4,210

Table 4-20. Dry Season Average Daily Discharges by Subembayment, TP (kg P/d)

Subembayment	2013	2014	2014/15	2015/16	2016/17	2017/18	2018/19	Trend ^(a,b)
Suisun Bay	372	309	330	328	381	415	398	Up (3.4%/yr)
San Pablo Bay	197	177	210	174	175	186	186	None
Central Bay	894	858	778	1,040	909	1,300	1,170	Up (6.6%/yr)
South Bay	1,140	1,200	1,260	1,390	1,460	1,410	1,550	Up (4.9%/yr)
Lower South Bay	750	760	943	1,020	721	684	710	None
Total	3,350	3,300	3,520	3,950	3,650	3,990	4,010	Up (3.4%/yr)

- c. Trend analysis is based on average monthly values. Discernible trends were identified based on the slope of a regression line determined using the method of least squares to fit the data (alpha = 0.05). Sample size is 35. Where "None" is stated, the limited dataset does not indicate a statistically relevant trend.
- d. The percent change represents the change per year as a percentage of the average value over the entire dataset (2012-2019).

4.7 Flows and Nutrient Loads Distribution by Subembayment

Flows and nutrient discharge loading for select nitrogen and phosphorus species has been analyzed by subembayment to demonstrate the relative contributions for each discharger. In this section, loading diagrams illustrate the discharge loads over time for the past seven years (Oct 2012 through Sep 2019).

The cumulative figures in the following subsections are organized by subembayment and present the relative contribution of each discharger within its respective subembayment for flow, ammonia, total inorganic nitrogen and total phosphorus.

4.7.1 Suisun Bay

The average monthly discharge to Suisun Bay by discharger for flow, ammonia, TIN and TP is provided in Figure 4-6 through Figure 4-9. Flows to Suisun Bay are dominated by the CCCSD discharge and followed, in terms of magnitude, by FSSD and Delta Diablo. CCCSD also discharges the largest loads of ammonia and total inorganic nitrogen. FSSD discharges the largest phosphorus load to Suisun Bay, followed by CCCSD.

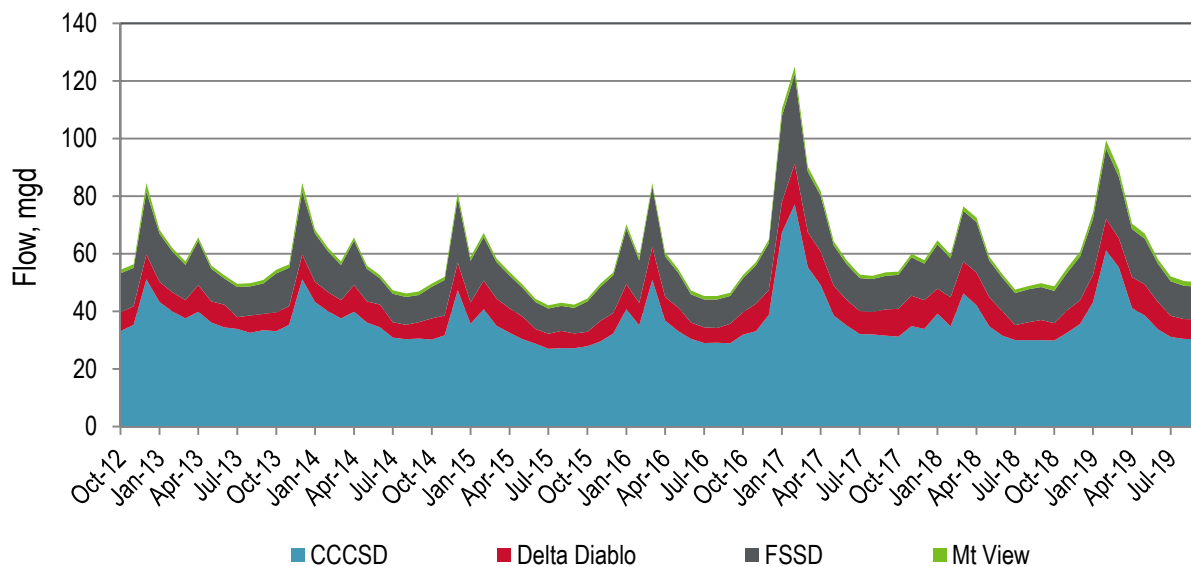


Figure 4-6. Flow Contribution by Discharger to Suisun Bay

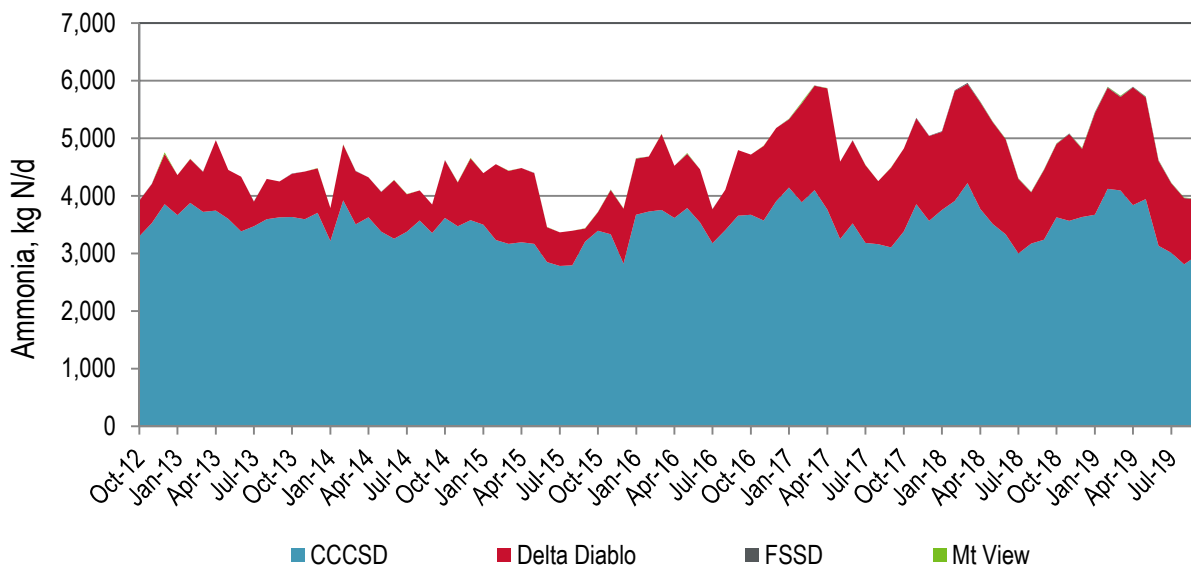


Figure 4-7. Ammonia Load Contribution by Discharger to Suisun Bay

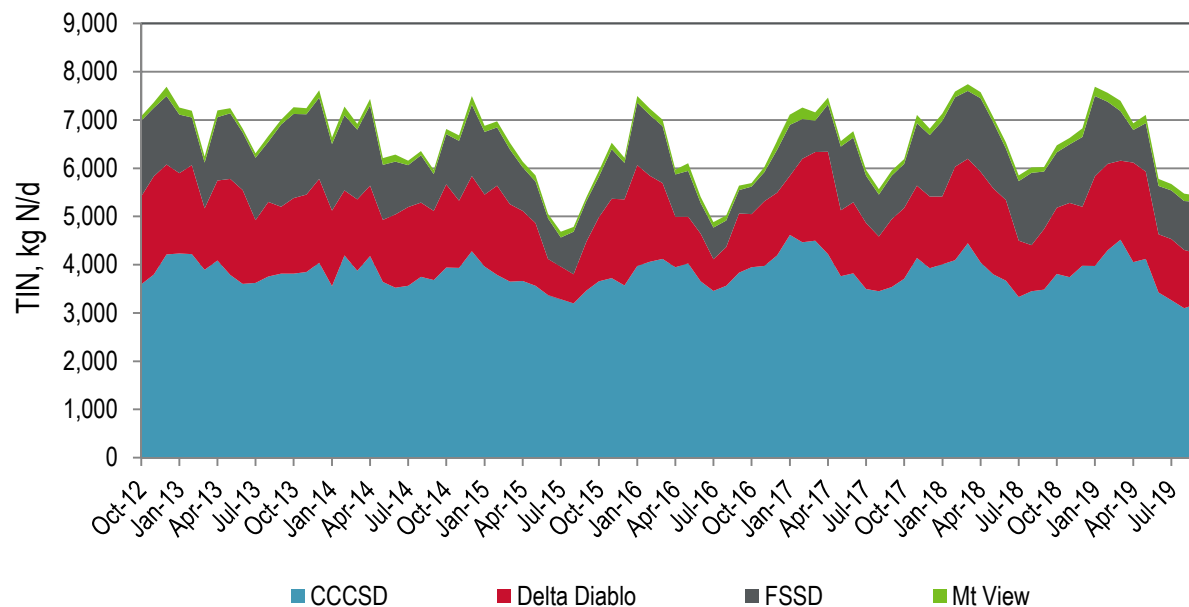


Figure 4-8. TIN Load Contribution by Discharger to Suisun Bay

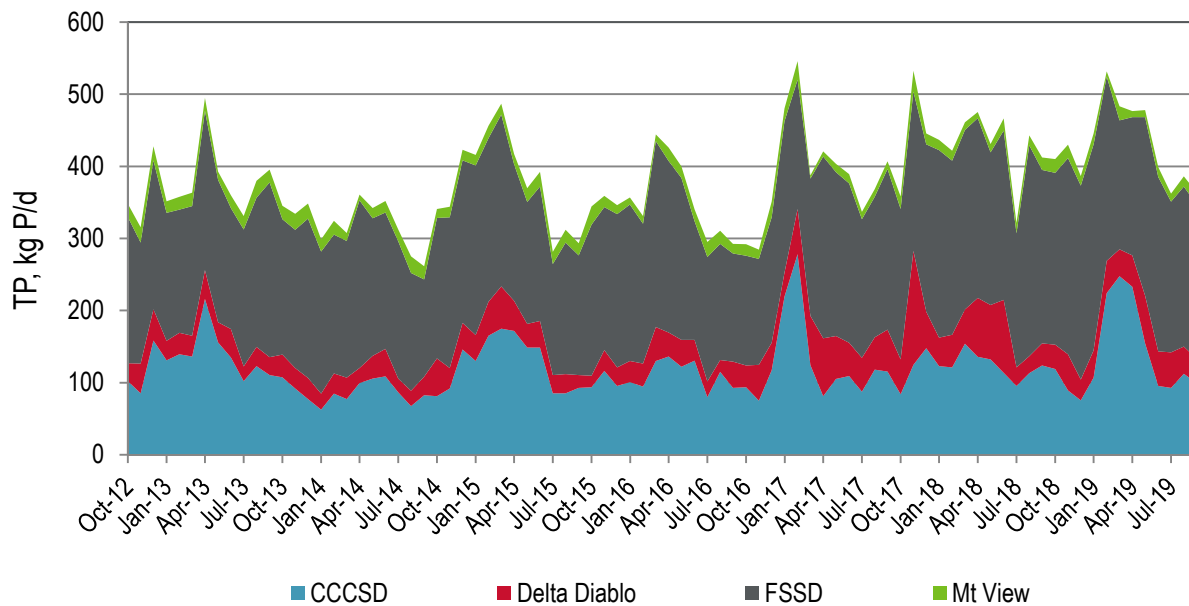


Figure 4-9. TP Load Contribution by Discharger to Suisun Bay

4.7.2 San Pablo Bay

The average monthly discharge to San Pablo Bay by discharger for discharge flows and loads are provided in Figure 4-10 through Figure 4-13. Figure 4-10 clearly demonstrates the seasonal discharges at Las Gallinas, Napa, Petaluma, and Sonoma Valley. Similar to flow, total inorganic nitrogen and total phosphorus loads to San Pablo Bay appear to exhibit a significant seasonal pattern with higher wintertime loads.

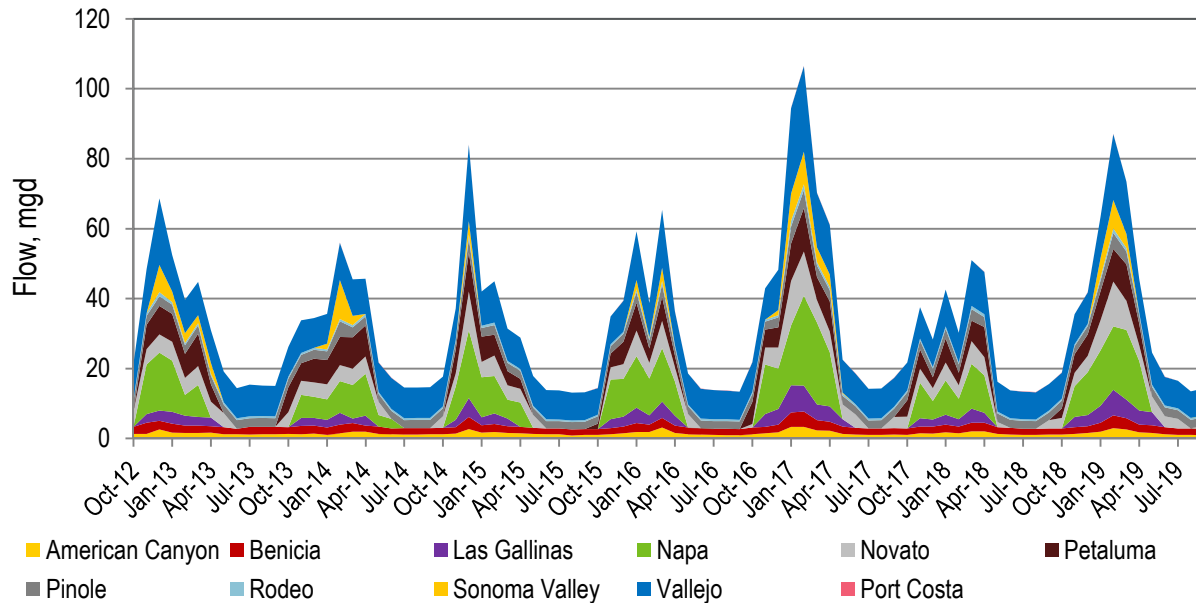


Figure 4-10. Flow Contribution by Discharger to San Pablo Bay

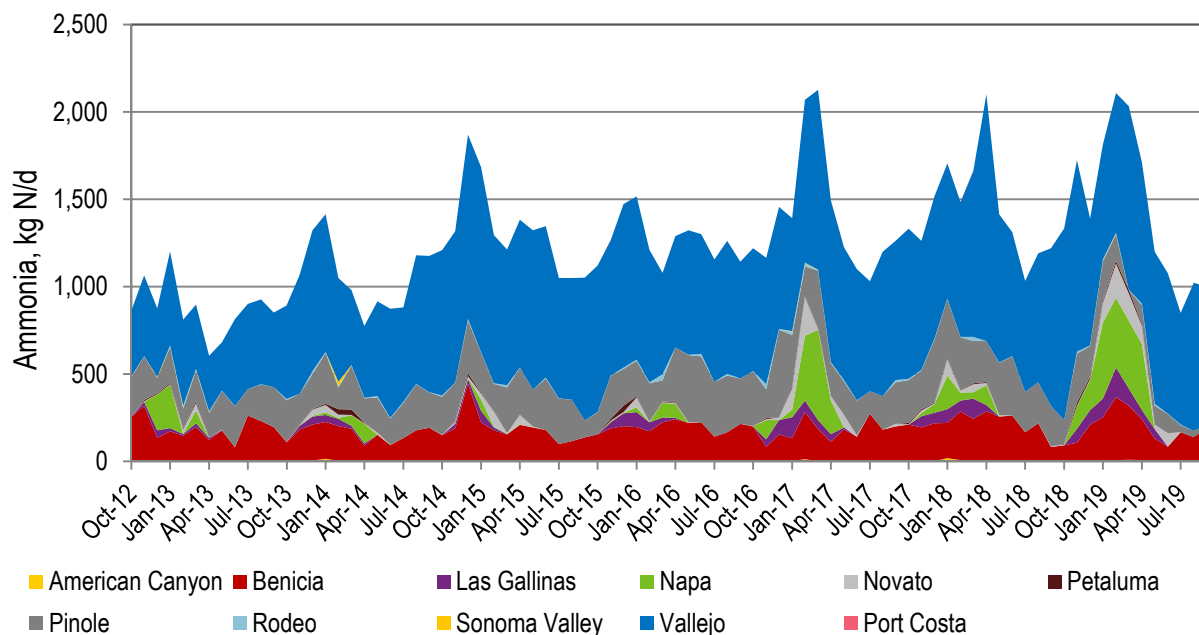


Figure 4-11. Ammonia Load Contribution by Discharger to San Pablo Bay

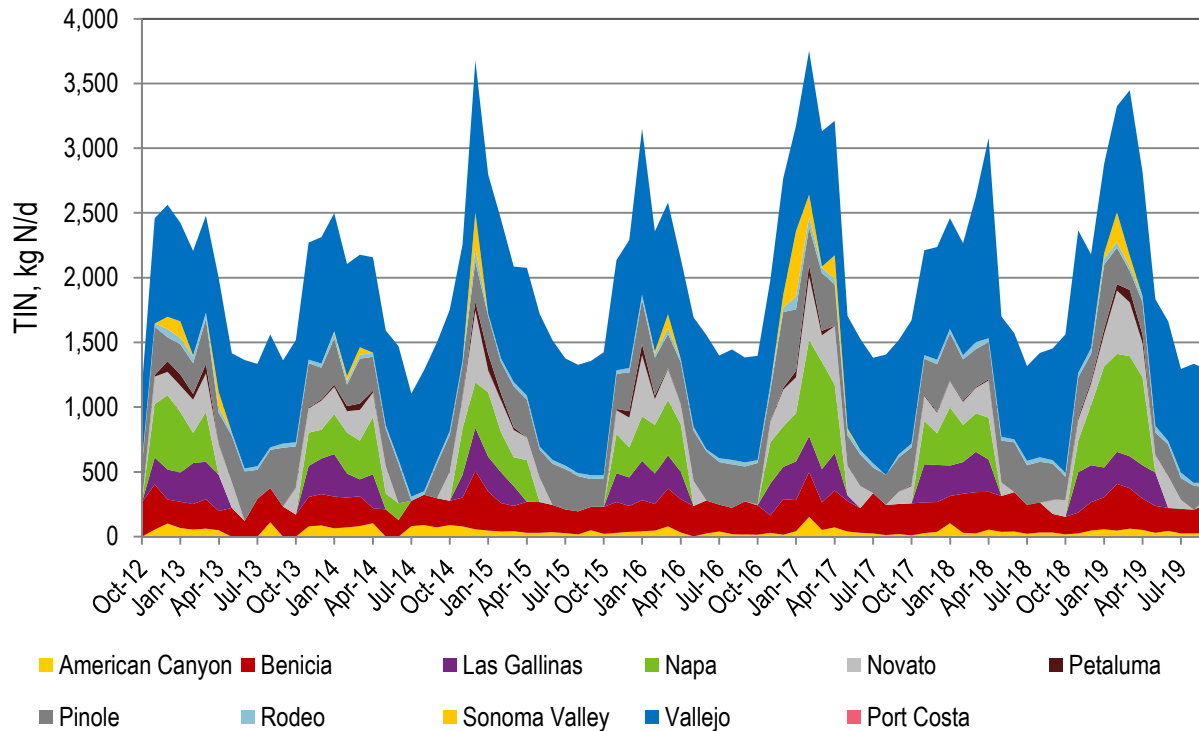


Figure 4-12. TIN Load Contribution by Discharger to San Pablo Bay

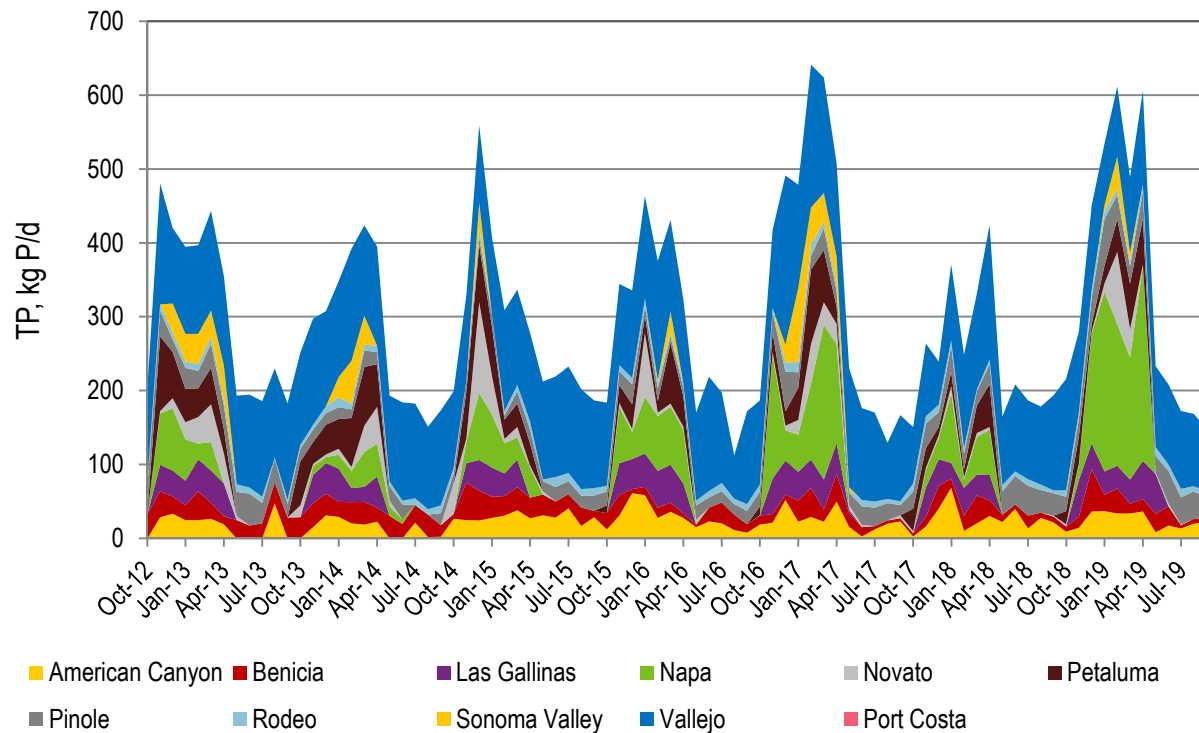


Figure 4-13. TP Load Contribution by Discharger to San Pablo Bay

4.7.3 Central Bay

The average monthly discharge to Central Bay by discharger for discharge flows and loads are provided in Figure 4-14 through Figure 4-17. Discharge flows and loads to the Central Bay are dominated by EBMUD.

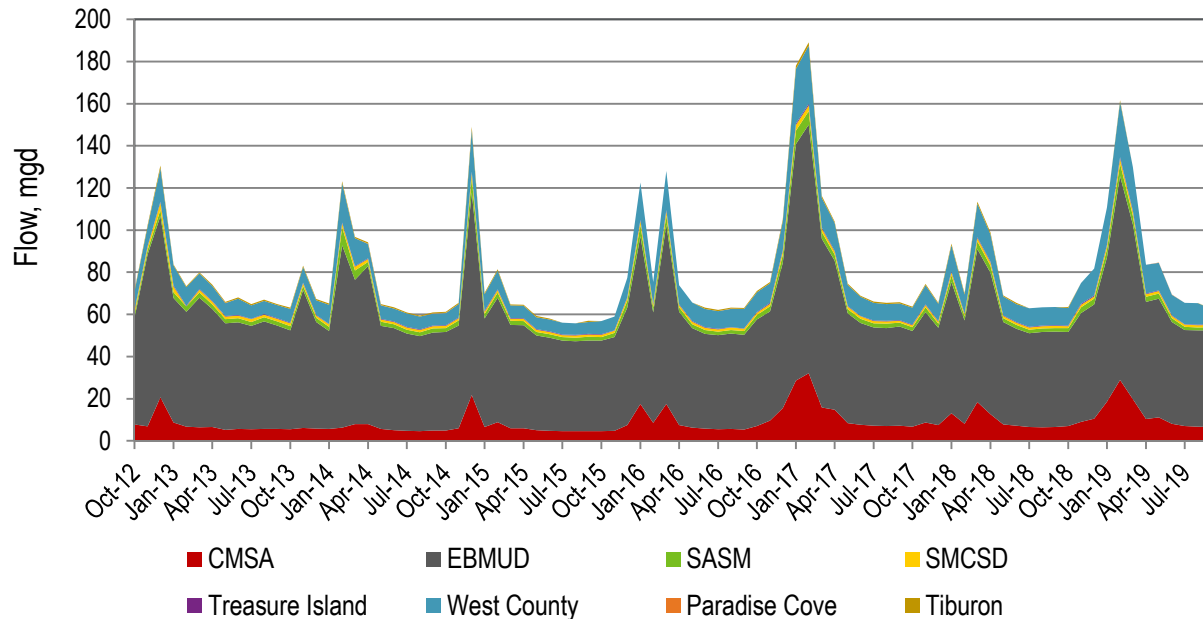


Figure 4-14. Flow Contribution by Discharger to Central Bay

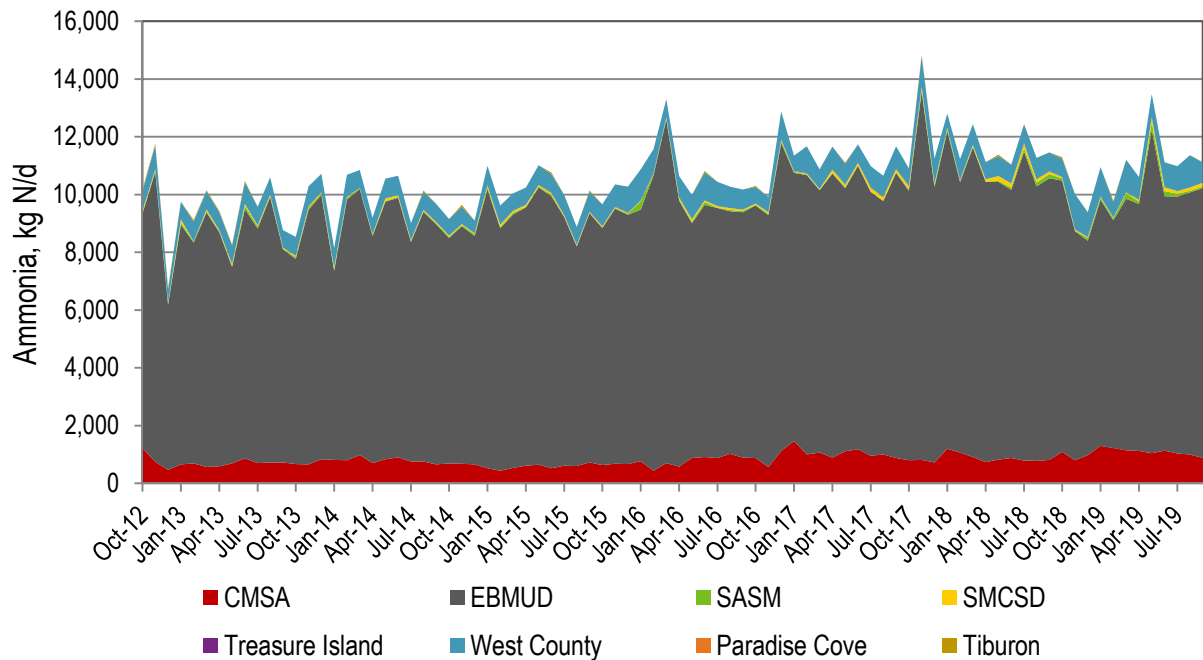


Figure 4-15. Ammonia Load Contribution by Discharger to Central Bay

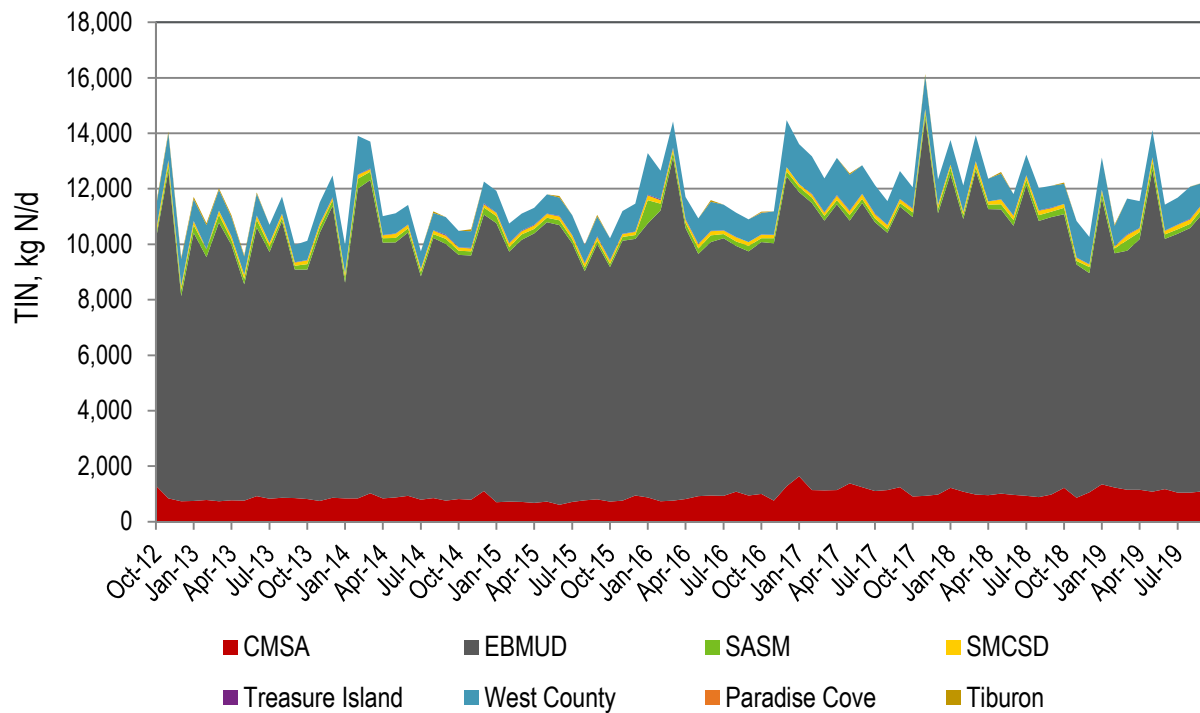


Figure 4-16. TIN Load Contribution by Discharger to Central Bay

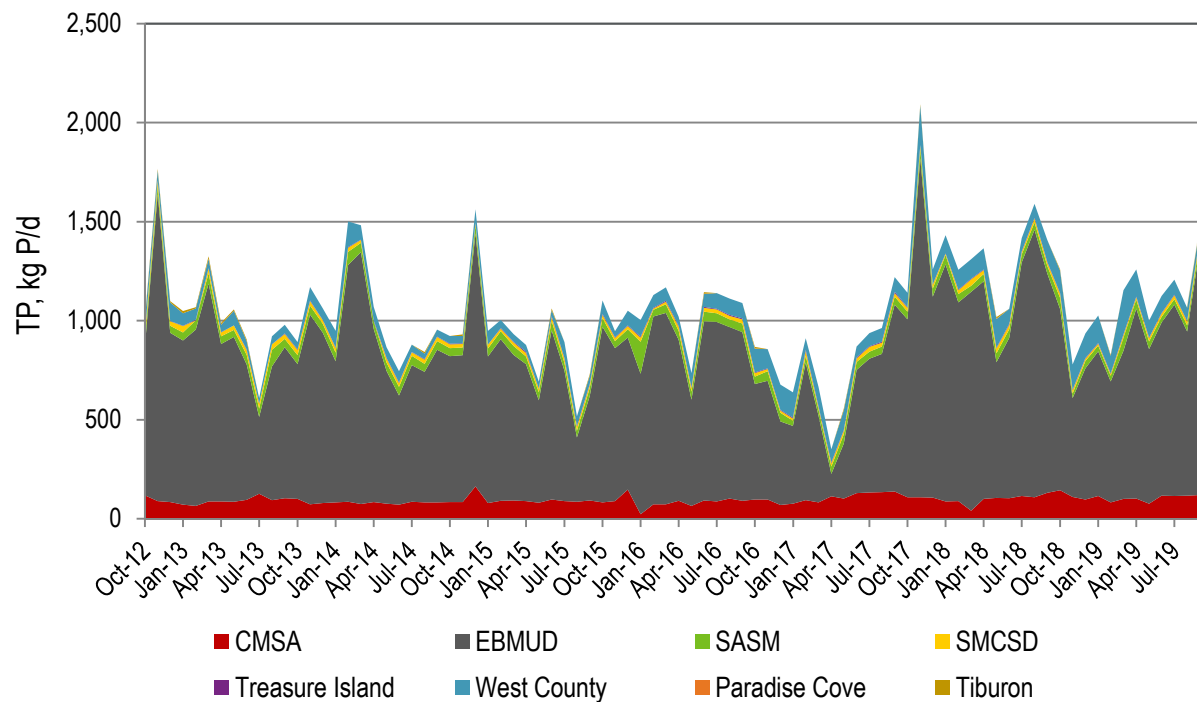


Figure 4-17. TP Load Contribution by Discharger to Central Bay

4.7.4 South Bay

The average monthly discharge to South Bay by discharger for discharge flows and loads are provided in Figure 4-18 through Figure 4-21. In the South Bay, the largest wastewater discharges are from the SFPUC Southeast Plant and EBDA. Ammonia and total inorganic nitrogen loads to the South Bay are also largest from the SFPUC Southeast Plant and EBDA. The total phosphorus discharges to the South Bay are more evenly distributed between EBDA, SFPUC Southeast Plant, San Mateo, and SVCW. SFPUC's total phosphorus loads are a lower proportion of the total compared to flow, ammonia, and total nitrogen.

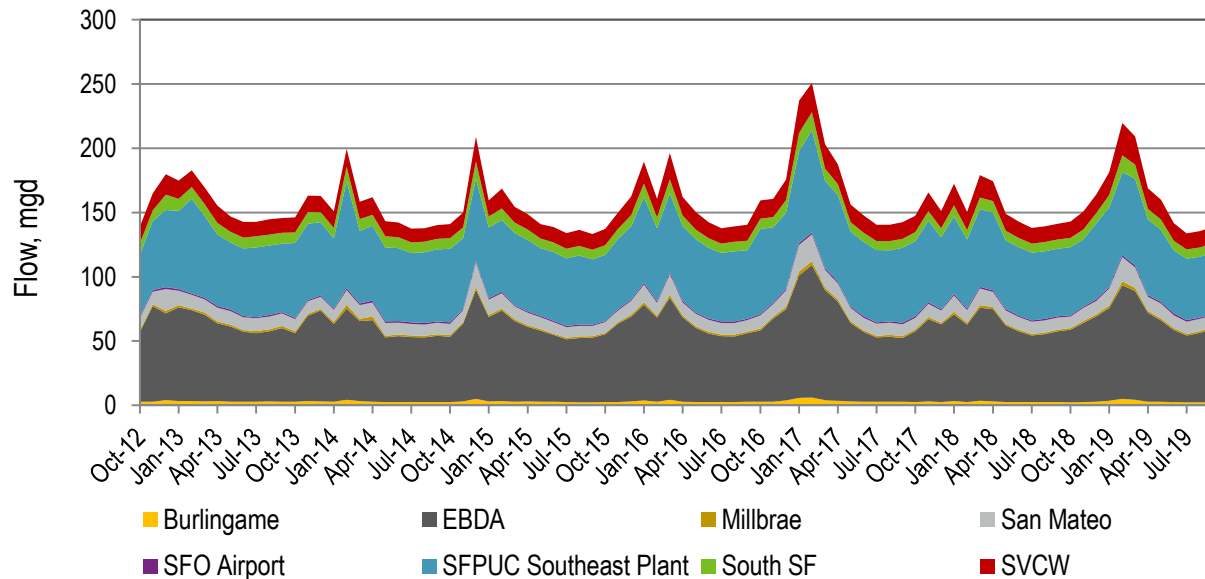


Figure 4-18. Flow Contribution by Discharger to South Bay

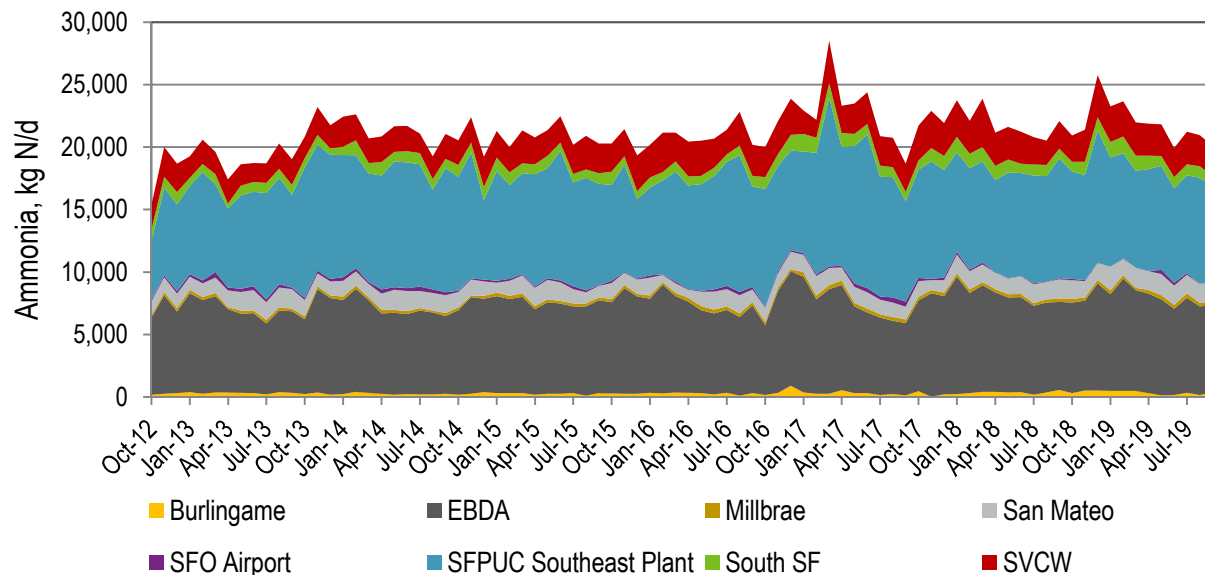


Figure 4-19. Ammonia Load Contribution by Discharger to South Bay

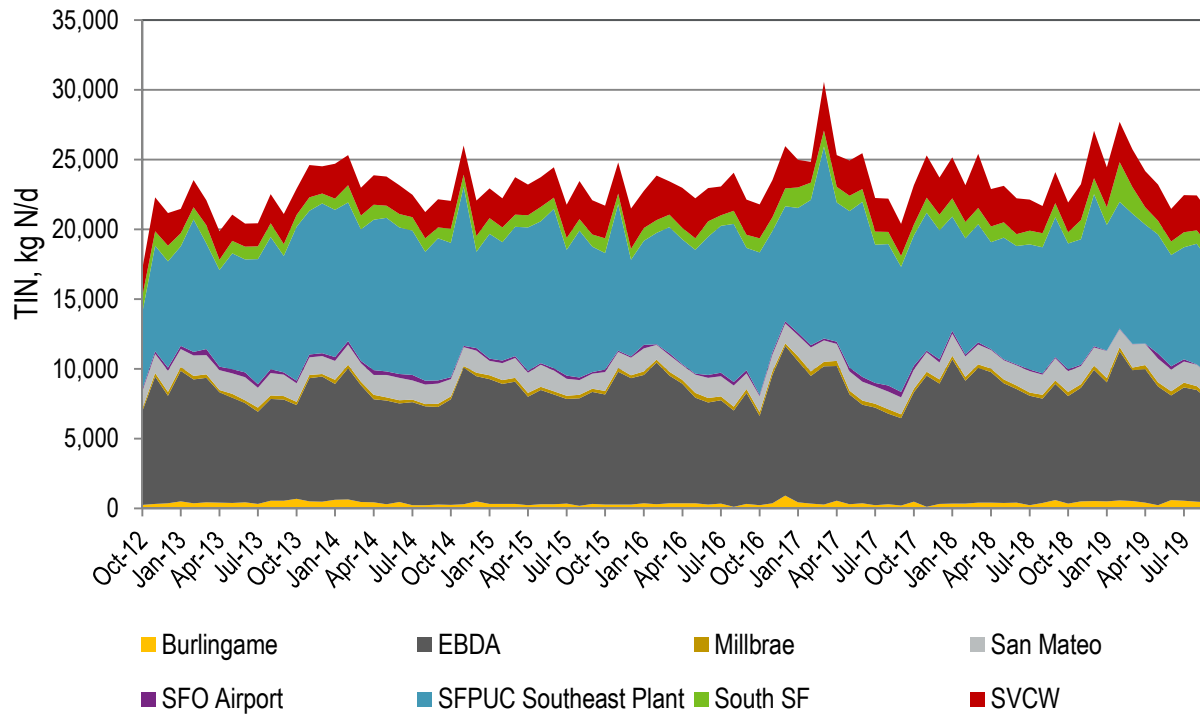


Figure 4-20. TIN Load Contribution by Discharger to South Bay

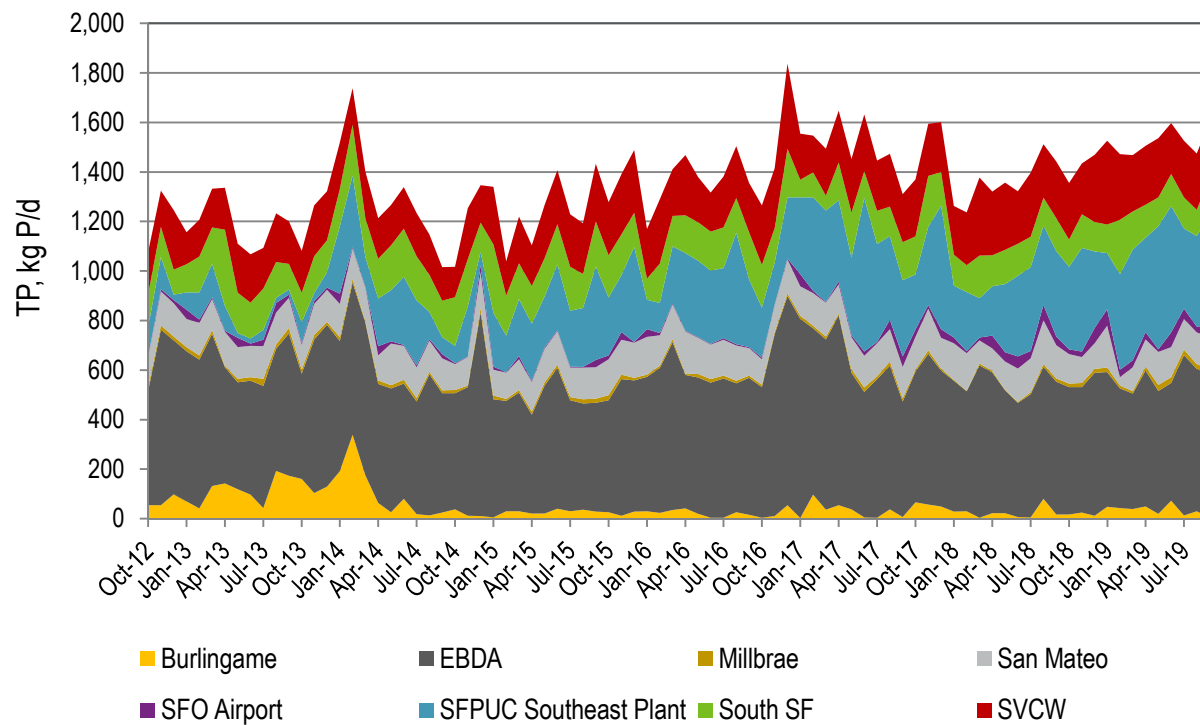


Figure 4-21. TP Load Contribution by Discharger to South Bay

4.7.5 Lower South Bay

The average monthly discharge to Lower South Bay by discharger for discharge flows and loads are provided in Figure 4-22 through Figure 4-25. Lower South Bay wastewater flows are dominated by San Jose. San Jose also discharges the largest total nitrogen load. Sunnyvale and San Jose's ammonia loads exhibit a significant seasonal pattern. San Jose's total nitrogen loads are sporadic (e.g., July 2015), which is likely attributed to the biological nitrogen removal step feed process.

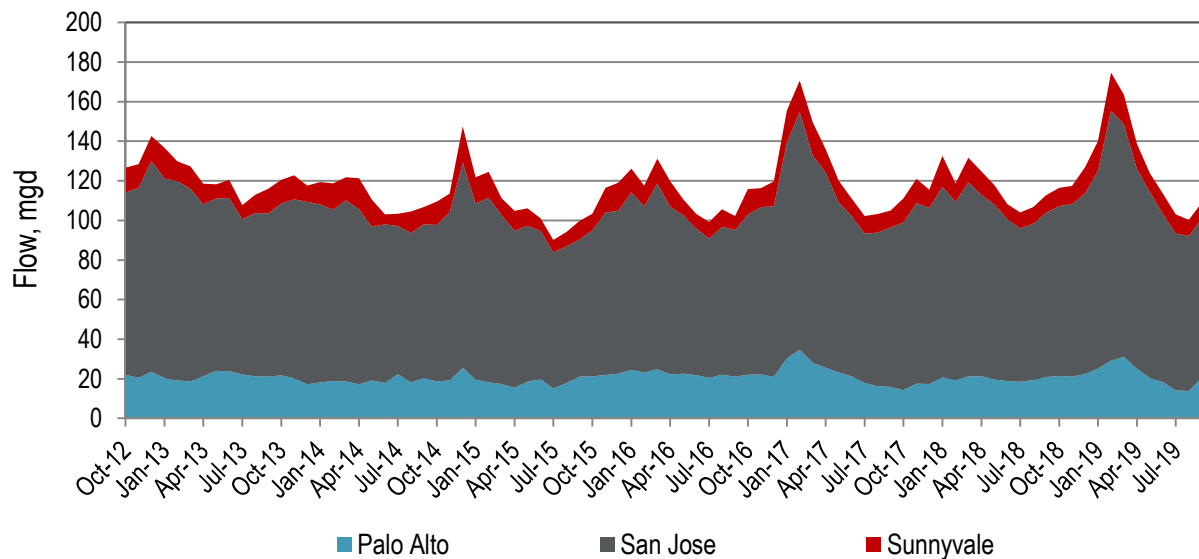


Figure 4-22. Flow Contribution by Discharger to Lower South Bay

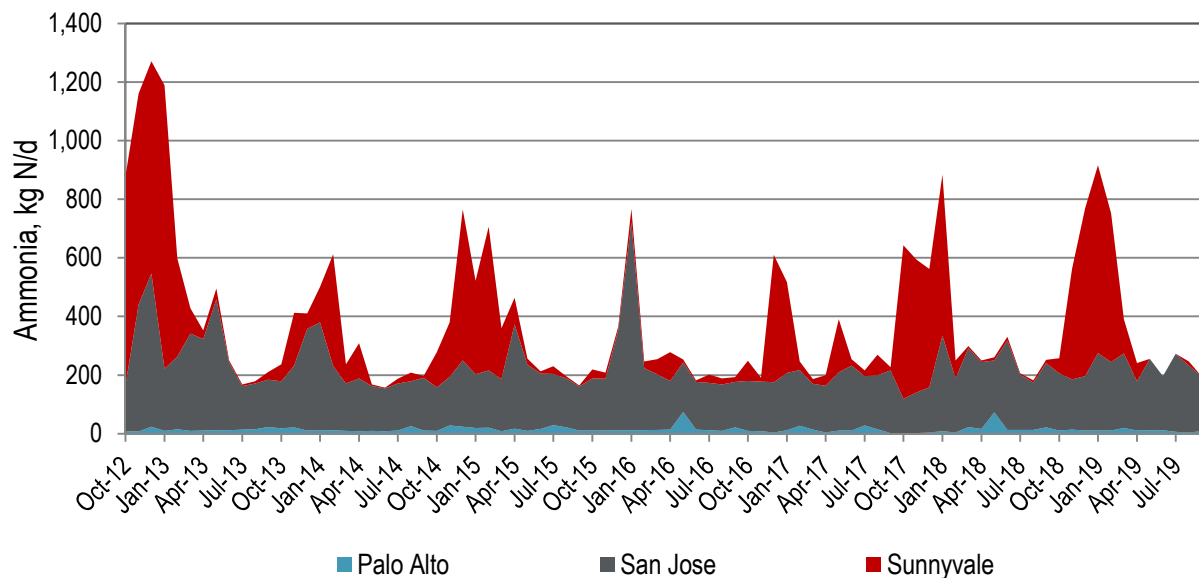


Figure 4-23. Ammonia Load Contribution by Discharger to Lower South Bay

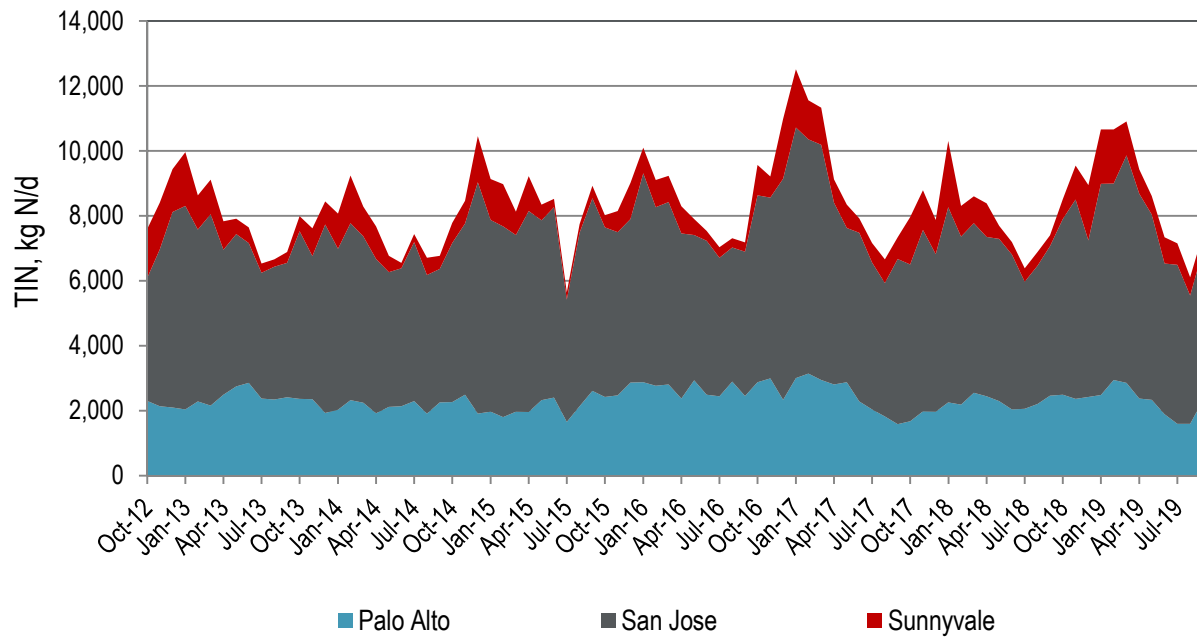


Figure 4-24. TIN Load Contribution by Discharger to Lower South Bay

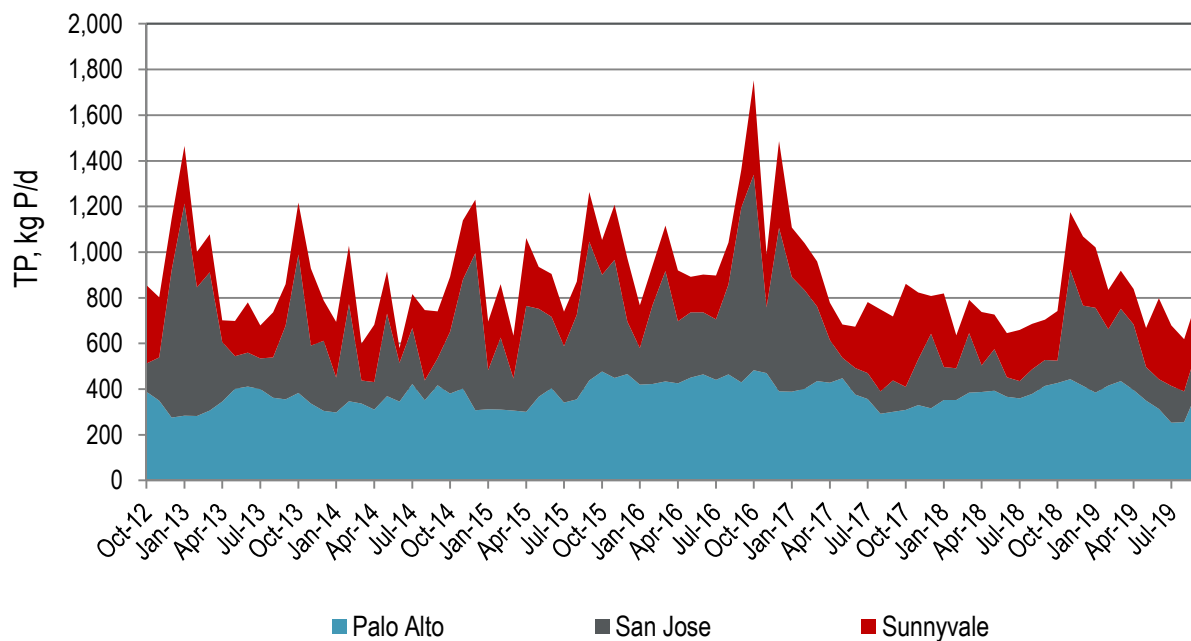


Figure 4-25. TP Load Contribution by Discharger to Lower South Bay

5 Discussion

The 2016/2017 dataset was one of the wettest years on record for Northern California. As a result, the average annual total flows during the 2016/2017 wet season were the highest since sampling began in 2012. Both average annual and dry season 2016/2017 loads for ammonia and TIN were also the highest since sampling began. Average annual total flows from the 2017/2018 dataset returned to pre-2016/2017 values, but increased again after another wet year in 2018/2019. In contrast, the dry season total discharge flows have remained relatively steady for the past three years of data collection. All dry season nutrient discharge loads, with the exception of a dip in TP in the 2016/2017 dataset, have remained steady for the past three years of data collection. Average annual total loads have been more variable in recent years.

A plot of the historical average monthly daily discharge flow, ammonia, NOx, TIN, and TP loads are presented in Figure 5-1. In general, ammonia, NOx, and TIN loads tend to track with the flows. For example, during peak wet weather events, both the flow and total nitrogen loads typically increase. However, the limited dataset restricts confidence in the strength of this relationship. It is unknown whether the trend would be as evident with increased sampling frequency where the impacts from an initial scouring event in the collection system due to wet weather would be reduced and dilution increased (similar to the “first flush” in stormwater collection systems). Additional data is needed to further understand the correlation between flow and loads during peak wet weather events.

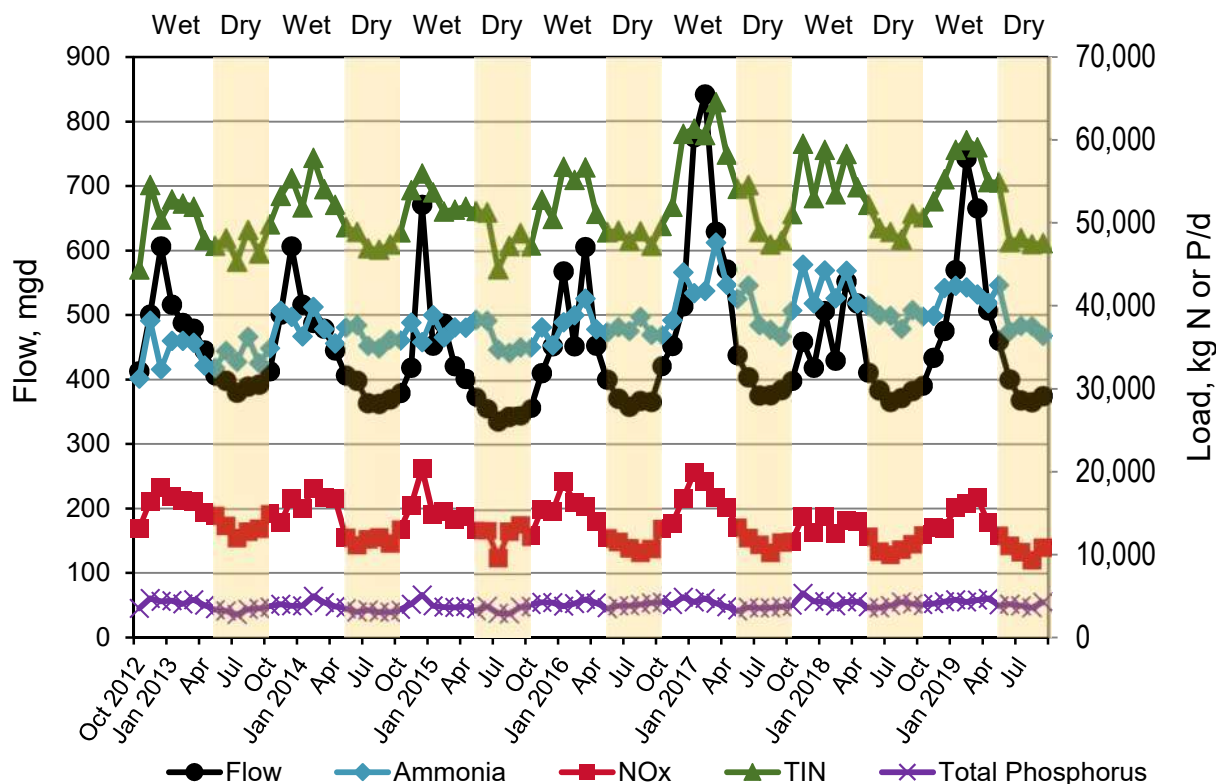


Figure 5-1. Historical Average Monthly Daily Discharge Flows and Loads

Dry season flows have returned to pre-drought levels since the 2016/2017 year as evidenced by flows comparable to 2013/2014 flows. Additionally, the three most recent years of dry season loads for Ammonia and TIN are the three highest since sampling began in 2012, although NO_x loads have seen a decrease over this same time frame.

This trending analysis shows an increase in ammonia, and TIN total loads for both the average annual and dry season is likely due to a combination of the following:

- Population increase in the Bay Area
- Robust labor market drawing more outside the Bay Area commuters.
- A strong economy in the Bay Area,
- Industrial impacts as more treatment plants across the Bay import organics for energy production.
- Infrequent sampling frequency (twice per month for Major Dischargers) can result in biased results. For example, if a plant's two sampling events were during peak flow events it could result in values that do not necessarily reflect day to day values for that particular month.
- Sampling requirements between Section 13267 Letter data and Watershed Permit as discussed in Section 3.

The following subsections present observations of each parameter considered, including outliers, seasonality, and the role of the largest dischargers.

5.1 Trending Statistics

The method of least squares trend analysis is intended to identify potential significant trends. Verifying the trends would require a more rigorous statistical approach than applied for this report. While effective as a first step for identifying potential significant trends, the method of least squares does not verify whether regression assumptions of normality and independence of errors have been satisfied. The recommended next steps if trend verification is required are as follows:

- 1) Verify the correlation of errors (e.g., Durbin-Watson correlation of errors).
- 2) Evaluate whether the data needs to be transformed (e.g., natural log) to provide context on whether data is conforming to the distributional assumptions of the modeling errors. A probability plot of errors will provide context on whether data is conforming to the errors.
- 3) Use the Cochran–Orkut regression model to adjust the data for a time series correlation in the error term.

5.2 Flow Analysis

Although the total Average Dry Weather Flow (ADWF) permitted capacity of the POTW dischargers in the San Francisco Bay is 826 mgd, the total average annual discharge ranged from 415 mgd to 515 mgd for the seven-year period. The ADWF total flows declined from 2012/2013 to 2014/2015, increased in 2015/2016 and 2016/2017, and have stayed relatively steady since then. Average annual flows peaked in 2016/2017 with a smaller but significant peak again in 2018/2019, primarily due to the unusually high precipitation during these periods.

The South Bay and Lower South Bay Subembayments received the highest flows, making up approximately 60 percent of the total flow discharged to the Bay. The largest discharger is San Jose, followed by SFPUC Southeast, EBDA, and EBMUD. San Pablo Bay has the largest portion of recycled water diversion during the dry season; several plants divert all flow and have a zero dry season discharge.

The dry season flow trends for all Subembayments are not statistically significant. While several subembayments had been previously identified as having a significant downward dry season trend (e.g., Suisun and Lower South Bay), dry season flows since the 2016/2017 season have rebounded such that there is no longer a significant dry season trend.

5.3 Ammonia Analysis

The total average annual ammonia discharge ranged from approximately 34,300 kg N/d to 40,800 kg N/d for the seven-year period. The Central Bay and South Bay Subembayments receive the highest ammonia loads, making up over 80 percent of the total ammonia discharged to the Bay. The largest overall ammonia discharger is the SFPUC Southeast Plant, followed by EBMUD and EBDA.

The dry season ammonia loads appear to be statistically increasing Bay-wide, and for all subembayments other than the Lower South Bay. Despite receiving the second highest flows, the Lower South Bay ammonia loads are about an order of magnitude lower than any other Subembayment, making up less than one percent of the total ammonia load to the Bay. This is because the three dischargers that make up the Lower South Bay are required to fully nitrify at their plants due to their shallow water discharges. Ammonia removal addresses ammonia related toxicity; however, a portion of the nitrogen is still present as NO_x in the discharge.

The seasonal variation of discharged ammonia load from the wet to the dry season (based on the percent difference) are most pronounced for the Lower South Bay and San Pablo Bay. The Lower South Bay has the most significant seasonal load reduction as evidenced by about a 40 percent reduction from the wet to the dry season. Similar to the seasonal variation in flow, these seasonal load variations are attributed to a combination of seasonal diversion of recycled water, pond dredging, colder temperatures, and seasonal nitrification. Nitrification is less effective at the cooler wet season temperatures; as a result, a few of the dischargers appear to experience increased ammonia concentrations during the wet season. Additionally, recycling water has the potential to divert loads from the Bay when used for consumptive purposes (e.g., irrigation).

Agencies with nitrifying trickling filters (e.g., Sunnyvale), have variable wet weather ammonia concentrations which are attributed to temperature variations that impact the nitrification process. As a result, these plants appear to have difficulty maintaining a consistent discharge ammonia load during winter months.

5.4 NO_x Analysis

The total average annual NO_x discharge ranged from approximately 12,400 kg N/d to 15,000 kg N/d for the seven-year period. Despite year-to-year increases in the 2016/2017 and 2018/2019 data, NO_x loads have an overall downward dry season trend, with the 2018/2019 showing a decrease of over 10% compared to the first year of data collection (2012/2013). The basis for this reduction is unclear and should be further evaluated in future nutrient trending reports. Possible reasons could include a reduction in nitrification for plants with intermittent nitrification or enhanced denitrification for plants that are denitrifying.

The Lower South Bay receives the highest NO_x load, making up approximately 65 percent of the total NO_x load discharged to the Bay. The largest overall discharger of NO_x is San Jose, averaging 4,919 kg N/d for the seven-year period, which is about 35 percent of the total NO_x load to the Bay. As previously stated, this is attributed to nitrification of ammonia at all three plants in the Lower South bay. A portion of the ammonia converted to NO_x is discharged as NO_x. The overwhelming majority of NO_x discharged is nitrate.

The seasonal variation of discharged NO_x load from the wet to the dry season (based on the percent difference) is most pronounced on a percentile load basis for San Pablo Bay, Central Bay, and South Bay, in that order. San Pablo Bay has the largest variation due to the lack of dry season dischargers coupled with several of the plants in San Pablo Bay performing nitrification. There are also occasional spikes of NO_x in the dry season from agencies that have intermittent nitrification, specifically for under-loaded trickling filter plants.

5.5 Total Inorganic Nitrogen Analysis

The total average annual TIN discharge ranged from 49,300 kg N/d to 55,000 kg N/d for the seven-year period. The Central Bay and South Bay Subembayments receive the highest total nitrogen loads, making up approximately 70 percent of the total nitrogen discharged to the Bay. The largest overall discharger of TIN on an average annual basis is EBMUD, followed by SFPUC Southeast and EBDA.

There appears to be a Baywide upward dry and wet season trend in TIN loads. However, the last three years of data have been relatively stable, with a decrease in TIN loads in 2018/2019. Subembayments that previously showed a statistically significant increase (e.g., San Pablo Bay South Bay) now show no significant trend. Central Bay is the only subembayment that shows a trend based on the least squares method, and the Baywide upward trend averages less than a 1% increase in load per year.

The seasonal difference in TIN discharges from the wet to the dry season (based on the percent difference) are most pronounced in San Pablo Bay and the Central Bay. San Pablo Bay has the most significant seasonal load reduction as evidenced by an approximately 27 percent reduction from the wet to the dry season. Similar to ammonia, this is attributed to a combination of more effective nitrification/denitrification during the dry season and seasonal use of recycled water, which diverts loads.

5.6 Total Phosphorus Analysis

The total average annual TP discharge ranged from approximately 3,750 kg P/d to 4,210 kg P/d for the seven-year period. TP sampling is a composite for both the Section 13267 Letter data and the Nutrient Watershed Permit. However, the Section 13267 Letter data required sampling during peak flows, as previously discussed.

The dry season trending varies by Subembayment. The South Bay received the largest TP load of all Subembayments at 38 percent of the total load, followed by the Central Bay at 29 percent. Both subembayments, as well as Suisun Bay, have an upward trend. Baywide dry season TP loads are also trending upward. However, this may be in part due to the different sampling standards between the Section 13267 Letter data and the Nutrient Watershed Permit data, as the TP data shows a significant jump between the 2014/2015 and the 2015/2016 years. The largest overall discharger of TP based on average annual loads is EBMUD, followed by EBDA and Palo Alto.

The seasonal variation of TP discharge loads from the wet to dry season (based on the percent difference) are most pronounced for San Pablo Bay, Central Bay, and Lower South Bay Subembayments. In contrast, the South Bay and Suisun Subembayments do not appear to have a significant variation in TP loading between the wet and dry season.

This page is intentionally blank.

6 Summary

Table 6-1 and Table 6-2 present an overall summary of the average annual and dry season flows and nutrient loads discharged to the San Francisco Bay, respectively, between October 2012 and September 2019. Similarly, Table 6-3 and Table 6-4 present a summary of the corresponding dry season and average annual constituent concentrations, respectively, for the same period. The concentrations were calculated by dividing the loads by the flows for the appropriate averaging period.

The 2016/2017 dataset was one of the wettest years on record for Northern California, and as such has the highest average annual flow for the data period. The most recent year of data also came during a wetter season than usual, representing the second highest flow since data collection began. In general, the most recent year of data matched closely with the 2017/2018 flows and loads, with a slight increase in dry weather flows and phosphorus loads, and a slight decrease in loads for nitrogen species. There has been little of the variation over the past three years of data collection as was seen in the first four years, suggesting that flows and loads Baywide are returning to a more predictable pattern since the drought.

Ammonia, TIN, and TP total loads discharged to the San Francisco Bay had generally increased from year to year for both dry season and average annual conditions, but appear to have leveled off over the past two years, with Ammonia and TIN decreasing in 2018/2019 and TP remaining the same compared to the previous year. The nutrient concentrations all decreased in 2016/2017 with respect to the prior year's dataset (2015/2016) except for dry season ammonia. This reduction in concentration was likely due to dilution as the flows increased with respect to the previous year.

The analysis did not evaluate influent flows and loadings to the dischargers over the seven-year period. Influent flows and loads are currently required under the new permit for plants with a design discharge flow of 10 mgd or higher, but only one quarter of data has been collected as the new permit came into effect in July 2019. Subsequent reports will include an influent analysis once a full year of data has been obtained.

Changes in the data collection procedures during the seven-year period created some uncertainty about the resulting trends. The data collection requirements were different in the initial two years, under the Section 13267 Letter data requirements, which disproportionately emphasized the importance of wet weather loading and potentially skewed the resulting trends. As a result, trends for each discharger were limited to the Dry Season, which limited the number of data points for use in the trend analysis (most agencies had 35). Future data will increase the size of the sample set and improve the level of confidence in the trends.

As expected, the largest dischargers dominate the nutrient loading. Generally, three to four large dischargers contribute more than 70 percent of the nutrient loads. The loading of ammonia and NO_x is impacted by plants that nitrify. Those plants that nitrify have the lowest ammonia discharge concentrations and the highest NO_x concentrations.

Seasonal variations are pronounced. Dry season loads are generally lower than wet season loads. This is attributed to two factors. First, the higher flows and sampling procedures amplify the wet season discharges. Secondly, during the dry season, water reuse diverts much of the nutrient load away from the Bay. In some instances, agencies have achieved zero discharge during the summer months. It is recommended that in future years, agencies report the flow diverted for recycled water use as well as any return streams (e.g., cooling tower blow down, advanced purification concentrate,

etc.) such that the total quantity of recycled water can be clearly quantified, as well as the associated nutrient loads being diverted from the San Francisco Bay.

Table 6-1. Summary of Average Annual Flow and Load Discharges to the Bay

Constituent	2012/13 (a)	2013/14 (a)	2014/15 (a)	2015/16 (a)	2016/17 (a)	2017/18 (a)	2018/19 (a)	7 Year Avg
Flow, mgd	451	428	415	430	515	433	480	450
Ammonia, kg N/d	34,300	37,000	36,700	37,500	40,600	40,800	39,800	38,100
NOx, kg N/d	15,000	14,300	14,200	13,600	14,500	12,400	13,000	13,900
TIN, kg N/d	49,300	51,300	50,900	51,100	55,000	53,200	53,100	52,000
TP, kg P/d	3,860	3,750	3,770	4,070	4,020	4,190	4,210	3,980

- Each reporting year represents the period between October 1 of the first year and September 30 of the second year. For example, 2012/13 represents the period between October 1, 2012 and September 30, 2013.
- Trend analysis is based on average monthly values. Discernible trends were identified based on the slope of a regression line determined using the method of least squares to fit the data ($\alpha = 0.05$). Sample size is 84. Where "None" is stated, the limited dataset does not indicate a statistically relevant trend.
- The percent change represents the change per year as a percentage of the average value over the entire dataset (2012-2019).

Table 6-2. Summary of Dry Season Flow and Load Discharges to the Bay

Constituent	2013 (a)	2014 (a)	2015 (a)	2016 (a)	2017 (a)	2018 (a)	2019 (a)	Trend (b,c)	7 Year Avg
Flow, mgd	393	374	351	372	396	383	394	None	381
Ammonia, kg N/d	34,000	36,300	36,200	37,300	38,900	38,900	38,200	Up (2.6%/yr)	37,100
NOx, kg N/d	13,400	11,800	12,500	11,100	11,700	11,000	10,900	Down (-2.5%/yr)	11,800
TIN, kg N/d	47,300	48,100	48,700	48,400	50,600	50,000	49,200	Up (1.3%/yr)	48,900
TP, kg P/d	3,400	3,320	3,570	3,960	3,660	4,000	4,010	Up (2.0%/yr)	3,700

- Each reporting year represents the period between October 1 of the first year and September 30 of the second year. For example, 2012/13 represents the period between October 1, 2012 and September 30, 2013.
- Trend analysis is based on average monthly values. Discernible trends were identified based on the slope of a regression line determined using the method of least squares to fit the data ($\alpha = 0.05$). Sample size is 35. Where "None" is stated, the limited dataset does not indicate a statistically relevant trend.
- The percent change represents the change per year as a percentage of the average value over the entire dataset (2012-2019).

Table 6-3. Summary of Average Annual Flow and Constituent Concentrations Discharged to the Bay

Constituent	2012/13 (a)	2013/14 (a)	2014/15 (a)	2015/16 (a)	2016/17 (a)	2017/18 (a)	2018/19 (a)	7 Year Avg
Flow, mgd	451	446	415	430	515	433	480	453
Ammonia, mg NL	20.1	21.9	23.4	23.0	20.8	24.9	21.9	22.2
NOx, mg N/L	8.78	8.51	9.06	8.38	7.42	7.58	7.15	8.09
TIN, mg N/L	28.9	30.4	32.5	31.4	28.3	32.5	29.3	30.4
TP, mg P/L	2.26	2.23	2.40	2.50	2.07	2.56	2.32	2.33

- Each reporting year represents the period between October 1 of the first year and September 30 of the second year. For example, 2012/13 represents the period between October 1, 2012 and September 30, 2013.
- Trend analysis is based on average monthly values. Discernible trends were identified based on the slope of a regression line determined using the method of least squares to fit the data ($\alpha = 0.05$). Sample size is 35. Where "None" is stated, the limited dataset does not indicate a statistically relevant trend.
- The percent change represents the change per year as a percentage of the average value over the entire dataset (2012-2019).

Table 6-4. Summary of Dry Season Flow and Constituent Concentrations Discharged to the Bay

Constituent	2012/13 (a)	2013/14 (a)	2014/15 (a)	2015/16 (a)	2016/17 (a)	2017/18 (a)	2018/19 (a)	Trend (b,c)	7 Year Avg
Flow, mgd	393	380	351	372	396	383	393	None	381
Ammonia, mg NL	22.9	25.2	27.3	26.5	26.0	26.9	22.9	Up (1.4%/yr)	25.7
NOx, mg N/L	8.99	8.24	9.42	7.90	7.82	7.57	8.99	Down (-3.5%/yr)	8.16
TIN, mg N/L	31.8	33.5	36.7	34.4	33.8	34.5	31.8	None	33.9
TP, mg P/L	2.28	2.31	2.69	2.81	2.44	2.76	2.28	Up (2.6%/yr)	2.57

- Each reporting year represents the period between October 1 of the first year and September 30 of the second year. For example, 2012/13 represents the period between October 1, 2012 and September 30, 2013.
- Trend analysis is based on average monthly values. Discernible trends were identified based on the slope of a regression line determined using the method of least squares to fit the data ($\alpha = 0.05$). Sample size is 35. Where "None" is stated, the limited dataset does not indicate a statistically relevant trend.
- The percent change represents the change per year as a percentage of the average value over the entire dataset (2012-2019).

This page is intentionally blank.

Appendix

Discharge Evaluation for Individual Dischargers

This page is intentionally blank.

Contents

1	City of American Canyon.....	1
2	City of Benicia	7
3	City of Burlingame	13
4	Central Contra Costa Sanitary District (CCCSD)	19
5	Central Marin Sanitation Agency (CMSA)	25
6	Crockett Community Services District - Port Costa	31
7	Delta Diablo	37
8	East Bay Dischargers Authority (EBDA)	43
9	East Bay Municipal Utility District (EBMUD)	49
10	Fairfield-Suisun Sewer District (FSSD)	55
11	Las Gallinas Valley Sanitary District	61
12	City of Millbrae.....	67
13	Mt. View Sanitary District	73
14	Napa Sanitation District.....	79
15	Novato Sanitary District.....	85
16	City of Palo Alto.....	91
17	Sanitary District No. 5 of Marin County - Paradise Cove Treatment Plant	97
18	City of Petaluma	103
19	City of Pinole	109
20	Rodeo Sanitary District.....	115
21	San Jose-Santa Clara Regional Wastewater Facility	123
22	City of San Mateo	129
23	Sewerage Agency of Southern Marin (SASM).....	135
24	San Francisco International Airport – MLTP (SFO)	141
25	SFPUC Southeast Plant.....	147
26	Sausalito-Marin City Sanitary District (SMCSD)	153
27	Sonoma Valley County Sanitation District.....	159
28	South San Francisco-San Bruno.....	165
29	City of Sunnyvale	171
30	Silicon Valley Clean Water (SVCW).....	177
31	Sanitary District No. 5 of Marin County – Tiburon Treatment Plant	183
32	Treasure Island	189
33	Vallejo Flood and Wastewater District	195
34	West County Agency Outfall	201

Tables

Table 1-1. American Canyon Monthly Flows and Loads	4
Table 2-1. Benicia Monthly Flows and Loads*	10
Table 3-1. Burlingame Monthly Flows and Loads	16
Table 4-1. CCCSD Monthly Flows and Loads	22
Table 5-1. CMSA Monthly Flows and Loads	28
Table 6-1. Port Costa Monthly Flows and Loads	34
Table 7-1. Delta Diablo Monthly Flows and Loads	40
Table 8-1. EBDA Monthly Flows and Loads	46
Table 9-1. EBMUD Monthly Flows and Loads	52
Table 10-1. Fairfield-Suisun Sewer District Monthly Flows and Loads	58
Table 11-1. Las Gallinas Monthly Flows and Loads	64
Table 12-1. Millbrae Monthly Flows and Loads	70
Table 13-1. Mt. View Sanitary District Monthly Flows and Loads	76
Table 14-1. Napa Sanitation District Monthly Flows and Loads	82
Table 15-1. Novato Monthly Flows and Loads	88
Table 16-1. Palo Alto Monthly Flows and Loads	94
Table 17-1. Paradise Cove Monthly Flows and Loads	100
Table 18-1. Petaluma Monthly Flows and Loads	106
Table 19-1. Pinole Monthly Flows and Loads	112
Table 20-1. Rodeo Monthly Flows and Loads	118
Table 21-1. San Jose Monthly Flows and Loads	126
Table 22-1. San Mateo Monthly Flows and Loads	132
Table 23-1. SASM Monthly Flows and Loads	138
Table 24-1. SFO Airport Monthly Flows and Loads	144
Table 25-1. SFPUC Southeast Monthly Flows and Loads	150
Table 26-1. SMCSD Monthly Flows and Loads	156
Table 27-1. Sonoma Valley Monthly Flows and Loads	162
Table 28-1. South SF-San Bruno Monthly Flows and Loads	168
Table 29-1. Sunnyvale Monthly Flows and Loads	174
Table 30-1. SVCW Monthly Flows and Loads	180
Table 31-1. Tiburon Monthly Flows and Loads	186
Table 32-1. Treasure Island Monthly Flows and Loads	192
Table 33-1. Vallejo Monthly Flows and Loads	198
Table 34-1. West County Monthly Flows and Loads	204

Figures

Figure 1-1. American Canyon Monthly Flows and Loads	1
Figure 1-2. American Canyon Monthly Nitrogen Loads	2
Figure 1-3. American Canyon Monthly Nitrogen Concentrations	2
Figure 1-4. American Canyon Monthly Phosphorus Loads	3
Figure 1-5. American Canyon Monthly Phosphorus Concentrations	3
Figure 2-1. Benicia Monthly Flows and Loads	7
Figure 2-2. Benicia Monthly Nitrogen Loads	8
Figure 2-3. Benicia Monthly Nitrogen Concentrations	8
Figure 2-4. Benicia Monthly Phosphorus Loads	9
Figure 2-5. Benicia Monthly Phosphorus Concentrations	9
Figure 3-1. Burlingame Monthly Flows and Loads	13
Figure 3-2. Burlingame Monthly Nitrogen Loads	14
Figure 3-3. Burlingame Monthly Nitrogen Concentrations	14
Figure 3-4. Burlingame Monthly Phosphorus Loads	15
Figure 3-5. Burlingame Monthly Phosphorus Concentrations	15
Figure 4-1. CCCSD Monthly Flows and Loads	19
Figure 4-2. CCCSD Monthly Nitrogen Loads	20
Figure 4-3. CCCSD Monthly Nitrogen Concentrations	20
Figure 4-4. CCCSD Monthly Phosphorus Loads	21
Figure 4-5. CCCSD Monthly Phosphorus Concentrations	21
Figure 5-1. CMSA Monthly Flows and Loads	25
Figure 5-2. CMSA Monthly Nitrogen Loads	26
Figure 5-3. CMSA Monthly Nitrogen Concentrations	26
Figure 5-4. CMSA Monthly Phosphorus Loads	27
Figure 5-5. CMSA Monthly Phosphorus Concentrations	27
Figure 6-1. Port Costa Monthly Flows and Loads	31
Figure 6-2. Port Costa Monthly Ammonia Loads	32
Figure 6-3. Port Costa Monthly Ammonia Concentrations	32
Figure 7-1. Delta Diablo Monthly Flows and Loads	37
Figure 7-2. Delta Diablo Monthly Nitrogen Loads	38
Figure 7-3. Delta Diablo Monthly Nitrogen Concentrations	38
Figure 7-4. Delta Diablo Monthly Phosphorus Loads	39
Figure 7-5. Delta Diablo Monthly Phosphorus Concentrations	39
Figure 8-1. EBDA Monthly Flows and Loads	43
Figure 8-2. EBDA Monthly Nitrogen Loads	44
Figure 8-3. EBDA Monthly Nitrogen Concentrations	44
Figure 8-4. EBDA Monthly Phosphorus Loads	45
Figure 8-5. EBDA Monthly Phosphorus Concentrations	45
Figure 9-1. EBMUD Monthly Flows and Loads	49
Figure 9-2. EBMUD Monthly Nitrogen Loads	50
Figure 9-3. EBMUD Monthly Nitrogen Concentrations	50
Figure 9-4. EBMUD Monthly Phosphorus Loads** (Refer to Table 9-1)	51
Figure 9-5. EBMUD Monthly Phosphorus Concentrations	51
Figure 10-1. Fairfield-Suisun Sewer District Monthly Flows and Loads	55

Figure 10-2. Fairfield-Suisun Sewer District Monthly Nitrogen Loads	56
Figure 10-3. Fairfield-Suisun Sewer District Monthly Nitrogen Concentrations.....	56
Figure 10-4. Fairfield-Suisun Sewer District Monthly Phosphorus Loads	57
Figure 10-5. Fairfield-Suisun Sewer District Monthly Phosphorus Concentrations	57
Figure 11-1. Las Gallinas Monthly Flows and Loads	61
Figure 11-2. Las Gallinas Monthly Nitrogen Loads.....	62
Figure 11-3. Las Gallinas Monthly Nitrogen Concentrations	62
Figure 11-4. Las Gallinas Monthly Phosphorus Loads	63
Figure 11-5. Las Gallinas Monthly Phosphorus Concentrations.....	63
Figure 12-1. Millbrae Monthly Flows and Loads	67
Figure 12-2. Millbrae Monthly Nitrogen Loads	68
Figure 12-3. Millbrae Monthly Nitrogen Concentrations	68
Figure 12-4. Millbrae Monthly Phosphorus Loads	69
Figure 12-5. Millbrae Monthly Phosphorus Concentrations.....	69
Figure 13-1. Mt. View Sanitary District Monthly Flows and Loads.....	73
Figure 13-2. Mt. View Sanitary District Monthly Nitrogen Loads	74
Figure 13-3. Mt. View Sanitary District Monthly Nitrogen Concentrations	74
Figure 13-4. Mt. View Sanitary District Monthly Phosphorus Loads.....	75
Figure 13-5. Mt. View Sanitary District Monthly Phosphorus Concentrations	75
Figure 14-1. Napa Sanitation District Monthly Flows and Loads	79
Figure 14-2. Napa Sanitation District Monthly Nitrogen Loads	80
Figure 14-3. Napa Sanitation District Monthly Nitrogen Concentrations	80
Figure 14-4. Napa Sanitation District Monthly Phosphorus Loads	81
Figure 14-5. Napa Sanitation District Monthly Phosphorus Concentrations.....	81
Figure 15-1. Novato Monthly Flows and Loads	85
Figure 15-2. Novato Monthly Nitrogen Loads	86
Figure 15-3. Novato Monthly Nitrogen Concentrations.....	86
Figure 15-4. Novato Monthly Phosphorus Loads	87
Figure 15-5. Novato Monthly Phosphorus Concentrations	87
Figure 16-1. Palo Alto Monthly Flows and Loads	91
Figure 16-2. Palo Alto Monthly Nitrogen Loads	92
Figure 16-3. Palo Alto Monthly Nitrogen Concentrations.....	92
Figure 16-4. Palo Alto Monthly Phosphorus Loads	93
Figure 16-5. Palo Alto Monthly Phosphorus Concentrations	93
Figure 17-1. Paradise Cove Monthly Flows and Loads	97
Figure 17-2. Paradise Cove Monthly Nitrogen Loads.....	98
Figure 17-3. Paradise Cove Monthly Nitrogen Concentrations	98
Figure 17-4. Paradise Cove Monthly Phosphorus Loads	99
Figure 17-5. Paradise Cove Monthly Phosphorus Concentrations.....	99
Figure 18-1. Petaluma Monthly Flows and Loads	103
Figure 18-2. Petaluma Monthly Nitrogen Loads	104
Figure 18-3. Petaluma Monthly Nitrogen Concentrations.....	104
Figure 18-4. Petaluma Monthly Phosphorus Loads.....	105
Figure 18-5. Petaluma Monthly Phosphorus Concentrations	105
Figure 19-1. Pinole Monthly Flows and Loads.....	109
Figure 19-2. Pinole Monthly Nitrogen Loads.....	110

Figure 19-3. Pinole Monthly Nitrogen Concentrations	110
Figure 19-4. Pinole Monthly Phosphorus Loads	111
Figure 19-5. Pinole Monthly Phosphorus Concentrations	111
Figure 20-1. Rodeo Monthly Flows and Loads	115
Figure 20-2. Rodeo Monthly Nitrogen Loads	116
Figure 20-3. Rodeo Monthly Nitrogen Concentrations	116
Figure 20-4. Rodeo Monthly Phosphorus Loads	117
Figure 20-5. Rodeo Monthly Phosphorus Concentrations	117
Figure 21-1. San Jose Monthly Flows and Loads	123
Figure 21-2. San Jose Monthly Nitrogen Loads	124
Figure 21-3. San Jose Monthly Nitrogen Concentrations	124
Figure 21-4. San Jose Monthly Phosphorus Loads	125
Figure 21-5. San Jose Monthly Phosphorus Concentrations	125
Figure 22-1. San Mateo Monthly Flows and Loads	129
Figure 22-2. San Mateo Monthly Nitrogen Loads	130
Figure 22-3. San Mateo Monthly Nitrogen Concentrations	130
Figure 22-4. San Mateo Monthly Phosphorus Loads	131
Figure 22-5. San Mateo Monthly Phosphorus Concentrations	131
Figure 23-1. SASM Monthly Flows and Loads	135
Figure 23-2. SASM Monthly Nitrogen Loads	136
Figure 23-3. SASM Monthly Nitrogen Concentrations	136
Figure 23-4. SASM Monthly Phosphorus Loads	137
Figure 23-5. SASM Monthly Phosphorus Concentrations	137
Figure 24-1. SFO Airport Monthly Flows and Loads	141
Figure 24-2. SFO Airport Monthly Nitrogen Loads	142
Figure 24-3. SFO Airport Monthly Nitrogen Concentrations	142
Figure 24-4. SFO Airport Monthly Phosphorus Loads	143
Figure 24-5. SFO Airport Monthly Phosphorus Concentrations	143
Figure 25-1. SFPUC Southeast Monthly Flows and Loads	147
Figure 25-2. SFPUC Southeast Monthly Nitrogen Loads	148
Figure 25-3. SFPUC Southeast Monthly Nitrogen Concentrations	148
Figure 25-4. SFPUC Southeast Monthly Phosphorus Loads	149
Figure 25-5. SFPUC Southeast Monthly Phosphorus Concentrations	149
Figure 26-1. SMCSO Monthly Flows and Loads	153
Figure 26-2. SMCSO Monthly Nitrogen Loads	154
Figure 26-3. SMCSO Monthly Nitrogen Concentrations	154
Figure 26-4. SMCSO Monthly Phosphorus Loads	155
Figure 26-5. SMCSO Monthly Phosphorus Concentrations	155
Figure 27-1. Sonoma Valley Monthly Flows and Loads	159
Figure 27-2. Sonoma Valley Monthly Nitrogen Loads	160
Figure 27-3. Sonoma Valley Monthly Nitrogen Concentrations	160
Figure 27-4. Sonoma Valley Monthly Phosphorus Loads	161
Figure 27-5. Sonoma Valley Monthly Phosphorus Concentrations	161
Figure 28-1. South SF-San Bruno Monthly Flows and Loads	165
Figure 28-2. South SF-San Bruno Monthly Nitrogen Loads	166
Figure 28-3. South SF-San Bruno Monthly Nitrogen Concentrations	166

Figure 28-4. South SF-San Bruno Monthly Phosphorus Loads.....	167
Figure 28-5. South SF-San Bruno Monthly Phosphorus Concentrations	167
Figure 29-1. Sunnyvale Monthly Flows and Loads.....	171
Figure 29-2. Sunnyvale Monthly Nitrogen Loads.....	172
Figure 29-3. Sunnyvale Monthly Nitrogen Concentrations	172
Figure 29-4. Sunnyvale Monthly Phosphorus Loads	173
Figure 29-5. Sunnyvale Monthly Phosphorus Concentrations.....	173
Figure 30-1. SVCW Monthly Flows and Loads	177
Figure 30-2. SVCW Monthly Nitrogen Loads.....	178
Figure 30-3. SVCW Monthly Nitrogen Concentrations	178
Figure 30-4. SVCW Monthly Phosphorus Loads	179
Figure 30-5. SVCW Monthly Phosphorus Concentrations.....	179
Figure 31-1. Tiburon Monthly Flows and Loads.....	183
Figure 31-2. Tiburon Monthly Nitrogen Loads	184
Figure 31-3. Tiburon Monthly Nitrogen Concentrations	184
Figure 31-4. Tiburon Monthly Phosphorus Loads.....	185
Figure 31-5. Tiburon Monthly Phosphorus Concentrations	185
Figure 32-1. Treasure Island Monthly Flows and Loads.....	189
Figure 32-2. Treasure Island Monthly Nitrogen Loads	190
Figure 32-3. Treasure Island Monthly Nitrogen Concentrations	190
Figure 32-4. Treasure Island Monthly Phosphorus Loads.....	191
Figure 32-5. Treasure Island Monthly Phosphorus Concentrations	191
Figure 33-1. Vallejo Monthly Flows and Loads.....	195
Figure 33-2. Vallejo Monthly Nitrogen Loads.....	196
Figure 33-3. Vallejo Monthly Nitrogen Concentrations	196
Figure 33-4. Vallejo Monthly Phosphorus Loads	197
Figure 33-5. Vallejo Monthly Phosphorus Concentrations.....	197
Figure 34-1. West County Monthly Flows and Loads	201
Figure 34-2. West County Monthly Nitrogen Loads	202
Figure 34-3. West County Monthly Nitrogen Concentrations	202
Figure 34-4. West County Monthly Phosphorus Loads	203
Figure 34-5. West County Monthly Phosphorus Concentrations.....	203

1 City of American Canyon

American Canyon discharges to San Pablo Bay, and serves approximately 5,562 connections. The plant is rated for an ADWF capacity of 2.5 mgd and a peak permitted wet weather flow of 5 mgd. It has a current ADWF flow of approximately 1.1 mgd. The plant is a nitrifying and denitrifying MBR plant.

The following observations are made based upon the figures and table in the subsequent pages:

- ◆ There are 8 missing monthly average nutrient load samples per nutrient up to June 2014, which may be attributed to seasonal discharge restrictions.
- ◆ Based on the table and figures with the average monthly values, there does not appear to be any emerging dry season trends for flow, ammonia or phosphorus loads. NO_x and TIN dry season loads show a decreasing trend.
- ◆ NO_x is the majority of the nitrogen species discharged, regardless of season. This would be expected since this plant nitrifies.
- ◆ Total phosphorus concentrations are wide ranging with values from less than 1 mg P/L to over 11 mg P/L.

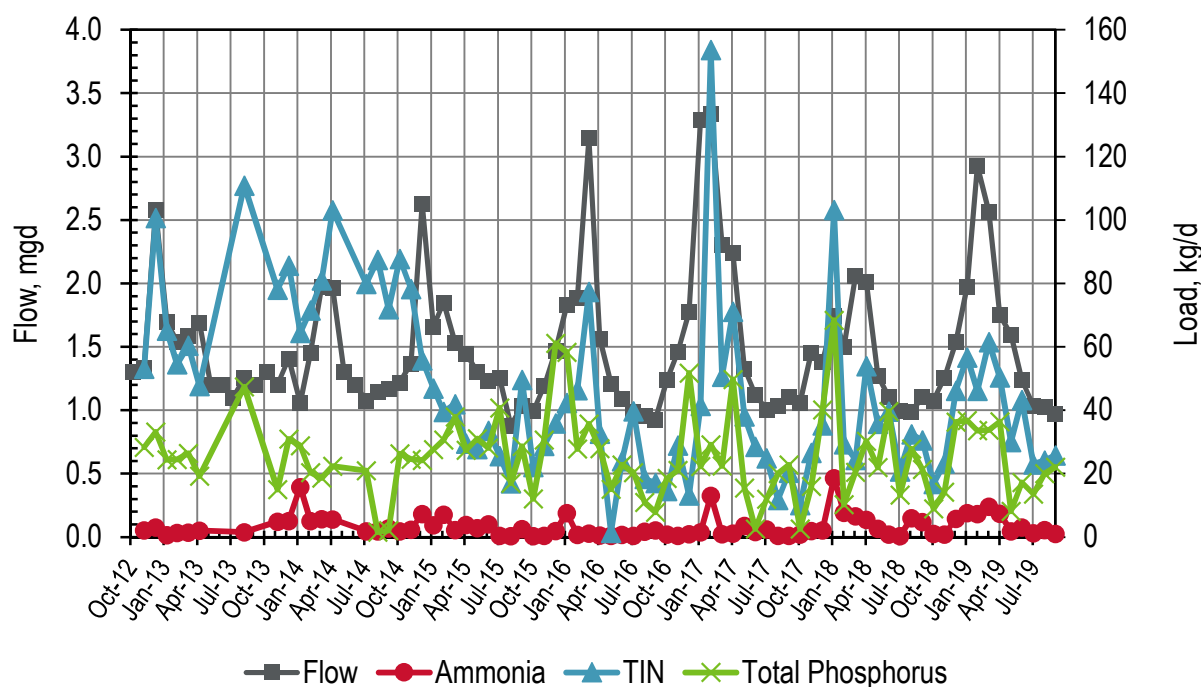


Figure 1-1. American Canyon Monthly Flows and Loads

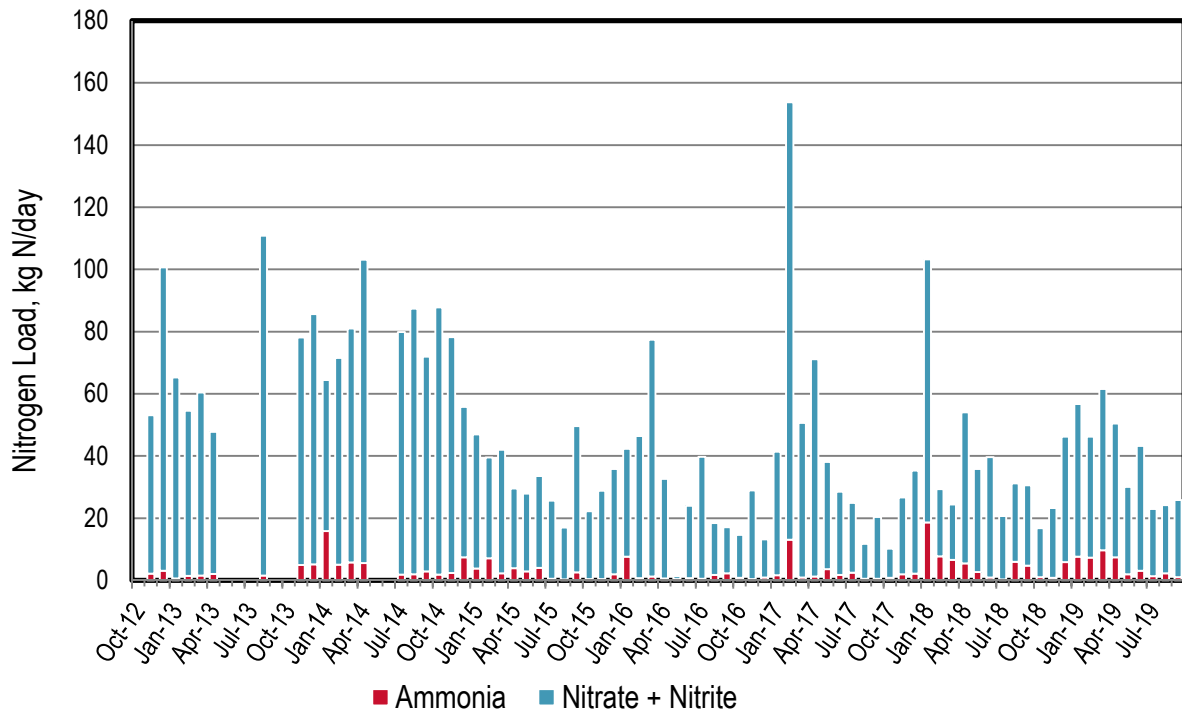


Figure 1-2. American Canyon Monthly Nitrogen Loads

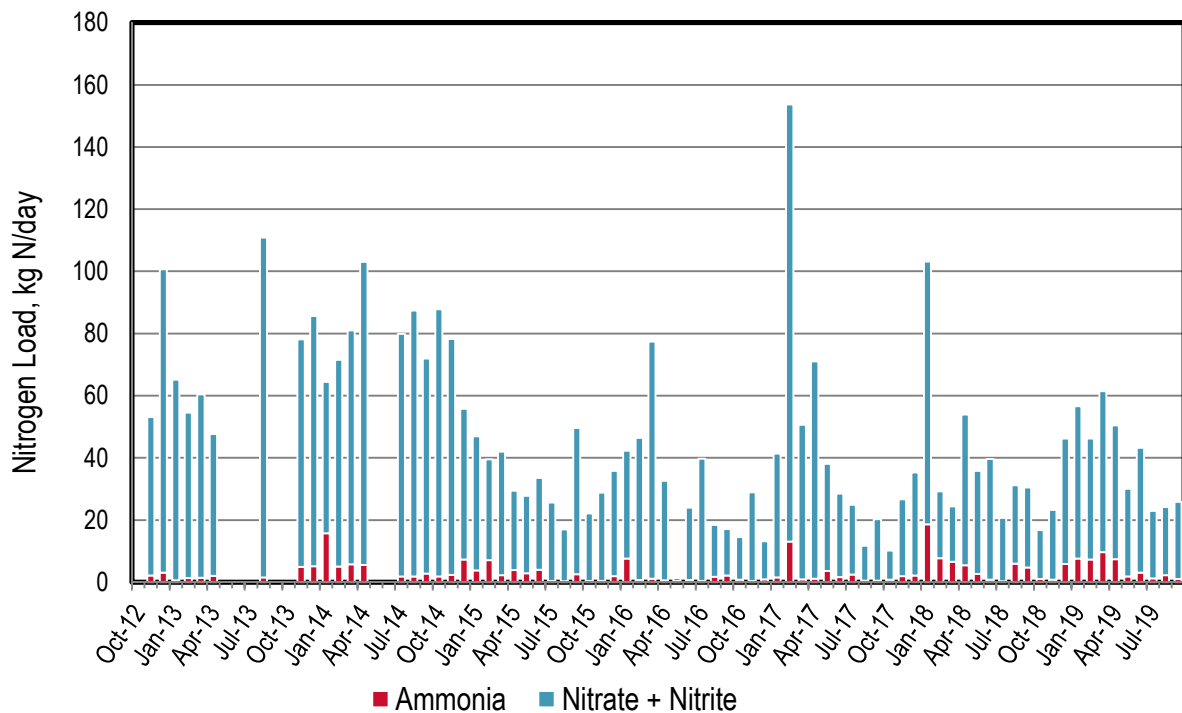


Figure 1-3. American Canyon Monthly Nitrogen Concentrations

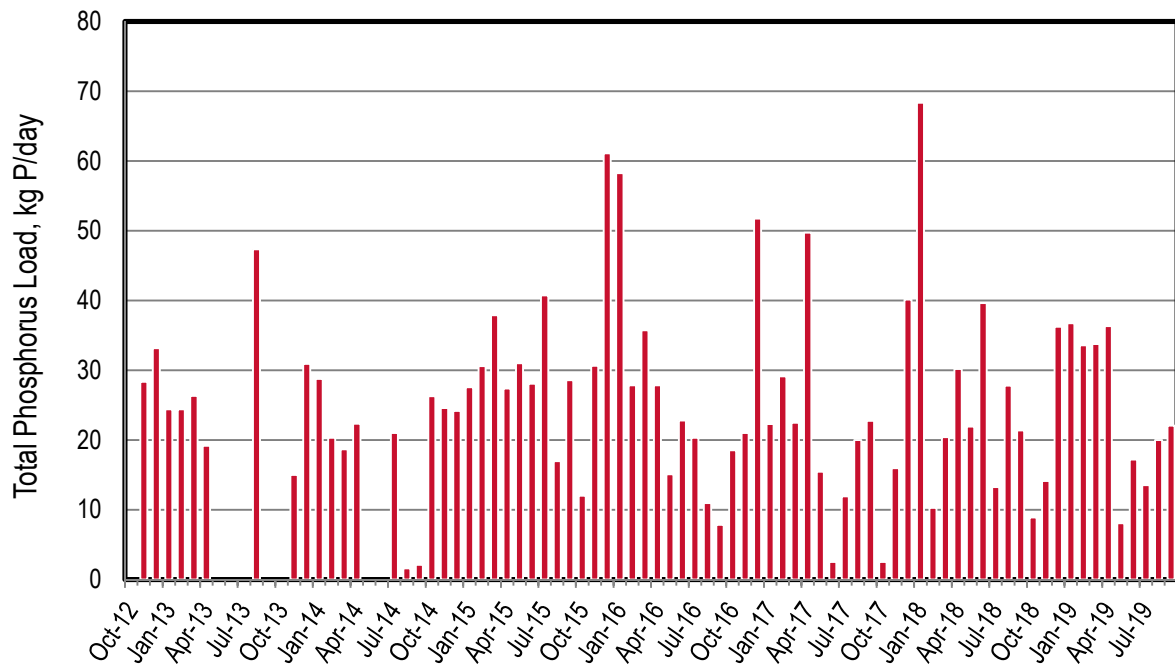


Figure 1-4. American Canyon Monthly Phosphorus Loads

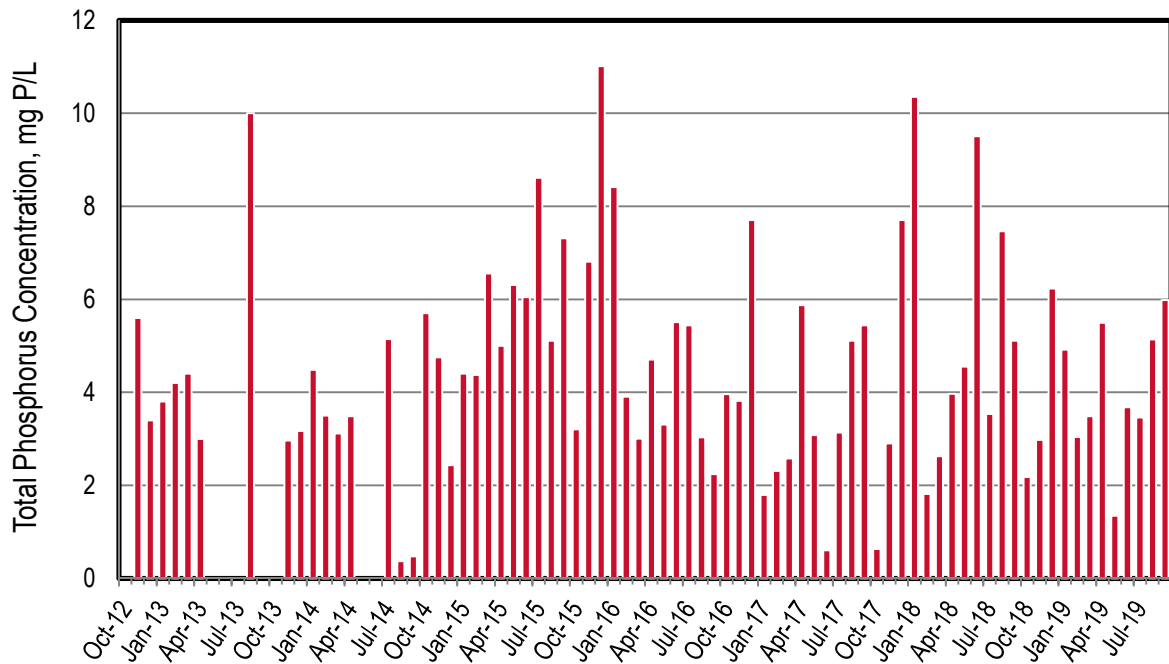


Figure 1-5. American Canyon Monthly Phosphorus Concentrations

Table 1-1. American Canyon Monthly Flows and Loads

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN*	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-12	1.30				
Nov-12	1.34	2.13	51.0	53.1	28.4
Dec-12	2.58	3.12	97.5	101	33.2
Jan-13	1.70	0.643	64.6	65.2	24.4
Feb-13	1.54	1.40	53.2	54.6	24.4
Mar-13	1.59	1.50	59.0	60.5	26.4
Apr-13	1.69	2.05	45.7	47.7	19.2
May-13	1.20				
Jun-13	1.20				
Jul-13	1.10				
Aug-13	1.25	1.56	109	111	47.4
Sep-13	1.20				
Oct-13	1.30				
Nov-13	1.20	4.91	73.2	78.1	15.0
Dec-13	1.41	5.12	80.5	85.6	30.9
Jan-14	1.06	15.8	48.6	64.4	28.8
Feb-14	1.46	5.06	66.4	71.5	20.3
Mar-14	1.98	5.75	75.3	81.0	18.7
Apr-14	1.97	5.58	97.5	103	22.3
May-14	1.30				
Jun-14	1.20				
Jul-14	1.08	1.88	78.0	79.9	21.0
Aug-14	1.15	1.91	85.5	87.4	1.60
Sep-14	1.17	2.83	69.1	71.9	2.10
Oct-14	1.22	1.89	85.9	87.8	26.3
Nov-14	1.37	2.33	75.9	78.2	24.6
Dec-14	2.63	7.36	48.4	55.8	24.2
Jan-15	1.66	3.83	43.1	46.9	27.6
Feb-15	1.85	7.13	32.4	39.5	30.6
Mar-15	1.53	2.26	39.7	42.0	37.9
Apr-15	1.45	3.89	25.6	29.5	27.4
May-15	1.30	2.85	25.0	27.9	31.0
Jun-15	1.23	4.04	29.5	33.5	28.1
Jul-15	1.25	0.474	25.1	25.6	40.8
Aug-15	0.879	0.333	16.6	17.0	17.0

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN*	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Sep-15	1.04	2.59	47.0	49.6	28.6
Oct-15	0.993	0.376	21.8	22.2	12.0
Nov-15	1.19	0.451	28.4	28.9	30.7
Dec-15	1.47	1.94	33.9	35.8	61.1
Jan-16	1.83	7.63	34.7	42.3	58.3
Feb-16	1.89	0.714	45.7	46.4	27.9
Mar-16	3.15	1.19	76.2	77.4	35.7
Apr-16	1.57	0.593	32.0	32.6	27.9
May-16	1.21	0.458	0.916	1.37	15.1
Jun-16	1.10	0.746	23.2	24.0	22.8
Jul-16	0.989	0.462	39.3	39.7	20.3
Aug-16	0.958	1.74	16.7	18.4	11.0
Sep-16	0.927	2.22	14.9	17.1	7.85
Oct-16	1.24	0.825	13.7	14.6	18.6
Nov-16	1.46	0.438	28.5	28.9	21.0
Dec-16	1.78	0.941	12.2	13.2	51.7
Jan-17	3.29	1.59	39.8	41.4	22.3
Feb-17	3.34	13.1	141	154	29.1
Mar-17	2.31	0.938	49.7	50.6	22.5
Apr-17	2.24	1.18	69.9	71.1	49.7
May-17	1.33	3.57	34.5	38.1	15.5
Jun-17	1.12	1.70	26.8	28.5	2.56
Jul-17	1.01	2.45	22.4	24.9	11.9
Aug-17	1.04	0.488	11.2	11.7	20.0
Sep-17	1.11	0.484	19.9	20.3	22.8
Oct-17	1.06	0.846	9.31	10.2	2.54
Nov-17	1.46	1.94	24.7	26.6	16.0
Dec-17	1.38	2.17	33.1	35.3	40.2
Jan-18	1.75	18.6	84.5	103	68.4
Feb-18	1.50	7.71	21.6	29.3	10.3
Mar-18	2.06	6.59	17.8	24.4	20.4
Apr-18	2.01	5.49	48.5	54.0	30.2
May-18	1.27	2.68	33.1	35.8	21.9
Jun-18	1.10	0.881	38.8	39.7	39.7
Jul-18	0.993	0.324	20.4	20.7	13.3
Aug-18	0.986	5.98	25.2	32.5	27.8
Sep-18	1.11	4.76	25.8	30.5	21.4

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN*	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-18	1.08	1.02	15.8	16.8	8.90
Nov-18	1.26	0.832	22.5	23.3	14.1
Dec-18	1.54	5.85	40.3	46.2	36.3
Jan-19	1.98	7.66	49.0	56.7	36.8
Feb-19	2.93	7.35	38.9	46.2	33.6
Mar-19	2.56	9.65	51.9	61.5	33.8
Apr-19	1.75	7.42	43.0	50.4	36.4
May-19	1.59	1.91	28.1	30.0	8.10
Jun-19	1.24	3.13	40.1	43.3	17.2
Jul-19	1.04	1.29	21.6	22.9	13.6
Aug-19	1.03	2.31	21.9	24.2	20.0
Sep-19	0.975	1.02	24.8	25.8	22.1
Dry Season Average	1.13	1.97	33.6	35.6	19.7
Dry Season Trend **	None	None	Down	Down	None
Wet Season Average	1.75	4.19	48.8	52.9	28.7
Average Annual	1.49	3.34	43.0	46.3	25.3

* The Total Inorganic Nitrogen value is calculated by adding the "Ammonia" and "Nitrate + Nitrite" values.

** Refer to the Section 3.5 in the main body for a description on the statistical analysis.

2 City of Benicia

Benicia discharges to San Pablo Bay, and serves approximately 9,569 service connections. The plant has a permitted ADWF capacity of 4.5 mgd and 18 mgd one-hour peak wet weather design flow capacity. It has a current ADWF flow of approximately 1.9 mgd. The plant performs secondary treatment using a combination of activated sludge and rotating biological contractors.

The following observations are made based upon the figures and table in the subsequent pages:

- ◆ Based on the table and figures with the average monthly values, there appears to be an emerging dry season downward trend for total phosphorus loads.
- ◆ Nitrogen loads increase with flow during wet weather events.
- ◆ Wet season loads are greater and more variable year to year than the dry season loads.
- ◆ Ammonia is the majority of the nitrogen species discharged, regardless of season. This would be expected since this plant does not nitrify.
- ◆ Ammonia concentrations vary in the range of 8 to 39 mg/L throughout the year.
- ◆ Total phosphorus concentrations range from less than 1 mg P/L to over 7 mg P/L.

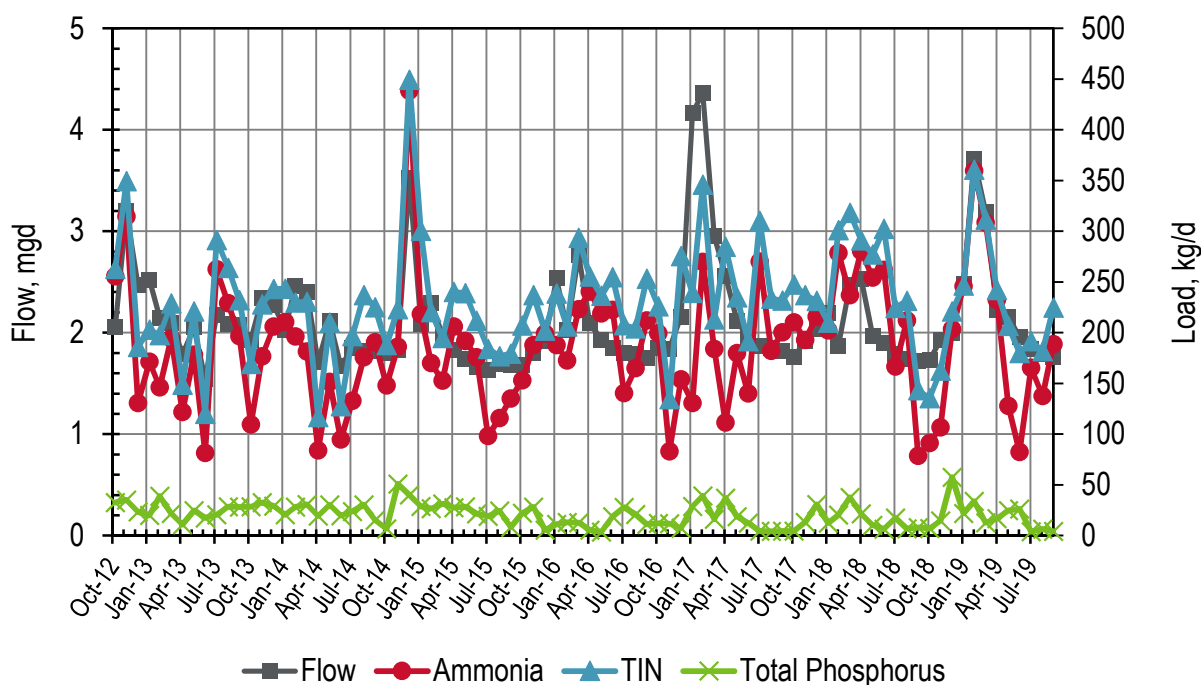


Figure 2-1. Benicia Monthly Flows and Loads

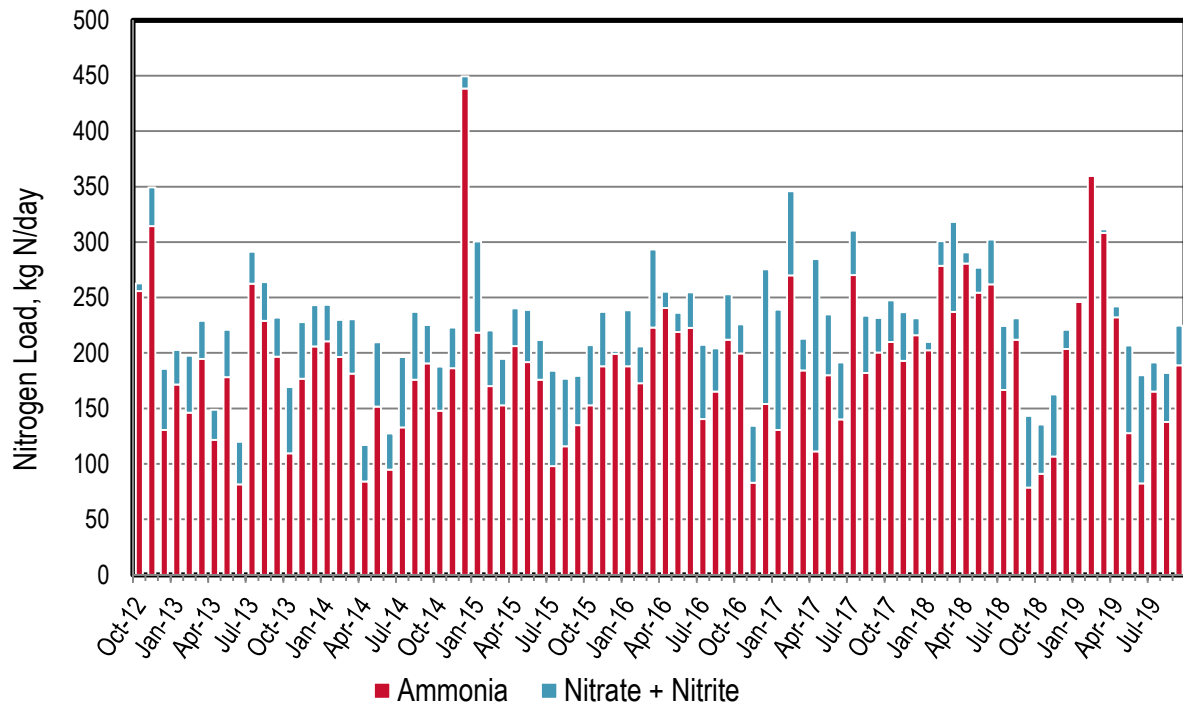


Figure 2-2. Benicia Monthly Nitrogen Loads

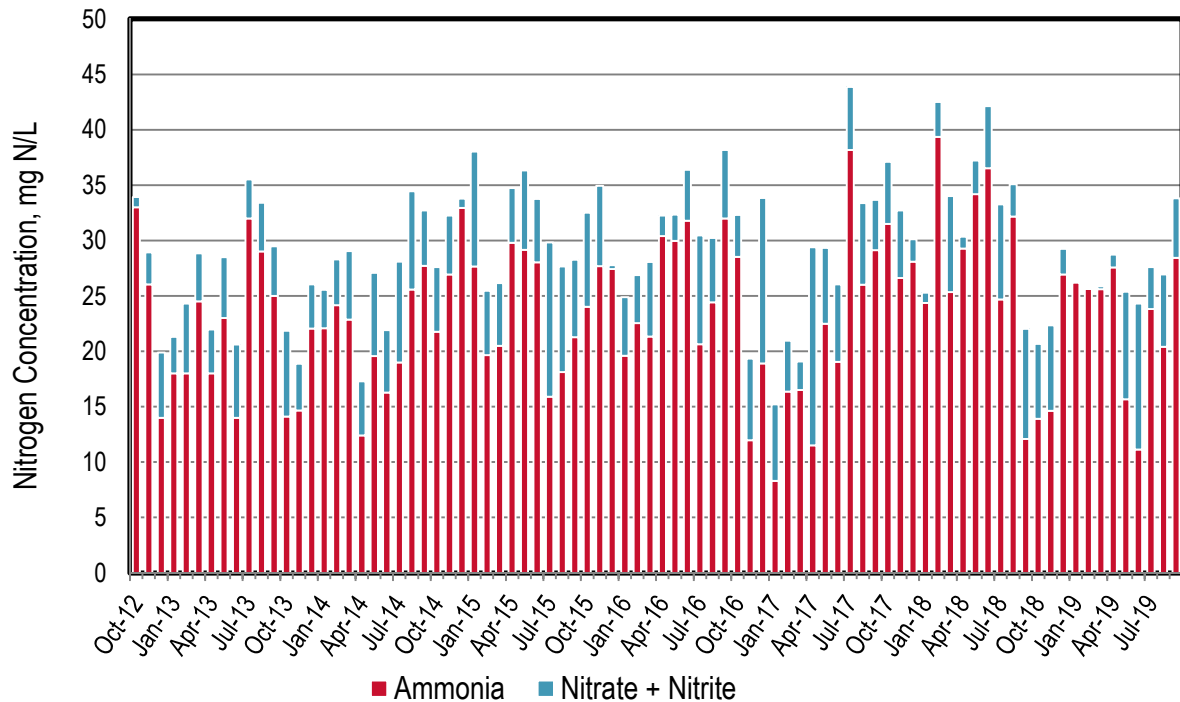


Figure 2-3. Benicia Monthly Nitrogen Concentrations

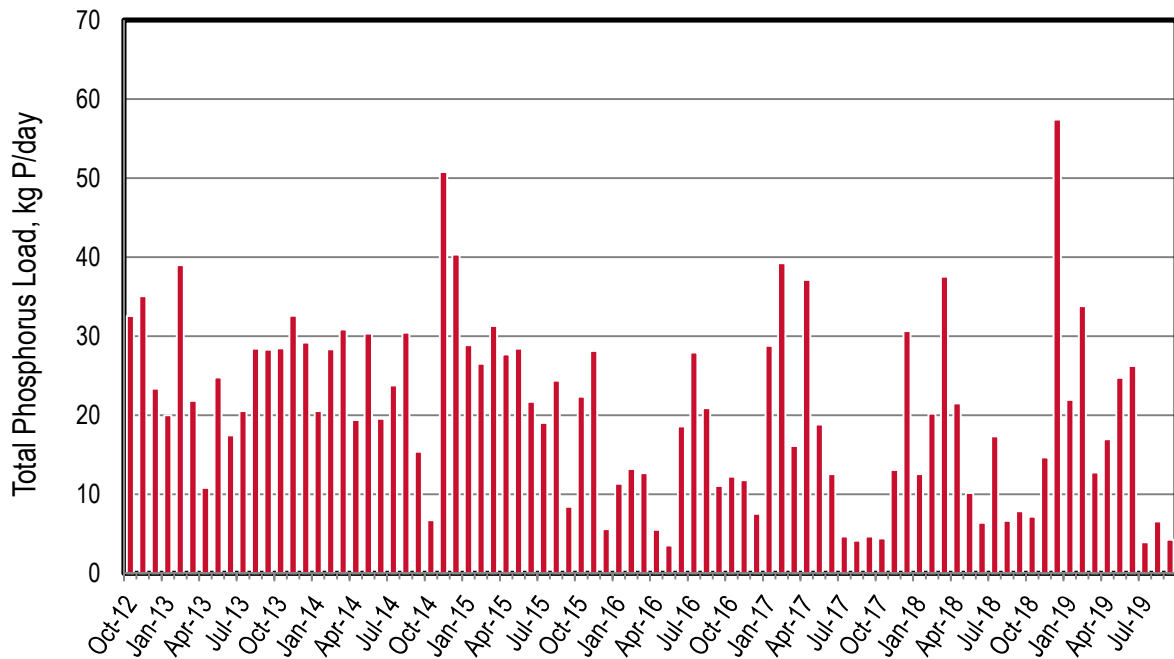


Figure 2-4. Benicia Monthly Phosphorus Loads

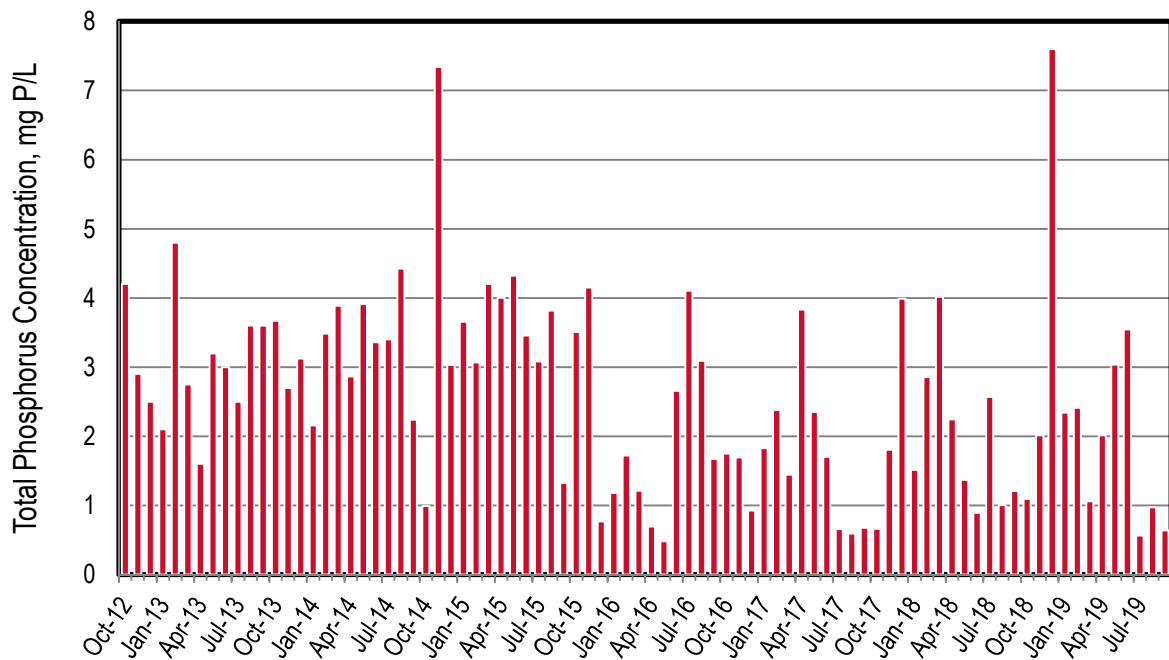


Figure 2-5. Benicia Monthly Phosphorus Concentrations

Table 2-1. Benicia Monthly Flows and Loads*

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-12	2.05	256	7.13	263	32.5
Nov-12	3.20	314	34.9	349	35.1
Dec-12	2.47	131	55.1	186	23.3
Jan-13	2.52	171	31.3	203	20.0
Feb-13	2.15	146	51.2	197	39.0
Mar-13	2.10	195	34.3	229	21.8
Apr-13	1.79	122	26.9	149	10.8
May-13	2.05	178	42.5	221	24.8
Jun-13	1.54	81.5	38.4	120	17.5
Jul-13	2.17	262	28.8	291	20.5
Aug-13	2.09	229	34.8	264	28.4
Sep-13	2.08	197	35.3	232	28.3
Oct-13	1.93	109	59.8	169	28.5
Nov-13	2.35	177	51.0	228	32.6
Dec-13	2.27	206	37.2	243	29.2
Jan-14	2.03	210	32.8	243	20.5
Feb-14	2.47	196	33.4	230	28.3
Mar-14	2.40	181	49.0	230	30.8
Apr-14	1.71	84.0	32.9	117	19.4
May-14	2.11	152	58.2	210	30.3
Jun-14	1.67	94.7	32.8	128	19.6
Jul-14	1.85	133	63.6	197	23.8
Aug-14	1.82	176	61.0	237	30.5
Sep-14	1.82	191	34.5	225	15.4
Oct-14	1.80	148	39.7	188	6.73
Nov-14	1.83	186	36.6	223	50.8
Dec-14	3.52	438	10.9	449	40.3
Jan-15	2.09	218	82.1	300	28.9
Feb-15	2.29	170	50.2	220	26.5
Mar-15	1.97	153	42.0	195	31.3
Apr-15	1.83	206	34.1	240	27.7
May-15	1.74	192	47.0	239	28.4
Jun-15	1.66	176	35.9	212	21.7
Jul-15	1.63	98.1	85.9	184	19.0
Aug-15	1.69	116	60.9	177	24.4
Sep-15	1.68	135	44.4	179	8.41

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-15	1.68	153	54.0	207	22.3
Nov-15	1.79	188	49.1	237	28.2
Dec-15	1.92	199	2.69	202	5.58
Jan-16	2.54	188	50.5	238	11.3
Feb-16	2.03	173	33.3	206	13.2
Mar-16	2.77	223	70.4	293	12.7
Apr-16	2.09	241	14.7	255	5.48
May-16	1.93	219	17.3	236	3.52
Jun-16	1.85	223	32.2	255	18.6
Jul-16	1.80	141	66.8	207	27.9
Aug-16	1.79	165	39.1	204	20.9
Sep-16	1.75	212	41.0	253	11.1
Oct-16	1.85	199	26.4	226	12.2
Nov-16	1.84	83.1	51.3	134	11.8
Dec-16	2.15	154	122	275	7.53
Jan-17	4.16	131	109	239	28.8
Feb-17	4.36	270	76.0	346	39.2
Mar-17	2.95	184	28.8	213	16.1
Apr-17	2.56	111	173	285	37.1
May-17	2.12	180	54.8	235	18.8
Jun-17	1.95	140	51.4	192	12.5
Jul-17	1.87	270	40.1	310	4.64
Aug-17	1.85	182	51.5	234	4.13
Sep-17	1.82	200	31.2	232	4.65
Oct-17	1.76	210	37.3	247	4.40
Nov-17	1.92	193	44.0	237	13.1
Dec-17	2.03	216	15.3	231	30.6
Jan-18	2.20	202	7.55	210	12.5
Feb-18	1.87	279	22.3	301	20.2
Mar-18	2.47	237	81.0	318	37.5
Apr-18	2.53	280	10.3	291	21.5
May-18	1.97	254	22.5	277	10.2
Jun-18	1.90	262	40.4	302	6.41
Jul-18	1.79	167	58.0	224	17.3
Aug-18	1.74	212	19.2	231	6.62
Sep-18	1.72	78.6	64.8	143	7.86
Oct-18	1.73	91.1	44.3	135	7.16

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Nov-18	1.93	107	56.0	163	14.7
Dec-18	2.00	203	17.4	221	57.4
Jan-19	2.48	246	0.615	246	22.0
Feb-19	3.71	360	0.763	360	33.8
Mar-19	3.19	308	3.08	312	12.8
Apr-19	2.23	232	9.83	242	17.0
May-19	2.16	128	79.1	207	24.8
Jun-19	1.96	82.4	97.4	180	26.2
Jul-19	1.84	165	26.2	192	3.93
Aug-19	1.79	138	44.1	182	6.54
Sep-19	1.76	189	35.8	225	4.23
Dry Season Average	1.86	172	46.2	218	16.6
Dry Season Trend	None	None	None	None	Down
Wet Season Average	2.32	198	41.7	239	23.3
Average Annual	2.12	187	43.6	230	20.5

* The City of Benicia has sampled more intensively since September 2015 than required under the Nutrient Watershed Permit. This data represents the average monthly loads during this intensive sampling period.

** The Total Inorganic Nitrogen value is calculated by adding the "Ammonia" and "Nitrate + Nitrite" values.

*** Refer to the Section 3.5 in the main body for a description on the statistical analysis.

3 City of Burlingame

Burlingame discharges to South Bay, and serves approximately 16,000 service connections. The plant has a permitted ADWF capacity of 5.5 mgd and a peak permitted wet weather flow of 16 mgd. It has a current ADWF flow of approximately 2.6 mgd. The plant performs secondary treatment using activated sludge.

The following observations are made based upon the figures and table in the subsequent pages:

- ◆ Based on the table and figures with the average monthly values, there appears to be a dry season downward trend for TP loads, with a stark drop beginning in spring 2014.
- ◆ Both nitrogen and phosphorus loads increase with flow during wet weather events.
- ◆ Wet season loads are greater and more variable year to year than the dry season loads.
- ◆ Ammonia is typically the majority of the nitrogen species discharged, regardless of season. However, from about August 2013 through June 2014, the NO_x load and concentration was significantly higher than in the preceding or subsequent year, indicating the potential occurrence of nitrification.
- ◆ Ammonia concentrations are relatively consistent throughout the year (with the exception of January 2017).
- ◆ Total phosphorus concentrations were typically above 10 mg P/L in the first two reporting years and then dropped to less than 5 mg P/L in the following years. This decrease in concentration is largely attributed to the change in sampling methodology between the Section 13267 Letter data and the Nutrient Watershed Permit dataset.

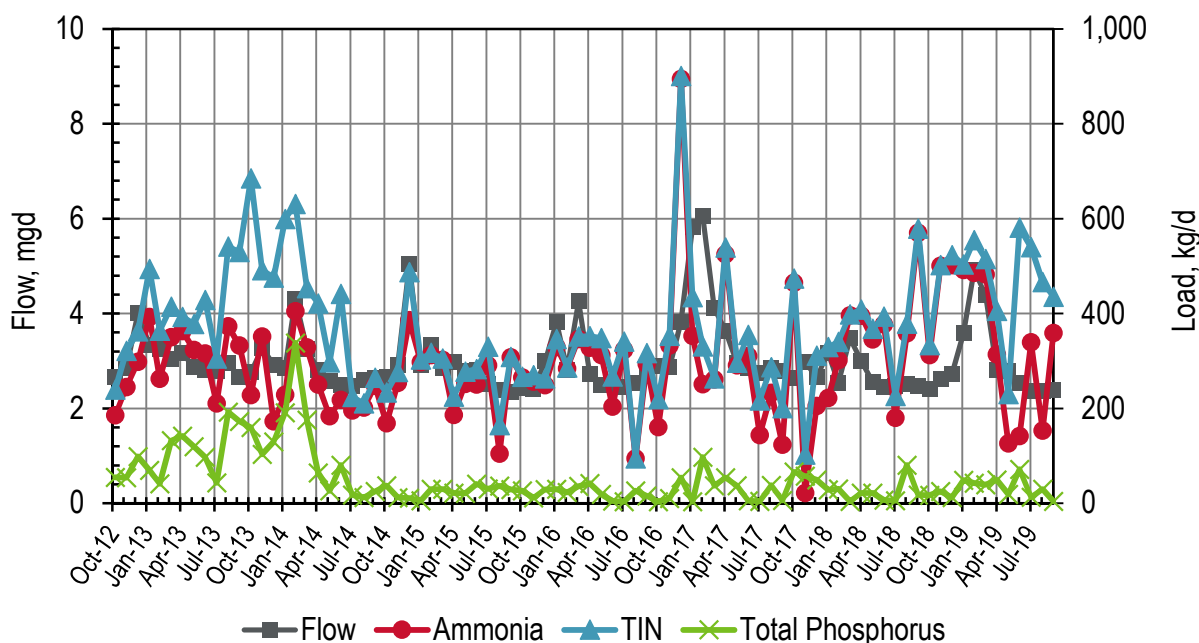


Figure 3-1. Burlingame Monthly Flows and Loads

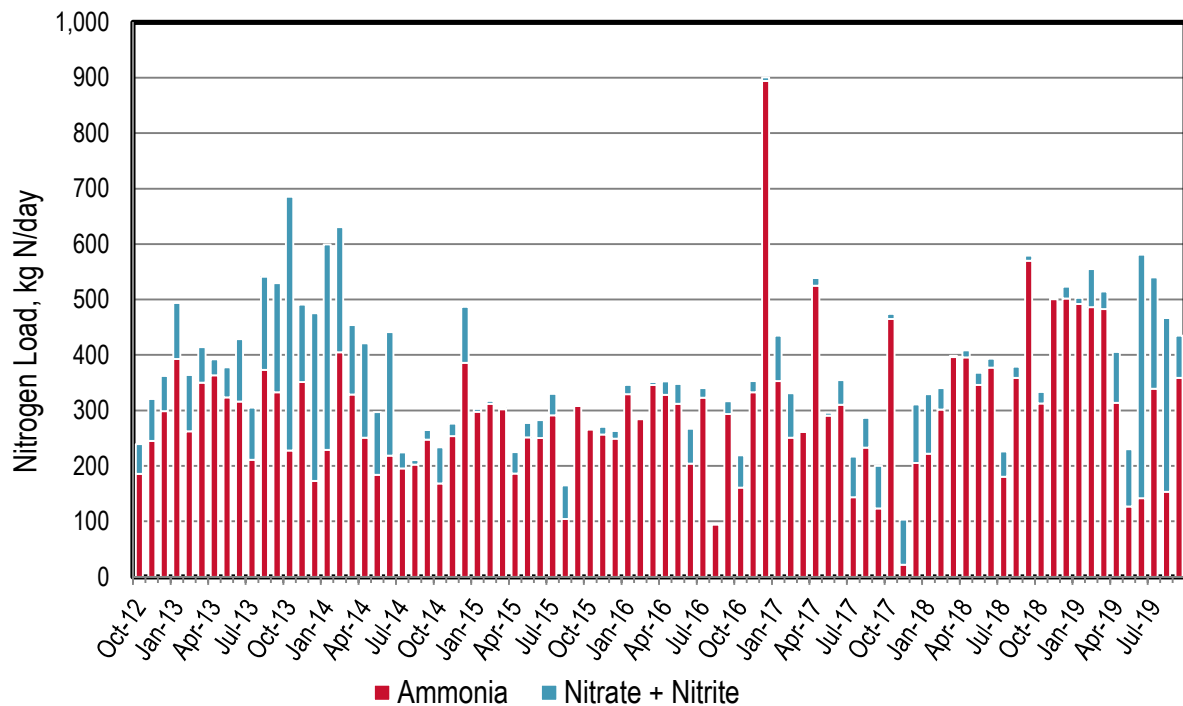


Figure 3-2. Burlingame Monthly Nitrogen Loads

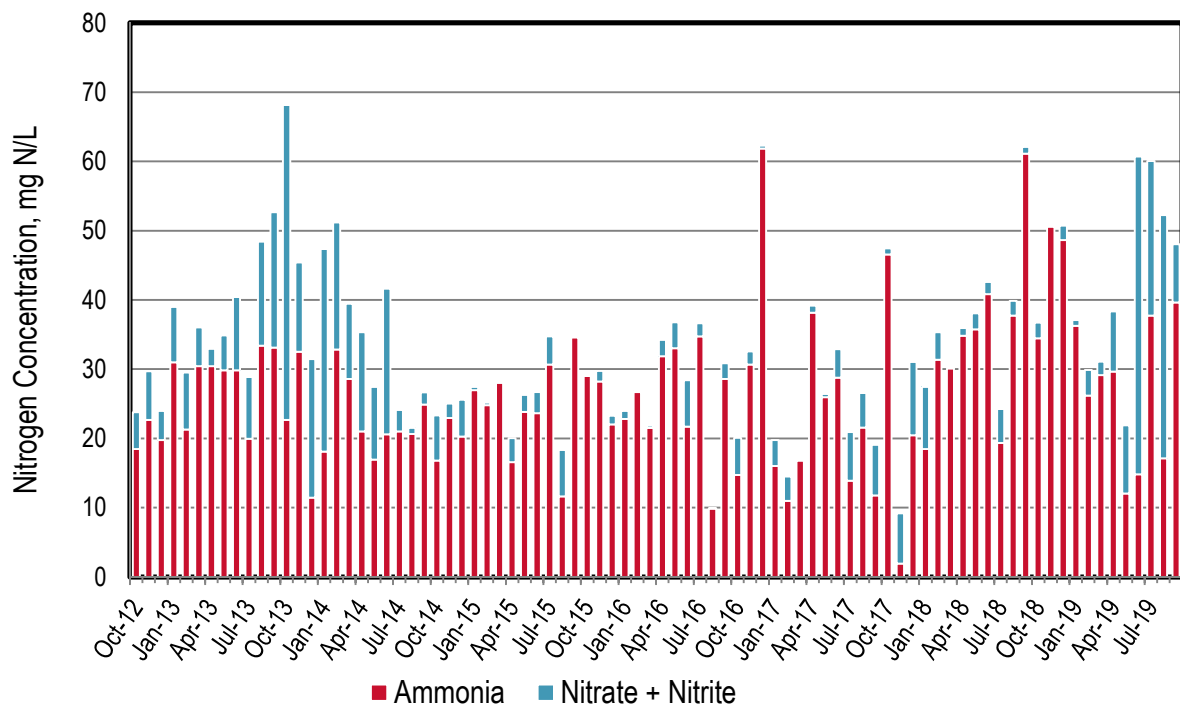


Figure 3-3. Burlingame Monthly Nitrogen Concentrations

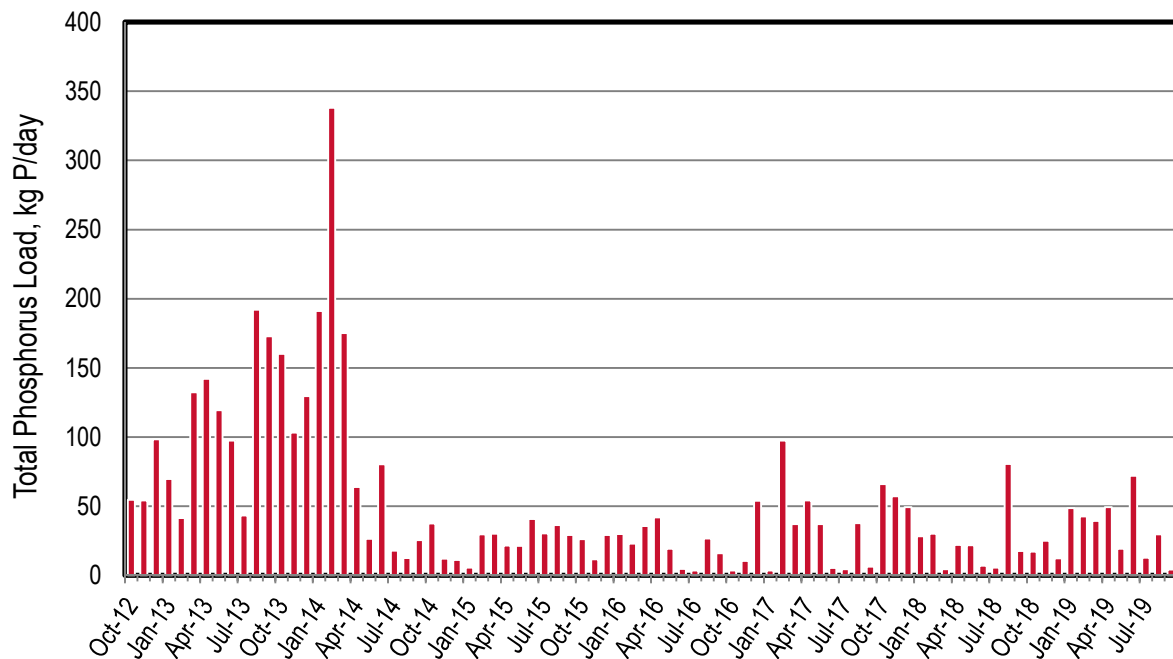


Figure 3-4. Burlingame Monthly Phosphorus Loads

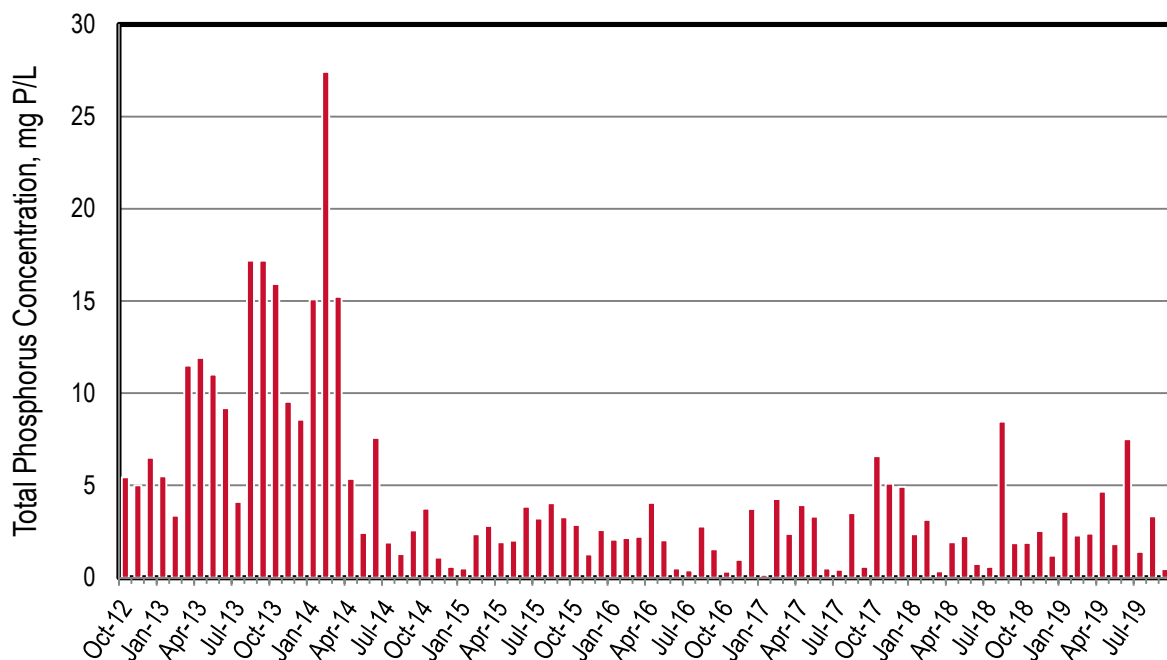


Figure 3-5. Burlingame Monthly Phosphorus Concentrations

Table 3-1. Burlingame Monthly Flows and Loads

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-12	2.66	186	53.5	239	54.7
Nov-12	2.86	245	75.7	321	54.1
Dec-12	4.00	299	63.6	362	98.3
Jan-13	3.35	393	101	494	69.6
Feb-13	3.26	263	101	364	41.4
Mar-13	3.04	350	64.0	414	132
Apr-13	3.16	363	29.3	392	142
May-13	2.87	323	54.7	378	119
Jun-13	2.80	316	112	428	97.5
Jul-13	2.80	211	94.2	305	43.3
Aug-13	2.96	373	168	541	192
Sep-13	2.66	333	197	529	173
Oct-13	2.77	228	457	685	160
Nov-13	3.28	351	139	491	103
Dec-13	2.92	173	303	475	130
Jan-14	2.86	229	370	599	191
Feb-14	4.30	405	226	631	338
Mar-14	3.25	329	125	454	175
Apr-14	2.81	251	171	421	63.9
May-14	2.58	184	114	297	26.3
Jun-14	2.50	218	223	441	80.3
Jul-14	2.46	195	28.9	224	17.7
Aug-14	2.59	202	8.56	211	12.5
Sep-14	2.63	248	17.3	265	25.4
Oct-14	2.65	169	65.0	234	37.4
Nov-14	2.92	254	22.9	276	12.0
Dec-14	5.04	386	101	487	11.0
Jan-15	2.92	298	5.15	303	5.50
Feb-15	3.33	312	4.73	317	29.7
Mar-15	2.85	302	2.69	305	30.1
Apr-15	2.97	186	39.0	225	21.5
May-15	2.79	251	25.8	277	21.2
Jun-15	2.80	250	32.4	283	40.6
Jul-15	2.51	291	38.7	330	30.3
Aug-15	2.38	105	60.2	165	36.3
Sep-15	2.36	308	0.727	309	29.1

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-15	2.42	266	0.683	266	26.2
Nov-15	2.41	257	13.6	270	11.5
Dec-15	2.99	249	14.1	263	29.1
Jan-16	3.82	329	16.7	346	29.7
Feb-16	2.82	284	1.76	286	22.8
Mar-16	4.26	346	5.12	351	35.7
Apr-16	2.72	328	24.2	352	41.7
May-16	2.50	312	35.7	348	19.2
Jun-16	2.49	204	63.2	267	4.60
Jul-16	2.46	323	17.4	340	3.56
Aug-16	2.54	94.6	0.185	94.8	26.5
Sep-16	2.72	294	23.1	317	15.8
Oct-16	2.89	161	58.5	219	3.53
Nov-16	2.87	333	20.1	353	10.4
Dec-16	3.83	894	6.25	901	53.9
Jan-17	5.82	353	82.0	435	3.35
Feb-17	6.05	251	79.7	331	97.4
Mar-17	4.11	261	1.92	263	36.9
Apr-17	3.64	525	14.3	539	54.1
May-17	2.96	291	5.33	296	37.1
Jun-17	2.86	311	44.4	355	5.39
Jul-17	2.74	144	72.8	217	4.33
Aug-17	2.86	233	53.9	287	37.7
Sep-17	2.78	123	76.8	200	6.19
Oct-17	2.64	465	8.83	474	65.9
Nov-17	2.97	21.5	81.5	103	57.2
Dec-17	2.65	205	106	311	49.2
Jan-18	3.18	222	108	330	28.2
Feb-18	2.55	302	38.4	340	30.2
Mar-18	3.48	396	2.27	398	4.41
Apr-18	3.01	396	12.6	408	21.9
May-18	2.56	346	22.2	368	21.7
Jun-18	2.44	377	16.2	393	6.88
Jul-18	2.47	181	45.7	226	5.51
Aug-18	2.51	359	20.3	379	80.4
Sep-18	2.47	570	9.05	579	17.5
Oct-18	2.40	313	20.5	333	17.2

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Nov-18	2.62	501	1.36	502	25.0
Dec-18	2.73	502	21.3	523	12.3
Jan-19	3.59	492	11.0	503	48.5
Feb-19	4.91	486	68.8	555	42.5
Mar-19	4.38	483	32.2	515	39.4
Apr-19	2.80	314	91.9	406	49.3
May-19	2.78	126	103	230	19.1
Jun-19	2.53	142	439	581	71.9
Jul-19	2.38	339	201	540	12.6
Aug-19	2.36	153	313	466	29.7
Sep-19	2.40	359	76.3	435	4.14
Dry Season Average	2.61	260	80.4	340	39.3
Dry Season Trend	None	None	None	None	Down
Wet Season Average	3.30	325	70.7	395	58.1
Average Annual	3.01	297	74.7	372	50.3

* The Total Inorganic Nitrogen value is calculated by adding the "Ammonia" and "Nitrate + Nitrite" values.

** Refer to the Section 3.5 in the main body for a description on the statistical analysis.

4 Central Contra Costa Sanitary District (CCCSD)

CCCSD discharges to Suisun Bay, and serves approximately 115,100 service connections. The plant has a permitted ADWF capacity of 53.8 mgd and a peak wet weather influent design flow of 250 mgd. It has a current ADWF flow of approximately 32 mgd. The plant performs secondary treatment using activated sludge.

The following observations are made based upon the figures and table in the subsequent pages:

- ◆ Based on the table and figures with the average monthly values, there are no trends for flow or nutrients.
- ◆ Ammonia and TIN loads increase with flow during wet weather events.
- ◆ Wet season loads are typically greater than the dry season loads.
- ◆ Ammonia is the majority of the nitrogen species discharged, regardless of season. This would be expected since this plant does not fully nitrify.
- ◆ Ammonia concentrations are greatest during the dry season and it becomes more pronounced towards the end of the dry season.
- ◆ Total phosphorus concentrations are generally less than 2 mg P/L, which is lower than typical effluent concentrations of 4 to 6 mg P/L. This indicates the plant is reliably removing phosphorus.

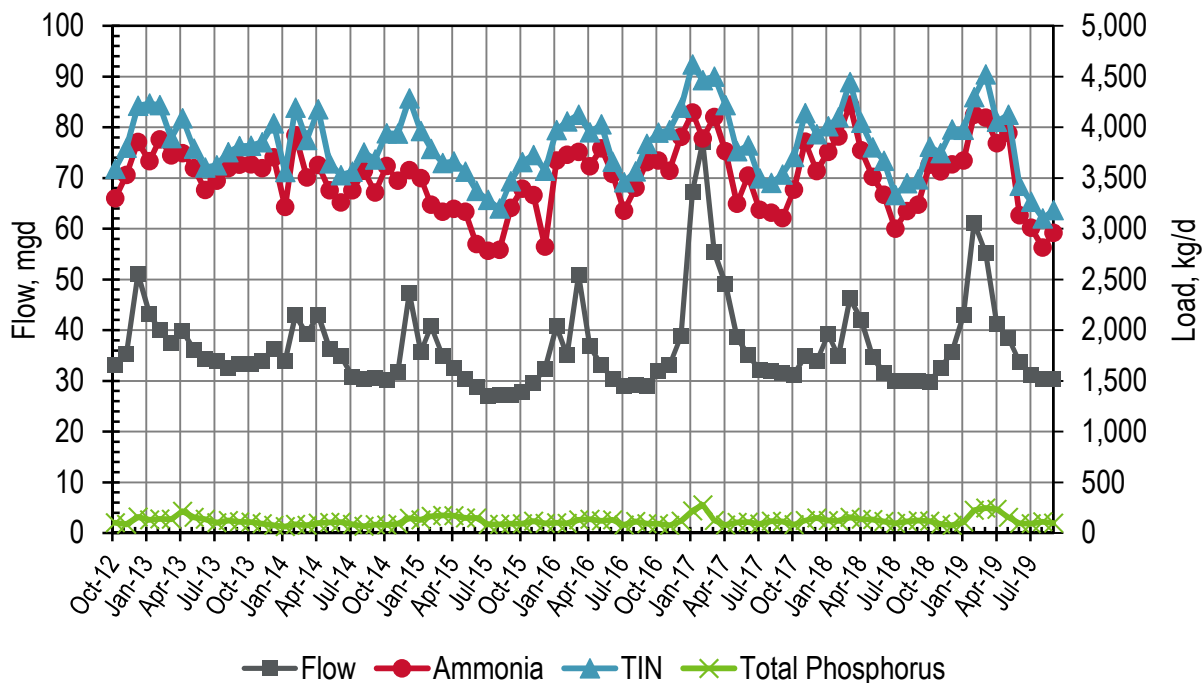


Figure 4-1. CCCSD Monthly Flows and Loads

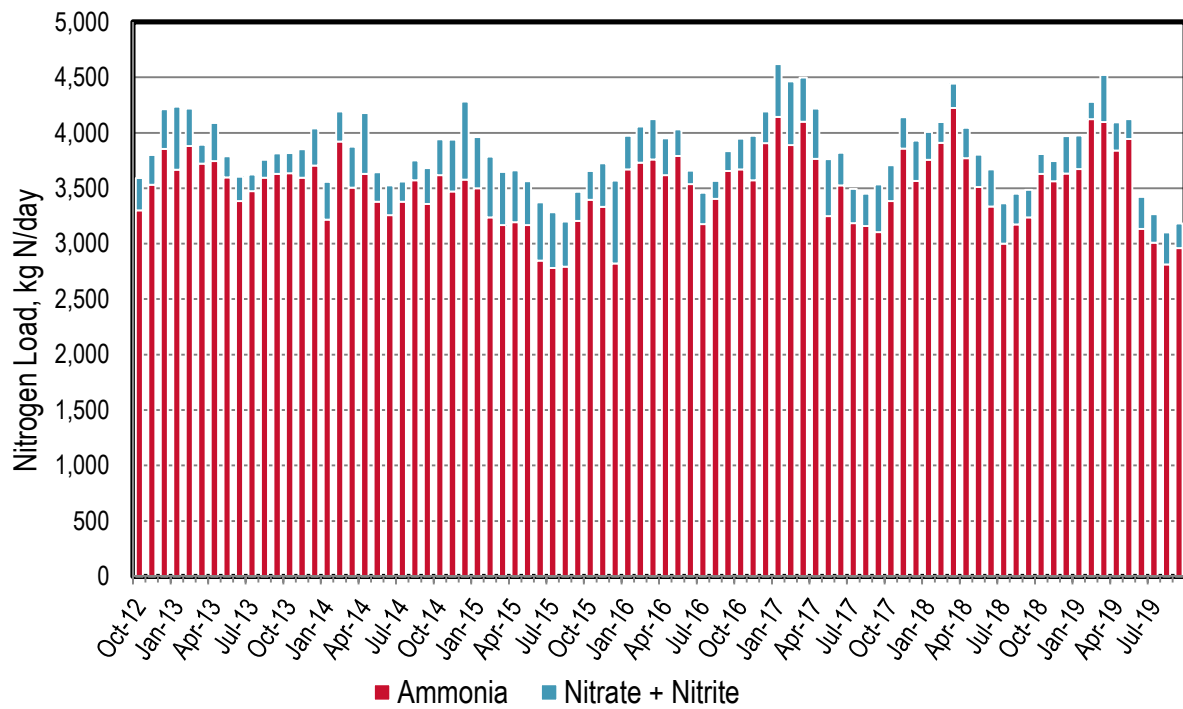


Figure 4-2. CCCSD Monthly Nitrogen Loads

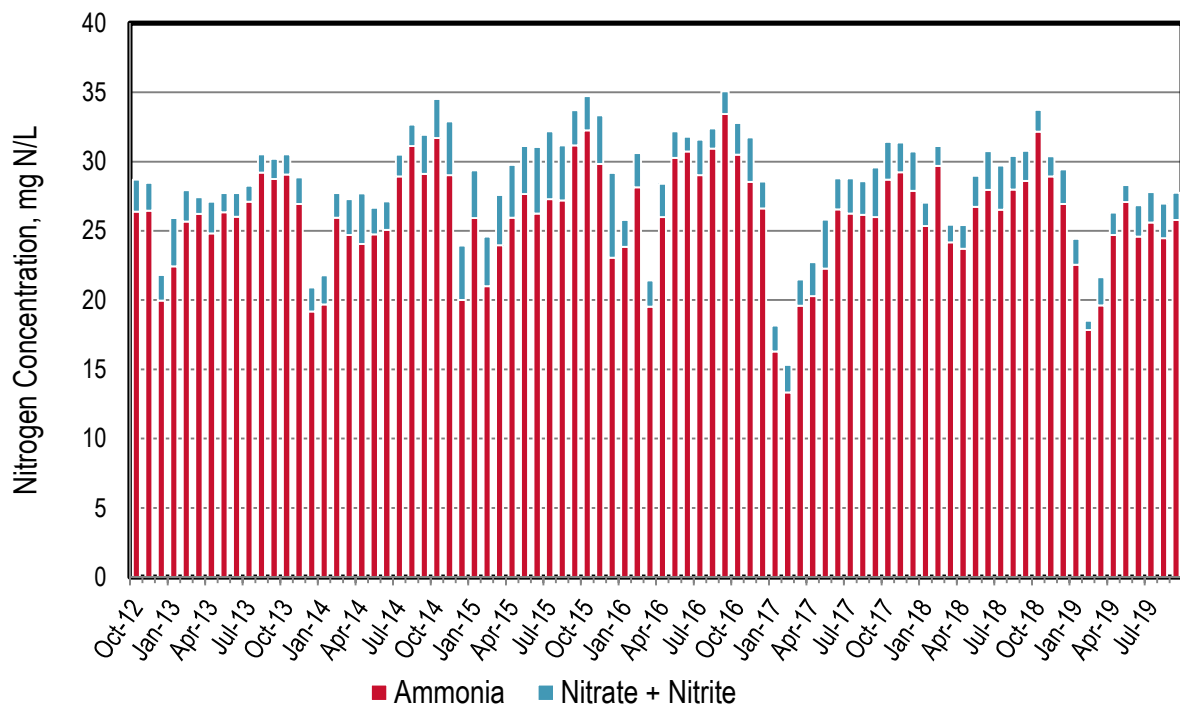


Figure 4-3. CCCSD Monthly Nitrogen Concentrations

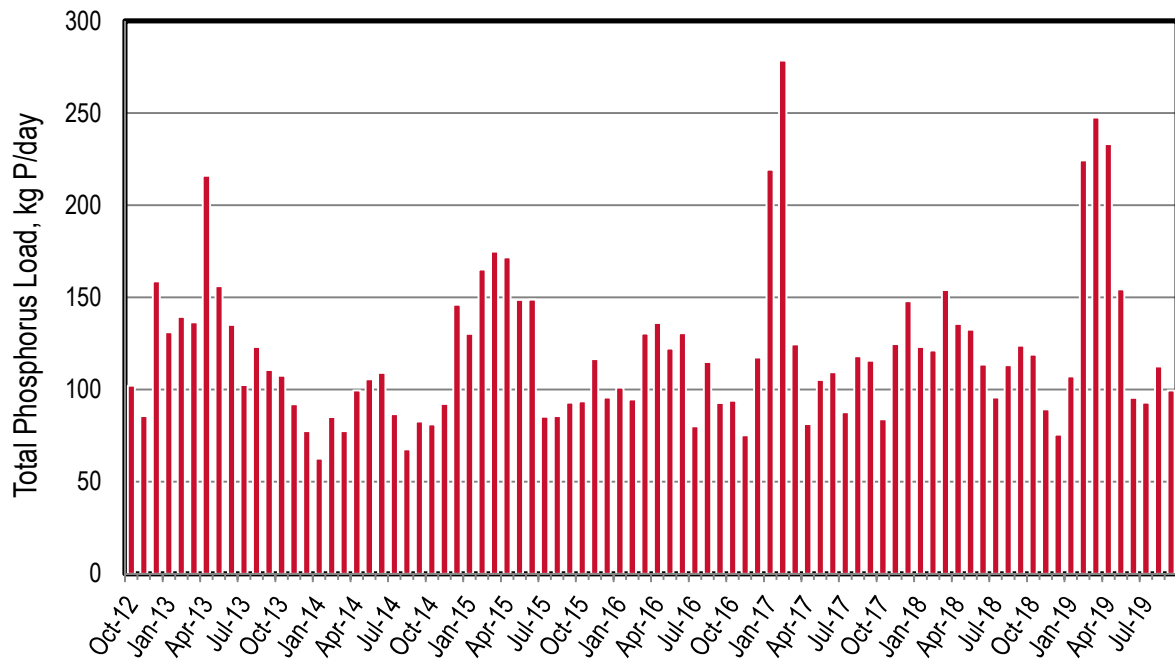


Figure 4-4. CCCSD Monthly Phosphorus Loads

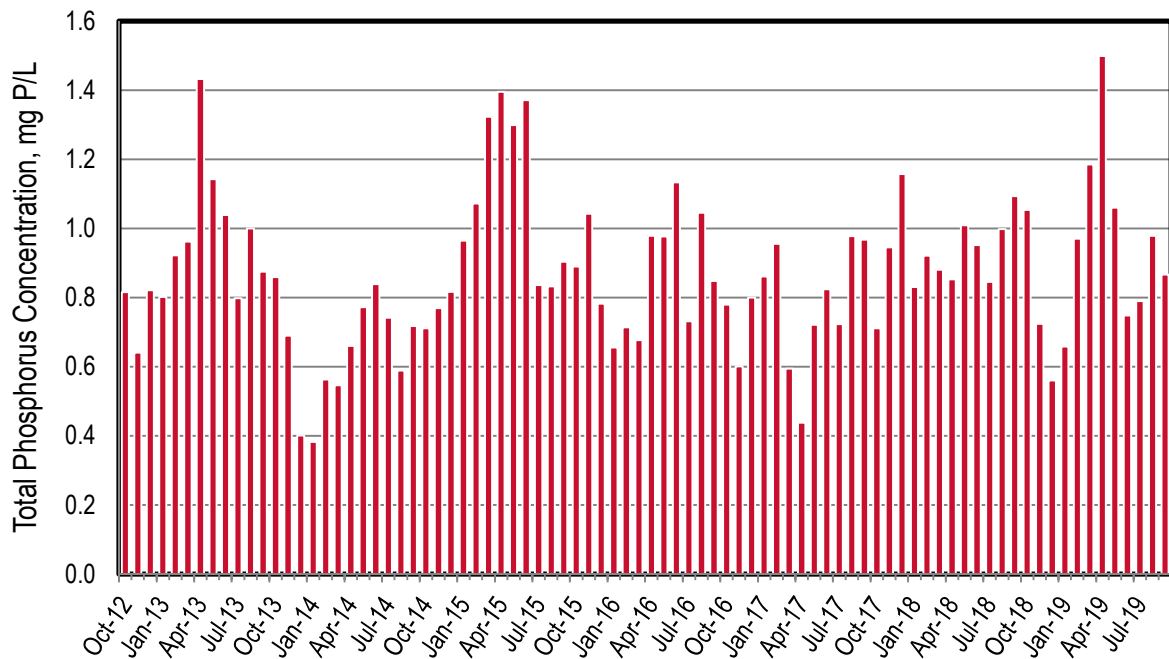


Figure 4-5. CCCSD Monthly Phosphorus Concentrations

Table 4-1. CCCSD Monthly Flows and Loads

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-12	33.1	3,300	290	3,590	102
Nov-12	35.3	3,530	269	3,800	85.5
Dec-12	51.1	3,850	357	4,210	159
Jan-13	43.2	3,670	569	4,240	131
Feb-13	40.0	3,880	340	4,220	139
Mar-13	37.6	3,720	170	3,890	137
Apr-13	39.9	3,740	344	4,090	216
May-13	36.1	3,600	191	3,790	156
Jun-13	34.4	3,380	220	3,600	135
Jul-13	33.9	3,470	149	3,620	102
Aug-13	32.6	3,600	160	3,760	123
Sep-13	33.4	3,630	184	3,810	111
Oct-13	33.3	3,640	182	3,820	108
Nov-13	34.0	3,600	255	3,850	92.0
Dec-13	36.3	3,700	336	4,040	77.5
Jan-14	34.0	3,220	342	3,560	62.5
Feb-14	42.9	3,920	270	4,190	85.0
Mar-14	39.2	3,500	370	3,870	77.5
Apr-14	43.0	3,630	550	4,180	99.5
May-14	36.3	3,380	264	3,640	106
Jun-14	35.0	3,260	268	3,530	109
Jul-14	30.9	3,380	182	3,560	86.5
Aug-14	30.4	3,570	178	3,750	67.6
Sep-14	30.5	3,360	325	3,680	82.7
Oct-14	30.2	3,620	323	3,940	81.1
Nov-14	31.7	3,470	465	3,940	92.1
Dec-14	47.3	3,580	705	4,280	146
Jan-15	35.7	3,500	463	3,960	130
Feb-15	40.7	3,240	550	3,790	165
Mar-15	35.0	3,170	479	3,650	175
Apr-15	32.6	3,200	467	3,660	172
May-15	30.3	3,170	395	3,560	149
Jun-15	28.7	2,850	524	3,370	149
Jul-15	27.0	2,780	501	3,280	85.2
Aug-15	27.2	2,790	406	3,200	85.5
Sep-15	27.2	3,210	260	3,470	92.9

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-15	27.8	3,400	260	3,660	93.6
Nov-15	29.6	3,330	393	3,720	116
Dec-15	32.4	2,820	747	3,570	95.7
Jan-16	40.7	3,670	302	3,970	101
Feb-16	35.1	3,730	327	4,060	94.7
Mar-16	50.9	3,760	365	4,120	130
Apr-16	36.8	3,620	333	3,950	136
May-16	33.1	3,790	239	4,030	122
Jun-16	30.5	3,540	120	3,660	130
Jul-16	29.0	3,180	283	3,460	80.0
Aug-16	29.1	3,410	159	3,560	115
Sep-16	28.9	3,660	178	3,830	92.7
Oct-16	31.8	3,670	277	3,950	93.9
Nov-16	33.1	3,570	402	3,970	75.1
Dec-16	38.8	3,910	284	4,190	117
Jan-17	67.3	4,140	475	4,620	219
Feb-17	77.1	3,890	574	4,460	278
Mar-17	55.4	4,100	397	4,500	124
Apr-17	49.1	3,760	454	4,220	81.2
May-17	38.6	3,250	515	3,760	105
Jun-17	35.1	3,520	296	3,820	109
Jul-17	32.1	3,190	309	3,490	87.7
Aug-17	32.0	3,160	293	3,450	118
Sep-17	31.6	3,110	428	3,530	116
Oct-17	31.2	3,390	323	3,710	83.9
Nov-17	34.9	3,860	282	4,140	125
Dec-17	33.8	3,570	363	3,930	148
Jan-18	39.2	3,760	252	4,010	123
Feb-18	34.8	3,910	188	4,100	121
Mar-18	46.2	4,220	221	4,440	154
Apr-18	42.1	3,770	274	4,050	136
May-18	34.7	3,510	292	3,800	132
Jun-18	31.6	3,340	333	3,670	114
Jul-18	29.9	3,000	362	3,330	95.7
Aug-18	30.0	3,170	277	3,450	113
Sep-18	30.0	3,240	247	3,480	124
Oct-18	29.9	3,630	178	3,810	119

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Nov-18	32.6	3,560	180	3,740	89.2
Dec-18	35.7	3,630	336	3,980	75.5
Jan-19	43.1	3,670	303	3,980	107
Feb-19	61.2	4,120	156	4,300	224
Mar-19	55.2	4,100	425	4,520	247
Apr-19	41.1	3,840	252	4,050	233
May-19	38.5	3,940	177	4,120	154
Jun-19	33.7	3,130	289	3,420	95.4
Jul-19	31.1	3,010	257	3,270	92.8
Aug-19	30.4	2,810	287	3,100	113
Sep-19	30.3	2,960	223	3,180	99.4
Dry Season Average	31.8	3,300	279	3,570	110
Dry Season Trend	None	None	None	None	None
Wet Season Average	40.1	3,650	355	4,010	128
Average Annual	36.6	3,500	324	3,830	121

* The Total Inorganic Nitrogen value is calculated by adding the "Ammonia" and "Nitrate + Nitrite" values.

** Refer to the Section 3.5 in the main body for a description on the statistical analysis.

5 Central Marin Sanitation Agency (CMSA)

CMSA discharges to the Central Bay Subembayment, and serves approximately 105,000 people via 52,200 service connections. The plant has a permitted ADWF capacity of 10.0 mgd. It has a current ADWF flow of approximately 6.2 mgd. The plant performs secondary treatment using a trickling filter and activated sludge process.

The following observations are made based upon the figures and table in the subsequent pages:

- ◆ Both nitrogen and phosphorus loads increase with flow during wet weather events.
- ◆ Based on the table and figures with the average monthly values, there appears to be an upward dry season trend for flow and the nutrient species analyzed, excluding NO_x.
- ◆ Ammonia is the majority of the nitrogen species discharged, regardless of season. This would be expected since the plant was not designed to nitrify (some nitrification does occur in the secondary process, most likely in the biotowers).
- ◆ Ammonia and TIN concentrations increase during the dry weather season as flows decrease and temperatures increase.
- ◆ Total phosphorus concentrations range from less than 1 mg P/L to 6 mg P/L.

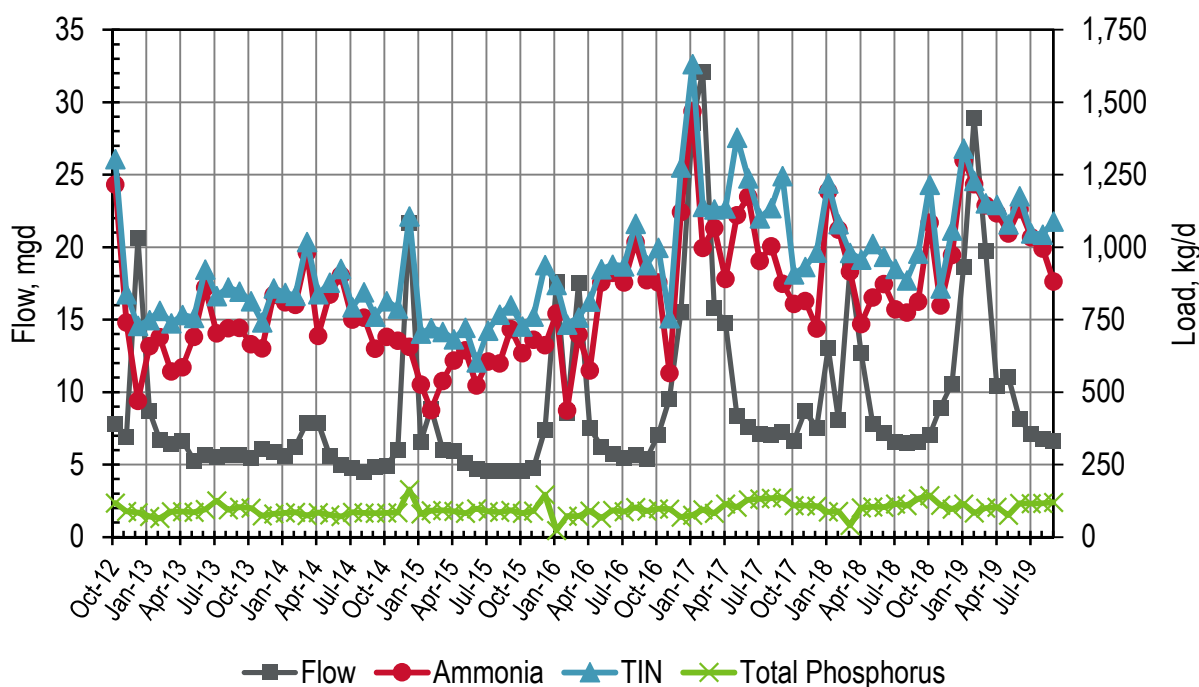


Figure 5-1. CMSA Monthly Flows and Loads

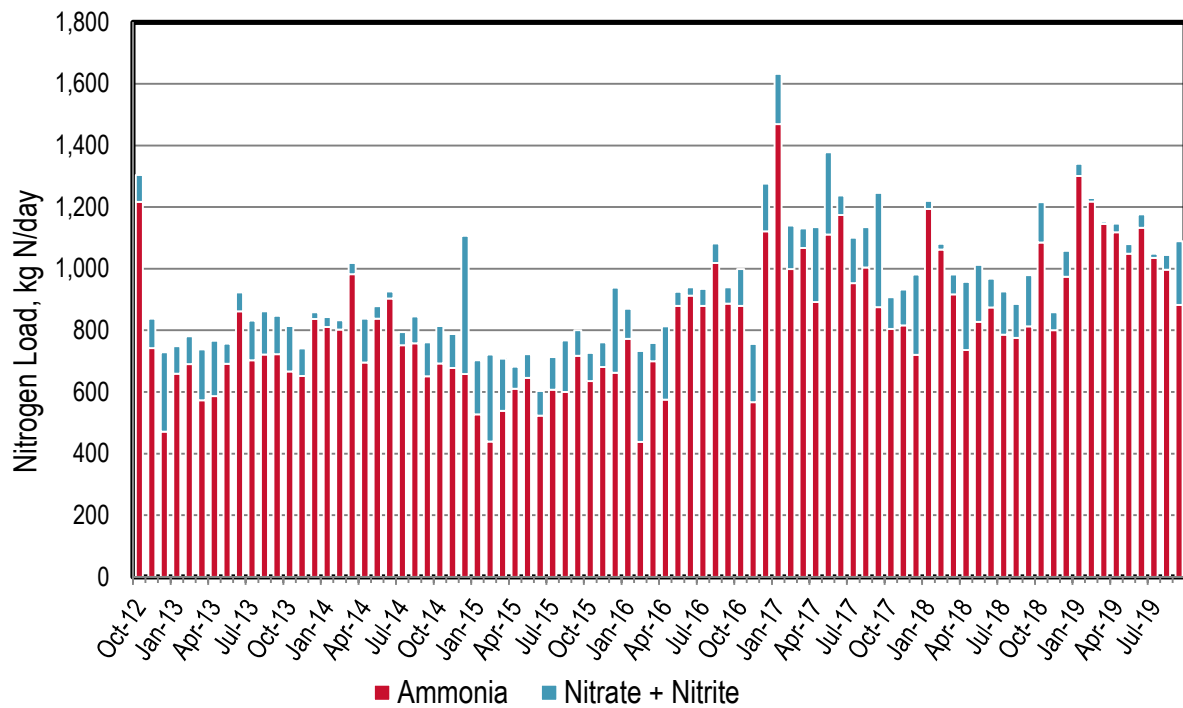


Figure 5-2. CMSA Monthly Nitrogen Loads

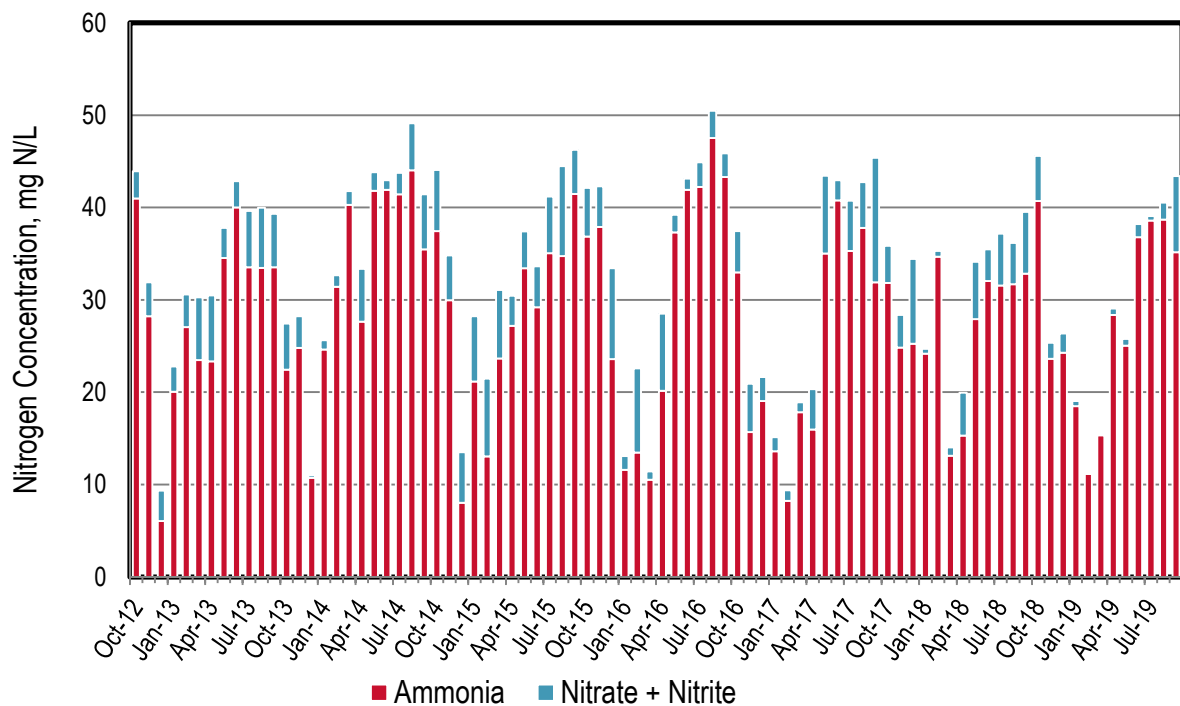


Figure 5-3. CMSA Monthly Nitrogen Concentrations

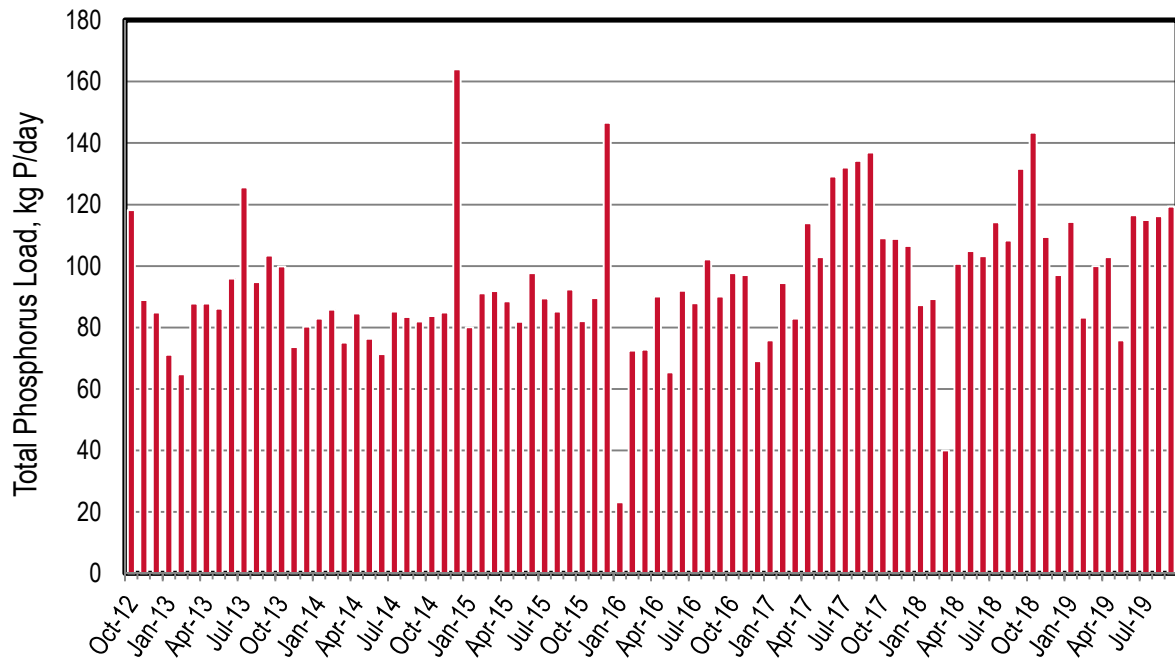


Figure 5-4. CMSA Monthly Phosphorus Loads

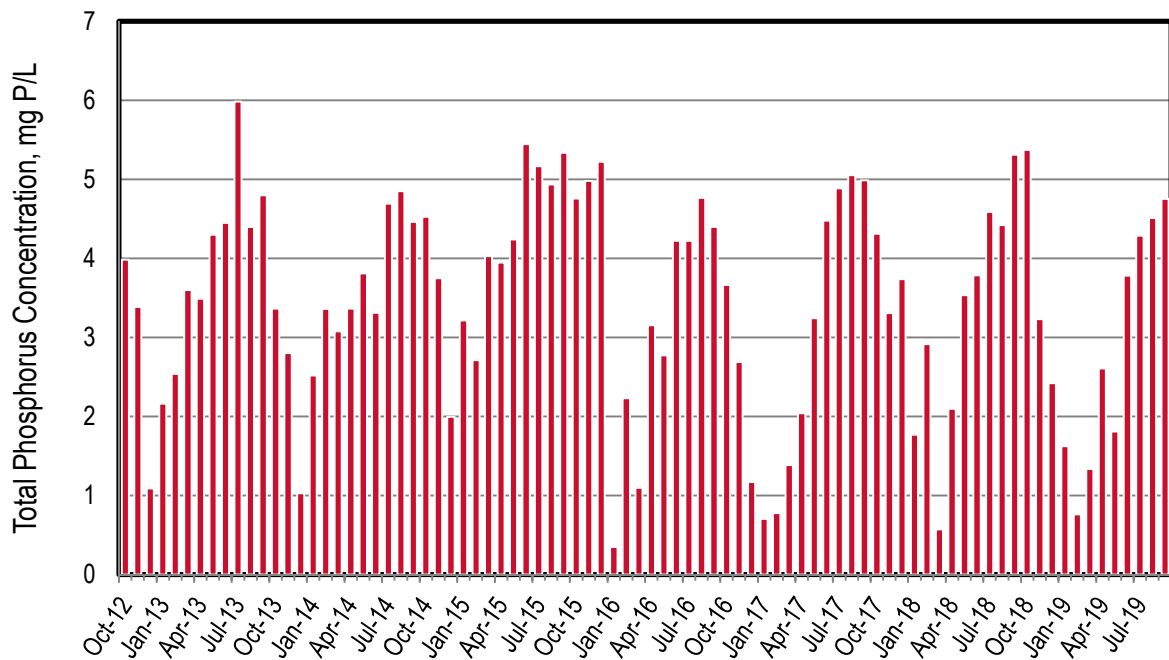


Figure 5-5. CMSA Monthly Phosphorus Concentrations

Table 5-1. CMSA Monthly Flows and Loads

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-12	7.85	1,220	87.5	1,300	118
Nov-12	6.95	742	96.3	838	88.9
Dec-12	20.7	471	258	729	84.9
Jan-13	8.70	660	89.3	749	71.1
Feb-13	6.75	691	90.2	781	64.8
Mar-13	6.45	573	165	738	87.7
Apr-13	6.65	586	180	767	87.8
May-13	5.30	692	65.2	757	86.1
Jun-13	5.70	862	61.6	923	95.9
Jul-13	5.55	703	128	831	126
Aug-13	5.70	721	140	862	94.8
Sep-13	5.70	722	125	847	103
Oct-13	5.50	666	148	814	99.8
Nov-13	6.10	652	89.5	741	73.7
Dec-13	5.90	836	22.4	859	80.3
Jan-14	5.65	810	32.8	843	82.9
Feb-14	6.25	802	31.0	833	85.8
Mar-14	7.90	982	36.5	1,020	75.0
Apr-14	7.90	695	143	838	84.6
May-14	5.61	838	40.6	878	76.3
Jun-14	5.03	903	22.6	926	71.3
Jul-14	4.80	752	41.9	794	85.1
Aug-14	4.55	757	87.6	845	83.4
Sep-14	4.86	651	110	761	82.0
Oct-14	4.89	692	122	814	83.7
Nov-14	5.99	678	110	788	84.9
Dec-14	21.7	658	449	1,110	164
Jan-15	6.59	527	176	703	80.1
Feb-15	8.89	439	283	721	91.2
Mar-15	6.03	539	169	708	91.9
Apr-15	5.93	610	72.4	682	88.5
May-15	5.11	645	77.0	722	81.9
Jun-15	4.74	524	79.5	603	97.6
Jul-15	4.58	607	106	713	89.5
Aug-15	4.57	600	168	768	85.2
Sep-15	4.58	718	82.6	800	92.4

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-15	4.56	636	91.4	727	82.1
Nov-15	4.76	681	79.6	761	89.6
Dec-15	7.43	663	277	939	147
Jan-16	17.6	772	98.1	870	23.1
Feb-16	8.59	438	296	733	72.4
Mar-16	17.6	700	58.8	758	72.8
Apr-16	7.55	575	238	813	90.1
May-16	6.24	880	45.1	925	65.4
Jun-16	5.76	913	26.8	940	92.0
Jul-16	5.51	879	55.7	935	87.9
Aug-16	5.67	1,020	63.8	1,080	102
Sep-16	5.42	887	52.5	939	90.0
Oct-16	7.05	880	120	999	97.7
Nov-16	9.56	567	189	756	97.1
Dec-16	15.6	1,120	154	1,280	69.0
Jan-17	28.6	1,470	163	1,630	75.8
Feb-17	32.1	999	141	1,140	94.4
Mar-17	15.8	1,070	63.7	1,130	82.8
Apr-17	14.8	892	243	1,130	114
May-17	8.39	1,110	267	1,380	103
Jun-17	7.62	1,170	63.5	1,240	129
Jul-17	7.15	953	147	1,100	132
Aug-17	7.03	1,000	132	1,140	134
Sep-17	7.26	875	371	1,250	137
Oct-17	6.69	805	102	907	109
Nov-17	8.69	816	117	932	109
Dec-17	7.54	720	261	982	107
Jan-18	13.1	1,190	25.5	1,220	87.3
Feb-18	8.10	1,060	18.6	1,080	89.2
Mar-18	18.5	916	64.3	981	39.9
Apr-18	12.7	736	222	957	101
May-18	7.84	828	184	1,010	105
Jun-18	7.21	874	93.3	967	103
Jul-18	6.59	786	139	926	114
Aug-18	6.48	776	110	886	108
Sep-18	6.55	813	166	979	132
Oct-18	7.06	1,090	131	1,220	143

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Nov-18	8.96	800	58.5	859	109
Dec-18	10.6	974	83.3	1,060	97.1
Jan-19	18.6	1,300	39.5	1,340	114
Feb-19	28.9	1,220	11.3	1,230	83.1
Mar-19	19.8	1,150	7.27	1,150	100.0
Apr-19	10.4	1,120	28.4	1,150	103
May-19	11.1	1,050	31.0	1,080	75.8
Jun-19	8.14	1,130	43.4	1,180	116
Jul-19	7.10	1,030	13.4	1,050	115
Aug-19	6.82	997	47.5	1,040	116
Sep-19	6.64	882	207	1,090	119
Dry Season Average	6.20	845	103	947	101
Dry Season Trend	Up	Up	None	Up	Up
Wet Season Average	11.0	814	127	941	91.2
Average Annual	9.02	827	117	944	95.2

* The Total Inorganic Nitrogen value is calculated by adding the "Ammonia" and "Nitrate + Nitrite" values.

** Refer to the Section 3.5 in the main body for a description on the statistical analysis.

6 Crockett Community Services District - Port Costa

The Crockett Community Services District serves two distinct separate communities, the town of Crockett and the town of Port Costa, each with their own treatment plant facilities. The Crockett Sanitary Department is excluded from the requirements of the Nutrient NPDES Order No. R2-2014-0014 as it shares use of an industrial wastewater treatment plant with C&H Sugar which has submitted its own sampling plan. The town of Port Costa has its own municipal wastewater treatment plant which is covered under the Nutrient NPDES Order. This analysis focuses on Port Costa.

The Community of Port Costa uses the Port Costa Wastewater Treatment Plant to discharge to the Carquinez Strait, which is connected to San Pablo Bay. The service area population is approximately 250 people. The plant has a permitted ADWF capacity of 0.033 mgd. It has a current ADWF flow of approximately 0.012 mgd. The plant performs secondary treatment using a septic tank for solids separation, followed by filtration and disinfection.

Port Costa was exempt from the Section 13267 Letter sampling requirements due to their permitted capacity flow (<1 mgd). The following observations are made based upon the available data presented in figures and table in the subsequent pages:

- ◆ The dataset is limited to flow, ammonia a few times per year, and most recently a few TIN and TP samples. Based on the average monthly values in the table and figures below, there appears to be an emerging upward dry season trend for flow. There is insufficient dry season nutrient data to perform trend analysis.
- ◆ Ammonia loads typically increase with flow during wet weather events. There is insufficient TIN and TP data to comment on trends.

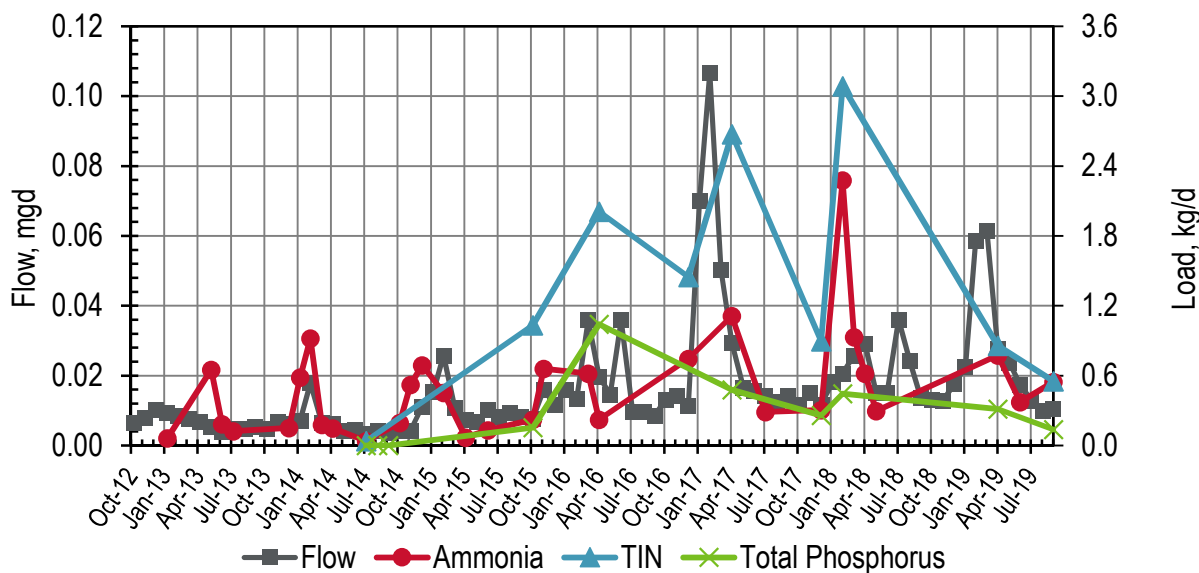


Figure 6-1. Port Costa Monthly Flows and Loads

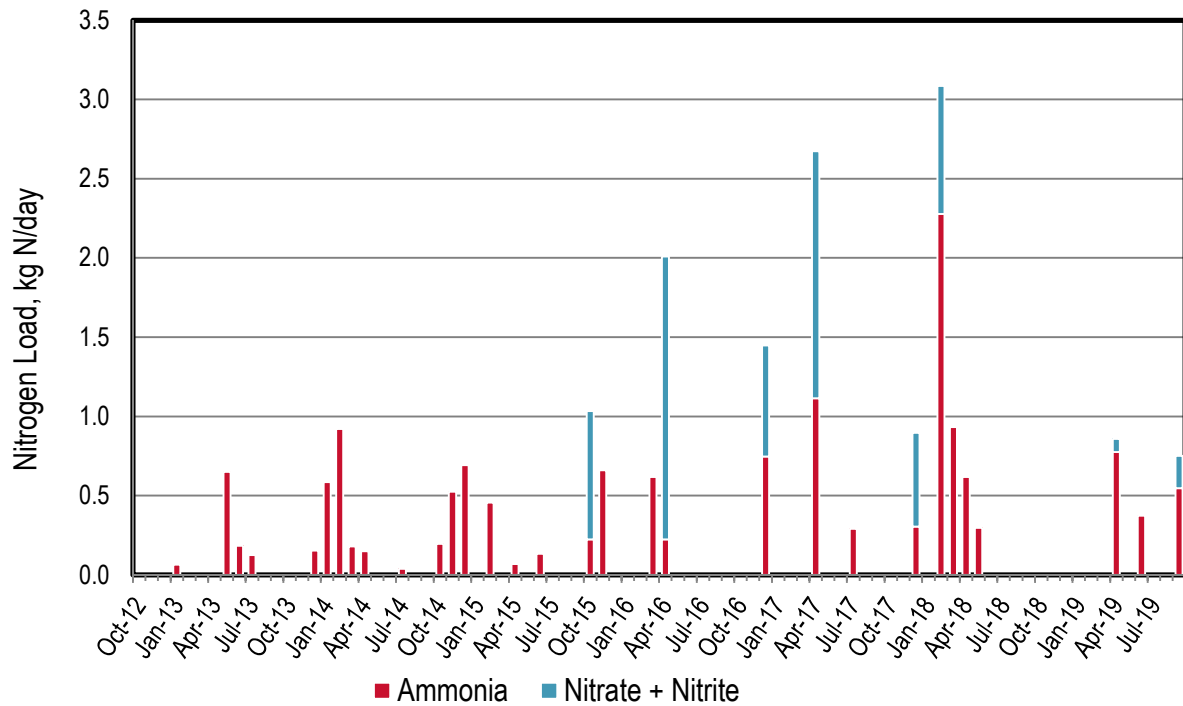


Figure 6-2. Port Costa Monthly Ammonia Loads

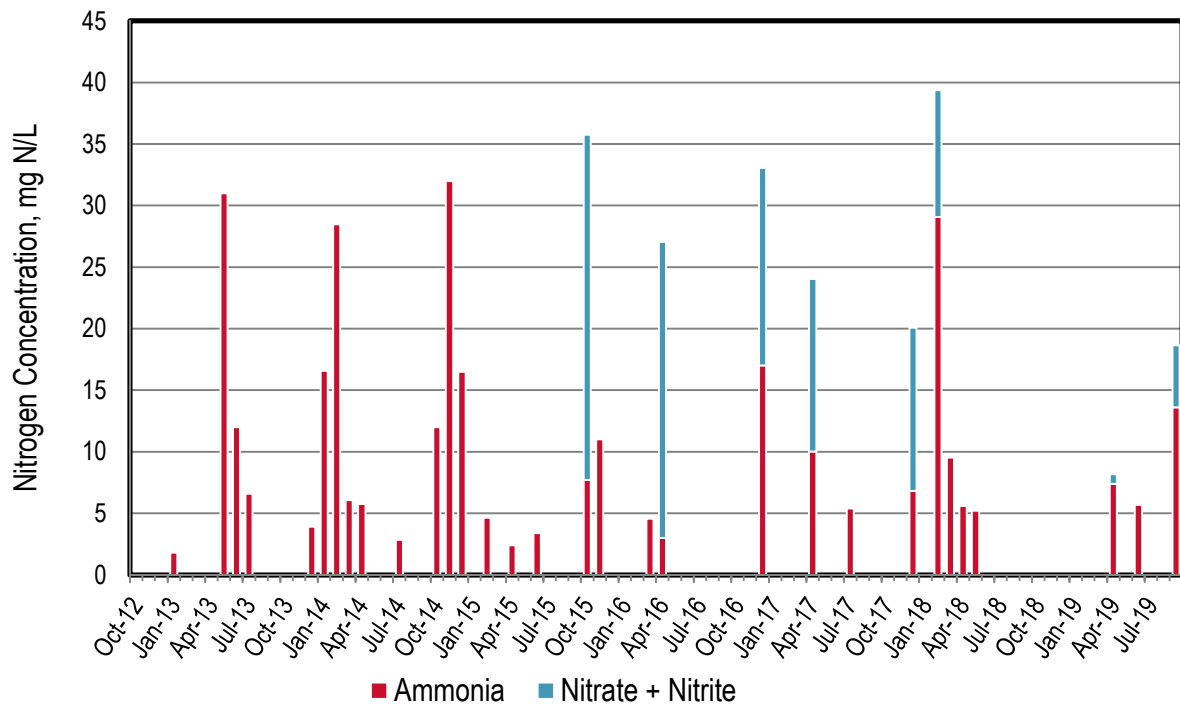


Figure 6-3. Port Costa Monthly Ammonia Concentrations

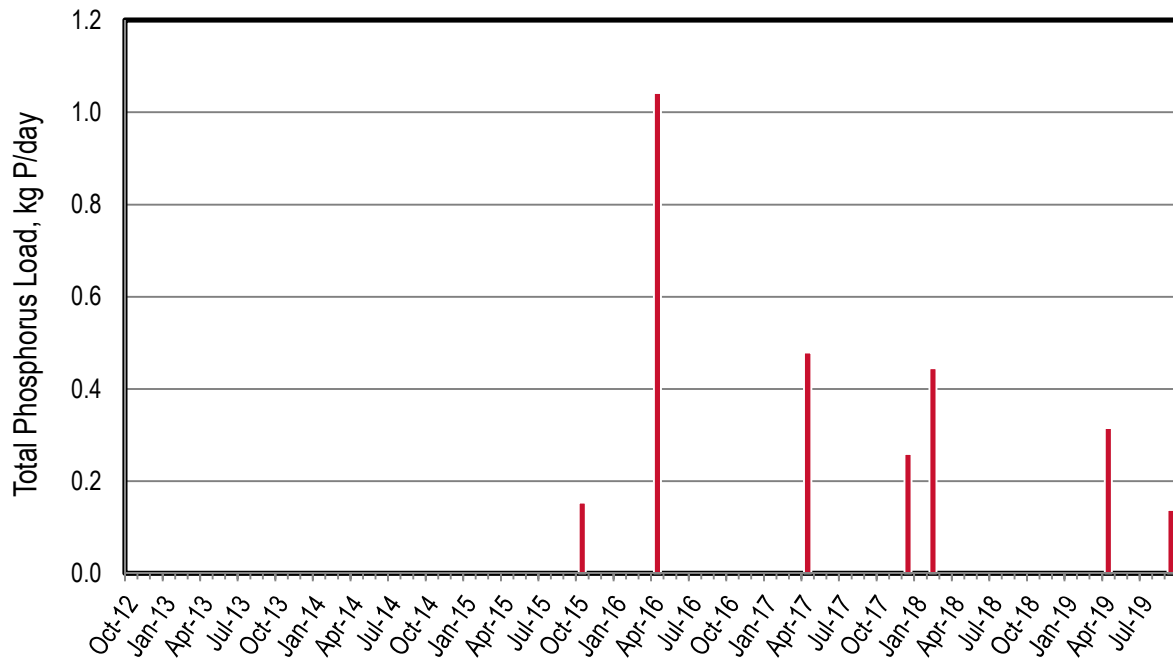


Figure 6-4. Port Costa Monthly Phosphorus Loads

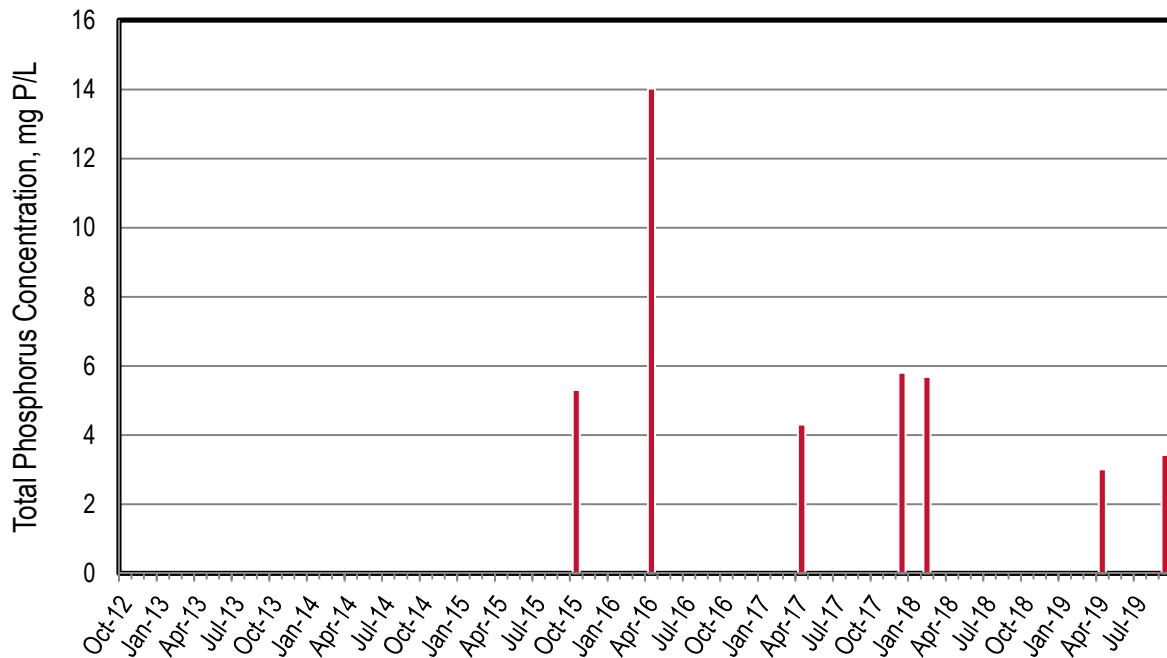


Figure 6-5. Port Costa Monthly Phosphorus Concentrations

Table 6-1. Port Costa Monthly Flows and Loads

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-12	0.00640				
Nov-12	0.00795				
Dec-12	0.0103				
Jan-13	0.00934	0.0636			
Feb-13	0.00855				
Mar-13	0.00780				
Apr-13	0.00680				
May-13	0.00555	0.650			
Jun-13	0.00405	0.184			
Jul-13	0.00497	0.124			
Aug-13	0.00483				
Sep-13	0.00538				
Oct-13	0.00473				
Nov-13	0.00688				
Dec-13	0.00631	0.153			
Jan-14	0.00720	0.585			
Feb-14	0.0179	0.920			
Mar-14	0.00644	0.179			
Apr-14	0.00622	0.148			
May-14	0.00409				
Jun-14	0.00456				
Jul-14	0.00354	0.0381		0.0381	
Aug-14	0.00419				
Sep-14	0.00361				
Oct-14	0.00430	0.195			
Nov-14	0.00433	0.524			
Dec-14	0.0111	0.691			
Jan-15	0.0153				
Feb-15	0.0259	0.455			
Mar-15	0.0108				
Apr-15	0.00747	0.0678			
May-15	0.00695				
Jun-15	0.0103	0.133			
Jul-15	0.00829				
Aug-15	0.00941				
Sep-15	0.00838				

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-15	0.00765	0.223	0.810	1.03	0.153
Nov-15	0.0159	0.660			
Dec-15	0.0118				
Jan-16	0.0159				
Feb-16	0.0133				
Mar-16	0.0359	0.618			
Apr-16	0.0197	0.223	1.79	2.01	1.04
May-16	0.0147				
Jun-16	0.0359				
Jul-16	0.00966				
Aug-16	0.00964				
Sep-16	0.00859				
Oct-16	0.0132				
Nov-16	0.0142				
Dec-16	0.0116	0.746	0.702	1.45	
Jan-17	0.0702				
Feb-17	0.107				
Mar-17	0.0503				
Apr-17	0.0294	1.11	1.56	2.67	0.479
May-17	0.0166				
Jun-17	0.0156				
Jul-17	0.0142	0.290			
Aug-17	0.0127				
Sep-17	0.0143				
Oct-17	0.0117				
Nov-17	0.0151				
Dec-17	0.0118	0.304	0.591	0.896	0.259
Jan-18	0.0182				
Feb-18	0.0207	2.28	0.808	3.09	0.445
Mar-18	0.0258	0.932			
Apr-18	0.0292	0.618			
May-18	0.0151	0.296			
Jun-18	0.0150				
Jul-18	0.0361				
Aug-18	0.0242				
Sep-18	0.0138				
Oct-18	0.0131				

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Nov-18	0.0127				
Dec-18	0.0176				
Jan-19	0.0224				
Feb-19	0.0587				
Mar-19	0.0614				
Apr-19	0.0277	0.775	0.0824	0.858	0.315
May-19	0.0237				
Jun-19	0.0174	0.374			
Jul-19	0.0128				
Aug-19	0.0100				
Sep-19	0.0106	0.547	0.203	0.552	0.138
Dry Season Average	0.0120	0.293	0.0507	0.295	0.0344
Dry Season Trend**	Up	None	--	--	--
Wet Season Average	0.0195	0.567	0.906	1.71	0.449
Average Annual	0.0163	0.487	0.595	1.40	0.283

* The Total Inorganic Nitrogen value is calculated by adding the "Ammonia" and "Nitrate + Nitrite" values.

** Refer to the Section 3.5 in the main body for a description on the statistical analysis. There is insufficient data for a trending analysis for nutrients other than Ammonia.

7 Delta Diablo

Delta Diablo discharges to New York Slough (part of the Suisun Bay) and serves approximately 57,700 service connections throughout Antioch, Pittsburg and Bay Point. The plant has a permitted ADWF capacity of 19.5 mgd. It has a current ADWF discharge of approximately 7 mgd. The plant performs secondary treatment using trickling filters, followed by activated sludge. Secondary effluent (up to 12.8 mgd) is diverted upstream of the disinfection process and sent for tertiary treatment prior to distribution to recycled water users. Approximately 90% of the recycled water is sent to two power plants for use in their cooling towers. The blowdown from the cooling towers is returned to the secondary treatment plant, blended with secondary effluent, and disinfected prior to discharge.

The following observations are made based upon the figures and table in the subsequent pages:

- ◆ The variability of the distribution of the nitrogen species in the effluent is due to the power plant cooling towers going in and out of nitrification and possible denitrification occurring sporadically. Since the summer of 2016, the predominant form of nitrogen has been the ammonia species due to the cessation of nitrification in the power plant cooling towers.
- ◆ Both nitrogen and phosphorus loads typically increase with flow during wet weather events.
- ◆ TN concentrations are variable, ranging from 30 to 82 mg N/L.
- ◆ TP concentrations are generally less than 2 mg P/L, which is lower than typical effluent concentrations of 4 to 6 mg P/L. This indicates the plant is removing phosphorus.

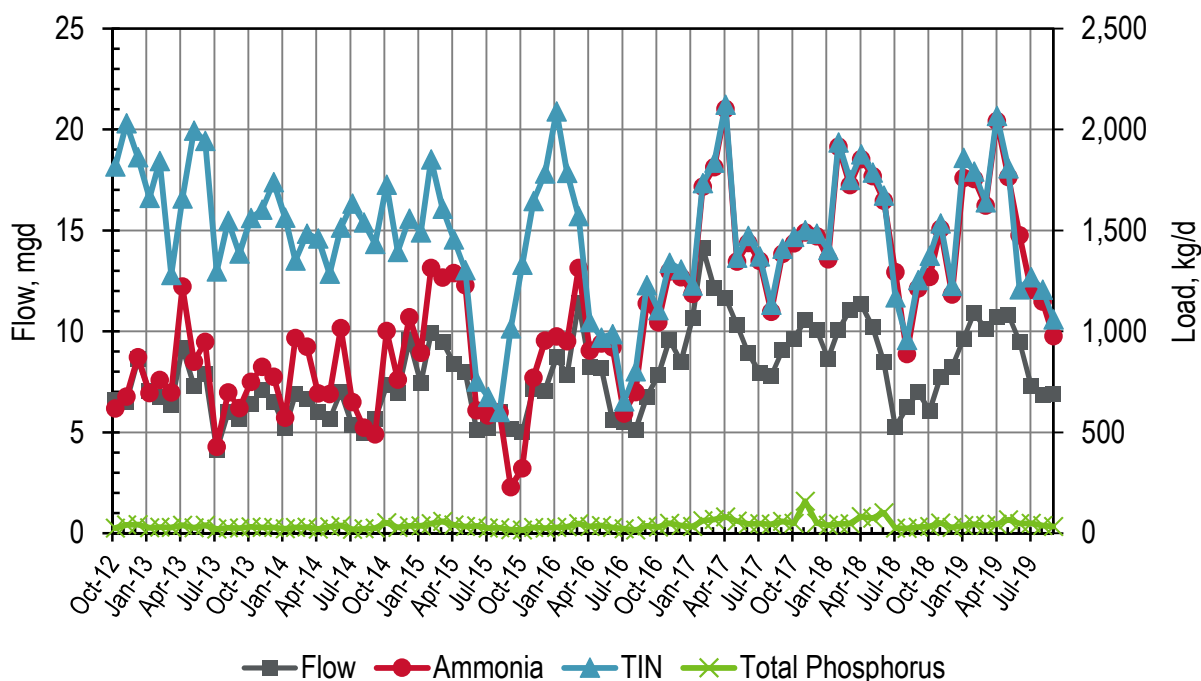


Figure 7-1. Delta Diablo Monthly Flows and Loads

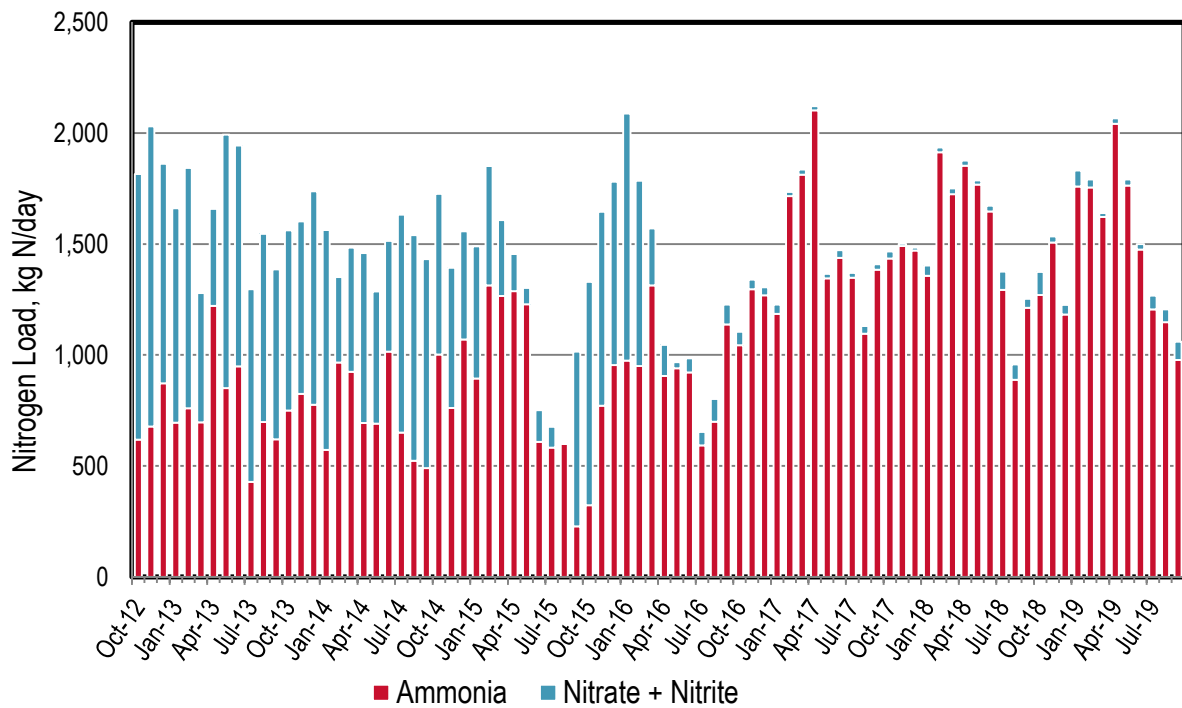


Figure 7-2. Delta Diablo Monthly Nitrogen Loads

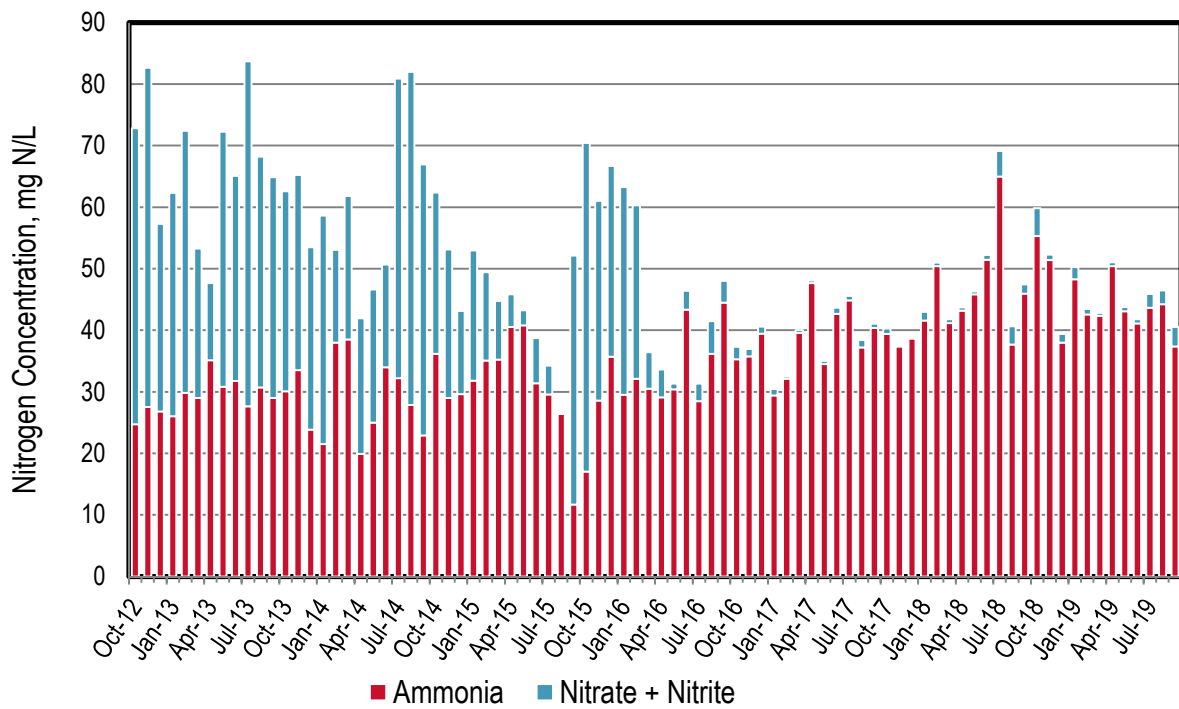


Figure 7-3. Delta Diablo Monthly Nitrogen Concentrations

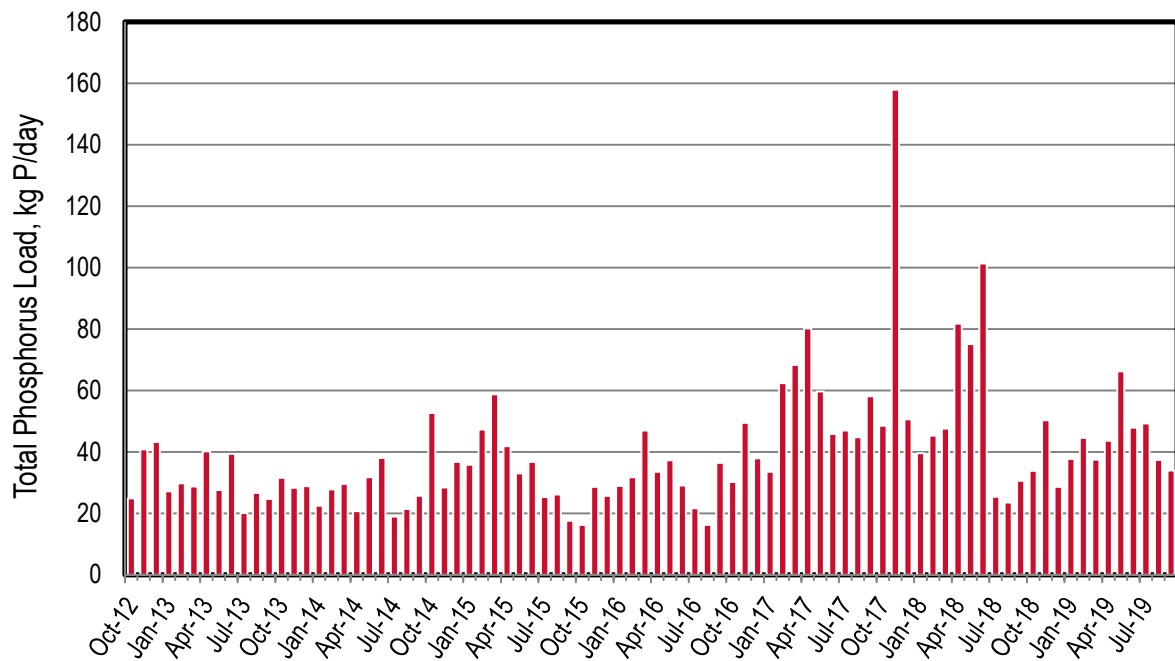


Figure 7-4. Delta Diablo Monthly Phosphorus Loads

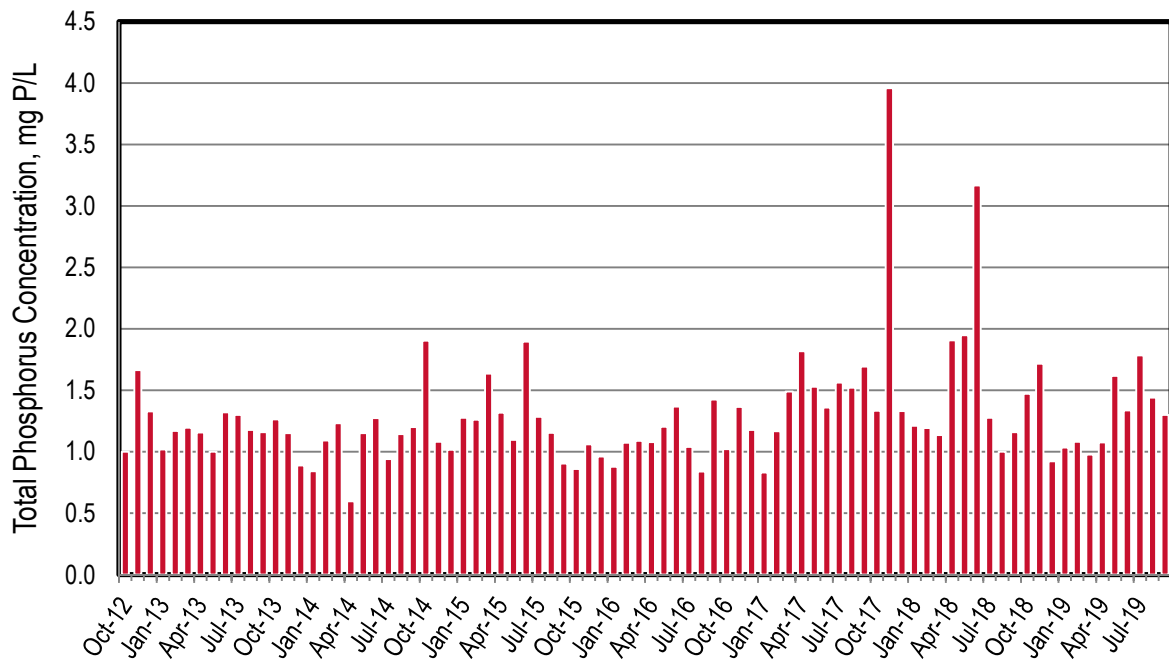


Figure 7-5. Delta Diablo Monthly Phosphorus Concentrations

Table 7-1. Delta Diablo Monthly Flows and Loads

Month, Year	Flow	Ammonia*	Nitrate + Nitrite	TIN**	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-12	6.60	618	1,200	1,820	24.9
Nov-12	6.50	677	1,350	2,030	40.9
Dec-12	8.60	872	991	1,860	43.2
Jan-13	7.05	694	967	1,660	27.2
Feb-13	6.73	760	1,080	1,840	29.7
Mar-13	6.35	697	582	1,280	28.7
Apr-13	9.20	1,220	437	1,660	40.2
May-13	7.30	850	1,140	1,990	27.6
Jun-13	7.90	948	995	1,940	39.4
Jul-13	4.10	429	868	1,300	20.1
Aug-13	6.00	697	850	1,550	26.7
Sep-13	5.65	619	767	1,390	24.7
Oct-13	6.40	750	812	1,560	31.5
Nov-13	7.10	824	778	1,600	28.3
Dec-13	6.50	776	963	1,740	28.9
Jan-14	5.20	573	990	1,560	22.5
Feb-14	6.90	966	385	1,350	27.8
Mar-14	6.67	925	559	1,480	29.6
Apr-14	6.00	693	767	1,460	20.8
May-14	5.65	690	596	1,290	31.8
Jun-14	7.00	1,020	498	1,510	38.0
Jul-14	5.34	651	982	1,630	19.0
Aug-14	4.97	524	1,020	1,540	21.5
Sep-14	5.66	490	942	1,430	25.7
Oct-14	7.32	1,000	725	1,730	52.7
Nov-14	6.94	761	633	1,390	28.4
Dec-14	9.56	1,070	488	1,560	36.8
Jan-15	7.44	894	595	1,490	35.9
Feb-15	9.91	1,310	538	1,850	47.3
Mar-15	9.50	1,270	341	1,610	58.8
Apr-15	8.40	1,290	167	1,450	41.9
May-15	7.97	1,230	73.8	1,300	33.0
Jun-15	5.13	609	142	751	36.8
Jul-15	5.22	583	92.7	676	25.4
Aug-15	6.00	599	1.43	601	26.2
Sep-15	5.15	228	787	1,010	17.6

Month, Year	Flow	Ammonia*	Nitrate + Nitrite	TIN**	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-15	4.99	322	1,010	1,330	16.2
Nov-15	7.13	771	875	1,650	28.6
Dec-15	7.07	954	828	1,780	25.7
Jan-16	8.73	975	1,110	2,090	29.0
Feb-16	7.83	951	834	1,780	31.8
Mar-16	11.4	1,310	256	1,570	47.0
Apr-16	8.23	905	141	1,050	33.6
May-16	8.18	940	28.2	968	37.2
Jun-16	5.62	921	64.4	985	29.1
Jul-16	5.51	593	59.9	653	21.6
Aug-16	5.11	699	102	801	16.2
Sep-16	6.76	1,140	89.9	1,230	36.4
Oct-16	7.83	1,040	60.0	1,100	30.2
Nov-16	9.59	1,300	43.5	1,340	49.5
Dec-16	8.50	1,270	36.7	1,310	37.9
Jan-17	10.7	1,190	41.1	1,230	33.5
Feb-17	14.1	1,720	18.9	1,730	62.4
Mar-17	12.1	1,810	22.5	1,840	68.4
Apr-17	11.7	2,100	19.5	2,120	80.2
May-17	10.3	1,350	19.5	1,370	59.6
Jun-17	8.92	1,440	34.7	1,470	45.8
Jul-17	7.95	1,350	22.1	1,370	47.0
Aug-17	7.79	1,100	34.7	1,130	44.8
Sep-17	9.07	1,380	23.8	1,410	58.1
Oct-17	9.63	1,440	32.0	1,470	48.5
Nov-17	10.6	1,490	11.1	1,500	158
Dec-17	10.1	1,470	12.8	1,480	50.6
Jan-18	8.64	1,360	45.8	1,400	39.6
Feb-18	10.0	1,910	21.7	1,940	45.3
Mar-18	11.1	1,720	26.3	1,750	47.6
Apr-18	11.4	1,850	23.6	1,880	81.8
May-18	10.2	1,770	17.6	1,790	75.1
Jun-18	8.47	1,650	25.6	1,670	101
Jul-18	5.27	1,290	82.6	1,170	25.4
Aug-18	6.24	888	69.2	957	23.6
Sep-18	6.98	1,210	40.8	1,250	30.6
Oct-18	6.08	1,270	104	1,370	33.8

Month, Year	Flow	Ammonia*	Nitrate + Nitrite	TIN**	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Nov-18	7.76	1,510	26.2	1,530	50.3
Dec-18	8.23	1,180	43.2	1,230	28.7
Jan-19	9.64	1,760	71.9	1,860	37.7
Feb-19	10.9	1,750	36.2	1,790	44.6
Mar-19	10.1	1,620	16.6	1,640	37.5
Apr-19	10.7	2,040	25.3	2,070	43.6
May-19	10.8	1,760	27.8	1,810	66.3
Jun-19	9.49	1,480	25.0	1,210	48.0
Jul-19	7.31	1,210	61.8	1,270	49.3
Aug-19	6.87	1,150	58.2	1,210	37.4
Sep-19	6.91	977	82.2	1,060	34.0
Dry Season Average	6.94	984	306	1,280	37.2
Dry Season Trend***	Up	Up	Down	None	Up
Wet Season Average	8.56	1,180	432	1,610	41.8
Average Annual	7.89	1,100	379	1,470	39.9

* Delta Diablo typically samples each month more than the required frequency for ammonia. This dataset includes this additional sampling.

** The Total Inorganic Nitrogen value is calculated by adding the "Ammonia" and "Nitrate + Nitrite" values.

*** Refer to the Section 3.5 in the main body for a description on the statistical analysis.

8 East Bay Dischargers Authority (EBDA)

EBDA discharges to the South Bay. EBDA has a permitted ADWF capacity of 107.8 mgd and a peak wet weather capacity of 189.1 mgd. It has a current ADWF flow of approximately 54 mgd. The EBDA plants have various types of secondary treatment.

The following observations are made based upon the figures and tables in the subsequent pages:

- ◆ The flows reduce 10 to 20 mgd from the wet to the dry season due to a combination of recycled water demand during the dry season and a lack of inflow and infiltration.
- ◆ Based on the average monthly values table, there appears to be a slight upward dry season trend for ammonia, TIN, and total phosphorus loads.
- ◆ Ammonia, total nitrogen, and phosphorus loads typically increase with flow during wet weather events. The increase in loads during a wet weather event is less pronounced with months where there are back to back months with storms, such as December 2014 and January 2015. This is attributed to a lack of scouring in the collection system during the latter month.
- ◆ Wet season loads are greater and more variable than the dry season loads.
- ◆ Ammonia is the majority of the nitrogen species discharged, regardless of season. This would be expected since the EBDA plants were not designed to nitrify.
- ◆ Total phosphorus concentrations are relatively flat and range from approximately 2 mg P/L to 3 mg P/L. Such values are lower than typical effluent concentrations of 4 to 6 mg P/L. This was expected as a portion of the EBDA plants perform either biological P removal using an anaerobic selector or chemical removal at the headworks, primaries, or filters.

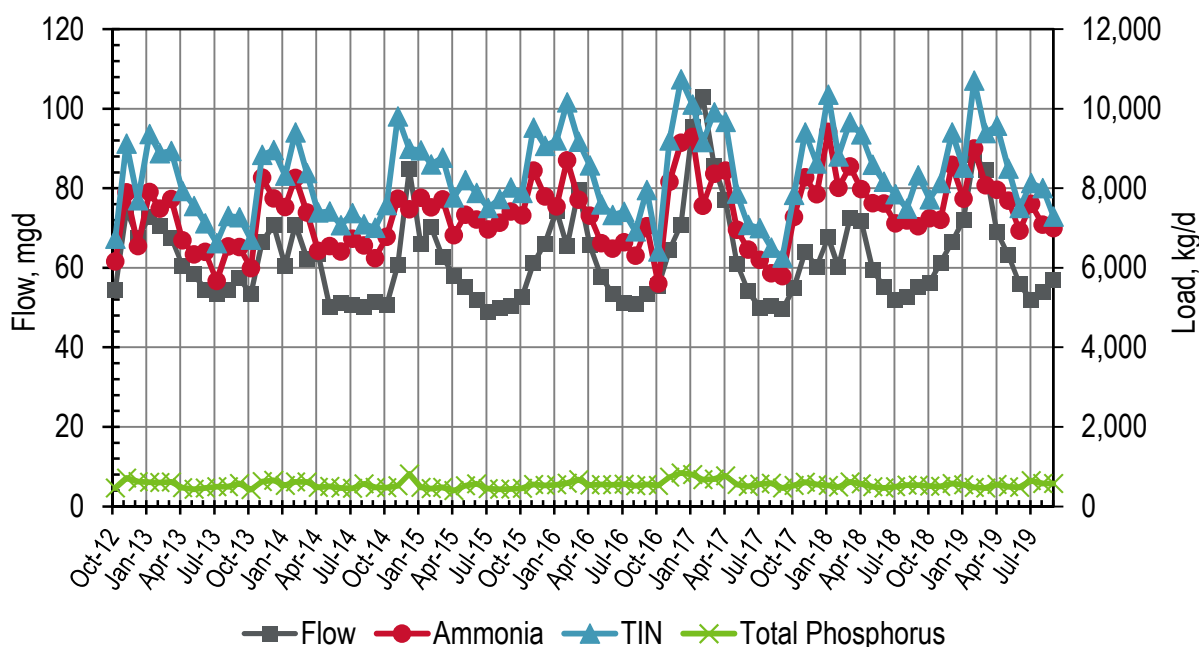


Figure 8-1. EBDA Monthly Flows and Loads

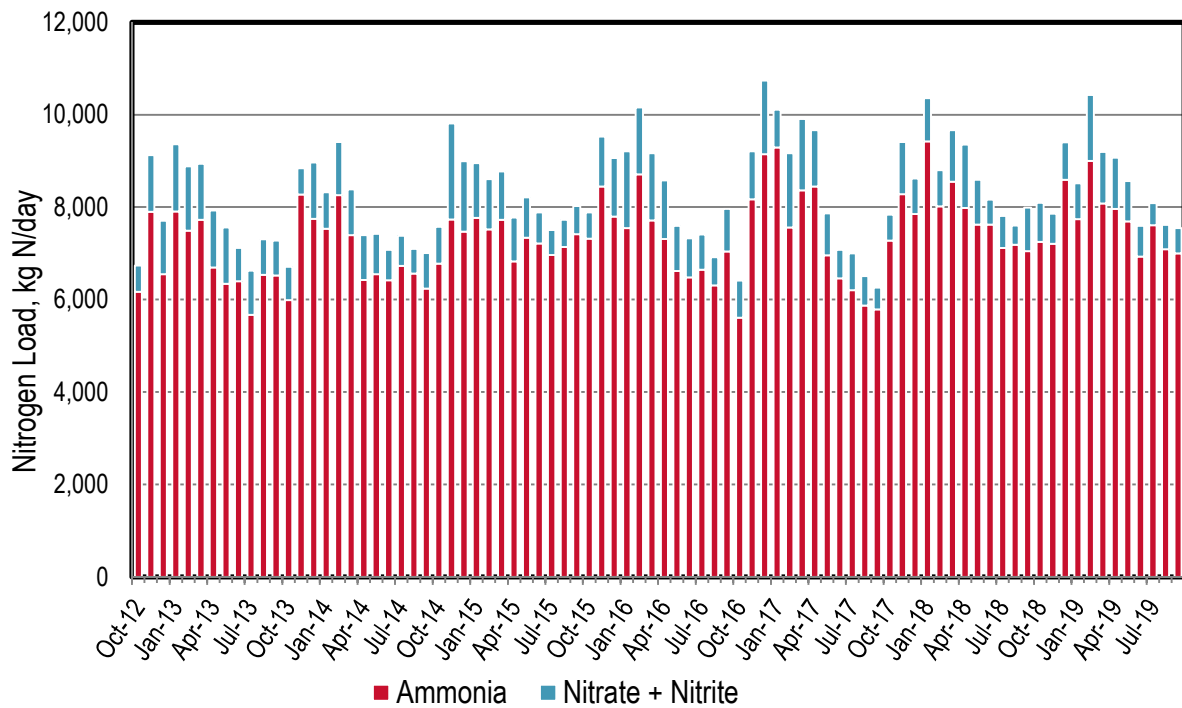


Figure 8-2. EBDA Monthly Nitrogen Loads

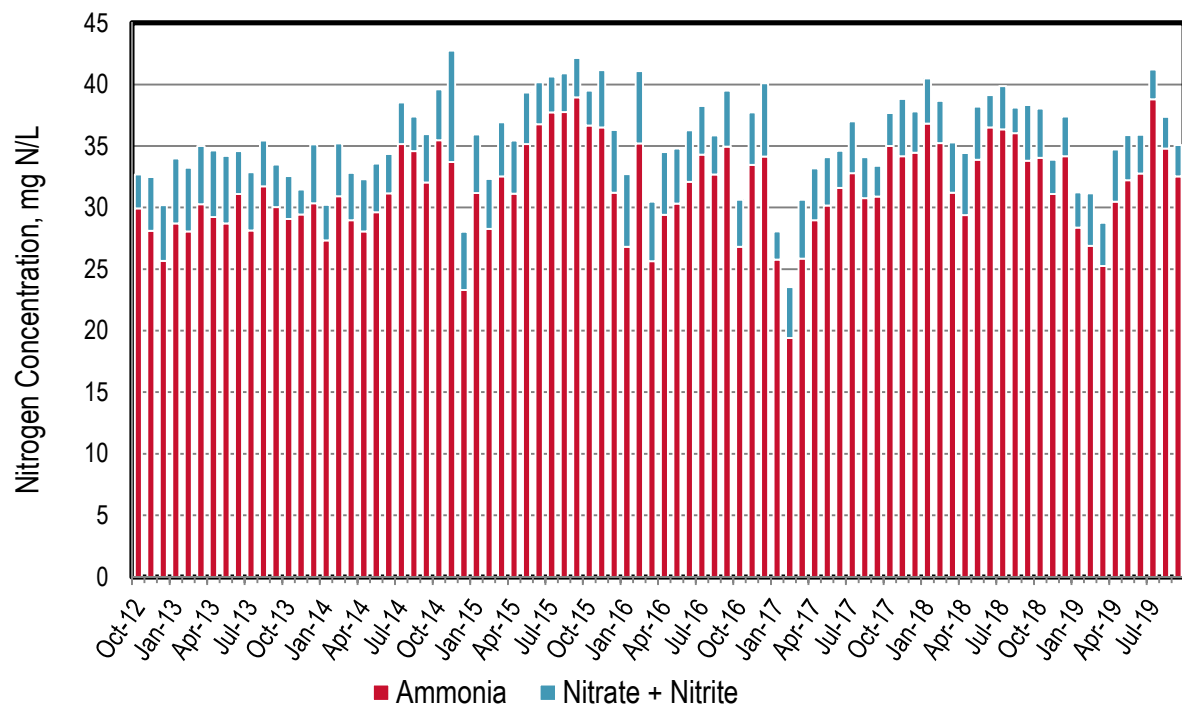


Figure 8-3. EBDA Monthly Nitrogen Concentrations

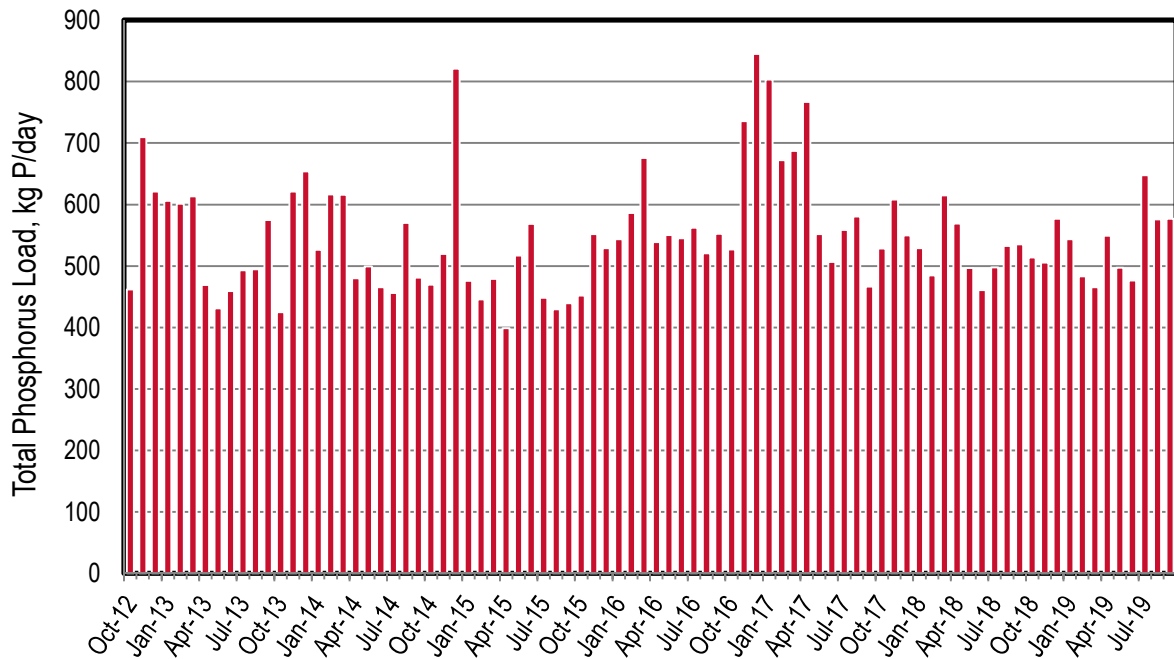


Figure 8-4. EBDA Monthly Phosphorus Loads

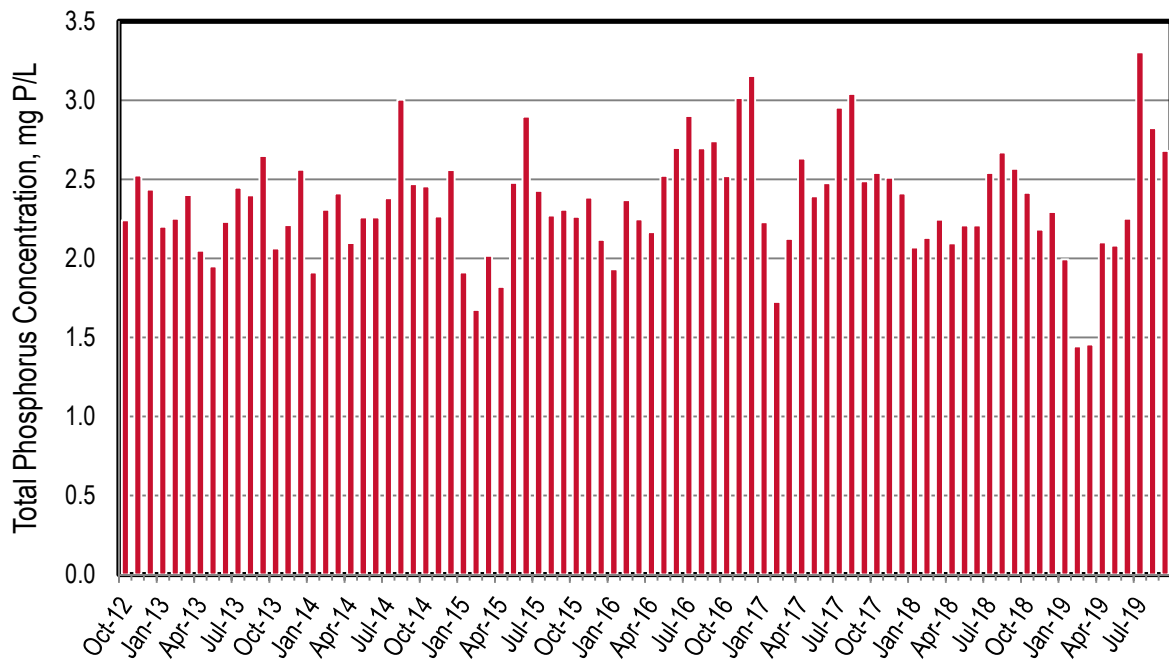


Figure 8-5. EBDA Monthly Phosphorus Concentrations

Table 8-1. EBDA Monthly Flows and Loads

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-12	54.5	6,160	568	6,730	462
Nov-12	74.3	7,900	1,230	9,130	710
Dec-12	67.5	6,550	1,150	7,700	621
Jan-13	72.9	7,900	1,460	9,360	606
Feb-13	70.7	7,490	1,390	8,880	601
Mar-13	67.6	7,730	1,210	8,940	613
Apr-13	60.6	6,690	1,240	7,930	469
May-13	58.5	6,340	1,220	7,560	431
Jun-13	54.5	6,400	719	7,120	459
Jul-13	53.3	5,670	953	6,620	493
Aug-13	54.5	6,540	763	7,300	494
Sep-13	57.5	6,520	750	7,270	575
Oct-13	53.4	5,990	715	6,700	425
Nov-13	66.5	8,270	567	8,840	621
Dec-13	70.7	7,740	1,220	8,960	654
Jan-14	60.6	7,530	789	8,320	526
Feb-14	70.9	8,260	1,150	9,410	616
Mar-14	62.3	7,400	986	8,380	616
Apr-14	63.5	6,430	966	7,390	480
May-14	50.3	6,550	873	7,420	499
Jun-14	51.2	6,410	660	7,070	465
Jul-14	50.7	6,730	649	7,380	456
Aug-14	50.2	6,560	534	7,090	570
Sep-14	51.5	6,240	765	7,000	481
Oct-14	50.6	6,780	795	7,570	470
Nov-14	60.7	7,740	2,070	9,810	520
Dec-14	84.9	7,470	1,520	8,990	821
Jan-15	65.9	7,770	1,180	8,950	476
Feb-15	70.4	7,520	1,080	8,600	446
Mar-15	62.8	7,720	1,050	8,770	479
Apr-15	58.0	6,820	948	7,770	399
May-15	55.2	7,340	874	8,210	517
Jun-15	51.9	7,220	667	7,880	569
Jul-15	48.8	6,970	540	7,510	448
Aug-15	50.0	7,130	594	7,730	429
Sep-15	50.3	7,410	609	8,020	439

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-15	52.8	7,320	564	7,880	452
Nov-15	61.2	8,440	1,080	9,530	552
Dec-15	66.1	7,790	1,270	9,070	529
Jan-16	74.4	7,550	1,660	9,200	543
Feb-16	65.4	8,710	1,450	10,200	586
Mar-16	79.6	7,710	1,450	9,170	676
Apr-16	65.8	7,310	1,260	8,580	539
May-16	57.7	6,620	972	7,590	550
Jun-16	53.5	6,480	845	7,330	545
Jul-16	51.2	6,650	763	7,410	562
Aug-16	51.0	6,310	608	6,920	520
Sep-16	53.3	7,040	916	7,960	552
Oct-16	55.3	5,600	802	6,410	527
Nov-16	64.5	8,170	1,040	9,200	736
Dec-16	70.9	9,140	1,600	10,700	845
Jan-17	95.3	9,290	819	10,100	803
Feb-17	103	7,560	1,600	9,160	672
Mar-17	85.5	8,360	1,540	9,910	687
Apr-17	77.1	8,440	1,220	9,670	767
May-17	61.0	6,960	905	7,860	552
Jun-17	54.1	6,460	617	7,080	506
Jul-17	50.0	6,200	797	7,000	559
Aug-17	50.5	5,870	638	6,500	580
Sep-17	49.6	5,790	467	6,260	466
Oct-17	55.0	7,280	559	7,830	528
Nov-17	64.1	8,280	1,130	9,410	608
Dec-17	60.3	7,850	767	8,620	550
Jan-18	67.7	9,420	937	10,400	529
Feb-18	60.2	8,010	785	8,800	485
Mar-18	72.4	8,550	1,110	9,660	615
Apr-18	71.9	7,980	1,370	9,360	569
May-18	59.5	7,620	972	8,590	497
Jun-18	55.2	7,620	545	8,160	461
Jul-18	51.8	7,120	686	7,850	498
Aug-18	52.8	7,190	415	7,490	533
Sep-18	55.1	7,040	942	8,330	535
Oct-18	56.3	7,240	849	7,720	514

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Nov-18	61.3	7,210	647	8,130	506
Dec-18	66.5	8,590	810	9,400	577
Jan-19	72.2	7,740	777	8,520	544
Feb-19	88.5	9,000	1,430	10,700	483
Mar-19	84.6	8,080	1,120	9,390	465
Apr-19	69.1	7,960	1,110	9,570	549
May-19	63.1	7,690	872	8,490	497
Jun-19	55.9	6,930	665	7,510	476
Jul-19	51.9	7,610	473	8,130	648
Aug-19	53.9	7,090	523	8,000	576
Sep-19	56.9	7,000	548	7,280	577
Dry Season Average	53.6	6,780	724	7,510	515
Dry Season Trend	None	Up	None	Up	Up
Wet Season Average	68.1	7,720	1,100	8,840	573
Average Annual	62.1	7,330	945	8,290	549

* The Total Inorganic Nitrogen value is calculated by adding the "Ammonia" and "Nitrate + Nitrite" values.

** Refer to the Section 3.5 in the main body for a description on the statistical analysis.

9 East Bay Municipal Utility District (EBMUD)

EBMUD discharges to the Central Bay. They have an ADWF permitted capacity of 120 mgd and a peak wet weather capacity of 320 mgd. It has a current ADWF flow of approximately 47 mgd. The plant performs secondary treatment using a high purity oxygen system. This plant accepts high-strength (organic) trucked wastes to its anaerobic digesters for renewable energy production. These wastes contribute to the plant discharge nutrient loads.

The following observations are made based upon the figures and table in the subsequent pages:

- ◆ Based on the average monthly values table and figures below, there appears to be a downward dry season trend for NO_x loads.
- ◆ There appears to be an upward dry season trend for ammonia, TIN, and total phosphorus loads.
- ◆ Wet season loads are typically greater and more variable than the dry season loads.
- ◆ Nitrogen loads typically increase with flow during wet weather events.
- ◆ The effluent TIN concentrations are relatively strong with occasional exceedance of 60 mg N/L.
- ◆ Ammonia is the majority of the nitrogen species discharged, regardless of season since EBMUD does not nitrify.

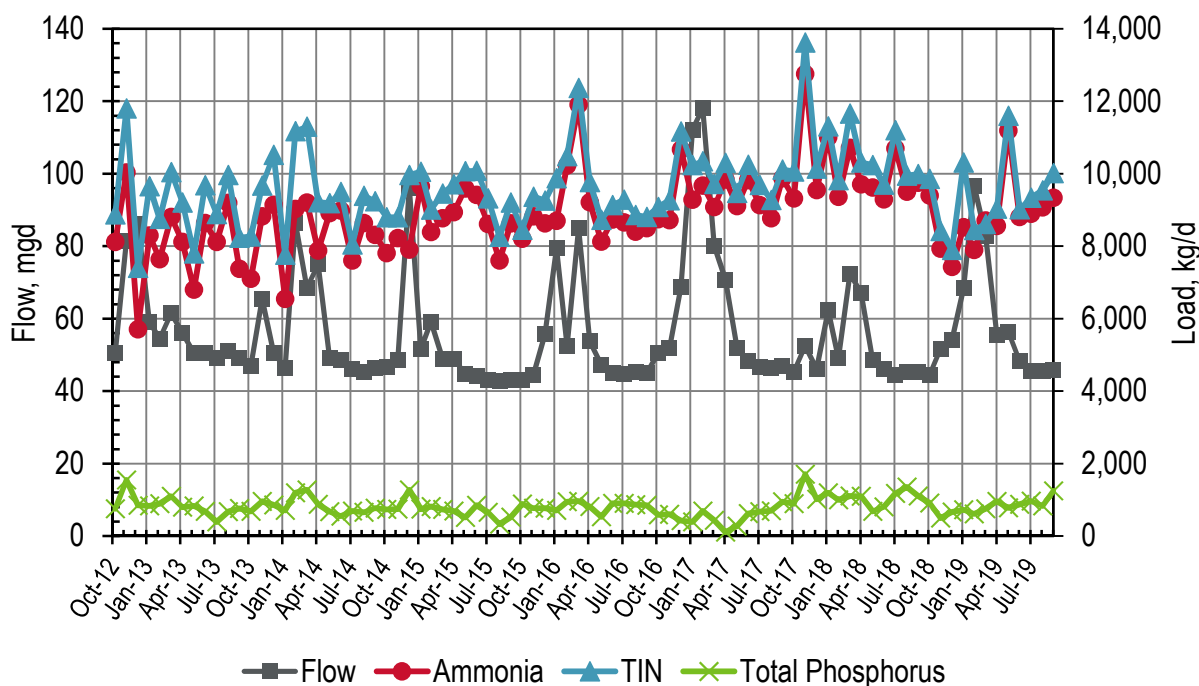


Figure 9-1. EBMUD Monthly Flows and Loads

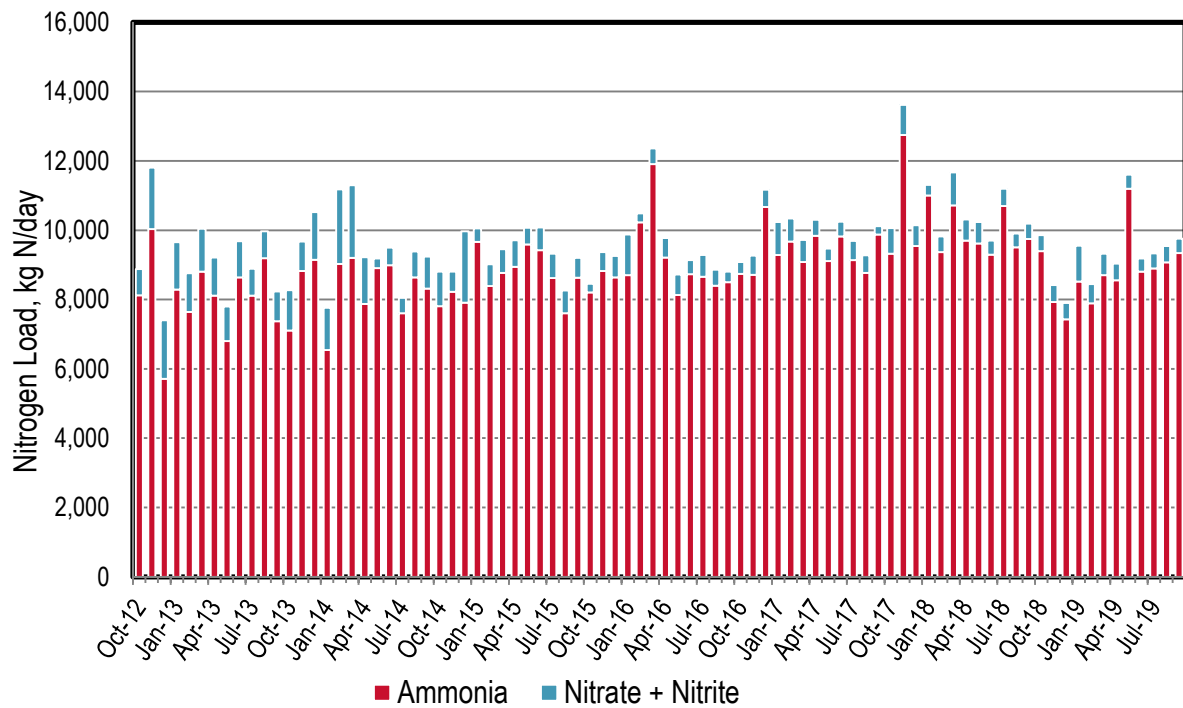


Figure 9-2. EBMUD Monthly Nitrogen Loads

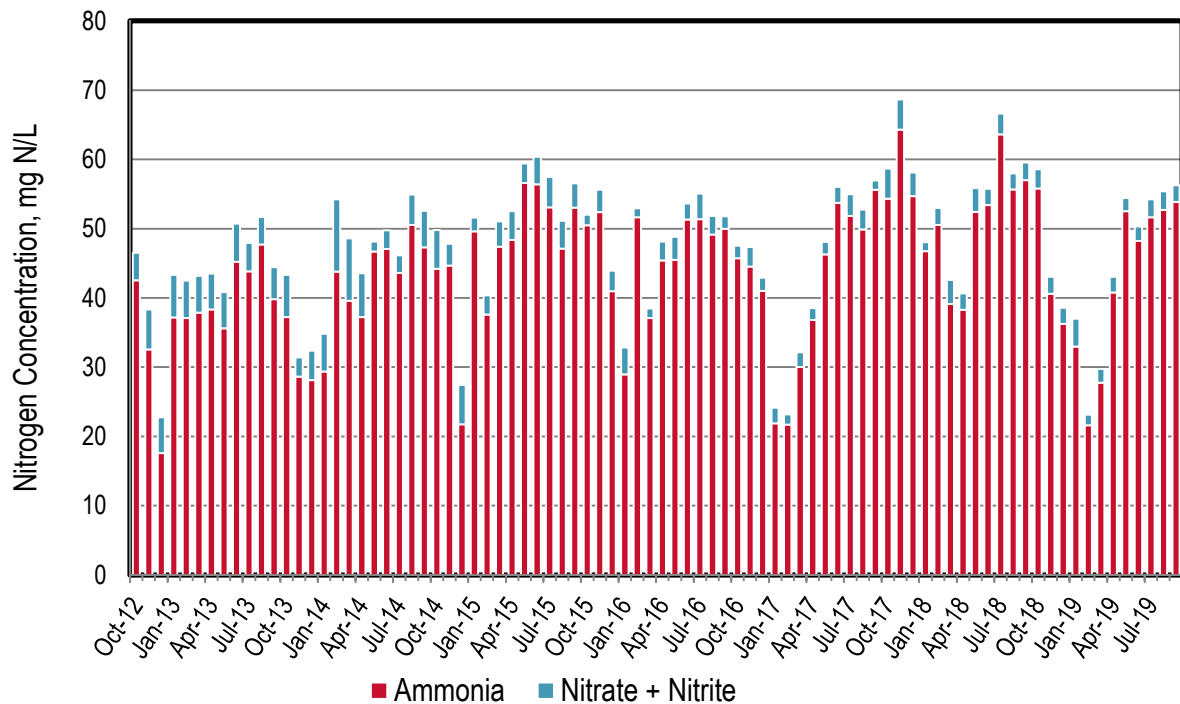


Figure 9-3. EBMUD Monthly Nitrogen Concentrations

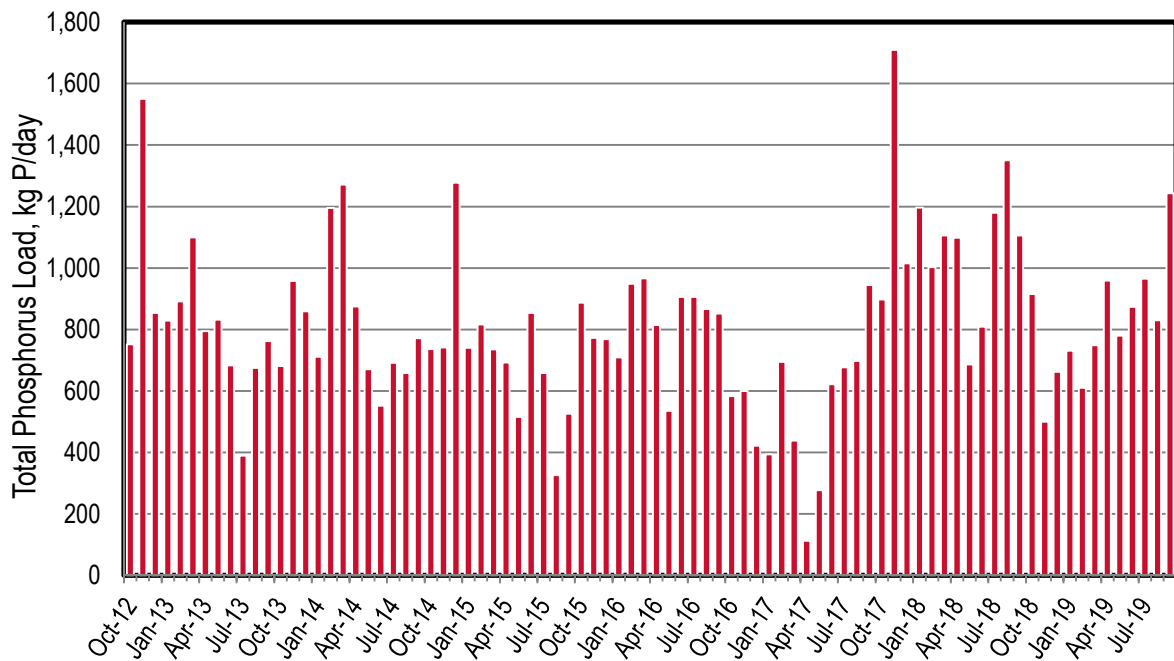


Figure 9-4. EBMUD Monthly Phosphorus Loads (Refer to Table 9-1)**

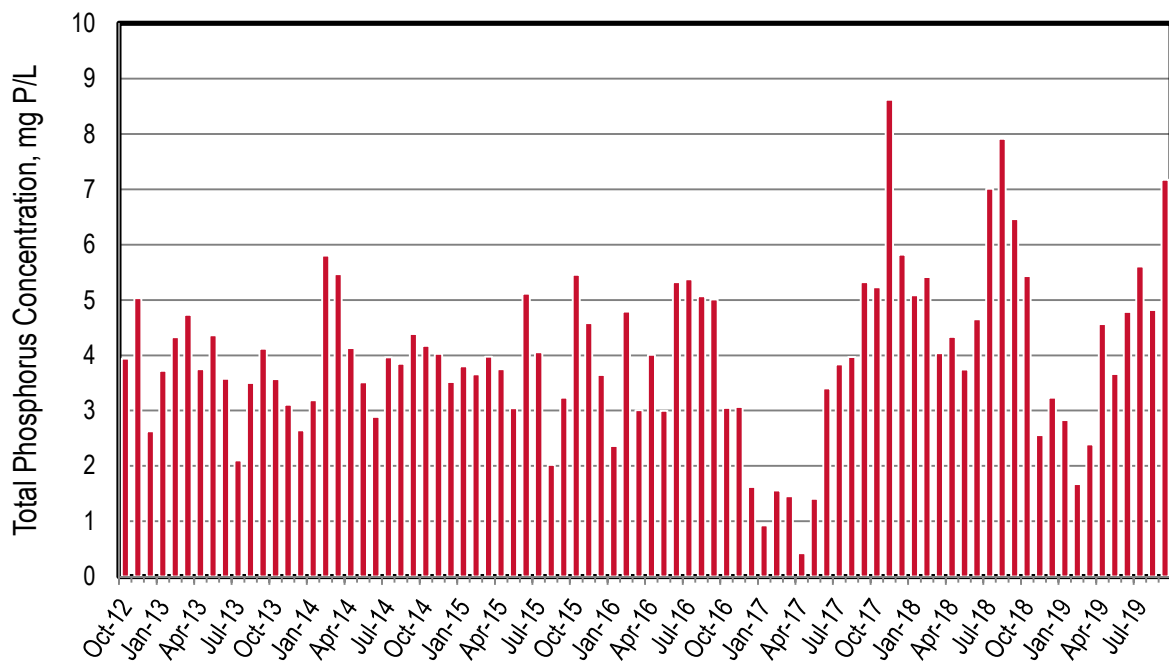


Figure 9-5. EBMUD Monthly Phosphorus Concentrations

Table 9-1. EBMUD Monthly Flows and Loads

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-12	50.5	8,120	756	8,880	752
Nov-12	81.5	10,000	1,770	11,800	1,550
Dec-12	86.0	5,710	1,690	7,400	854
Jan-13	59.0	8,290	1,370	9,660	829
Feb-13	54.5	7,640	1,120	8,760	891
Mar-13	61.5	8,800	1,240	10,000	1,100
Apr-13	56.0	8,110	1,090	9,210	794
May-13	50.5	6,800	996	7,800	832
Jun-13	50.5	8,640	1,050	9,680	683
Jul-13	49.0	8,120	767	8,880	389
Aug-13	51.0	9,200	771	9,970	675
Sep-13	49.0	7,380	858	8,230	762
Oct-13	47.0	7,100	1,170	8,270	681
Nov-13	65.5	8,820	847	9,670	958
Dec-13	50.5	9,150	1,380	10,500	859
Jan-14	46.5	6,550	1,220	7,770	711
Feb-14	86.5	9,020	2,150	11,200	1,200
Mar-14	68.5	9,200	2,090	11,300	1,270
Apr-14	75.0	7,880	1,340	9,220	874
May-14	49.0	8,910	277	9,190	671
Jun-14	48.5	8,990	509	9,500	551
Jul-14	46.1	7,610	444	8,050	691
Aug-14	45.2	8,640	749	9,390	658
Sep-14	46.5	8,320	927	9,240	771
Oct-14	46.7	7,810	992	8,800	737
Nov-14	48.7	8,230	574	8,800	742
Dec-14	96.2	7,910	2,060	9,970	1,280
Jan-15	51.5	9,660	392	10,100	740
Feb-15	59.1	8,390	623	9,010	816
Mar-15	49.0	8,770	679	9,450	736
Apr-15	48.9	8,940	765	9,710	693
May-15	44.8	9,590	479	10,100	516
Jun-15	44.2	9,420	664	10,100	854
Jul-15	42.9	8,620	708	9,320	658
Aug-15	42.7	7,600	652	8,260	326
Sep-15	43.1	8,630	570	9,200	526

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-15	43.0	8,200	247	8,450	887
Nov-15	44.6	8,820	543	9,370	772
Dec-15	55.8	8,630	624	9,260	769
Jan-16	79.5	8,700	1,170	9,880	709
Feb-16	52.4	10,200	259	10,500	948
Mar-16	85.0	11,900	457	12,400	966
Apr-16	53.7	9,210	557	9,770	814
May-16	47.3	8,130	595	8,730	535
Jun-16	45.0	8,730	400	9,130	905
Jul-16	44.6	8,650	629	9,280	906
Aug-16	45.2	8,400	458	8,860	866
Sep-16	45.0	8,500	309	8,810	852
Oct-16	50.6	8,740	340	9,080	583
Nov-16	51.8	8,720	554	9,270	600
Dec-16	68.8	10,700	494	11,200	422
Jan-17	112	9,290	953	10,200	393
Feb-17	118	9,670	669	10,300	695
Mar-17	80.0	9,080	640	9,720	438
Apr-17	70.7	9,840	463	10,300	112
May-17	52.1	9,110	357	9,470	277
Jun-17	48.4	9,820	423	10,200	622
Jul-17	46.6	9,140	555	9,690	677
Aug-17	46.5	8,770	511	9,280	698
Sep-17	47.0	9,870	243	10,100	945
Oct-17	45.4	9,320	742	10,100	898
Nov-17	52.5	12,800	867	13,600	1,710
Dec-17	46.2	9,550	593	10,100	1,020
Jan-18	62.3	11,000	303	11,300	1,200
Feb-18	49.0	9,360	458	9,820	1,000
Mar-18	72.5	10,700	945	11,700	1,110
Apr-18	67.1	9,700	606	10,300	1,100
May-18	48.5	9,620	622	10,200	686
Jun-18	46.0	9,290	409	9,700	809
Jul-18	44.5	10,700	499	11,200	1,180
Aug-18	45.2	9,510	394	9,950	1,350
Sep-18	45.3	9,750	435	9,990	1,110
Oct-18	44.5	9,400	467	9,860	915

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Nov-18	51.7	7,930	484	8,420	500
Dec-18	54.2	7,430	468	7,900	663
Jan-19	68.4	8,520	1,030	10,300	731
Feb-19	96.6	7,890	552	8,450	610
Mar-19	82.9	8,710	614	8,610	749
Apr-19	55.5	8,560	477	9,030	959
May-19	56.4	11,200	406	11,600	780
Jun-19	48.3	8,810	380	9,010	874
Jul-19	45.5	8,890	440	9,330	965
Aug-19	45.5	9,070	467	9,540	830
Sep-19	45.9	9,340	413	10,000	1,240
Dry Season Average	46.9	8,910	553	9,460	762
Dry Season Trend	None	Up	Down	Up	Up
Wet Season Average	63.3	8,910	855	9,770	843
Average Annual	56.5	8,910	729	9,640	809

* The Total Inorganic Nitrogen value is calculated by adding the "Ammonia" and "Nitrate + Nitrite" values.

** Refer to the Section 3.5 in the main body for a description on the statistical analysis.

*** Numbers in this table are slightly different compared to those reported in the CIWQS, due to rounding of conversion factors used.

10 Fairfield-Suisun Sewer District (FSSD)

FSSD discharges to waterways in the Suisun Marsh that flow more than 13 miles before reaching Suisun Bay. FSSD serves approximately 40,300 service connections. The plant has a permitted ADWF capacity of 23.7 mgd and a peak wet weather capacity of 52.9 mgd. The current ADWF flow is approximately 11 mgd. The plant fully nitrifies and partially denitrifies using a combination of trickling filters and activated sludge.

The following observations are made based upon the figures and table in the subsequent pages:

- ◆ Based on the table with the average monthly values, there appears to be an emerging dry season upward trend for total phosphorus loads, as well as flow.
- ◆ Nitrogen loads typically increase with flow during wet weather events, whereas the phosphorus loads are relatively flat year round.
- ◆ Nitrogen wet season loads are typically greater and more variable than the dry season loads.
- ◆ NO_x is the majority of the nitrogen species discharged, regardless of season. This would be expected since this plant reliably nitrifies year round.
- ◆ Total phosphorus concentrations are wide ranging from approximately 1.5 to 6.8 mg P/L. Typical effluent TP concentrations are 3 to 6 mg P/L

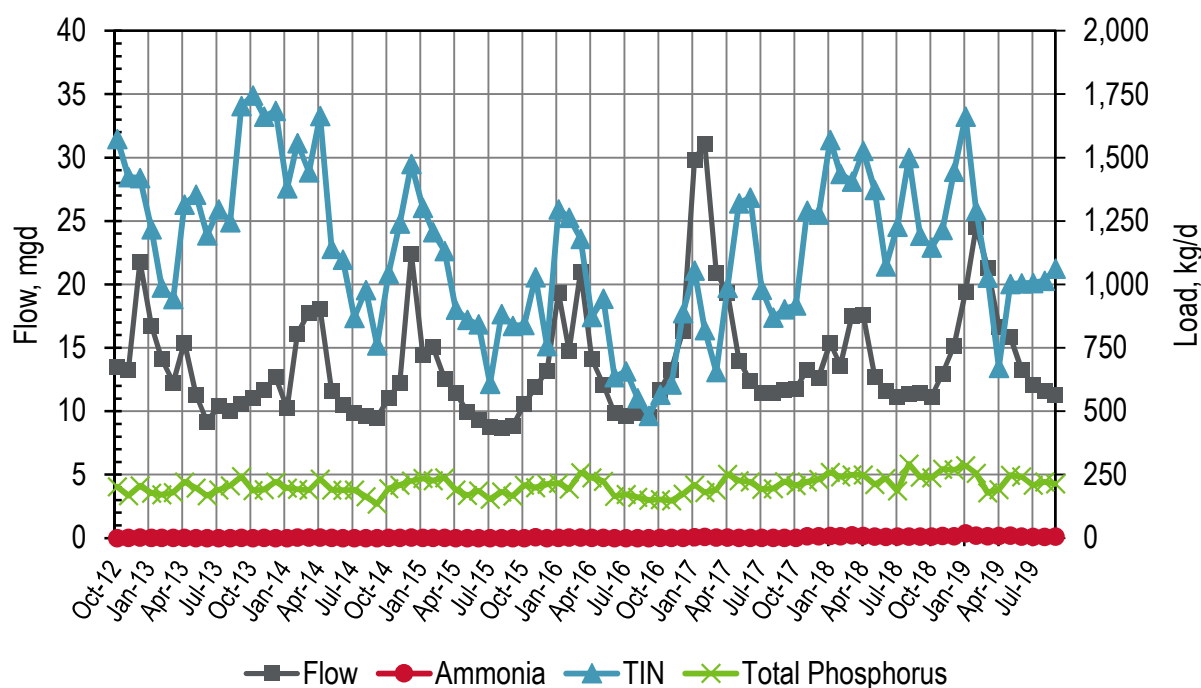


Figure 10-1. Fairfield-Suisun Sewer District Monthly Flows and Loads

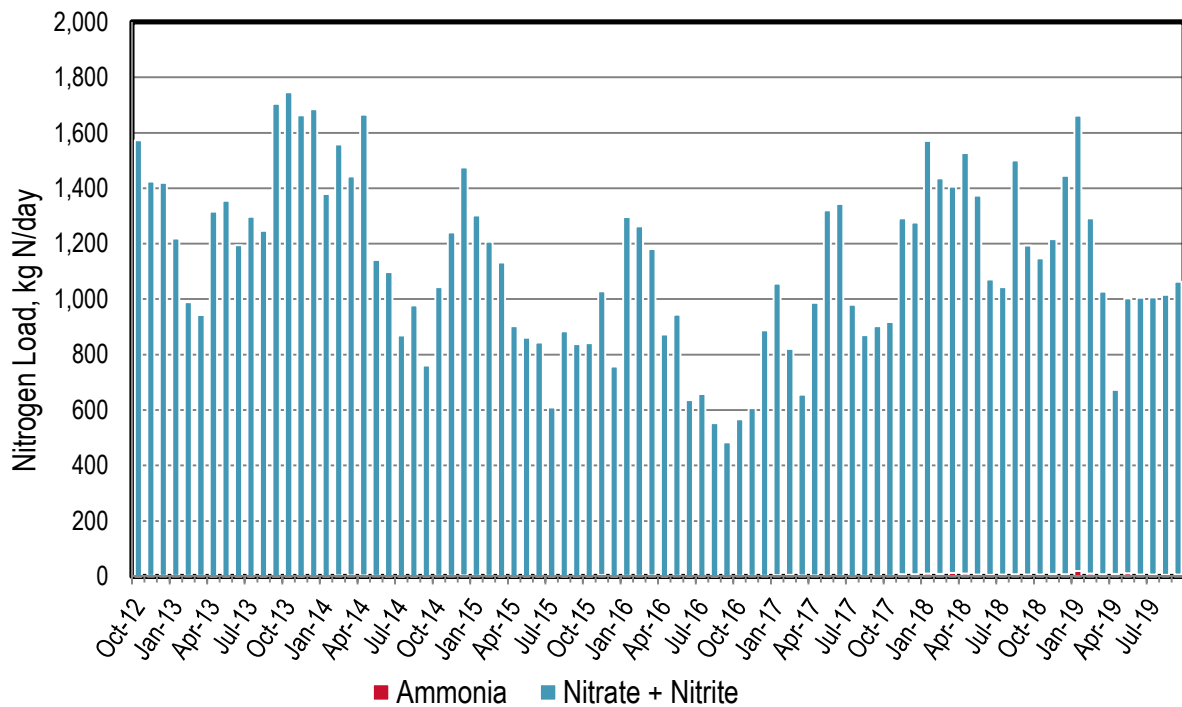


Figure 10-2. Fairfield-Suisun Sewer District Monthly Nitrogen Loads

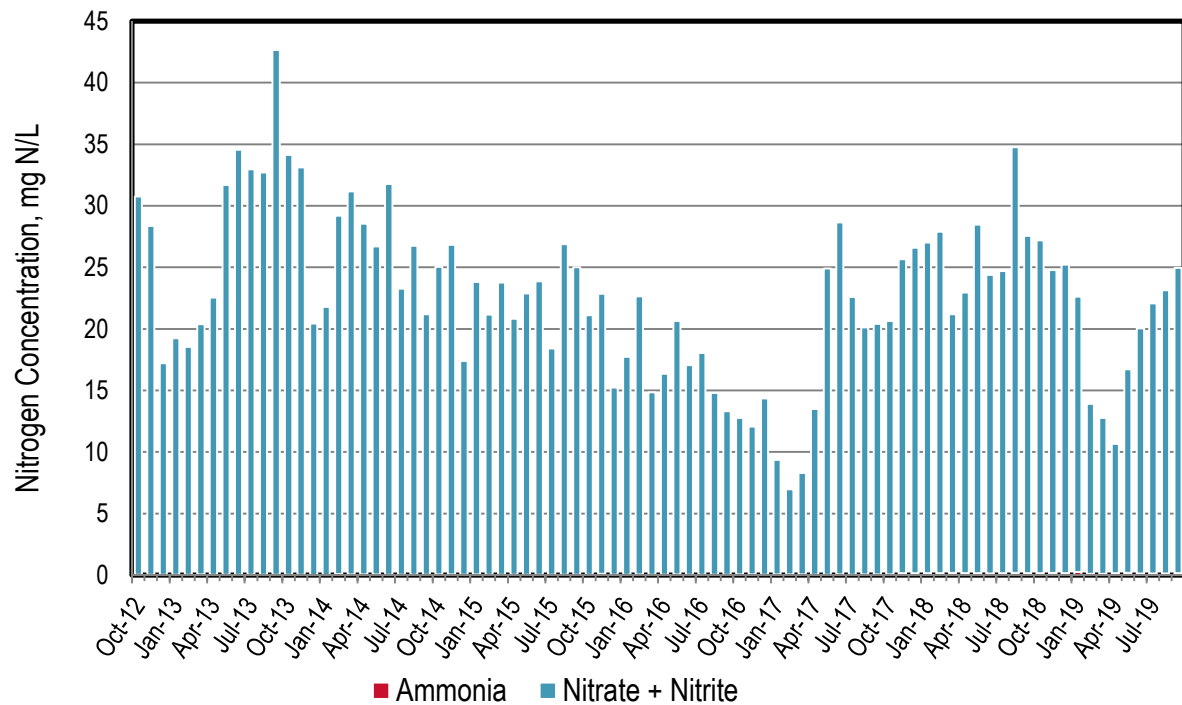


Figure 10-3. Fairfield-Suisun Sewer District Monthly Nitrogen Concentrations

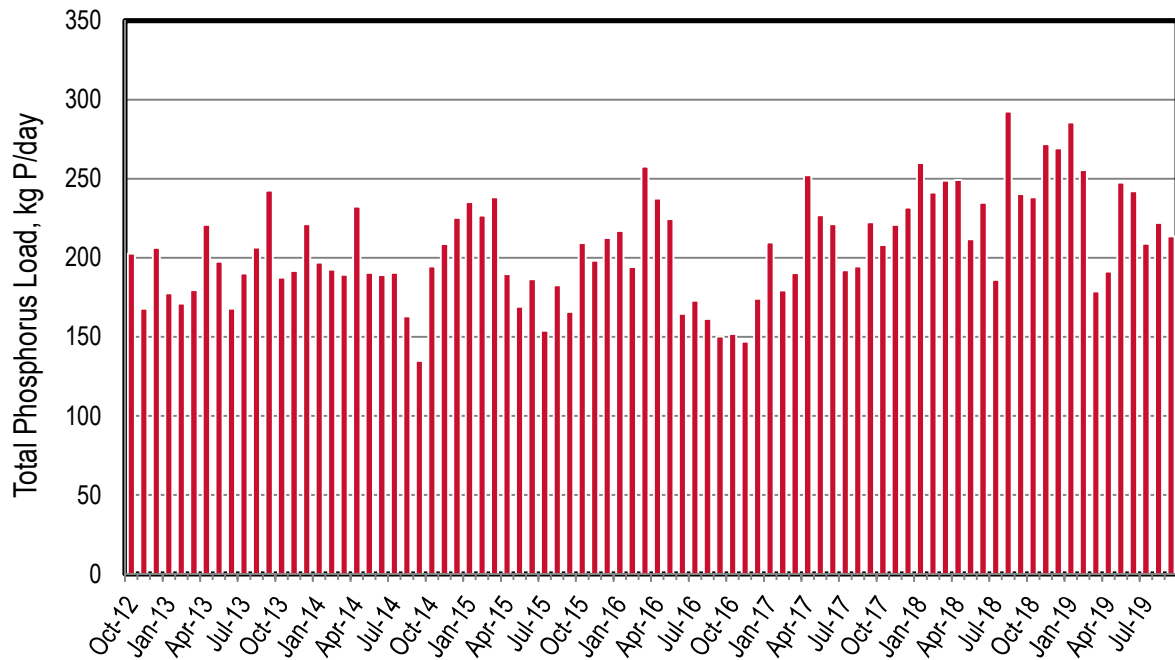


Figure 10-4. Fairfield-Suisun Sewer District Monthly Phosphorus Loads

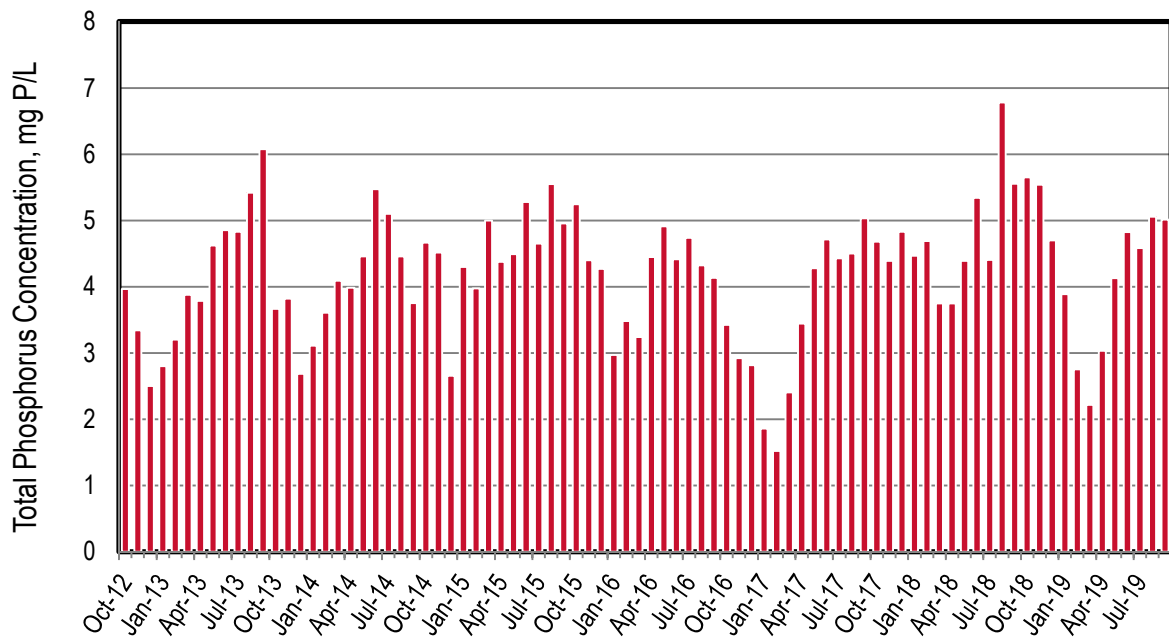


Figure 10-5. Fairfield-Suisun Sewer District Monthly Phosphorus Concentrations

Table 10-1. Fairfield-Suisun Sewer District Monthly Flows and Loads

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-12	13.5	1.26	1,570	1,570	203
Nov-12	13.3	1.81	1,420	1,420	168
Dec-12	21.8	2.74	1,420	1,420	206
Jan-13	16.7	1.90	1,220	1,220	177
Feb-13	14.1	1.60	987	989	171
Mar-13	12.2	1.95	941	943	179
Apr-13	15.4	1.46	1,310	1,320	221
May-13	11.3	0.855	1,350	1,350	198
Jun-13	9.15	0.691	1,190	1,190	168
Jul-13	10.4	0.787	1,300	1,300	190
Aug-13	10.1	0.940	1,240	1,250	206
Sep-13	10.6	1.42	1,700	1,700	243
Oct-13	11.1	1.25	1,740	1,750	187
Nov-13	11.7	1.50	1,660	1,660	192
Dec-13	12.7	0.962	1,680	1,690	221
Jan-14	10.3	0.775	1,380	1,380	197
Feb-14	16.1	3.57	1,550	1,560	193
Mar-14	17.8	2.89	1,440	1,440	189
Apr-14	18.1	2.82	1,660	1,670	232
May-14	11.6	1.75	1,140	1,140	191
Jun-14	10.5	0.982	1,100	1,100	189
Jul-14	9.88	1.12	868	869	190
Aug-14	9.67	1.18	977	978	163
Sep-14	9.50	1.32	759	761	135
Oct-14	11.0	1.83	1,040	1,040	195
Nov-14	12.2	2.00	1,240	1,240	209
Dec-14	22.4	3.12	1,470	1,480	225
Jan-15	14.5	2.18	1,300	1,300	235
Feb-15	15.1	1.78	1,210	1,210	227
Mar-15	12.6	1.45	1,130	1,130	238
Apr-15	11.5	1.34	901	902	190
May-15	9.95	1.18	860	861	169
Jun-15	9.35	1.07	842	843	187
Jul-15	8.75	0.924	608	609	154
Aug-15	8.70	1.03	883	884	183
Sep-15	8.85	0.896	836	837	166

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-15	10.6	1.17	840	842	209
Nov-15	11.9	4.73	1,020	1,030	198
Dec-15	13.2	1.36	756	757	213
Jan-16	19.3	2.38	1,290	1,300	217
Feb-16	14.8	2.69	1,260	1,260	194
Mar-16	21.0	2.77	1,180	1,180	258
Apr-16	14.1	1.58	871	873	238
May-16	12.1	1.99	942	944	225
Jun-16	9.86	1.01	634	635	164
Jul-16	9.65	1.04	657	658	173
Aug-16	9.88	0.910	552	553	161
Sep-16	9.60	1.33	482	483	150
Oct-16	11.7	1.76	565	566	152
Nov-16	13.3	2.52	604	607	147
Dec-16	16.4	2.15	885	887	174
Jan-17	29.8	4.77	1,050	1,060	210
Feb-17	31.1	5.60	815	821	179
Mar-17	20.9	3.24	653	656	190
Apr-17	19.4	2.83	984	987	252
May-17	14.0	1.96	1,320	1,320	227
Jun-17	12.4	2.10	1,340	1,340	221
Jul-17	11.5	1.58	979	980	192
Aug-17	11.4	1.73	868	870	195
Sep-17	11.7	1.84	900	902	223
Oct-17	11.8	1.94	916	918	208
Nov-17	13.3	7.91	1,280	1,290	221
Dec-17	12.7	7.81	1,270	1,280	232
Jan-18	15.4	9.74	1,560	1,570	260
Feb-18	13.6	8.61	1,430	1,440	241
Mar-18	17.6	12.0	1,390	1,410	249
Apr-18	17.6	9.75	1,520	1,530	249
May-18	12.8	7.29	1,370	1,370	212
Jun-18	11.6	5.97	1,070	1,070	235
Jul-18	11.2	6.74	1,040	1,230	186
Aug-18	11.4	7.57	1,490	1,500	293
Sep-18	11.4	6.56	1,190	1,190	240
Oct-18	11.2	6.63	1,140	1,150	238

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Nov-18	13.0	9.32	1,210	1,220	272
Dec-18	15.2	8.32	1,440	1,450	269
Jan-19	19.4	19.9	1,640	1,660	286
Feb-19	24.5	10.6	1,280	1,290	256
Mar-19	21.3	7.67	1,020	1,030	179
Apr-19	16.7	9.60	663	672	191
May-19	15.9	11.4	991	1,000	248
Jun-19	13.3	6.98	998	1,010	242
Jul-19	12.1	6.36	1,000	1,010	209
Aug-19	11.6	5.73	1,010	1,020	222
Sep-19	11.3	6.57	1,060	1,060	214
Dry Season Average	10.9	2.94	1,020	1,020	199
Dry Season Trend	Up	***	None	None	Up
Wet Season Average	15.8	4.28	1,200	1,200	213
Average Annual	13.8	3.72	1,120	1,130	207

* The Total Inorganic Nitrogen value is calculated by adding the "Ammonia" and "Nitrate + Nitrite" values.

** Refer to the Section 3.5 in the main body for a description on the statistical analysis.

*** Ammonia was not considered in the trending as the plant reliably fully nitrifies and the majority of samples are non-detects

11 Las Gallinas Valley Sanitary District

Las Gallinas discharges to Miller Creek that is connected to San Pablo Bay. The plant has approximately 15,800 service connections; it has a permitted capacity of 2.92 mgd ADWF and a peak wet weather secondary treatment capacity of 8.0 mgd. The plant performs secondary treatment using two rock trickling filters and nitrification using a third trickling filter equipped with plastic media. Discharge to Miller Creek is prohibited June 1 through October 31.

The following observations are made based upon the figures and table in the subsequent pages:

- ◆ Based on the average monthly values table, there are no emerging dry season trends as Las Gallinas does not typically discharge during the dry season.
- ◆ Wet season trends analyzed (statistical data not shown) and there is an emerging upward trend for ammonia loads. This trend is likely attributed to the 2016 winter that had relatively high levels of precipitation. However, TIN loads are relatively consistent over the years shown.
- ◆ NO_x is the majority of the nitrogen species discharged as would be expected since this plant nitrifies. A portion of ammonia bleeds through during the colder months. This increases the ammonia contribution during such months.
- ◆ Total phosphorus concentrations range from 0.5 to 5.0 mg P/L. This suggests occasional P removal as typical effluent TP concentrations are 4 to 6 mg P/L.

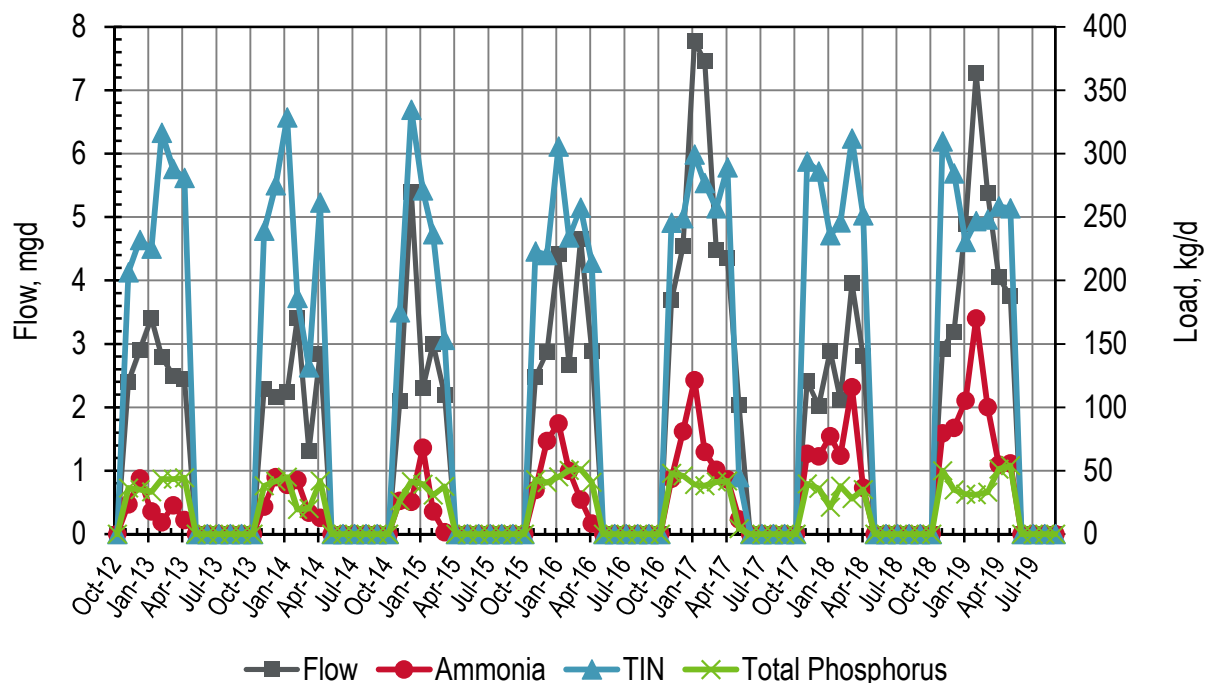


Figure 11-1. Las Gallinas Monthly Flows and Loads

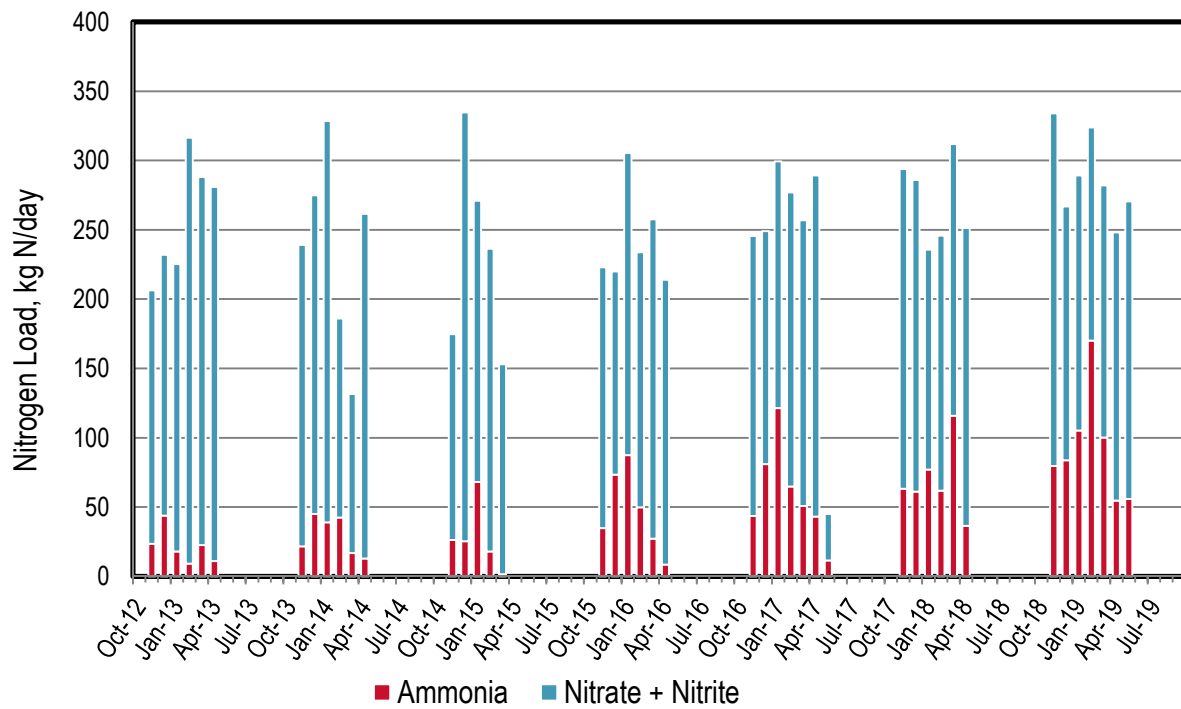


Figure 11-2. Las Gallinas Monthly Nitrogen Loads

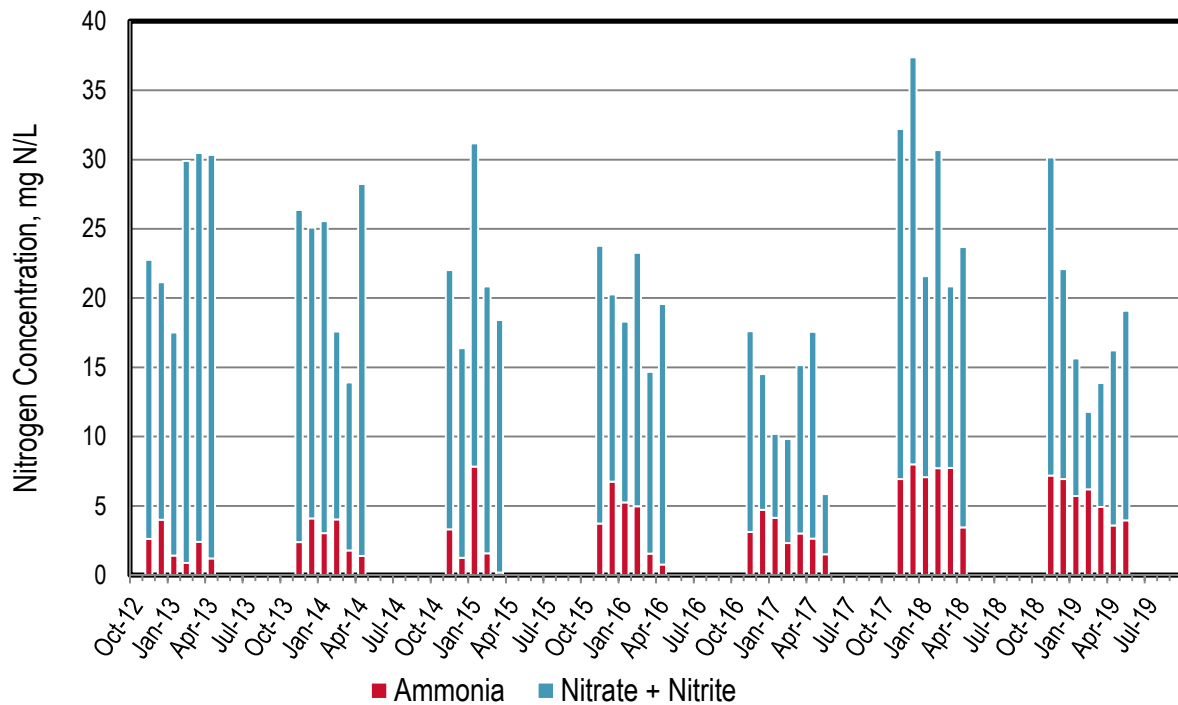


Figure 11-3. Las Gallinas Monthly Nitrogen Concentrations

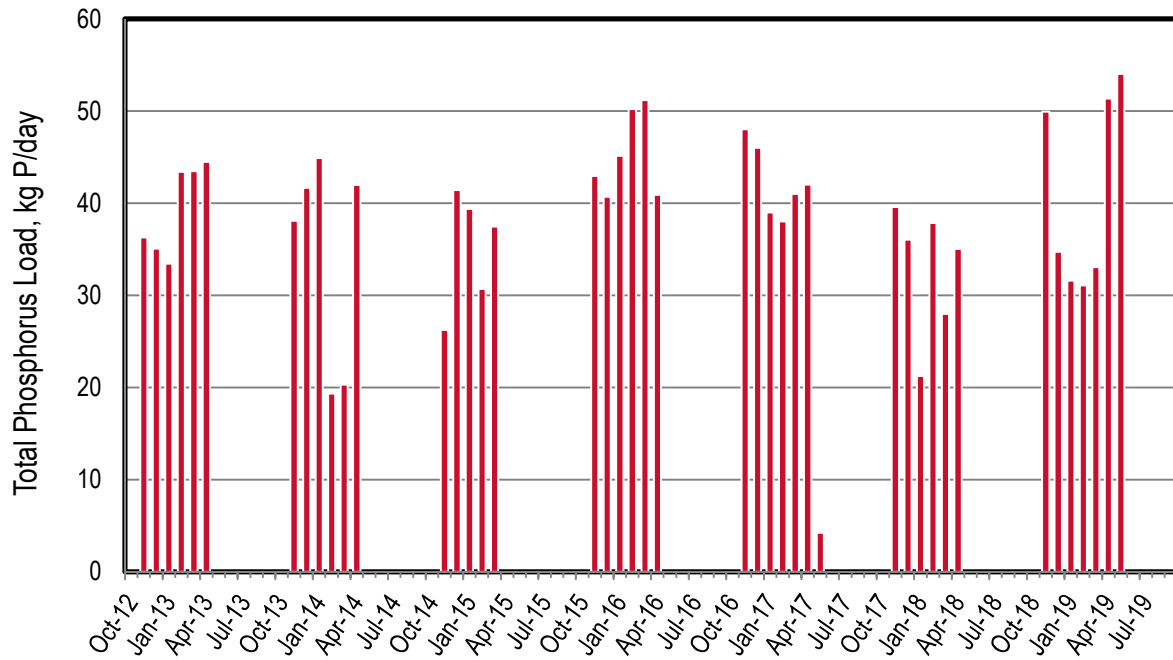


Figure 11-4. Las Gallinas Monthly Phosphorus Loads

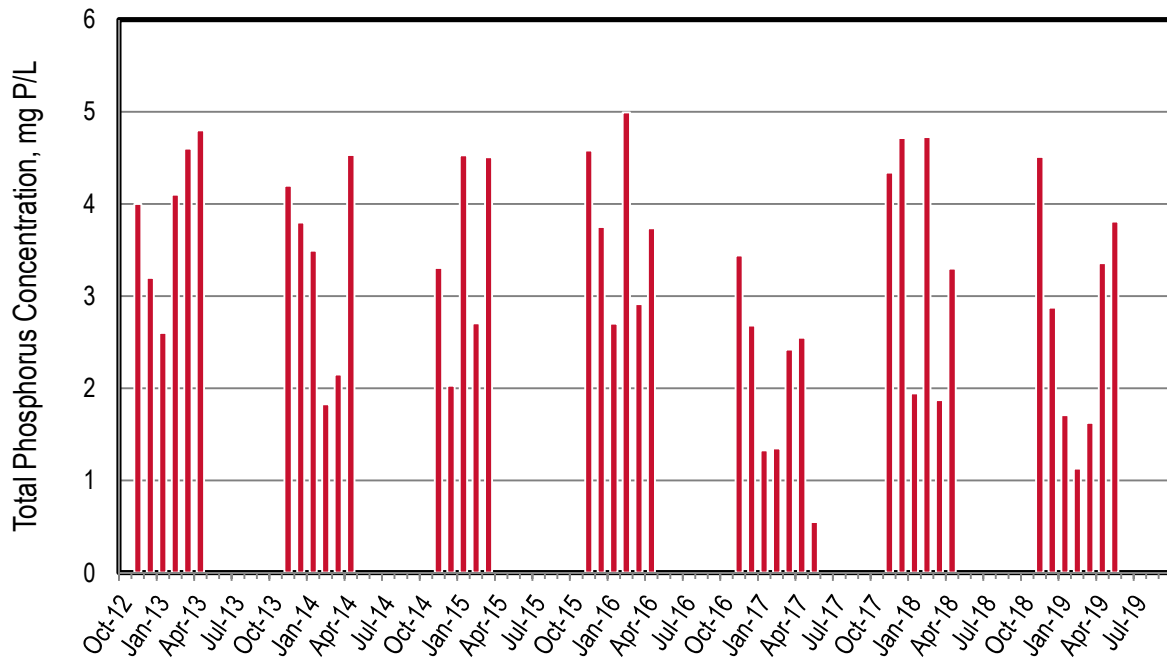


Figure 11-5. Las Gallinas Monthly Phosphorus Concentrations

Table 11-1. Las Gallinas Monthly Flows and Loads

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-12	0	0	0	0	0
Nov-12	2.40	23.6	183	206	36.3
Dec-12	2.90	43.8	188	232	35.1
Jan-13	3.40	18.0	207	225	33.4
Feb-13	2.80	9.21	307	316	43.4
Mar-13	2.50	22.7	265	288	43.5
Apr-13	2.45	11.1	270	281	44.5
May-13	0	0	0	0	0
Jun-13	0	0	0	0	0
Jul-13	0	0	0	0	0
Aug-13	0	0	0	0	0
Sep-13	0	0	0	0	0
Oct-13	0	0	0	0	0
Nov-13	2.29	21.6	217	239	38.1
Dec-13	2.16	44.9	230	275	41.6
Jan-14	2.24	38.9	289	328	44.9
Feb-14	3.41	42.5	144	186	19.3
Mar-14	1.31	16.8	115	132	20.3
Apr-14	2.85	12.9	249	262	42.0
May-14	0	0	0	0	0
Jun-14	0	0	0	0	0
Jul-14	0	0	0	0	0
Aug-14	0	0	0	0	0
Sep-14	0	0	0	0	0
Oct-14	0	0	0	0	0
Nov-14	2.10	26.2	149	175	26.2
Dec-14	5.40	25.4	309	335	41.4
Jan-15	2.30	68.1	203	271	39.4
Feb-15	3.00	17.9	218	236	30.7
Mar-15	2.20	1.60	152	153	37.5
Apr-15	0	0	0	0	0
May-15	0	0	0	0	0
Jun-15	0	0	0	0	0
Jul-15	0	0	0	0	0
Aug-15	0	0	0	0	0
Sep-15	0	0	0	0	0

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-15	0	0	0	0	0
Nov-15	2.48	34.8	188	223	42.9
Dec-15	2.87	73.3	147	220	40.7
Jan-16	4.42	87.4	218	305	45.1
Feb-16	2.66	49.8	184	234	50.2
Mar-16	4.65	27.2	230	257	51.2
Apr-16	2.89	8.42	206	214	40.9
May-16	0	0	0	0	0
Jun-16	0	0	0	0	0
Jul-16	0	0	0	0	0
Aug-16	0	0	0	0	0
Sep-16	0	0	0	0	0
Oct-16	0	0	0	0	0
Nov-16	3.69	43.6	202	246	48.0
Dec-16	4.54	81.0	168	249	46.0
Jan-17	7.77	121	178	299	39.0
Feb-17	7.45	64.9	212	277	38.0
Mar-17	4.48	50.8	206	257	41.0
Apr-17	4.36	43.3	246	289	42.0
May-17	2.04	11.6	33.3	44.9	4.22
Jun-17	0	0	0	0	0
Jul-17	0	0	0	0	0
Aug-17	0	0	0	0	0
Sep-17	0	0	0	0	0
Oct-17	0	0	0	0	0
Nov-17	2.41	63.2	231	294	39.6
Dec-17	2.02	61.2	225	286	36.0
Jan-18	2.89	77.1	159	236	21.2
Feb-18	2.12	61.7	184	246	37.8
Mar-18	3.96	116	196	312	28.0
Apr-18	2.81	36.5	215	251	35.0
May-18	0	0	0	0	0
Jun-18	0	0	0	0	0
Jul-18	0	0	0	0	0
Aug-18	0	0	0	0	0
Sep-18	0	0	0	0	0
Oct-18	0	0	0	0	0

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Nov-18	2.93	79.5	254	310	49.9
Dec-18	3.19	83.7	183	284	34.7
Jan-19	4.89	105	184	230	31.6
Feb-19	7.27	170	154	247	31.1
Mar-19	5.38	100	182	248	33.1
Apr-19	4.05	54.8	193	258	51.3
May-19	3.75	55.9	215	257	54.0
Jun-19	0	0	0	0	0
Jul-19	0	0	0	0	0
Aug-19	0	0	0	0	0
Sep-19	0	0	0	0	0
Dry Season Average	0.165	1.93	7.09	8.62	1.66
Dry Season Trend	--	--	--	--	--
Wet Season Average	2.90	43.7	172	212	32.1
Average Annual	1.76	26.3	103	128	19.4

* The Total Inorganic Nitrogen value is calculated by adding the "Ammonia" and "Nitrate + Nitrite" values.

** The dry season average is so much lower than the wet season due to only having one month with a dry season discharge (May 2017).

*** No dry season trending analysis was performed on Las Gallinas as there is only a single month of dry season discharge (May 2017) since sampling began in July 2012.

12 City of Millbrae

Millbrae discharges to the South Bay. The plant has approximately 6,500 service connections and it has a permitted capacity of 3.0 mgd ADWF. The current plant flows are approximately 1.4 mgd ADWF. The plant performs secondary treatment using an activated sludge process.

The following observations are made based upon the figures and table in the subsequent pages:

- ◆ Based on the table with the average monthly values, there appears to be an emerging dry season upward trend for ammonia and total inorganic nitrogen loads.
- ◆ Both nitrogen and phosphorus loads typically increase with flow during wet weather events. However, the loads typically stay elevated after the flows decline back to typical values.
- ◆ Ammonia is the majority of the nitrogen species discharged, regardless of season. This would be expected since this plant does not nitrify.
- ◆ Total phosphorus concentrations range from 0.5 to 4.7 mg P/L. This suggests occasional P removal as typical effluent TP concentrations are 4 to 6 mg P/L. The removal mechanism is thought to be the anaerobic selector in the activated sludge process.

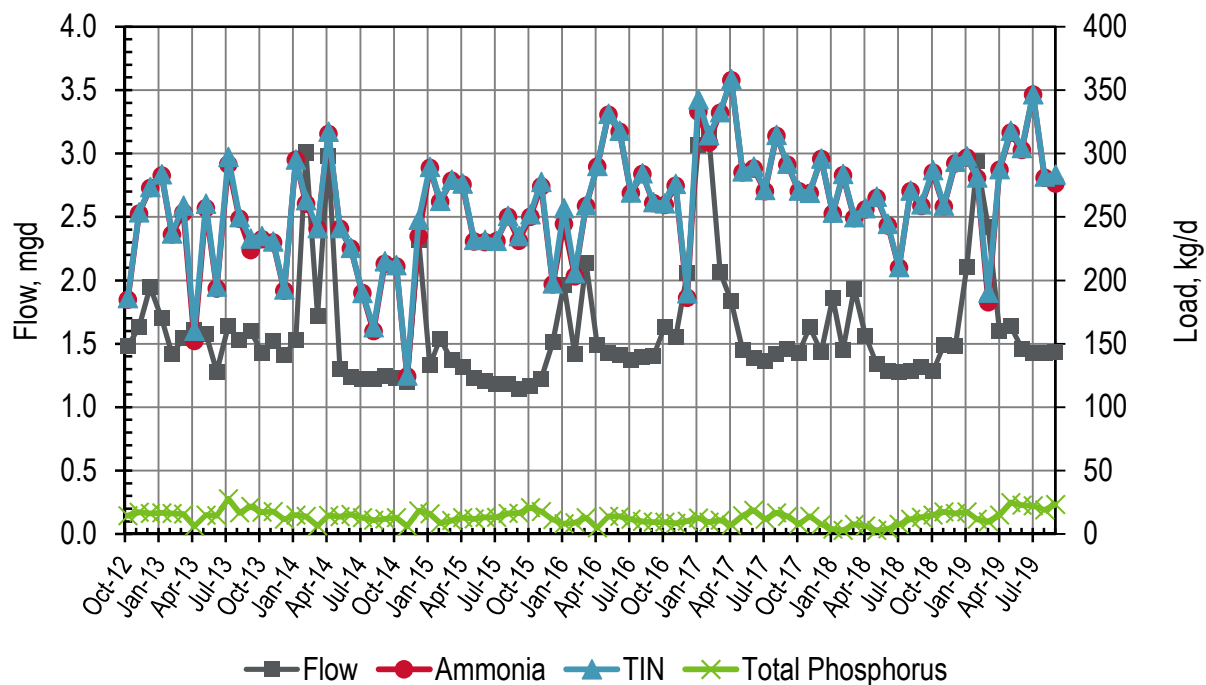


Figure 12-1. Millbrae Monthly Flows and Loads

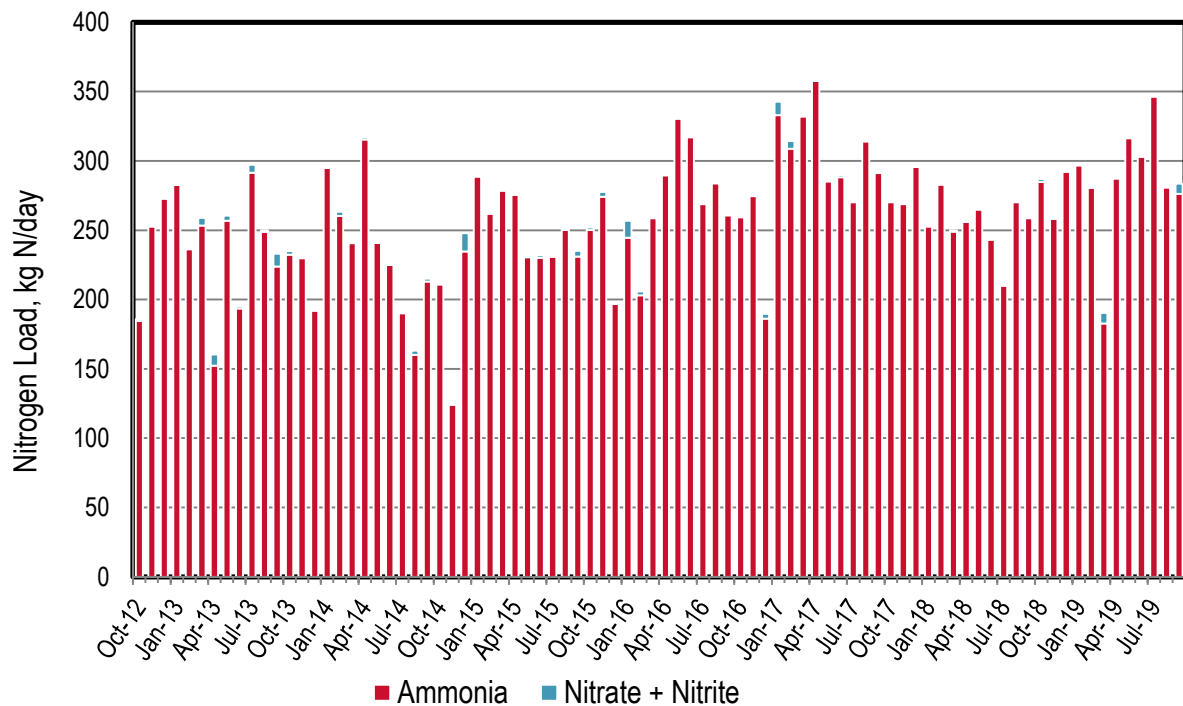


Figure 12-2. Millbrae Monthly Nitrogen Loads

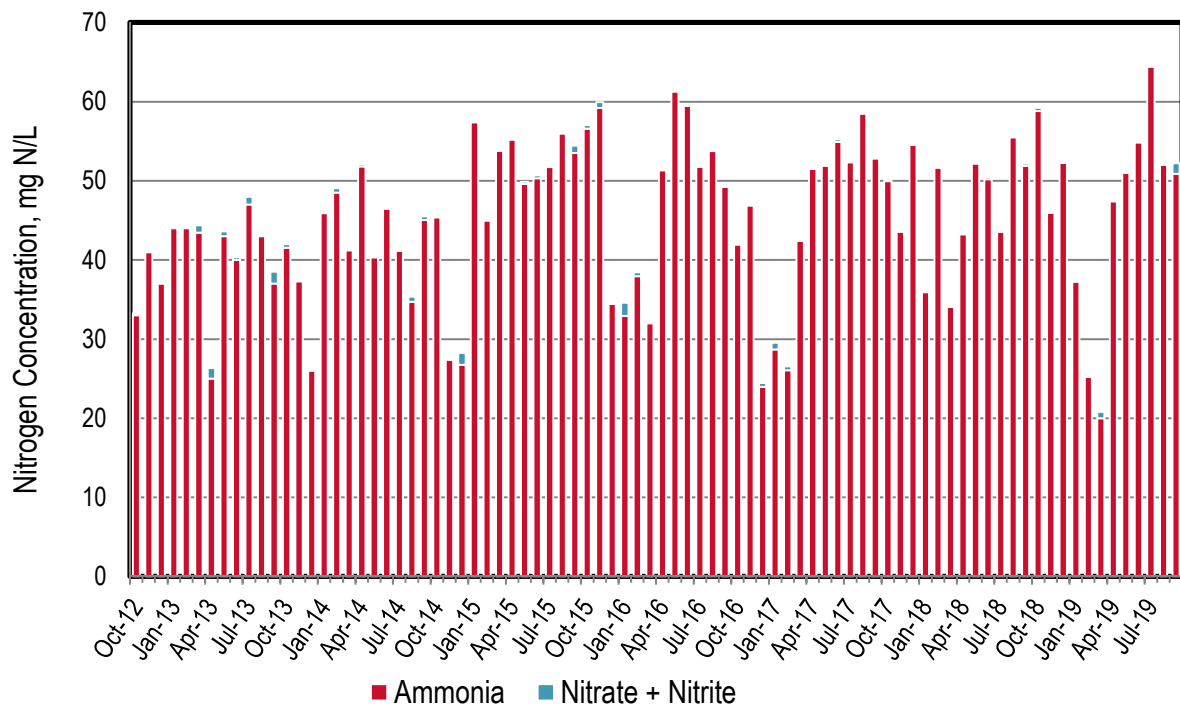


Figure 12-3. Millbrae Monthly Nitrogen Concentrations

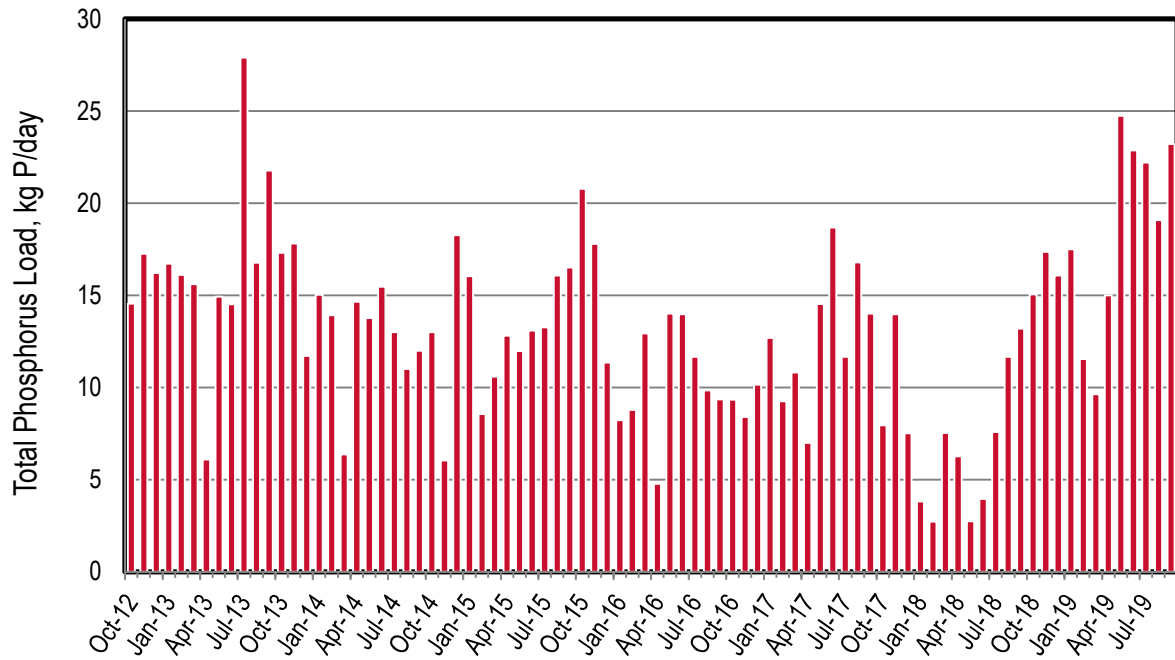


Figure 12-4. Millbrae Monthly Phosphorus Loads

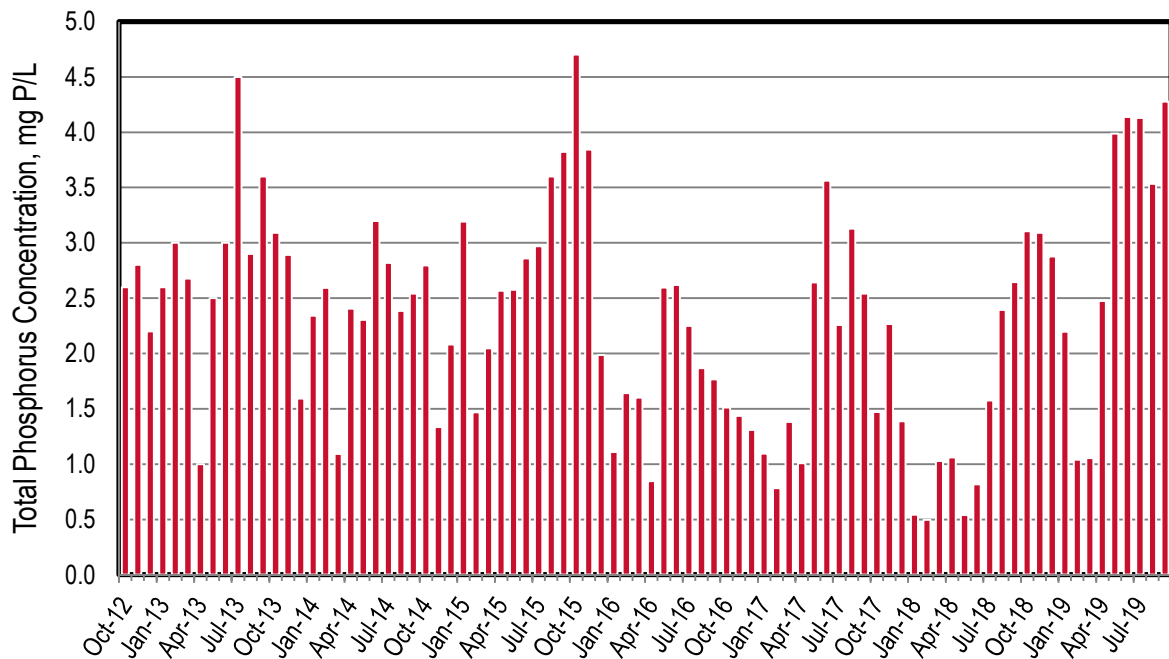


Figure 12-5. Millbrae Monthly Phosphorus Concentrations

Table 12-1. Millbrae Monthly Flows and Loads

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-12	1.48	185	1.40	186	14.5
Nov-12	1.63	253	1.11	254	17.3
Dec-12	1.95	273	0.855	274	16.2
Jan-13	1.70	283	0.945	284	16.7
Feb-13	1.42	236	0.896	237	16.1
Mar-13	1.54	253	5.46	259	15.6
Apr-13	1.61	152	8.23	160	6.09
May-13	1.58	257	3.72	261	14.9
Jun-13	1.28	194	1.55	195	14.5
Jul-13	1.64	291	5.95	297	27.9
Aug-13	1.53	249	1.15	250	16.8
Sep-13	1.60	224	9.19	233	21.8
Oct-13	1.43	232	2.43	235	17.3
Nov-13	1.52	230	0.718	231	17.8
Dec-13	1.41	192	0.933	193	11.7
Jan-14	1.53	295	0.197	295	15.0
Feb-14	3.01	260	2.96	263	13.9
Mar-14	1.72	241	0.592	241	6.37
Apr-14	2.98	315	1.72	317	14.6
May-14	1.30	241	0.457	241	13.8
Jun-14	1.24	225	0.502	225	15.5
Jul-14	1.22	190	0.0650	190	13.0
Aug-14	1.22	160	3.00	163	11.0
Sep-14	1.25	213	2.00	215	12.0
Oct-14	1.23	211	1.00	212	13.0
Nov-14	1.20	124	0.670	125	6.05
Dec-14	2.32	235	13.0	248	18.3
Jan-15	1.33	289	0.750	289	16.0
Feb-15	1.54	262	0.690	263	8.55
Mar-15	1.37	279	0.780	279	10.6
Apr-15	1.32	276	0.900	276	12.8
May-15	1.23	231	1.33	232	12.0
Jun-15	1.21	230	1.76	232	13.1
Jul-15	1.18	231	0.0856	231	13.3
Aug-15	1.18	250	0.715	251	16.1
Sep-15	1.14	231	4.00	235	16.5

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-15	1.17	250	1.91	252	20.8
Nov-15	1.22	274	3.46	277	17.8
Dec-15	1.51	197	0.644	197	11.4
Jan-16	1.96	245	12.4	257	8.24
Feb-16	1.42	203	2.63	206	8.78
Mar-16	2.14	259	0.600	259	12.9
Apr-16	1.49	290	0.738	290	4.77
May-16	1.43	331	0.672	331	14.0
Jun-16	1.41	317	0.753	318	14.0
Jul-16	1.37	269	0.492	269	11.7
Aug-16	1.40	284	0.510	284	9.85
Sep-16	1.40	261	0.935	262	9.35
Oct-16	1.63	259	1.40	261	9.33
Nov-16	1.55	275	1.46	276	8.40
Dec-16	2.05	186	3.55	190	10.2
Jan-17	3.07	333	9.52	343	12.7
Feb-17	3.13	309	5.66	314	9.26
Mar-17	2.07	332	0.440	332	10.8
Apr-17	1.84	358	0.874	359	7.00
May-17	1.45	285	0.778	286	14.5
Jun-17	1.39	288	1.55	290	18.7
Jul-17	1.37	270	0.954	271	11.7
Aug-17	1.42	314	0.595	315	16.8
Sep-17	1.46	291	0.560	292	14.0
Oct-17	1.43	270	0.472	271	7.95
Nov-17	1.63	269	0.349	269	14.0
Dec-17	1.43	296	0.296	296	7.53
Jan-18	1.86	253	0.699	253	3.82
Feb-18	1.45	283	1.07	284	2.72
Mar-18	1.93	249	0.811	250	7.53
Apr-18	1.57	256	0.888	257	6.27
May-18	1.34	265	0.899	266	2.74
Jun-18	1.28	243	1.38	245	3.96
Jul-18	1.28	210	0.581	210	7.59
Aug-18	1.29	270	0.435	271	11.7
Sep-18	1.32	259	1.32	260	13.2
Oct-18	1.28	285	1.99	287	15.0

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Nov-18	1.49	258	0.751	259	17.4
Dec-18	1.48	292	1.31	294	16.1
Jan-19	2.11	297	0.989	298	17.5
Feb-19	2.94	281	0.611	281	11.6
Mar-19	2.42	183	7.48	190	9.64
Apr-19	1.60	287	0.500	288	15.0
May-19	1.64	316	1.44	318	24.7
Jun-19	1.46	303	1.49	304	22.9
Jul-19	1.42	346	0.417	347	22.2
Aug-19	1.43	281	1.06	282	19.1
Sep-19	1.44	276	7.18	283	23.2
Dry Season Average	1.37	260	1.70	262	14.8
Dry Season Trend	None	Up	None	Up	None
Wet Season Average	1.76	257	2.24	259	12.0
Average Annual	1.59	258	2.01	260	13.2

* The Total Inorganic Nitrogen value is calculated by adding the "Ammonia" and "Nitrate + Nitrite" values.

** Refer to the Section 3.5 in the main body for a description on the statistical analysis.

13 Mt. View Sanitary District

Mt. View Sanitary District discharges to Suisun Bay. The plant has approximately 10,500 service connections; it has a permitted capacity of 3.2 mgd ADFW and a peak wet weather capacity of 8.5 mgd. The current flow is 1.3 mgd ADFW. The plant performs nitrification using a series of trickling filters.

The following observations are made based upon the figures and table in the subsequent pages:

- ◆ Both nitrogen and phosphorus loads typically increase with flow during wet weather events.
- ◆ Wet season nitrogen loads are greater and more variable than the dry season loads.
- ◆ NO_x is the majority of the nitrogen species discharged as would be expected since this plant nitrifies. A portion of ammonia bleeds through during the colder months. This increases the ammonia contribution during such months.
- ◆ Based on average monthly values, there appears to be a downward dry season trend for Total Phosphorus loads, and an upward trend for flows and all reported nitrogen species.
- ◆ Total phosphorus concentrations range from 0.6 to 6.2 mg P/L, which suggests occasional P removal as typical effluent TP concentrations are 4 to 6 mg P/L.

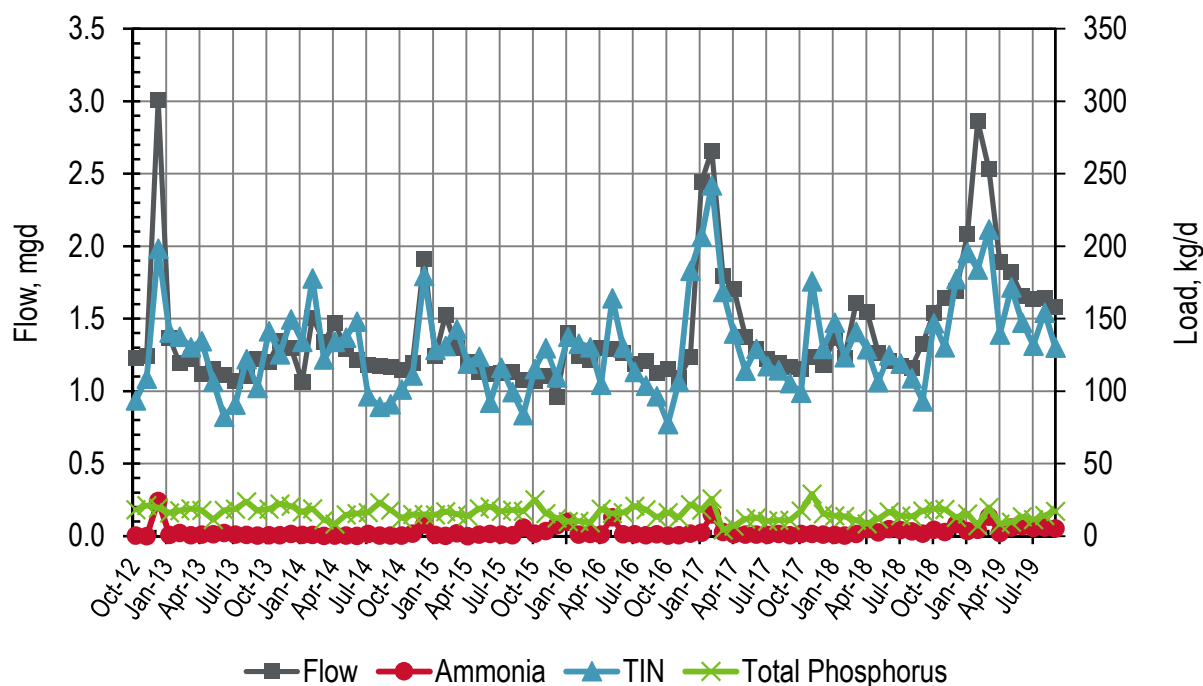


Figure 13-1. Mt. View Sanitary District Monthly Flows and Loads

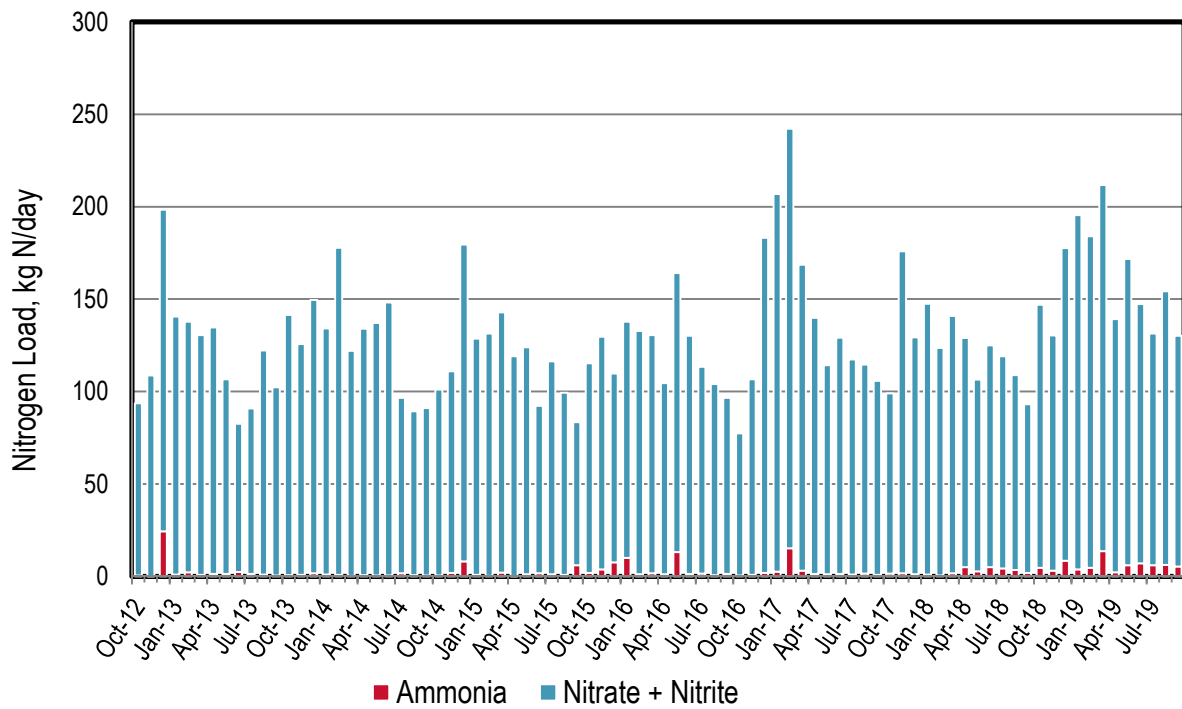


Figure 13-2. Mt. View Sanitary District Monthly Nitrogen Loads

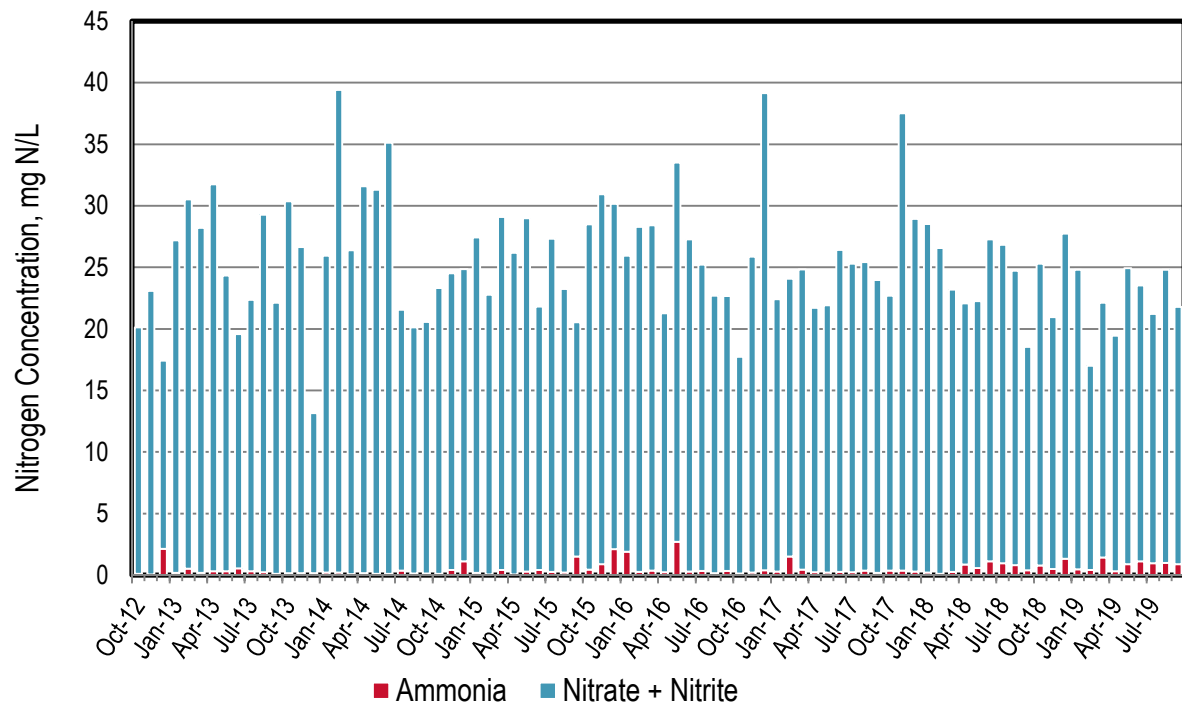


Figure 13-3. Mt. View Sanitary District Monthly Nitrogen Concentrations

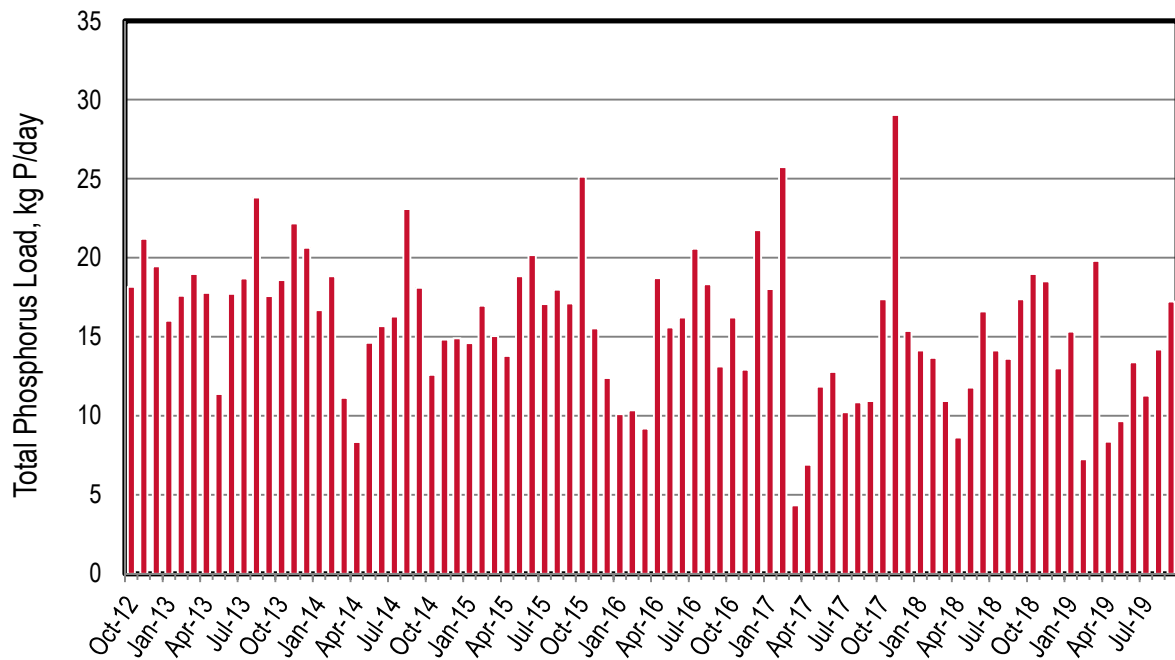


Figure 13-4. Mt. View Sanitary District Monthly Phosphorus Loads

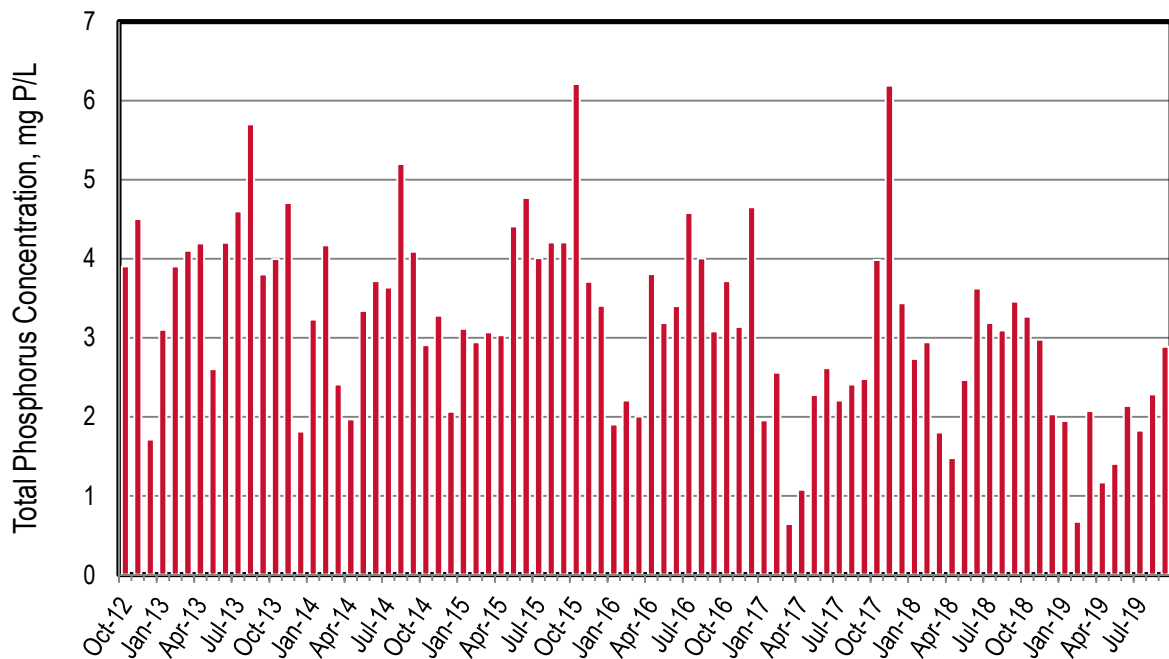


Figure 13-5. Mt. View Sanitary District Monthly Phosphorus Concentrations

Table 13-1. Mt. View Sanitary District Monthly Flows and Loads

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-12	1.23	0.461	93.2	93.7	18.2
Nov-12	1.25	0.189	109	109	21.2
Dec-12	3.01	24.3	174	198	19.5
Jan-13	1.37	0.982	140	141	16.0
Feb-13	1.19	2.30	135	138	17.6
Mar-13	1.22	0.879	130	130	19.0
Apr-13	1.12	1.34	133	135	17.8
May-13	1.16	1.40	105	107	11.4
Jun-13	1.12	2.32	80.2	82.6	17.7
Jul-13	1.08	1.30	89.6	90.9	18.7
Aug-13	1.11	1.00	121	122	23.8
Sep-13	1.22	0.509	102	102	17.6
Oct-13	1.20	0.680	141	141	18.6
Nov-13	1.35	0.771	125	126	22.2
Dec-13	1.30	1.77	148	150	20.6
Jan-14	1.07	1.03	133	134	16.7
Feb-14	1.51	0.913	177	178	18.8
Mar-14	1.34	0.334	122	122	11.1
Apr-14	1.47	0.611	133	134	8.33
May-14	1.29	0.483	137	137	14.6
Jun-14	1.22	0.457	148	148	15.7
Jul-14	1.19	1.67	94.9	96.6	16.3
Aug-14	1.17	0.620	88.8	89.4	23.1
Sep-14	1.17	0.540	90.6	91.1	18.1
Oct-14	1.15	0.460	101	101	12.6
Nov-14	1.20	1.94	109	111	14.8
Dec-14	1.91	8.07	171	180	14.9
Jan-15	1.24	0.910	128	129	14.6
Feb-15	1.53	0.370	131	131	17.0
Mar-15	1.30	2.01	141	143	15.1
Apr-15	1.20	0.190	119	119	13.8
May-15	1.13	1.19	123	124	18.8
Jun-15	1.12	1.72	90.6	92.3	20.2
Jul-15	1.13	1.15	115	116	17.1
Aug-15	1.13	0.899	98.5	99.4	18.0
Sep-15	1.08	6.11	77.4	83.5	17.1

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-15	1.07	1.82	114	115	25.1
Nov-15	1.11	3.74	126	130	15.5
Dec-15	0.963	7.66	102	110	12.4
Jan-16	1.41	10.1	128	138	10.1
Feb-16	1.24	1.18	132	133	10.3
Mar-16	1.22	1.70	129	130	9.20
Apr-16	1.30	1.18	103	105	18.7
May-16	1.30	13.2	151	164	15.6
Jun-16	1.26	1.39	129	130	16.2
Jul-16	1.19	1.52	112	113	20.6
Aug-16	1.21	0.715	103	104	18.3
Sep-16	1.13	1.44	95.2	96.6	13.1
Oct-16	1.15	0.555	76.8	77.3	16.2
Nov-16	1.09	0.861	106	107	12.9
Dec-16	1.24	1.81	181	183	21.7
Jan-17	2.44	2.52	204	207	18.0
Feb-17	2.66	15.1	227	242	25.7
Mar-17	1.80	3.03	166	169	4.35
Apr-17	1.70	1.45	138	140	6.92
May-17	1.38	1.13	113	114	11.8
Jun-17	1.29	1.33	128	129	12.8
Jul-17	1.23	1.07	116	117	10.2
Aug-17	1.19	1.58	113	115	10.8
Sep-17	1.17	0.831	105	106	10.9
Oct-17	1.15	1.61	97.4	99.0	17.4
Nov-17	1.24	1.74	174	176	29.0
Dec-17	1.18	1.24	128	129	15.4
Jan-18	1.37	1.06	146	147	14.1
Feb-18	1.23	0.501	123	124	13.7
Mar-18	1.61	1.64	139	141	10.9
Apr-18	1.55	5.06	124	129	8.62
May-18	1.26	2.69	104	106	11.8
Jun-18	1.21	5.07	120	125	16.6
Jul-18	1.17	4.24	115	119	14.1
Aug-18	1.17	3.51	105	109	13.6
Sep-18	1.33	1.95	91.2	93.1	17.4
Oct-18	1.54	4.57	142	147	19.0

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Nov-18	1.65	3.07	127	130	18.5
Dec-18	1.69	8.45	169	178	13.0
Jan-19	2.09	3.76	192	195	15.3
Feb-19	2.86	4.61	179	184	7.26
Mar-19	2.53	13.6	198	212	19.8
Apr-19	1.89	2.28	137	139	8.36
May-19	1.82	6.01	166	172	9.67
Jun-19	1.66	7.02	140	147	13.4
Jul-19	1.64	5.96	125	131	11.3
Aug-19	1.65	6.17	148	154	14.2
Sep-19	1.58	5.35	125	130	17.2
Dry Season Average	1.26	2.67	113	116	15.7
Dry Season Trend	Up	Up	Up	Up	Down
Wet Season Average	1.49	3.19	139	142	15.6
Average Annual	1.40	2.98	128	131	15.6

* The Total Inorganic Nitrogen value is calculated by adding the "Ammonia" and "Nitrate + Nitrite" values.

** Refer to the Section 3.5 in the main body for a description on the statistical analysis.

14 Napa Sanitation District

Napa Sanitation District discharges to the Napa River that is connected to San Pablo Bay. The plant has a permitted capacity of 15.4 mgd ADWF. The plant performs nitrogen removal using a step-feed activated sludge process with anoxic zones coupled with oxidation ponds which also serves as equalization during peak flow. Discharge is prohibited July 1 through September 30.

The following observations are made based upon the figures and table in the subsequent pages:

- ◆ There are no emerging dry season trends as Napa has only discharged for a portion of two dry season months (May and June 2014) since sampling began in 2012.
- ◆ Both nitrogen and phosphorus loads generally increase with flow during wet weather events.
- ◆ NO_x is the majority of the nitrogen discharged as the Activated Sludge system is operated to nitrify. During the wet season months partially nitrified pond effluent may be clarified then comingled with nitrified Activated Sludge effluent prior to discharge which may increase the ammonia levels during such months.
- ◆ Based on average monthly values, the plant discharge currently meets Level 2 TIN limits (i.e., 15 mg N/L) developed under the Scoping and Evaluation Plan.
- ◆ The plant discharge average monthly total phosphorus concentrations ranging from 0.3 to 3.3 mg P/L. This suggests a portion of P is removed as typical influent TP concentrations are 4 to 6 mg P/L. The removal mechanism is most likely from ferric chloride addition.

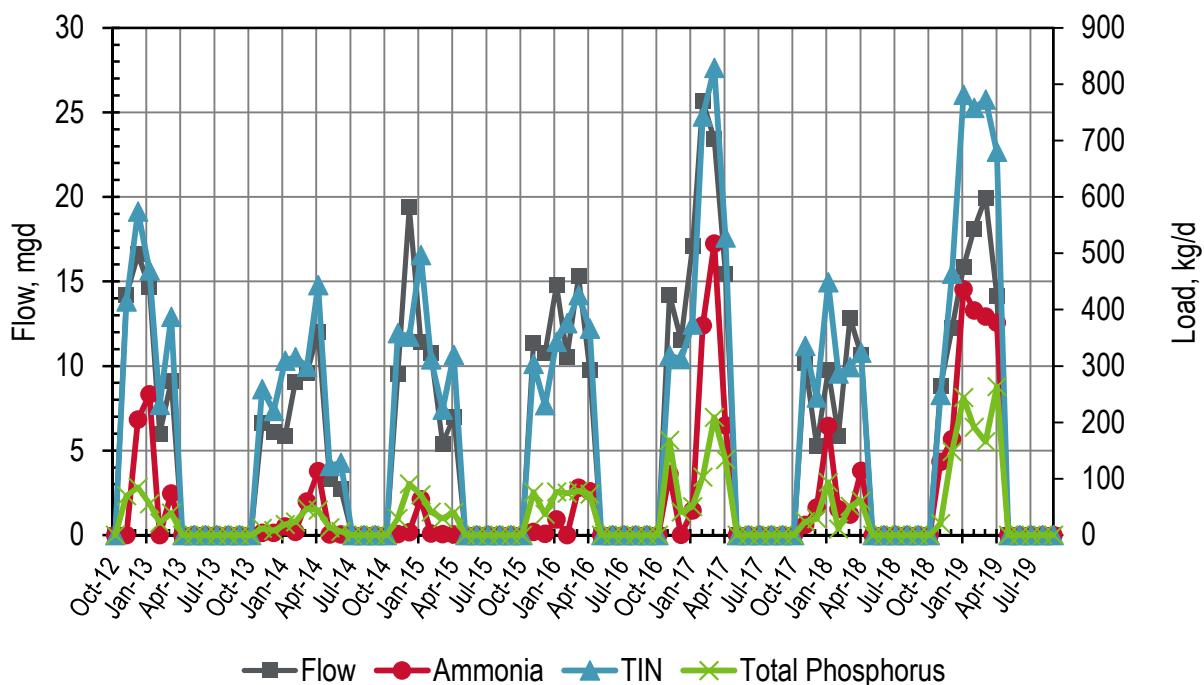


Figure 14-1. Napa Sanitation District Monthly Flows and Loads

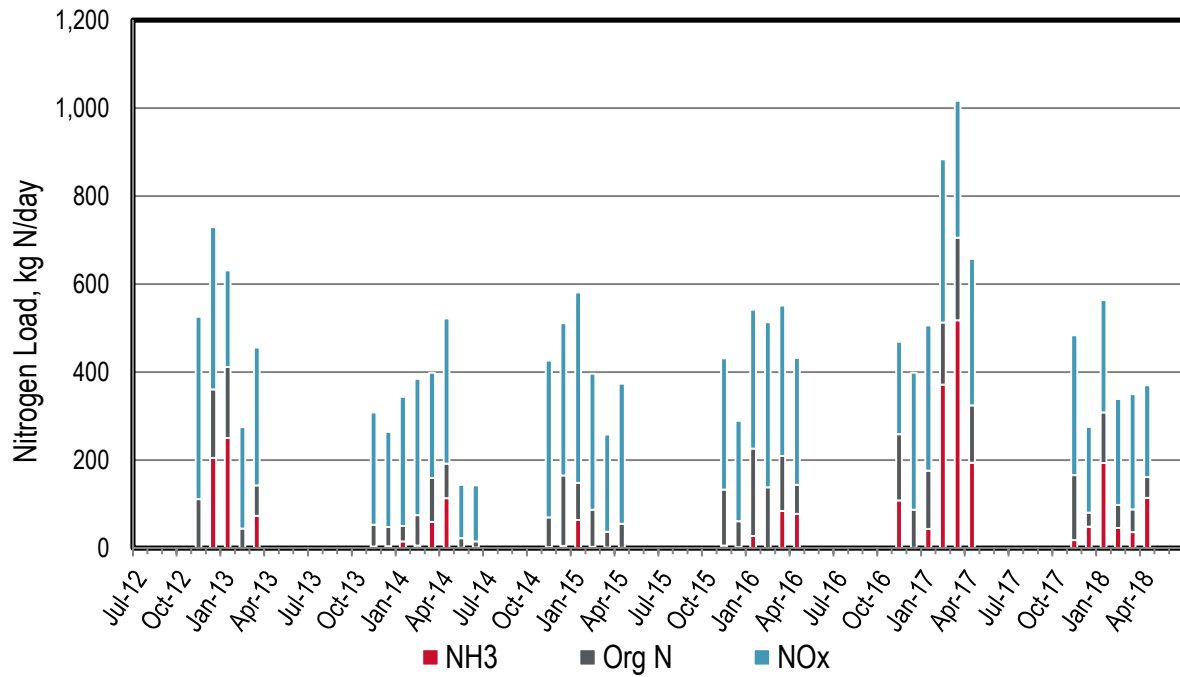


Figure 14-2. Napa Sanitation District Monthly Nitrogen Loads

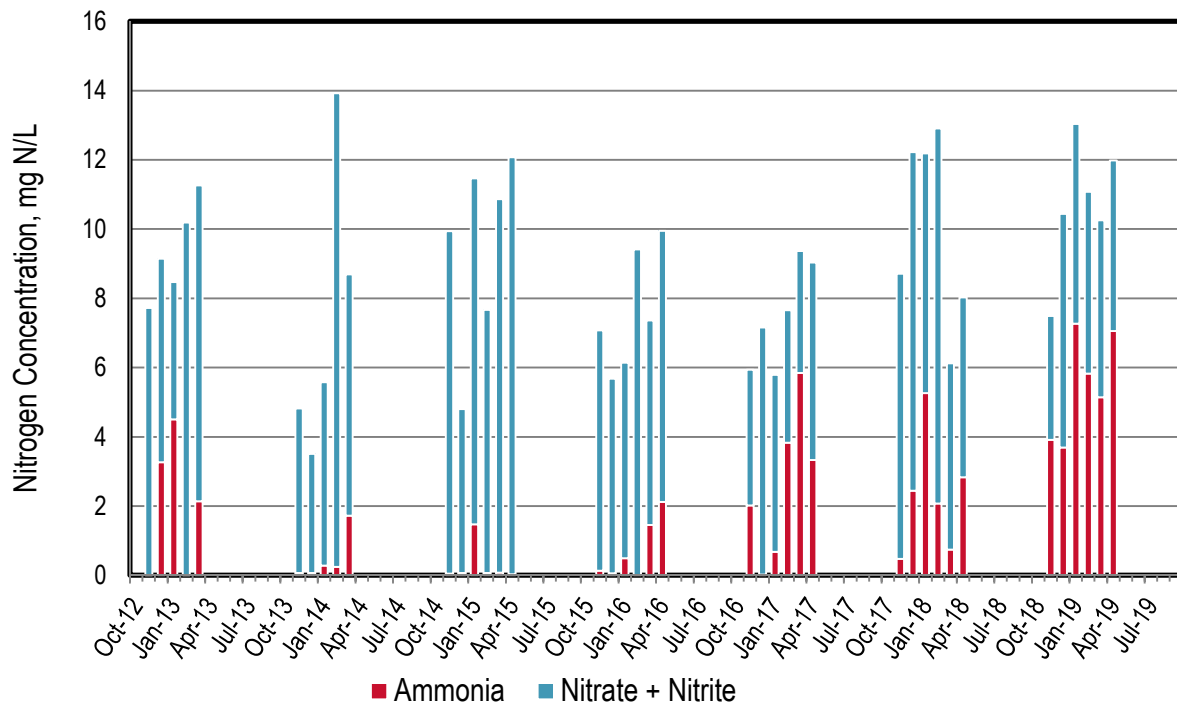


Figure 14-3. Napa Sanitation District Monthly Nitrogen Concentrations

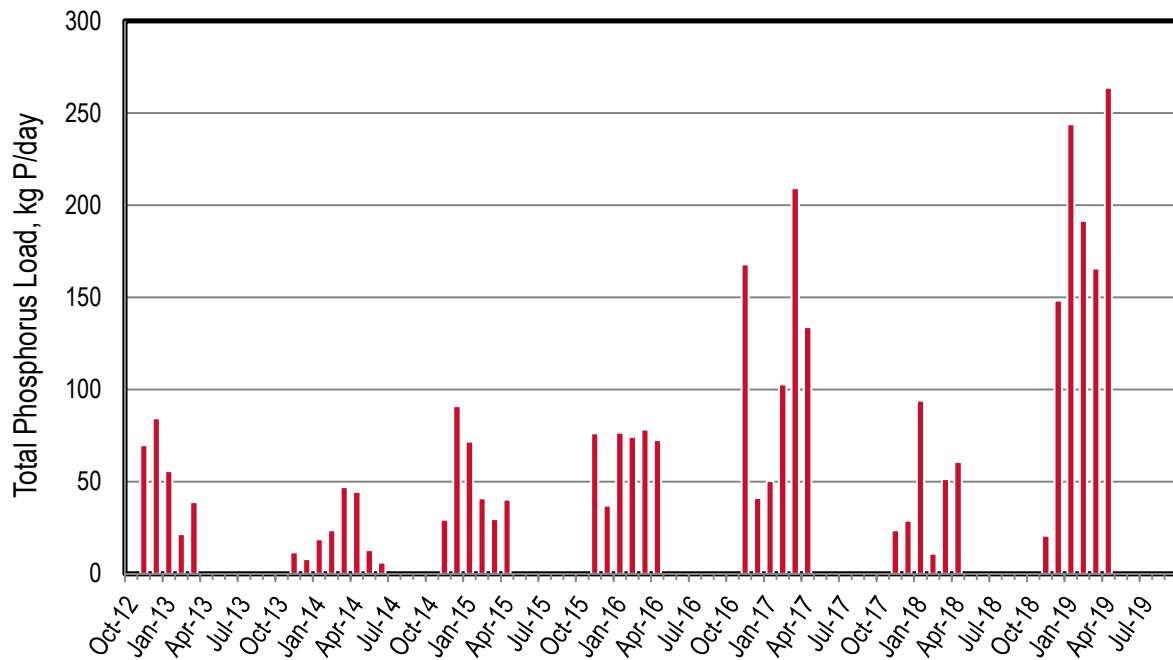


Figure 14-4. Napa Sanitation District Monthly Phosphorus Loads

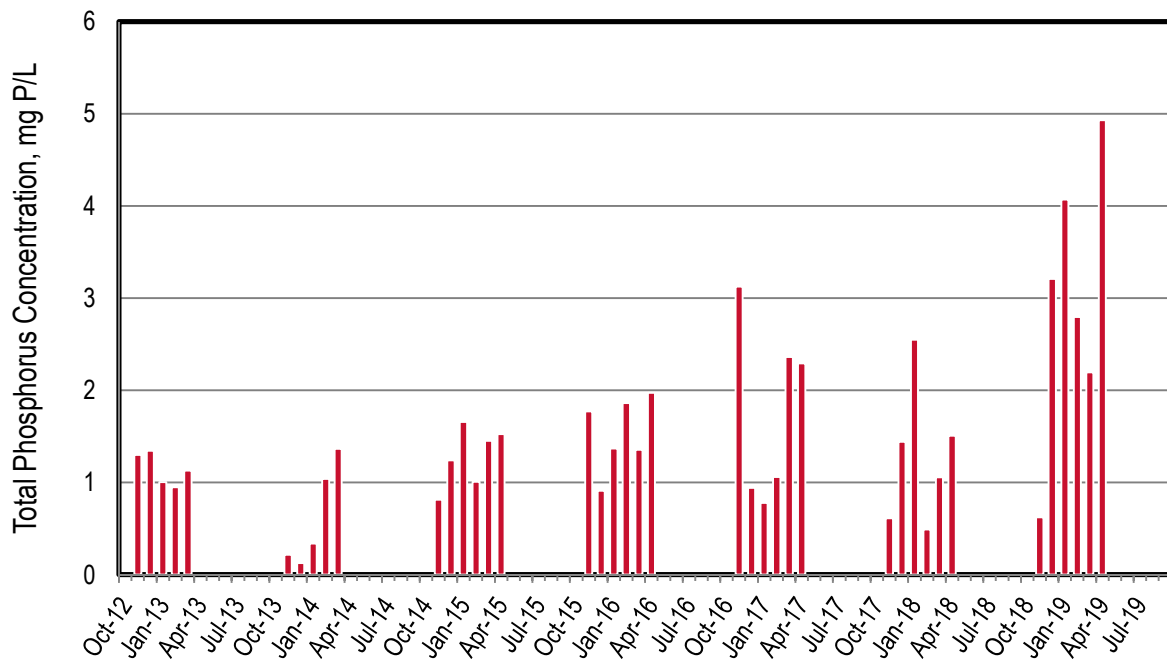


Figure 14-5. Napa Sanitation District Monthly Phosphorus Concentrations

Table 14-1. Napa Sanitation District Monthly Flows and Loads

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-12	0	0	0	0	0
Nov-12	14.2	0.268	414	415	69.8
Dec-12	16.6	205	369	574	84.4
Jan-13	14.7	250	220	470	55.8
Feb-13	5.99	0.113	231	231	21.5
Mar-13	9.10	73.6	314	387	38.9
Apr-13	0	0	0	0	0
May-13	0	0	0	0	0
Jun-13	0	0	0	0	0
Jul-13	0	0	0	0	0
Aug-13	0	0	0	0	0
Sep-13	0	0	0	0	0
Oct-13	0	0	0	0	0
Nov-13	6.61	3.77	255	259	11.6
Dec-13	6.08	4.25	216	220	8.04
Jan-14	5.85	15.4	294	309	18.7
Feb-14	9.09	5.49	310	315	23.5
Mar-14	9.60	59.3	239	299	47.0
Apr-14	12.0	113	330	443	44.5
May-14	3.30	0.988	122	122	12.8
Jun-14	2.70	1.09	127	128	6.06
Jul-14	0	0	0	0	0
Aug-14	0	0	0	0	0
Sep-14	0	0	0	0	0
Oct-14	0	0	0	0	0
Nov-14	9.53	1.91	356	358	29.3
Dec-14	19.4	5.30	347	352	91.0
Jan-15	11.5	63.8	433	497	71.8
Feb-15	10.8	2.73	309	312	41.1
Mar-15	5.42	1.51	221	223	29.8
Apr-15	7.00	0.900	319	319	40.4
May-15	0	0	0	0	0
Jun-15	0	0	0	0	0
Jul-15	0	0	0	0	0
Aug-15	0	0	0	0	0
Sep-15	0	0	0	0	0

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-15	0	0	0	0	0
Nov-15	11.4	5.66	298	304	76.1
Dec-15	10.7	2.26	228	231	37.0
Jan-16	14.8	27.7	315	343	76.5
Feb-16	10.6	0	376	376	74.3
Mar-16	15.3	84.3	342	426	78.3
Apr-16	9.74	78.1	288	366	72.6
May-16	0	0	0	0	0
Jun-16	0	0	0	0	0
Jul-16	0	0	0	0	0
Aug-16	0	0	0	0	0
Sep-16	0	0	0	0	0
Oct-16	0	0	0	0	0
Nov-16	14.2	109	210	319	168
Dec-16	11.5	0.778	311	312	41.1
Jan-17	17.1	43.5	330	374	50.3
Feb-17	25.7	372	371	743	103
Mar-17	23.4	517	311	829	209
Apr-17	15.4	194	333	528	134
May-17	0	0	0	0	0
Jun-17	0	0	0	0	0
Jul-17	0	0	0	0	0
Aug-17	0	0	0	0	0
Sep-17	0	0	0	0	0
Oct-17	0	0	0	0	0
Nov-17	10.2	18.1	317	336	23.6
Dec-17	5.29	48.8	195	244	28.8
Jan-18	9.74	194	255	449	93.9
Feb-18	5.88	46.1	241	287	10.9
Mar-18	12.9	36.3	262	298	51.4
Apr-18	10.7	114	209	323	60.7
May-18	0	0	0	0	0
Jun-18	0	0	0	0	0
Jul-18	0	0	0	0	0
Aug-18	0	0	0	0	0
Sep-18	0	0	0	0	0
Oct-18	0	0	0	0	0

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Nov-18	8.79	130	119	249	20.7
Dec-18	12.2	171	312	464	148
Jan-19	15.9	436	345	781	244
Feb-19	18.1	399	359	758	191
Mar-19	19.9	388	385	772	166
Apr-19	14.1	377	263	680	264
May-19	0	0	0	0	0
Jun-19	0	0	0	0	0
Jul-19	0	0	0	0	0
Aug-19	0	0	0	0	0
Sep-19	0	0	0	0	0
Dry Season Average	0.171	0.0593	7.10	7.16	0.539
Dry Season Trend**	--	--	--	--	--
Wet Season Average	10.1	93.8	248	342	64.3
Average Annual	5.99	54.8	148	203	37.7

* The Total Inorganic Nitrogen value is calculated by adding the "Ammonia" and "Nitrate + Nitrite" values.

** No dry season trending analysis was performed on Napa as there are only two months (May and June 2014) that discharged since sampling began in 2012.

15 Novato Sanitary District

Novato discharges to San Pablo Bay. The plant has approximately 28,500 service connections; it has a permitted capacity of 7.0 mgd ADWF and a peak wet weather capacity of 47 mgd. The plant performs nitrogen removal using activated sludge. Discharge is prohibited June 1 through August 31, unless (1) facility inflow will exceed the capacity of influent storage (after factoring in anticipated wet weather storage needs), and facility effluent flow will exceed the capacity of the reclamation water distribution and storage system to meet reclaimed water demand (e.g., June 2017); and (2) the discharge meets the advanced treatment limits specified in the permit. The discharge will increase to year-round if Novato begins discharging to a new wetland adjacent to San Pablo Bay as noted in their current permit.

The following observations are made based upon the figures and table in the subsequent pages:

- ◆ There are no emerging dry season trends as Novato does not typically discharge during the dry season.
- ◆ Wet season trends were analyzed (data not shown) and there are no emerging trends.
- ◆ Both nitrogen and phosphorus loads typically increase with flow during wet weather events.
- ◆ NO_x is the majority of the nitrogen species discharged as would be expected since this plant nitrifies. A portion of ammonia bleeds through during the colder months. This increases the ammonia contribution during such months.
- ◆ The plant nearly meets Level 2 TIN concentration limits (i.e., 15 mg N/L) developed under the Scoping and Evaluation Plan with values reliably less than 22 mg N/L.
- ◆ Total phosphorus concentrations range from 0.1 to 3.2 mg P/L. This suggests a portion of P is removed as typical effluent TP concentrations for similar treatment plants are 4 to 6 mg P/L. The removal mechanism might be attributed to a combination of ferric chloride addition to the digester influent and/or biological P removal.

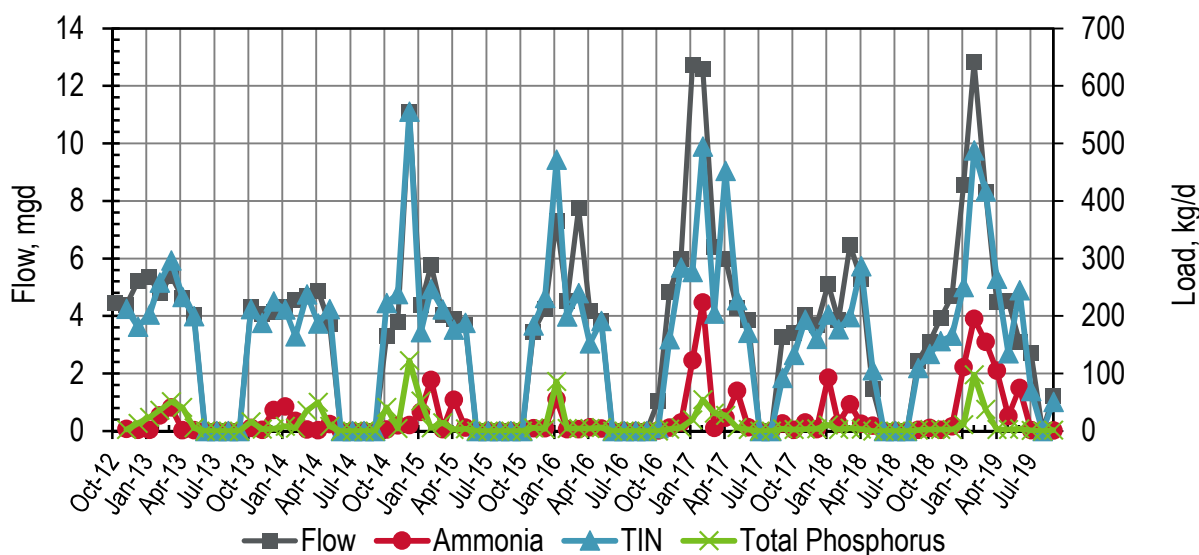


Figure 15-1. Novato Monthly Flows and Loads

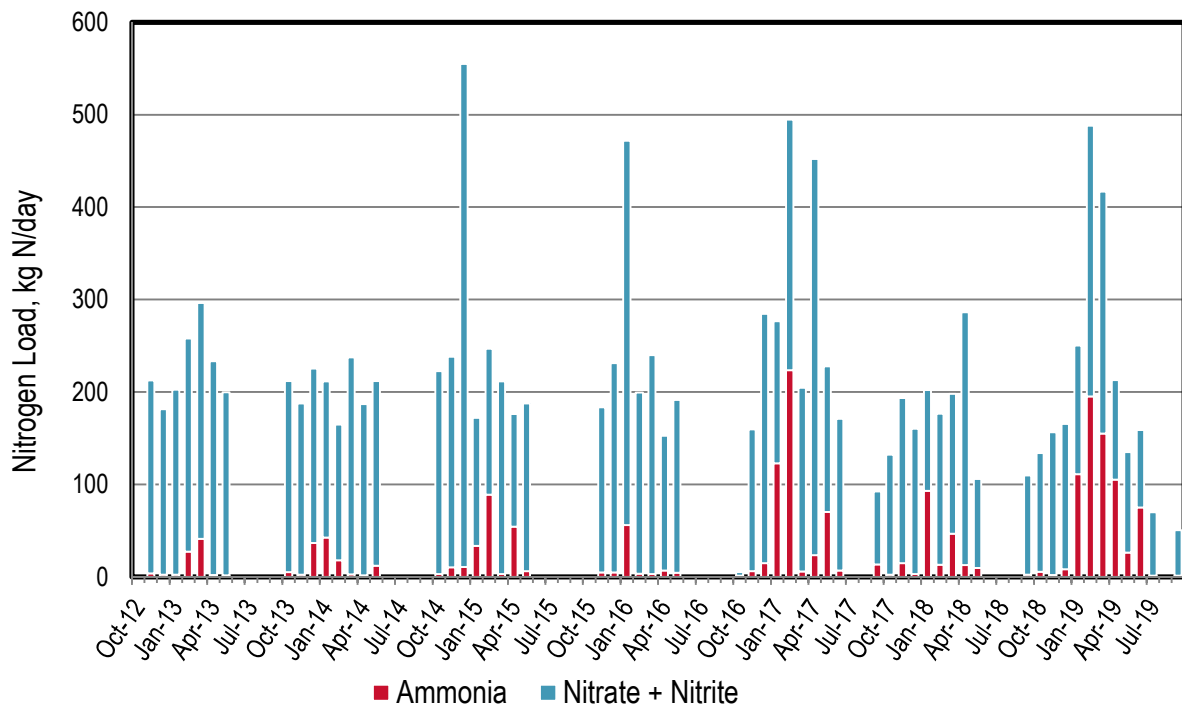


Figure 15-2. Novato Monthly Nitrogen Loads

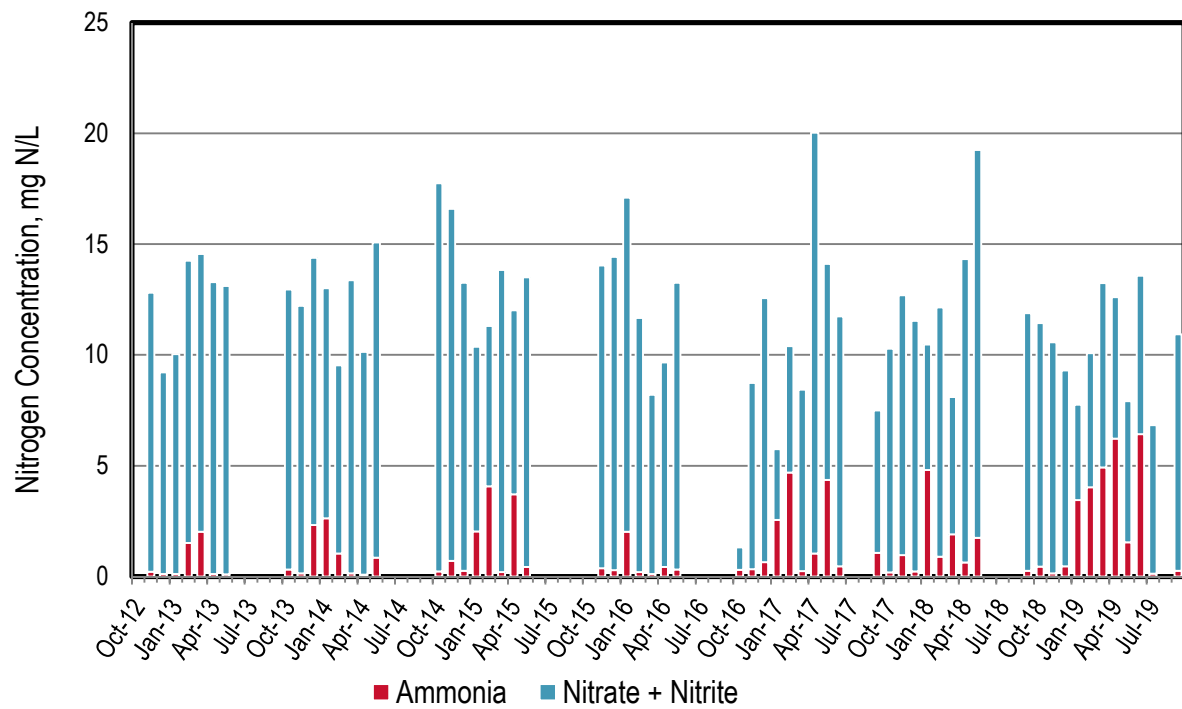


Figure 15-3. Novato Monthly Nitrogen Concentrations

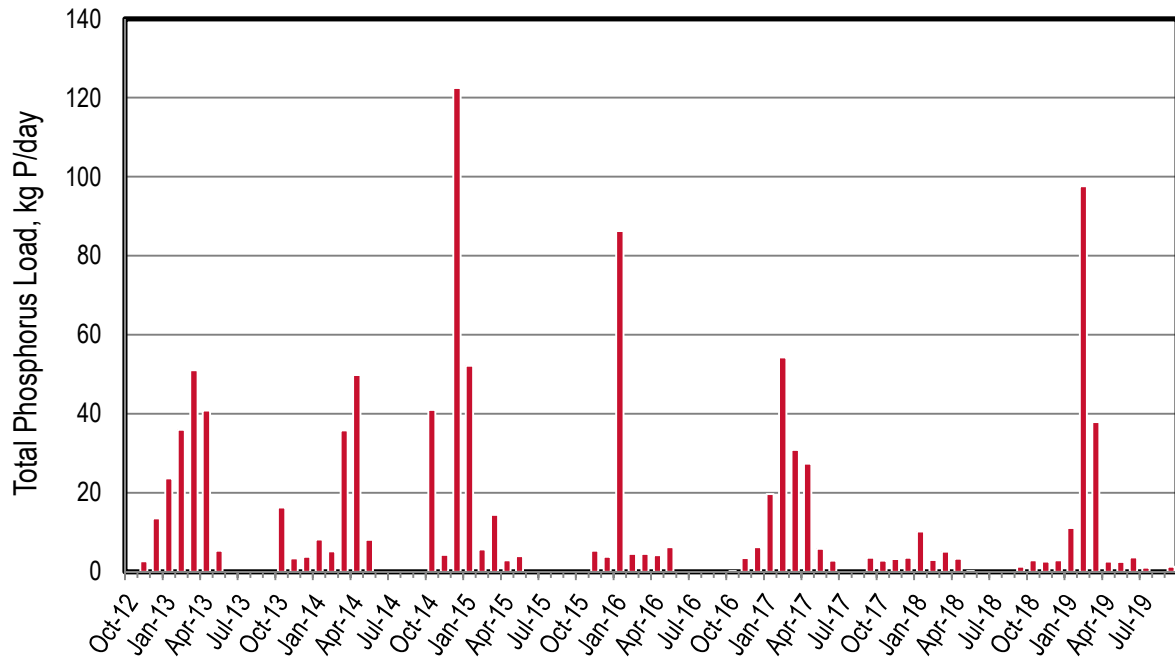


Figure 15-4. Novato Monthly Phosphorus Loads

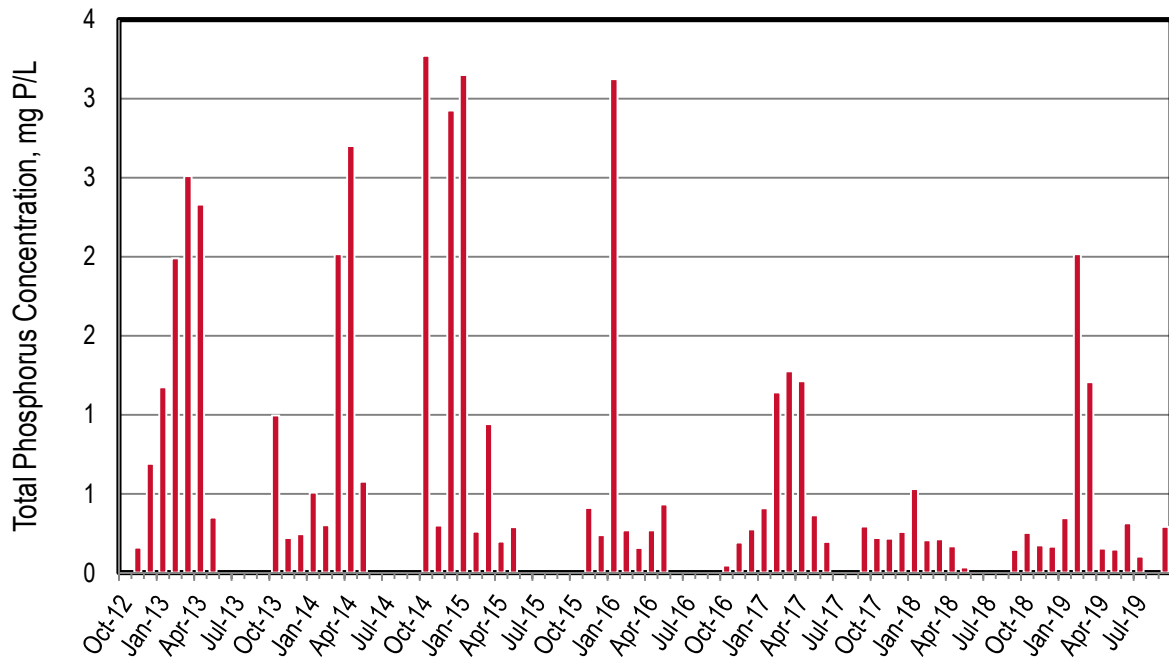


Figure 15-5. Novato Monthly Phosphorus Concentrations

Table 15-1. Novato Monthly Flows and Loads

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-12	4.44				
Nov-12	4.39	3.63	209	213	2.65
Dec-12	5.21	2.16	179	181	13.6
Jan-13	5.34	2.30	200	203	23.7
Feb-13	4.79	27.3	231	258	36.0
Mar-13	5.39	41.0	255	296	51.1
Apr-13	4.64	1.85	231	233	40.9
May-13	4.03	1.52	198	200	5.32
Jun-13	0	0	0	0	0
Jul-13	0	0	0	0	0
Aug-13	0	0	0	0	0
Sep-13	0	0	0	0	0
Oct-13	4.33	5.24	207	212	16.3
Nov-13	4.07	2.16	186	188	3.39
Dec-13	4.14	36.4	189	225	3.82
Jan-14	4.30	42.6	169	211	8.23
Feb-14	4.57	17.8	147	165	5.18
Mar-14	4.70	2.52	235	238	35.8
Apr-14	4.88	1.66	185	187	49.8
May-14	3.71	11.9	200	212	8.09
Jun-14	0	0	0	0	0
Jul-14	0	0	0	0	0
Aug-14	0	0	0	0	0
Sep-14	0	0	0	0	0
Oct-14	3.32	2.88	220	222	41.0
Nov-14	3.80	10.1	228	238	4.30
Dec-14	11.1	10.6	544	555	123
Jan-15	4.38	33.6	138	172	52.2
Feb-15	5.78	89.0	158	247	5.70
Mar-15	4.05	3.10	208	212	14.4
Apr-15	3.88	54.3	122	176	2.90
May-15	3.68	6.00	182	188	4.00
Jun-15	0	0	0	0	0
Jul-15	0	0	0	0	0
Aug-15	0	0	0	0	0
Sep-15	0	0	0	0	0

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-15	0	0	0	0	0
Nov-15	3.46	4.81	179	183	5.36
Dec-15	4.24	4.67	227	231	3.82
Jan-16	7.30	55.8	416	472	86.2
Feb-16	4.52	3.43	196	199	4.57
Mar-16	7.75	3.16	237	240	4.58
Apr-16	4.18	6.68	146	152	4.25
May-16	3.82	4.51	187	191	6.22
Jun-16	0	0	0	0	0
Jul-16	0	0	0	0	0
Aug-16	0	0	0	0	0
Sep-16	0	0	0	0	0
Oct-16***	1.05	1.19	4.01	5.20	0.182
Nov-16	4.84	6.01	154	160	3.51
Dec-16	5.99	14.7	270	284	6.22
Jan-17	12.7	123	154	276	19.7
Feb-17	12.6	223	271	495	54.3
Mar-17	6.41	5.74	199	204	30.9
Apr-17	5.97	23.4	429	452	27.4
May-17	4.27	70.3	157	228	5.86
Jun-17	3.85	6.71	164	171	2.83
Jul-17	0	0	0	0	0
Aug-17	0	0	0	0	0
Sep-17	3.27	13.2	79.2	92.5	3.60
Oct-17	3.40	2.38	130	132	2.81
Nov-17	4.03	14.7	179	193	3.27
Dec-17	3.67	3.14	157	160	3.57
Jan-18	5.11	93.0	109	202	10.2
Feb-18	3.85	12.9	164	177	2.98
Mar-18	6.46	46.5	151	198	5.15
Apr-18	5.28	12.7	273	286	3.32
May-18***	1.45	9.61	96.1	106	0.186
Jun-18	0	0	0	0	0
Jul-18	0	0	0	0	0
Aug-18	0	0	0	0	0
Sep-18	2.44	2.41	107	110	1.34
Oct-18	3.10	5.28	129	134	2.96

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Nov-18	3.91	2.06	154	156	2.57
Dec-18	4.71	8.23	157	165	2.93
Jan-19	8.54	111	139	250	11.1
Feb-19	12.8	195	293	488	97.6
Mar-19	8.32	155	262	417	37.9
Apr-19	4.47	105	108	265	2.58
May-19	4.51	26.3	109	135	2.51
Jun-19	3.09	75.1	83.5	245	3.66
Jul-19	2.70	1.35	68.4	69.7	1.03
Aug-19	0	0	0	0	0
Sep-19***	1.22	1.16	49.2	50.4	1.34
Dry Season Average	1.20	6.57	48.0	57.0	1.31
Dry Season Trend	None	None	None	None	None
Wet Season Average	5.31	34.0	198	234	20.3
Average Annual	3.60	22.5	135	159	12.3

* The Total Inorganic Nitrogen value is calculated by adding the "Ammonia" and "Nitrate + Nitrite" values.

** No dry season trending analysis was performed on Novato as the facility does not discharge during most dry season months.

*** Lower than typical monthly averages due to discharge to the Bay only occurring during a portion of the month.

16 City of Palo Alto

Palo Alto discharges to the Lower South Bay. The plant serves an estimated population of 217,000 and it has a permitted ADWF capacity of 39 mgd and a peak wet weather capacity of 80 mgd. The current ADWF flow is approximately 20 mgd. The plant performs ammonia and limited nitrogen removal using a combination of trickling filters and activated sludge.

The following observations are made based upon the figures and table in the subsequent pages:

- ◆ There are no dry season trends for nutrient loads in the data. There is a downward dry season trend for flows.
- ◆ NO_x is the majority of the nitrogen species discharged, regardless of season. This would be expected since this plant reliably nitrifies year round.
- ◆ TN loads in general increase with flows.
- ◆ TP discharge concentrations range from 3.1 to 5.9 mg P/L. This is within the range of typical effluent TP concentrations (4 to 6 mg P/L).

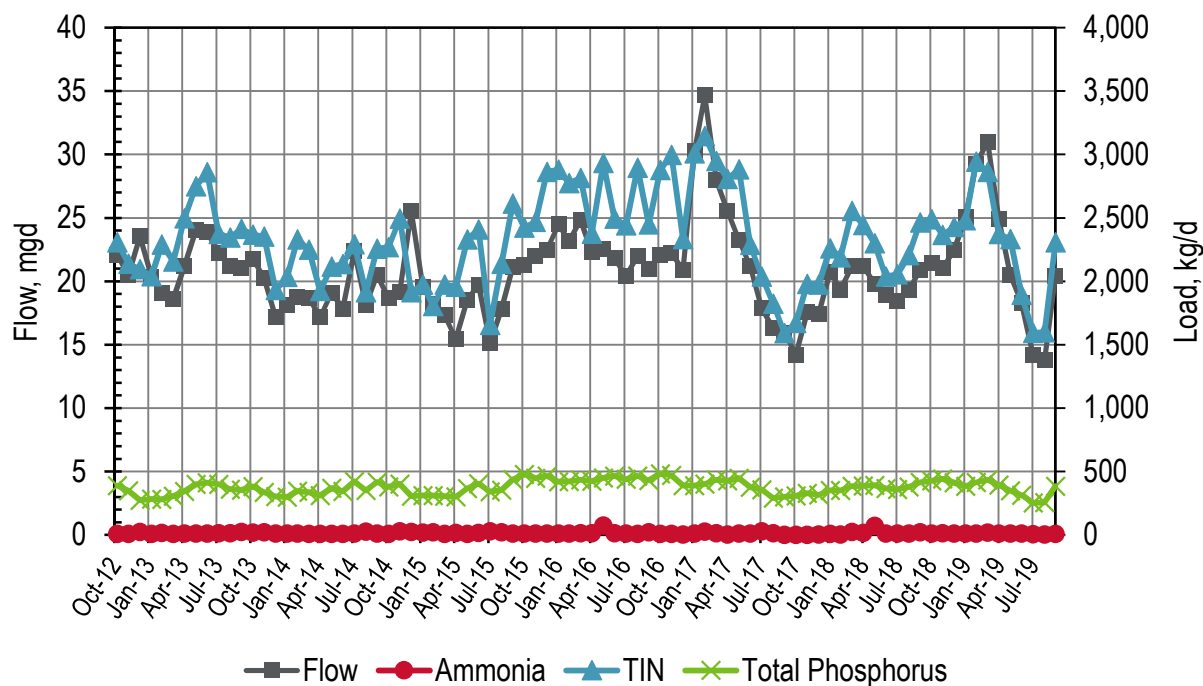


Figure 16-1. Palo Alto Monthly Flows and Loads

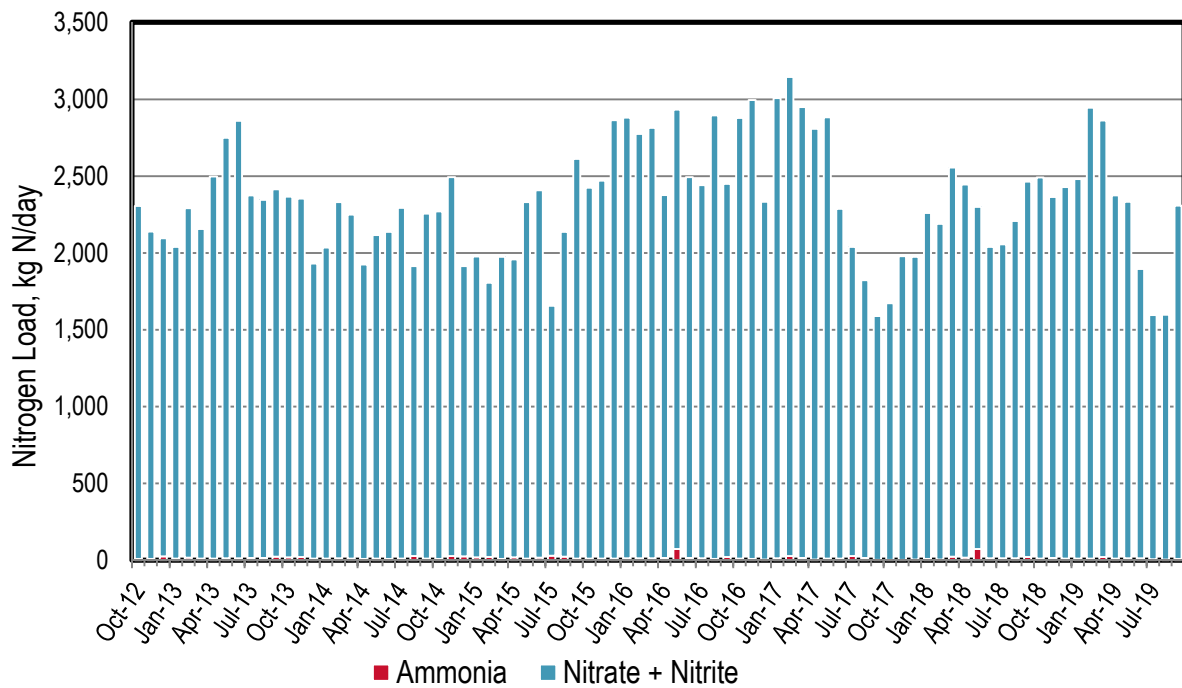


Figure 16-2. Palo Alto Monthly Nitrogen Loads

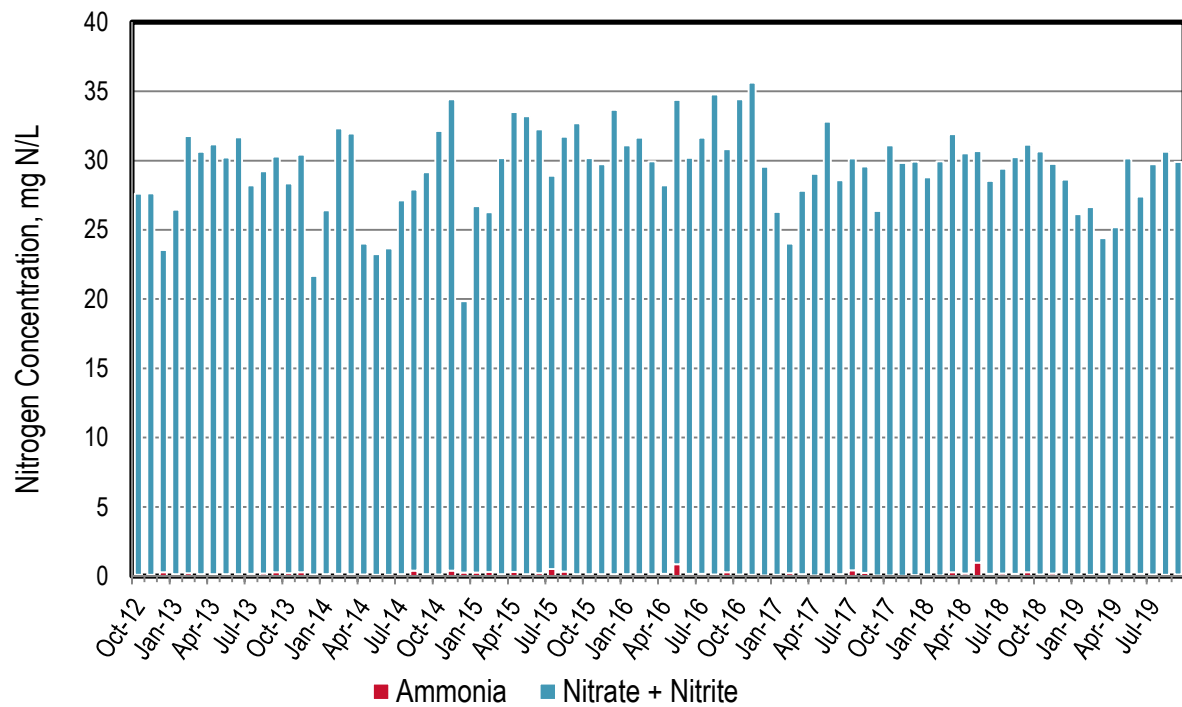


Figure 16-3. Palo Alto Monthly Nitrogen Concentrations

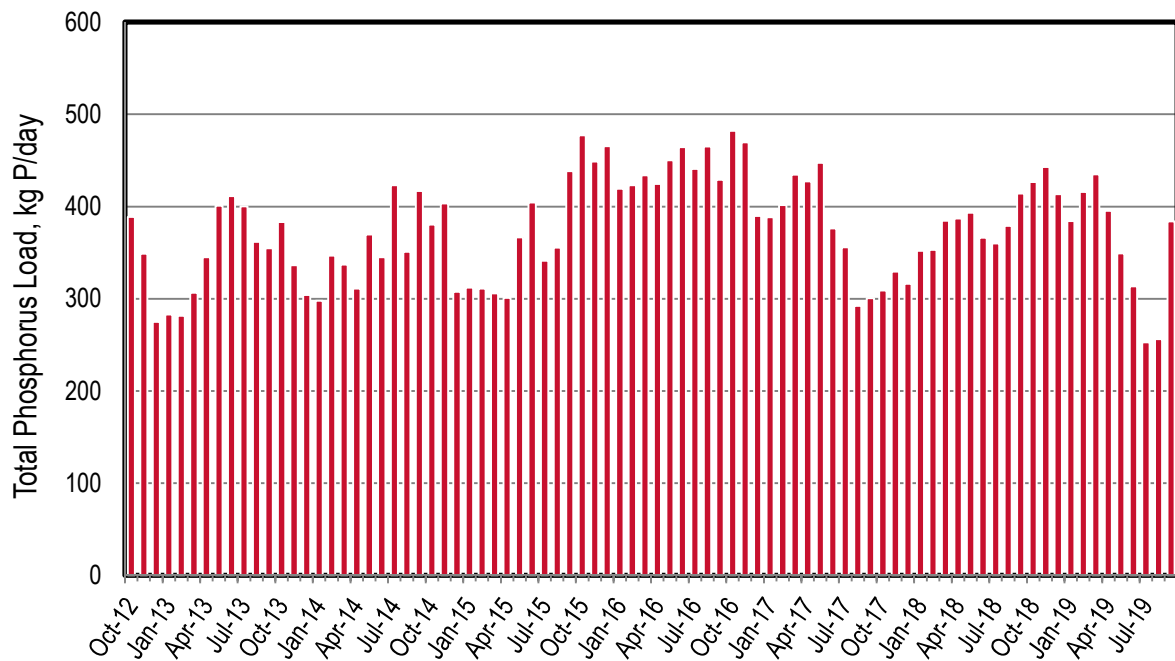


Figure 16-4. Palo Alto Monthly Phosphorus Loads

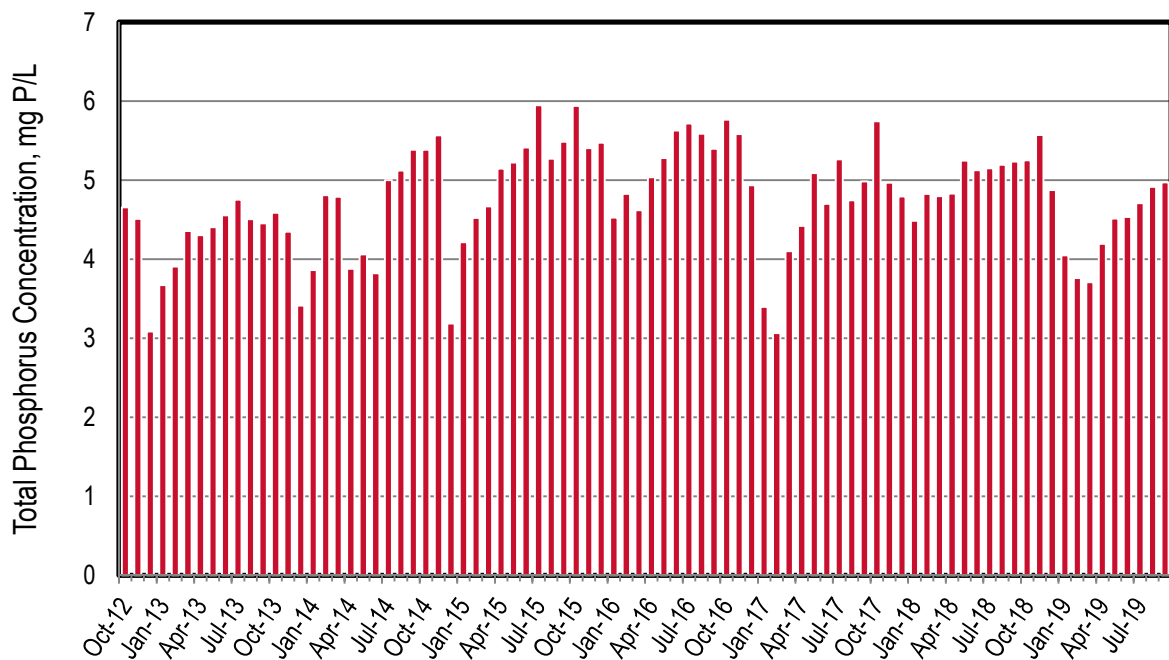


Figure 16-5. Palo Alto Monthly Phosphorus Concentrations

Table 16-1. Palo Alto Monthly Flows and Loads

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-12	22.1	8.36	2,300	2,310	389
Nov-12	20.5	7.75	2,130	2,140	349
Dec-12	23.6	23.9	2,070	2,100	275
Jan-13	20.4	9.88	2,030	2,040	283
Feb-13	19.1	15.3	2,280	2,290	282
Mar-13	18.6	9.16	2,150	2,160	306
Apr-13	21.2	10.4	2,490	2,500	345
May-13	24.1	11.8	2,740	2,750	401
Jun-13	23.9	11.8	2,850	2,860	411
Jul-13	22.3	14.3	2,360	2,370	400
Aug-13	21.2	14.9	2,330	2,340	362
Sep-13	21.1	22.8	2,390	2,410	355
Oct-13	21.8	17.7	2,350	2,370	383
Nov-13	20.2	21.0	2,330	2,350	336
Dec-13	17.2	10.0	1,920	1,930	304
Jan-14	18.1	10.4	2,030	2,040	298
Feb-14	18.8	11.4	2,320	2,330	347
Mar-14	18.7	9.42	2,240	2,250	337
Apr-14	17.2	8.45	1,920	1,920	311
May-14	19.1	9.40	2,110	2,120	370
Jun-14	17.8	8.78	2,130	2,140	345
Jul-14	22.4	11.0	2,280	2,290	423
Aug-14	18.1	26.2	1,890	1,910	351
Sep-14	20.5	10.1	2,250	2,260	417
Oct-14	18.7	8.94	2,260	2,270	380
Nov-14	19.2	27.7	2,470	2,490	403
Dec-14	25.5	23.8	1,890	1,910	307
Jan-15	19.6	19.3	1,960	1,980	312
Feb-15	18.2	20.4	1,790	1,810	311
Mar-15	17.3	8.52	1,970	1,970	306
Apr-15	15.5	17.5	1,940	1,960	301
May-15	18.6	9.47	2,320	2,330	367
Jun-15	19.8	15.6	2,390	2,410	404
Jul-15	15.2	29.6	1,630	1,660	341
Aug-15	17.8	21.6	2,120	2,140	355

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Sep-15	21.1	10.4	2,600	2,610	438
Oct-15	21.3	10.5	2,410	2,420	477
Nov-15	22.0	10.8	2,460	2,470	449
Dec-15	22.5	11.1	2,850	2,860	465
Jan-16	24.5	12.1	2,870	2,880	419
Feb-16	23.2	11.4	2,760	2,770	423
Mar-16	24.9	12.9	2,800	2,810	434
Apr-16	22.3	13.9	2,360	2,380	425
May-16	22.6	73.4	2,860	2,930	450
Jun-16	21.8	13.6	2,480	2,490	465
Jul-16	20.4	12.1	2,430	2,440	441
Aug-16	22.0	8.89	2,890	2,890	465
Sep-16	21.0	21.1	2,430	2,450	429
Oct-16	22.1	9.67	2,870	2,880	482
Nov-16	22.2	8.12	2,990	3,000	470
Dec-16	20.9	3.86	2,330	2,330	390
Jan-17	30.2	11.5	3,000	3,010	388
Feb-17	34.7	27.0	3,120	3,150	402
Mar-17	28.0	13.6	2,930	2,950	435
Apr-17	25.6	4.20	2,800	2,810	427
May-17	23.2	11.0	2,870	2,880	447
Jun-17	21.2	10.6	2,280	2,290	376
Jul-17	17.9	27.7	2,010	2,040	356
Aug-17	16.3	14.9	1,810	1,820	292
Sep-17	15.9	2.14	1,590	1,590	300
Oct-17	14.2	2.02	1,670	1,670	309
Nov-17	17.5	2.13	1,980	1,980	329
Dec-17	17.4	4.22	1,970	1,970	316
Jan-18	20.8	8.38	2,250	2,260	352
Feb-18	19.3	3.91	2,190	2,190	353
Mar-18	21.2	22.8	2,530	2,560	384
Apr-18	21.2	15.6	2,430	2,440	387
May-18	19.8	72.7	2,230	2,300	393
Jun-18	18.9	12.4	2,030	2,040	366
Jul-18	18.5	12.4	2,040	2,060	360
Aug-18	19.3	12.1	2,200	2,210	379
Sep-18	20.9	21.0	2,440	2,460	414

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-18	21.5	10.3	2,480	2,490	427
Nov-18	21.0	14.0	2,350	2,360	443
Dec-18	22.4	10.1	2,420	2,430	414
Jan-19	25.1	10.2	2,470	2,480	384
Feb-19	29.2	10.4	2,930	2,940	416
Mar-19	31.0	19.7	2,840	2,860	435
Apr-19	24.9	10.8	2,360	2,370	395
May-19	20.5	11.6	2,320	2,330	349
Jun-19	18.3	11.4	1,880	1,890	313
Jul-19	14.2	5.75	1,590	1,590	252
Aug-19	13.8	4.40	1,590	1,600	256
Sep-19	20.4	8.35	2,300	2,310	384
Dry Season Average	19.7	17.0	2,250	2,260	378
Dry Season Trend	Down	None	None	None	None
Wet Season Average	21.7	12.3	2,370	2,380	373
Average Annual	20.9	14.3	2,320	2,330	375

* The Total Inorganic Nitrogen value is calculated by adding the "Ammonia" and "Nitrate + Nitrite" values.

** Refer to the Section 3.5 in the main body for a description on the statistical analysis.

17 Sanitary District No. 5 of Marin County - Paradise Cove Treatment Plant

The Paradise Cove Treatment Plant discharges to the Central Bay. The service area has approximately 65 service connections. The plant has a permitted ADWF capacity of 0.040 mgd and it has current flows of approximately 0.014 mgd ADWF. The plant performs secondary treatment using an activated sludge treatment process.

The plant is classified as a minor discharger (<1 mgd permitted capacity) and thus not required to sample as frequently as the major dischargers (>1 mgd permitted capacity). The minor dischargers are required to sample twice per year under the Nutrient Watershed Permit. As a result, there are several months of nutrient data gaps.

The following observations are made based upon the figures and table in the subsequent pages:

- ◆ Flow values are provided over the entire study period. The remaining nutrient species only have monthly sampling for the first year of sampling, followed by occasional sampling thereafter.
- ◆ The plant occasionally nitrifies as evidenced by ammonia values of less than 0.2 mg N/L.
- ◆ During months of nitrification, NO_x is the majority of the nitrogen species discharged. During months of no nitrification, ammonia is the majority of the nitrogen species discharged.
- ◆ Total phosphorus concentrations are wide ranging from approximately 2.2 to 16 mg P/L. Typical effluent TP concentrations range from 4 to 6 mg P/L.

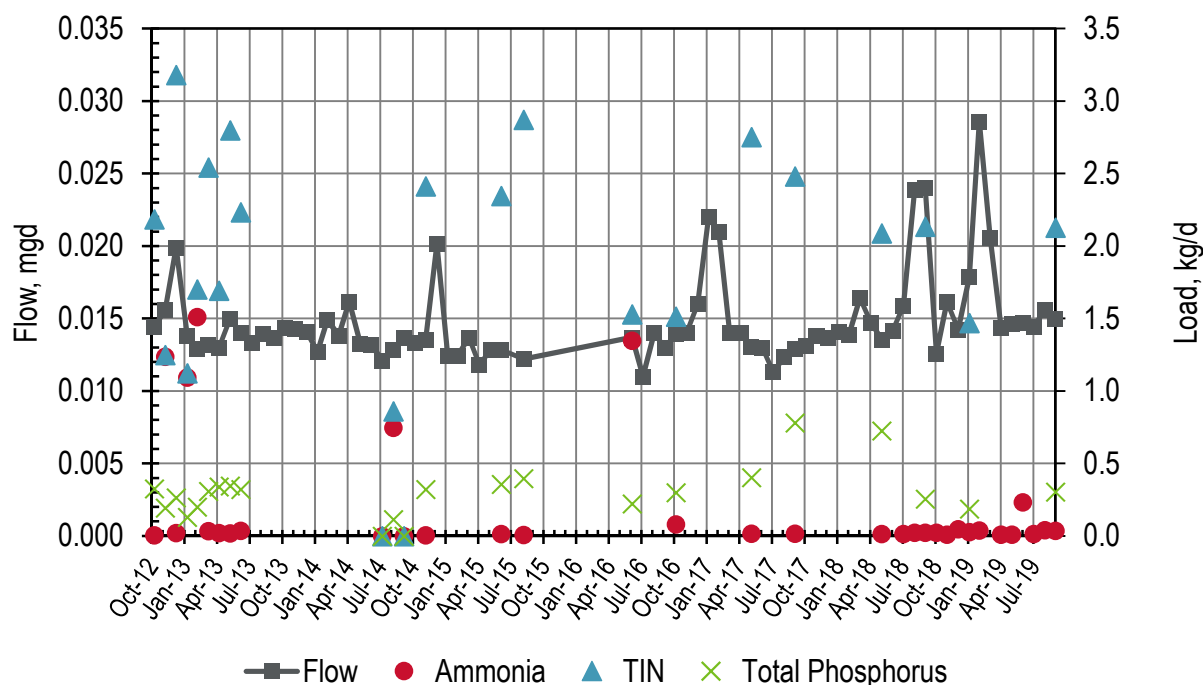


Figure 17-1. Paradise Cove Monthly Flows and Loads

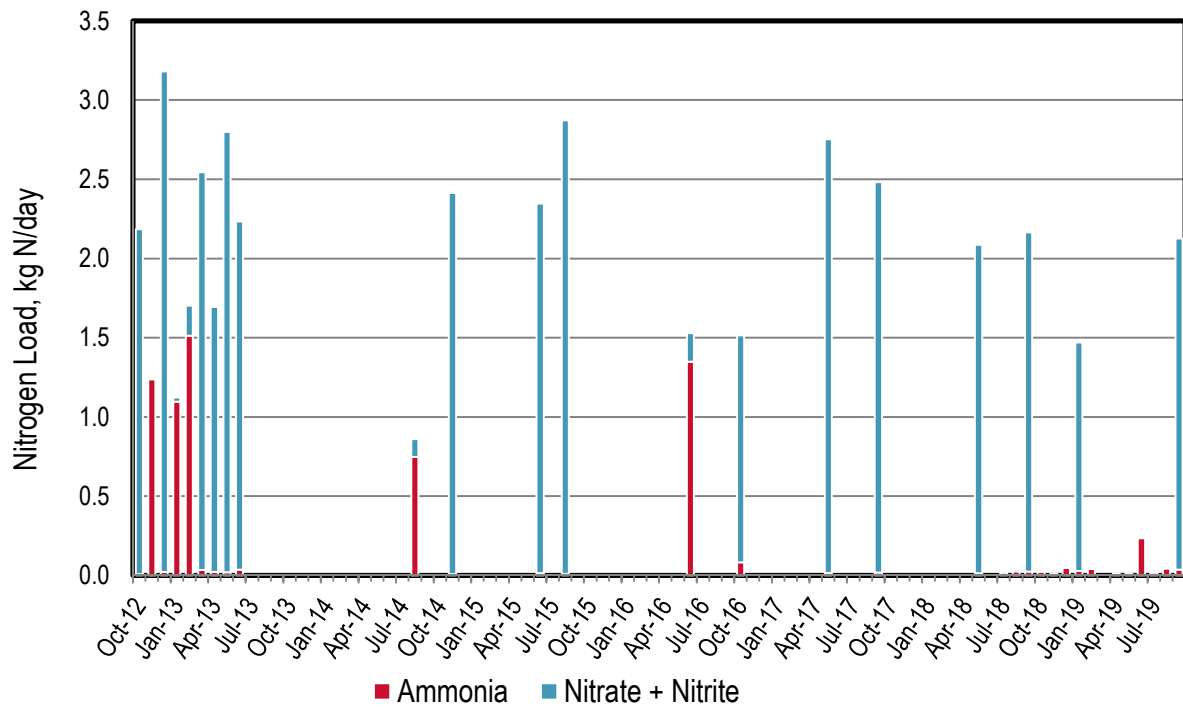


Figure 17-2. Paradise Cove Monthly Nitrogen Loads

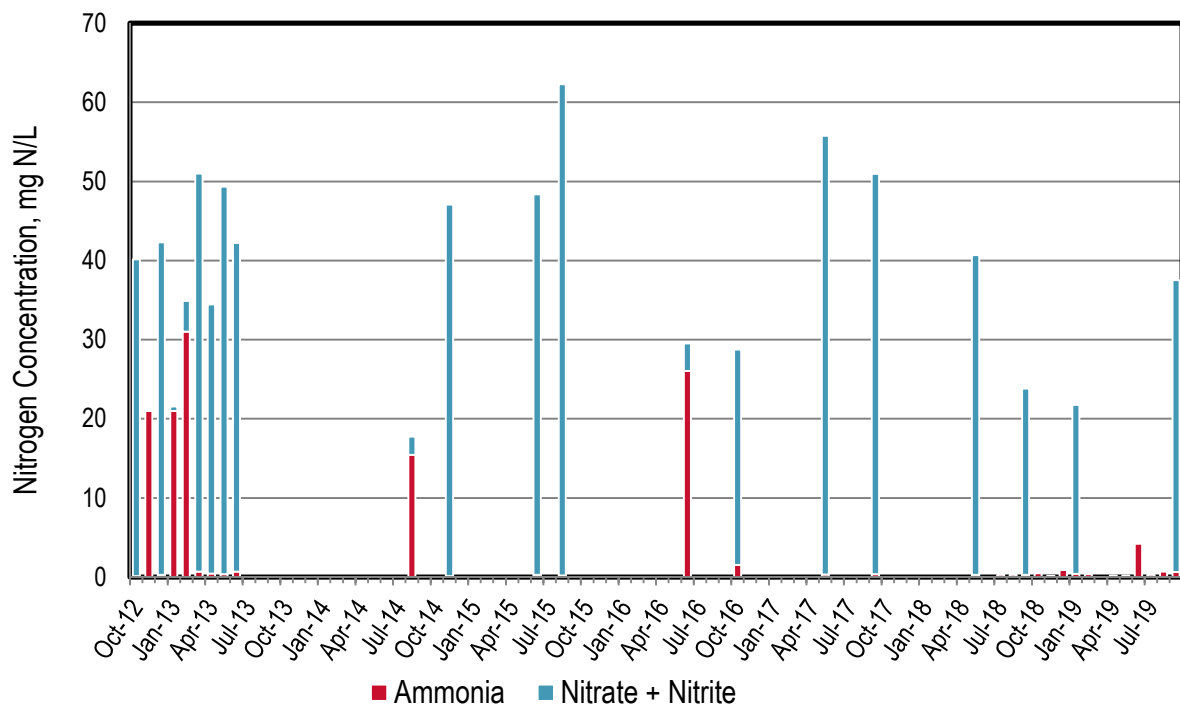


Figure 17-3. Paradise Cove Monthly Nitrogen Concentrations

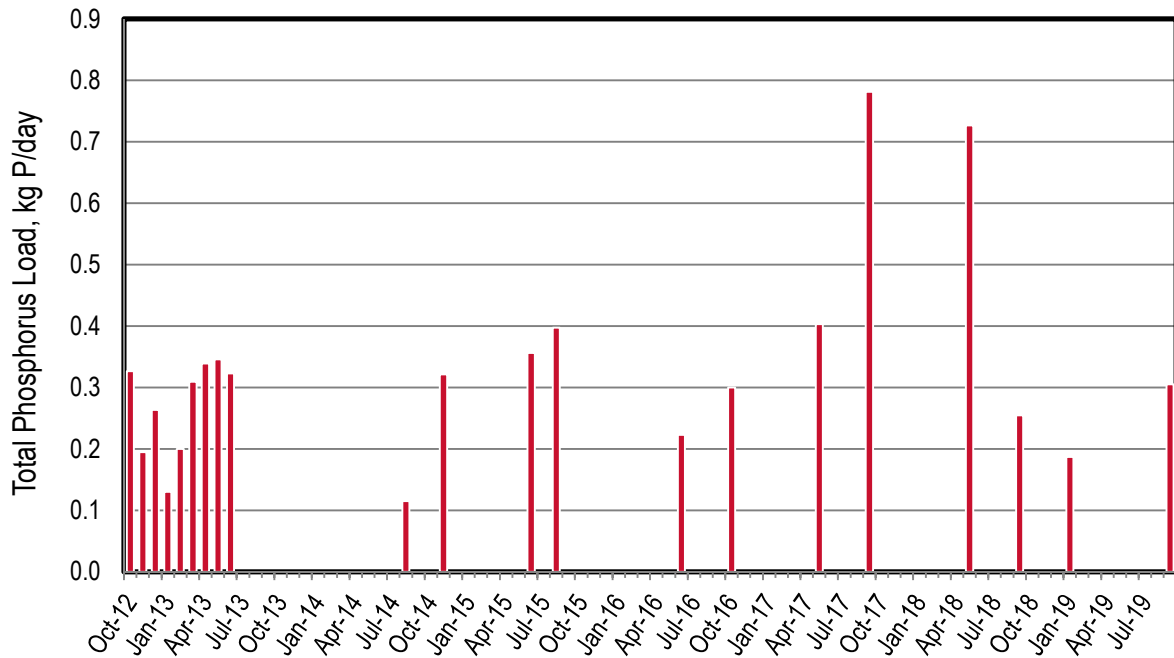


Figure 17-4. Paradise Cove Monthly Phosphorus Loads

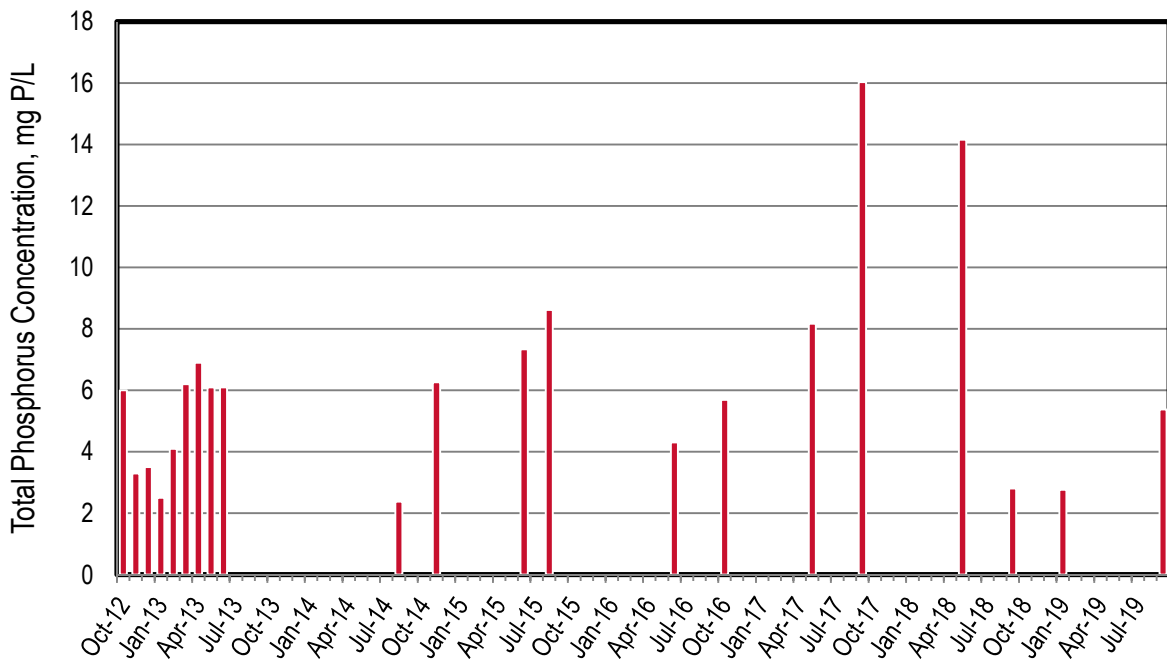


Figure 17-5. Paradise Cove Monthly Phosphorus Concentrations

Table 17-1. Paradise Cove Monthly Flows and Loads

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-12	0.0144	0.00708	2.18	2.19	0.327
Nov-12	0.0156	1.24	0.0113	1.25	0.195
Dec-12	0.0199	0.0218	3.16	3.18	0.263
Jan-13	0.0138	1.10	0.0282	1.12	0.130
Feb-13	0.0129	1.51	0.191	1.70	0.200
Mar-13	0.0132	0.0349	2.51	2.54	0.309
Apr-13	0.0130	0.0216	1.67	1.69	0.339
May-13	0.0150	0.0198	2.78	2.80	0.346
Jun-13	0.0140	0.0370	2.20	2.23	0.323
Jul-13	0.0133				
Aug-13	0.0139				
Sep-13	0.0137				
Oct-13	0.0144				
Nov-13	0.0143				
Dec-13	0.0141				
Jan-14	0.0127				
Feb-14	0.0149				
Mar-14	0.0138				
Apr-14	0.0162				
May-14	0.0132				
Jun-14	0.0132				
Jul-14	0.0121	0	0	0	0
Aug-14	0.0128	0.748	0.112	0.860	0.115
Sep-14	0.0137	0	0	0	0
Oct-14	0.0133				
Nov-14	0.0136	0.00689	2.41	2.41	0.321
Dec-14	0.0202				
Jan-15	0.0124				
Feb-15	0.0124				
Mar-15	0.0137				
Apr-15	0.0118				
May-15	0.0128				
Jun-15	0.0128	0.0146	2.33	2.35	0.356
Jul-15					
Aug-15	0.0122	0.00924	2.86	2.87	0.397
Sep-15					

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-15					
Nov-15					
Dec-15					
Jan-16					
Feb-16					
Mar-16					
Apr-16					
May-16					
Jun-16	0.0137	1.35	0.180	1.53	0.223
Jul-16	0.0110				
Aug-16	0.0140				
Sep-16	0.0130				
Oct-16	0.0139	0.0818	1.43	1.51	0.300
Nov-16	0.0140				
Dec-16	0.0160				
Jan-17	0.0220				
Feb-17	0.0210				
Mar-17	0.0140				
Apr-17	0.0140				
May-17	0.0131	0.0165	2.74	2.75	0.403
Jun-17	0.0130				
Jul-17	0.0113				
Aug-17	0.0123				
Sep-17	0.0129	0.0174	2.46	2.48	0.781
Oct-17	0.0131				
Nov-17	0.0138				
Dec-17	0.0137				
Jan-18	0.0141				
Feb-18	0.0139				
Mar-18	0.0164				
Apr-18	0.0147				
May-18	0.0136	0.0149	2.07	2.09	0.726
Jun-18	0.0142				
Jul-18	0.0159	0.0159			
Aug-18	0.0239	0.0239			
Sep-18	0.0240	0.0240	2.14	2.13	0.255
Oct-18	0.0126	0.0229			

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Nov-18	0.0162	0.0102			
Dec-18	0.0142	0.0469			
Jan-19	0.0179	0.0277	1.44	1.47	0.187
Feb-19	0.0286	0.0401			
Mar-19	0.0206				
Apr-19	0.0144	0.0114			
May-19	0.0147	0.0113			
Jun-19	0.0147	0.233			
Jul-19	0.0144	0.0158			
Aug-19	0.0156	0.0413			
Sep-19	0.0150	0.0368	2.09	2.13	0.305
Dry Season Average	0.0142	0.138	1.69	1.86	0.325
Dry Season Trend	None	***	***	***	***
Wet Season Average	0.0152	0.279	1.50	1.91	0.257
Average Annual	0.0148	0.200	1.61	1.88	0.296

* The Total Inorganic Nitrogen value is calculated by adding the "Ammonia" and "Nitrate + Nitrite" values.

** Refer to the Section 3.5 in the main body for a description on the statistical analysis.

*** No statistical dry season trending analysis was performed on nutrient species due to the limited number of samples required for minor dischargers.

18 City of Petaluma

Petaluma discharges to Petaluma River that is connected to San Pablo Bay. The plant has approximately 25,300 service connections and it has a permitted capacity of 6.7 mgd ADWF. The plant performs nitrogen and phosphorus removal using oxidation ditches coupled with treatment wetlands and oxidation ponds. The oxidation ponds also serve as equalization during peak wet weather flow. Effluent flow that is not discharged to the Petaluma River is diverted to recycled water whenever possible. Discharge to Petaluma River is prohibited May 1 through October 20, except when the Facility inflow exceeds the recycled water distribution and storage system capacity.

The following observations are made based upon the figures and table in the subsequent pages:

- ◆ There are no emerging dry season trends as Petaluma does not discharge during the dry season.
- ◆ Wet season trends analyzed (data not shown) and there are no emerging trends.
- ◆ Both nitrogen and phosphorus loads typically increase with flow during wet weather events.
- ◆ NO_x and organic nitrogen are the majority of the nitrogen species discharged as would be expected since this plant nitrifies. The plant has reduced their total nitrogen and NO_x discharge loads in 2017/2018 due to enhanced denitrification.
- ◆ The plant meets Level 3 TIN concentration limits (i.e., 6 mg N/L) developed under the Bay Area Clean Water Agencies Scoping and Evaluation Plan for the whole dataset.
- ◆ Total phosphorus concentrations range from 0.5 to 3.8 mg P/L, which suggests P removal. The removal mechanism is attributed to biological P removal in the oxidation ditch.

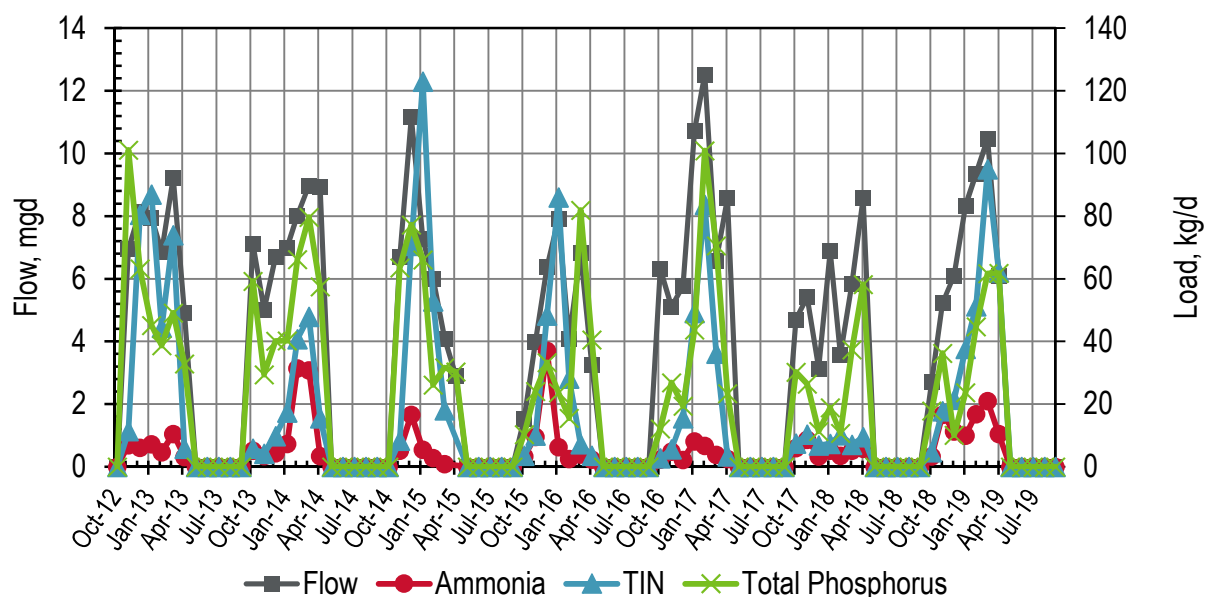


Figure 18-1. Petaluma Monthly Flows and Loads

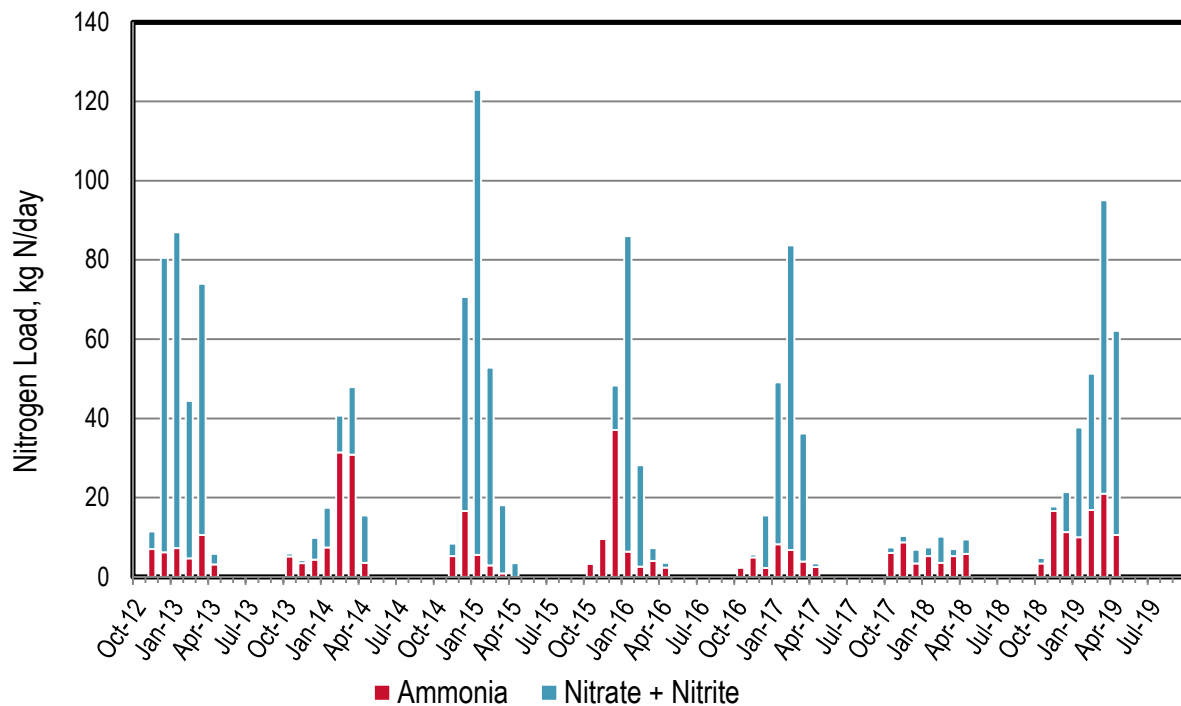


Figure 18-2. Petaluma Monthly Nitrogen Loads

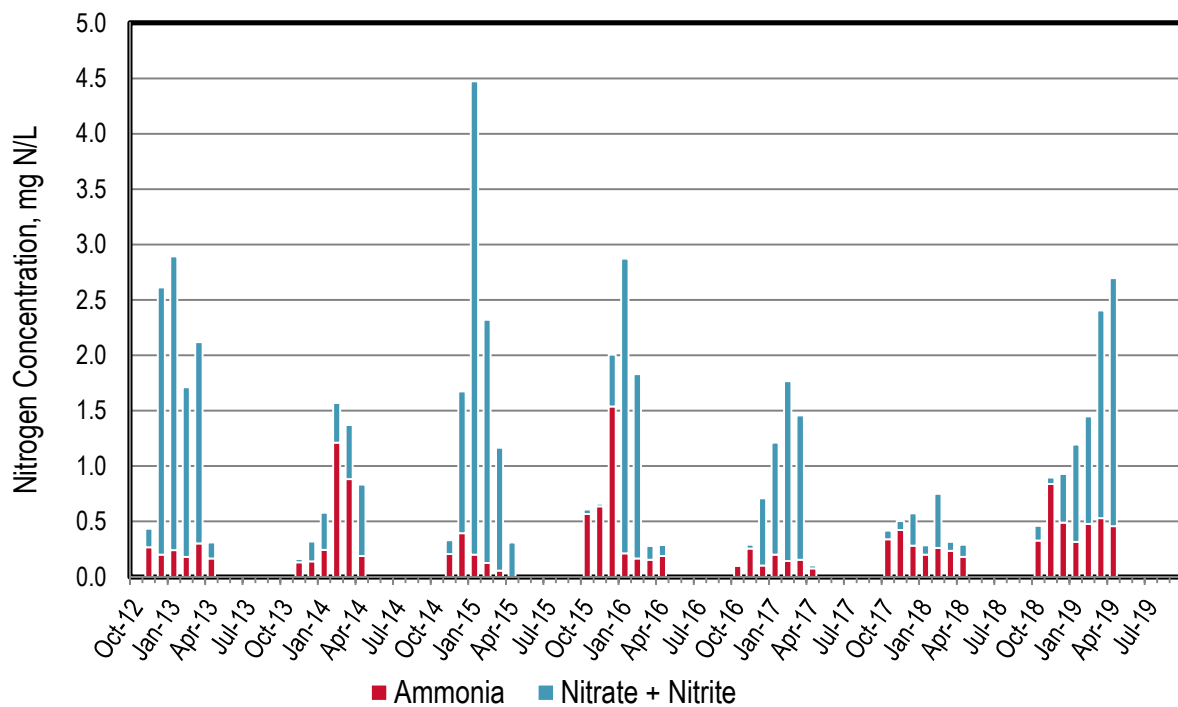


Figure 18-3. Petaluma Monthly Nitrogen Concentrations

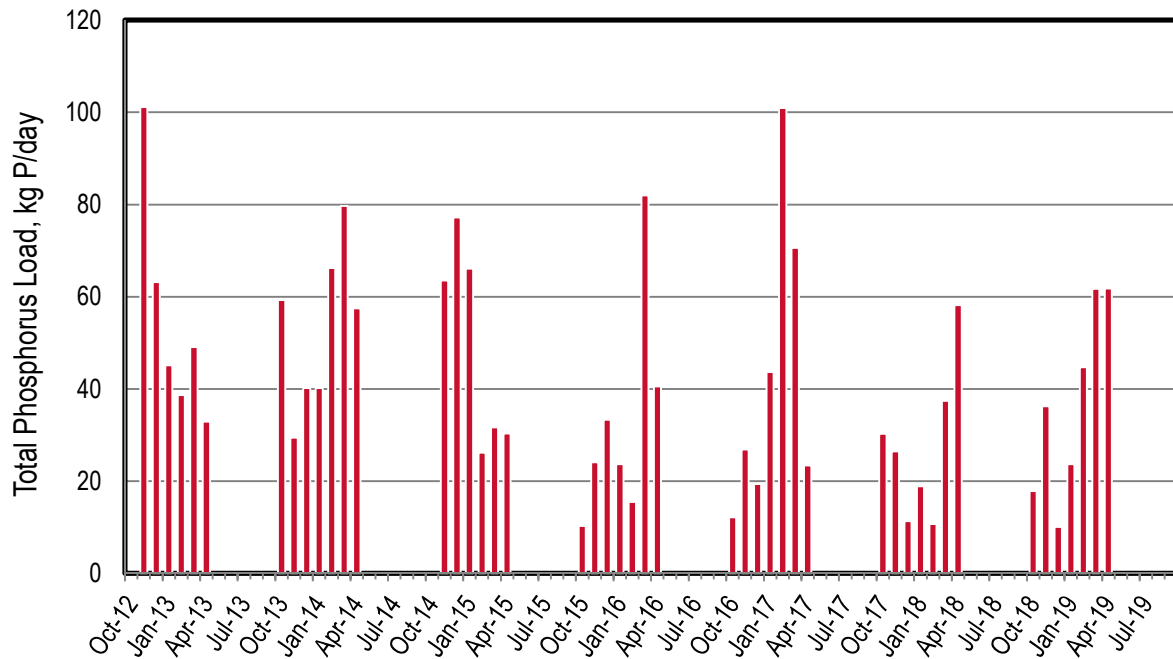


Figure 18-4. Petaluma Monthly Phosphorus Loads

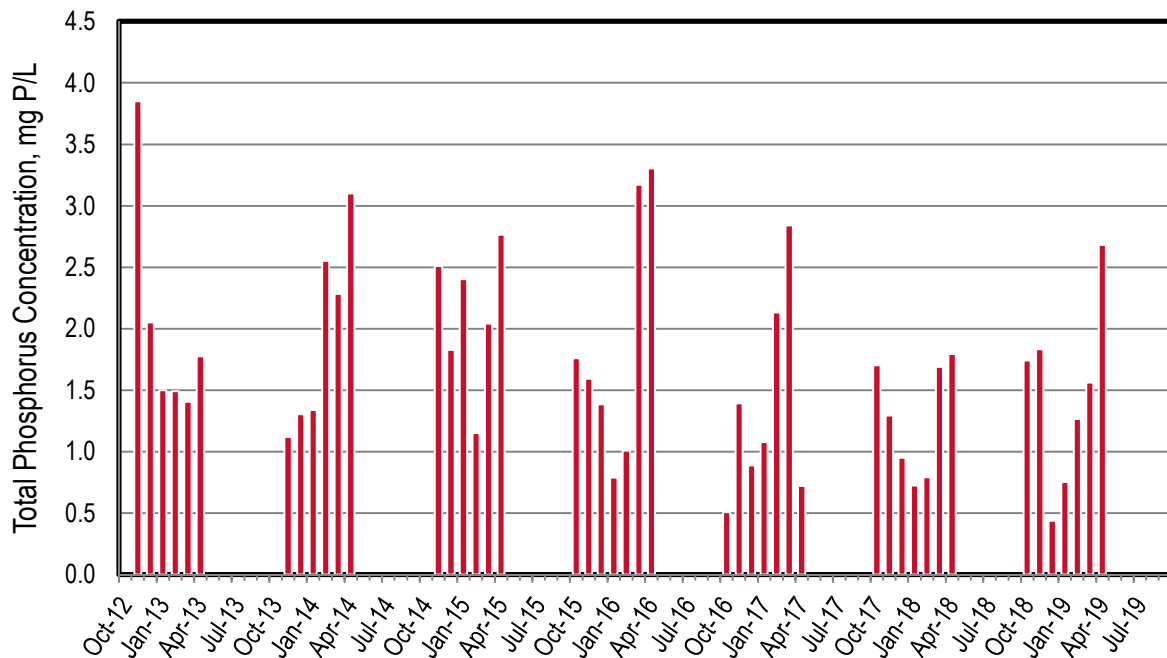


Figure 18-5. Petaluma Monthly Phosphorus Concentrations

Table 18-1. Petaluma Monthly Flows and Loads

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-12	0	0	0	0	0
Nov-12	6.95	6.98	4.47	11.4	101
Dec-12	8.15	6.16	74.4	80.5	63.2
Jan-13	7.96	7.23	79.7	87.0	45.1
Feb-13	6.87	4.65	39.7	44.4	38.7
Mar-13	9.24	10.5	63.5	74.0	49.1
Apr-13	4.91	3.11	2.68	5.79	32.9
May-13	0	0	0	0	0
Jun-13	0	0	0	0	0
Jul-13	0	0	0	0	0
Aug-13	0	0	0	0	0
Sep-13	0	0	0	0	0
Oct-13	7.11	5.16	0.691	5.85	59.3
Nov-13	5.01	3.42	0.760	4.18	29.4
Dec-13	6.72	4.36	5.46	9.82	40.2
Jan-14	7.01	7.37	10.0	17.4	40.2
Feb-14	8.03	31.4	9.31	40.7	66.2
Mar-14	8.98	30.8	17.1	47.9	79.7
Apr-14	8.94	3.50	12.0	15.5	57.5
May-14	0	0	0	0	0
Jun-14	0	0	0	0	0
Jul-14	0	0	0	0	0
Aug-14	0	0	0	0	0
Sep-14	0	0	0	0	0
Oct-14	0	0	0	0	0
Nov-14	6.70	5.20	3.18	8.37	63.5
Dec-14	11.2	16.6	54.0	70.6	77.2
Jan-15	7.27	5.51	117	123	66.1
Feb-15	6.02	2.85	49.9	52.8	26.2
Mar-15	4.10	0.870	17.2	18.1	31.6
Apr-15	2.90		3.41		30.3
May-15	0	0	0	0	0
Jun-15	0	0	0	0	0
Jul-15	0	0	0	0	0
Aug-15	0	0	0	0	0
Sep-15	0	0	0	0	0

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-15	1.54	3.31	0.234	3.54	10.3
Nov-15	4.00	9.62	0.344	9.97	24.1
Dec-15	6.37	37.0	11.3	48.3	33.3
Jan-16	7.92	6.32	79.7	86.0	23.6
Feb-16	4.07	2.56	25.6	28.2	15.5
Mar-16	6.84	3.97	3.23	7.20	81.9
Apr-16	3.24	2.33	1.20	3.54	40.5
May-16	0	0	0	0	0
Jun-16	0	0	0	0	0
Jul-16	0	0	0	0	0
Aug-16	0	0	0	0	0
Sep-16	0	0	0	0	0
Oct-16	6.31	2.35	0.406	2.76	12.1
Nov-16	5.10	4.92	0.686	5.61	26.8
Dec-16	5.77	2.26	13.2	15.5	19.4
Jan-17	10.7	8.19	40.9	49.1	43.7
Feb-17	12.5	6.73	76.9	83.6	101
Mar-17	6.57	3.82	32.4	36.2	70.6
Apr-17	8.58	2.51	0.841	3.35	23.4
May-17	0	0	0	0	0
Jun-17	0	0	0	0	0
Jul-17	0	0	0	0	0
Aug-17	0	0	0	0	0
Sep-17	0	0	0	0	0
Oct-17	4.70	6.05	1.39	7.44	30.3
Nov-17	5.41	8.67	1.62	10.3	26.4
Dec-17	3.15	3.33	3.48	6.81	11.3
Jan-18	6.89	5.21	2.17	7.37	18.9
Feb-18	3.57	3.51	6.62	10.1	10.7
Mar-18	5.86	5.20	1.79	6.98	37.4
Apr-18	8.58	5.82	3.63	9.45	58.2
May-18	0	0	0	0	0
Jun-18	0	0	0	0	0
Jul-18	0	0	0	0	0
Aug-18	0	0	0	0	0
Sep-18	0	0	0	0	0
Oct-18	2.71	3.36	1.36	4.72	17.8

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Nov-18	5.23	16.6	1.12	17.7	36.2
Dec-18	6.10	11.3	10.1	21.4	10.1
Jan-19	8.34	10.0	27.7	37.7	23.7
Feb-19	9.36	16.9	34.4	51.3	44.7
Mar-19	10.5	21.0	74.1	95.0	61.7
Apr-19	6.10	10.5	51.6	62.1	61.8
May-19	0	0	0	0	0
Jun-19	0	0	0	0	0
Jul-19	0	0	0	0	0
Aug-19	0	0	0	0	0
Sep-19	0	0	0	0	0
Dry Season Average	0	0	0	0	0
Dry Season Trend**	--	--	--	--	--
Wet Season Average	6.33	7.90	21.9	30.2	40.3
Average Annual	3.69	4.57	12.8	17.5	23.5

* The Total Inorganic Nitrogen value is calculated by adding the "Ammonia" and "Nitrate + Nitrite" values.

** No dry season trending analysis was performed on Petaluma as the facility does not discharge during dry season months.

19 City of Pinole

The Pinole-Hercules Water Pollution Control Plant discharges to San Pablo Bay. The plant has approximately 11,215 service connections; it has a permitted capacity of 4.06 mgd ADWF and a peak wet weather capacity of 20.0 mgd. The current flow averages about 2.3 mgd ADWF.

The following observations are made based upon the figures and table in the subsequent pages:

- ◆ They just completed a \$45 Mil plant upgrade project that included the ability to remove ammonia and TIN loads. They commissioned this process in 2019.
- ◆ Based on the table with the average monthly values, there appears to be an emerging dry season downward trend for TIN loads.
- ◆ Nitrogen and phosphorus loads do not track with the flows as seen at the majority of the other plants.
- ◆ With the exception of ammonia, nutrient species were not sampled in July and August 2014.
- ◆ Total phosphorus concentrations from 0.5 to 5.1 mg P/L.

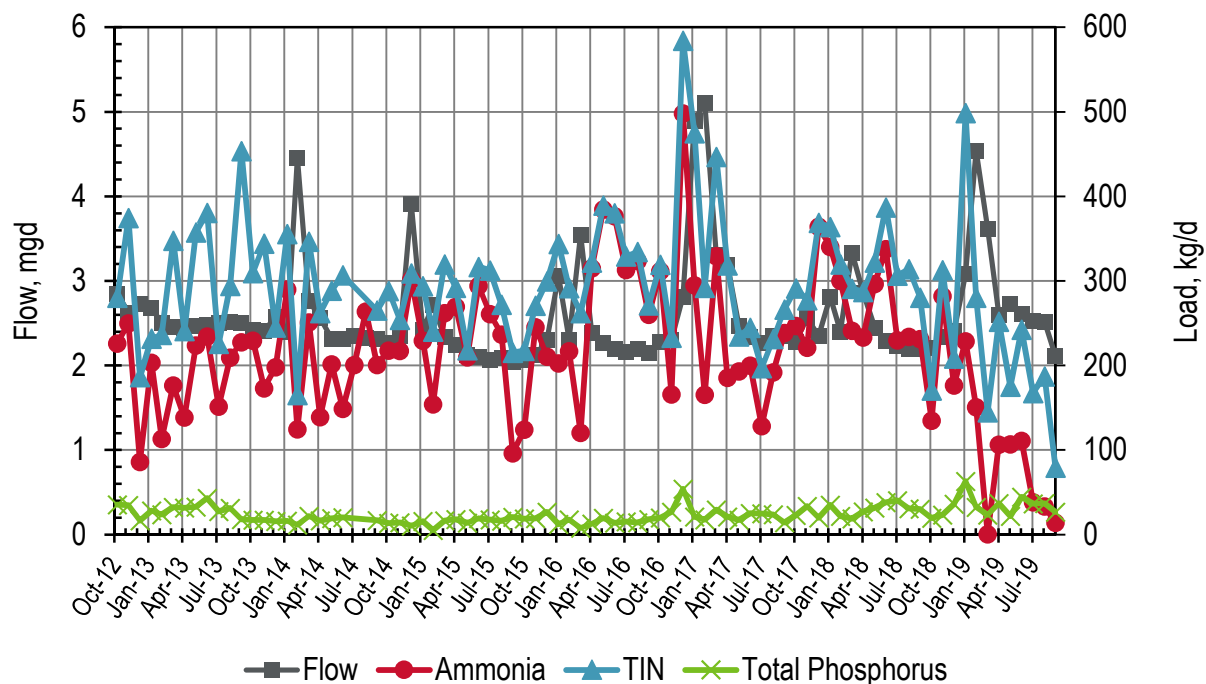


Figure 19-1. Pinole Monthly Flows and Loads

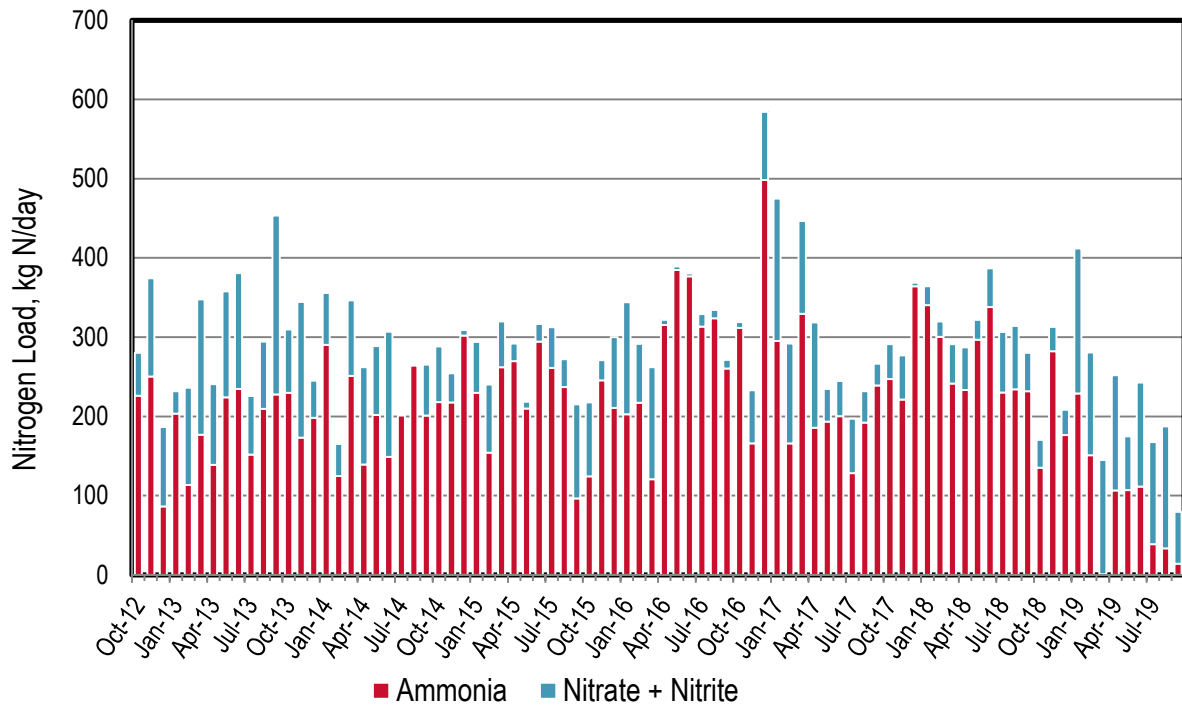


Figure 19-2. Pinole Monthly Nitrogen Loads

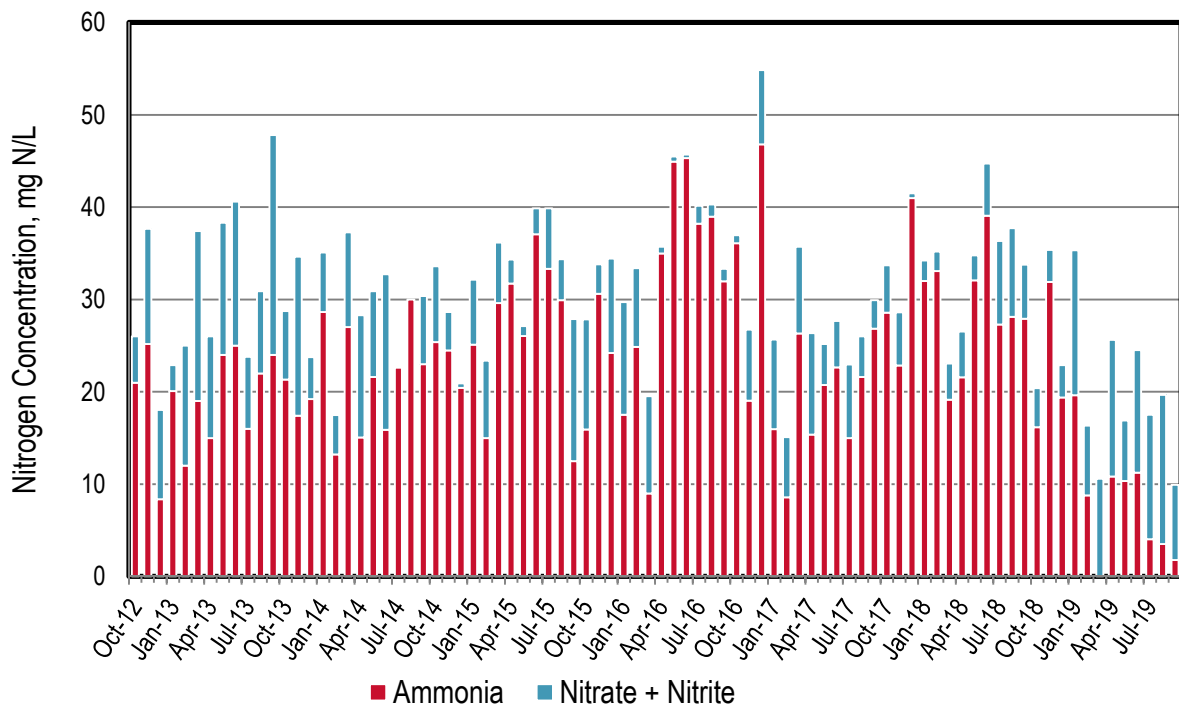


Figure 19-3. Pinole Monthly Nitrogen Concentrations

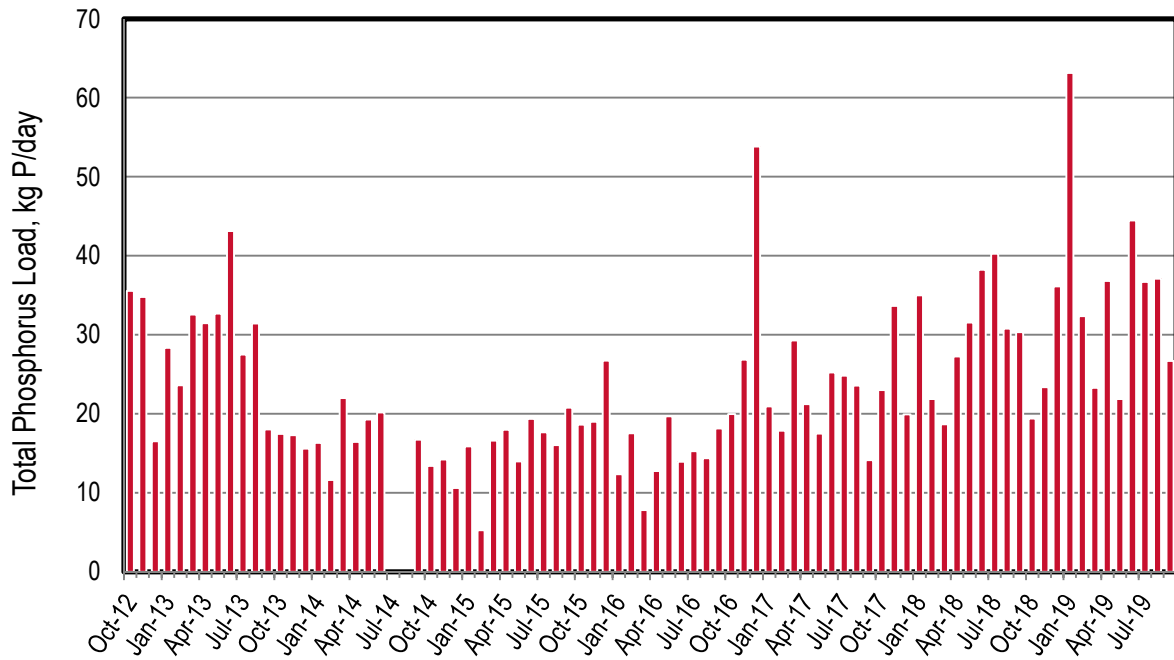


Figure 19-4. Pinole Monthly Phosphorus Loads

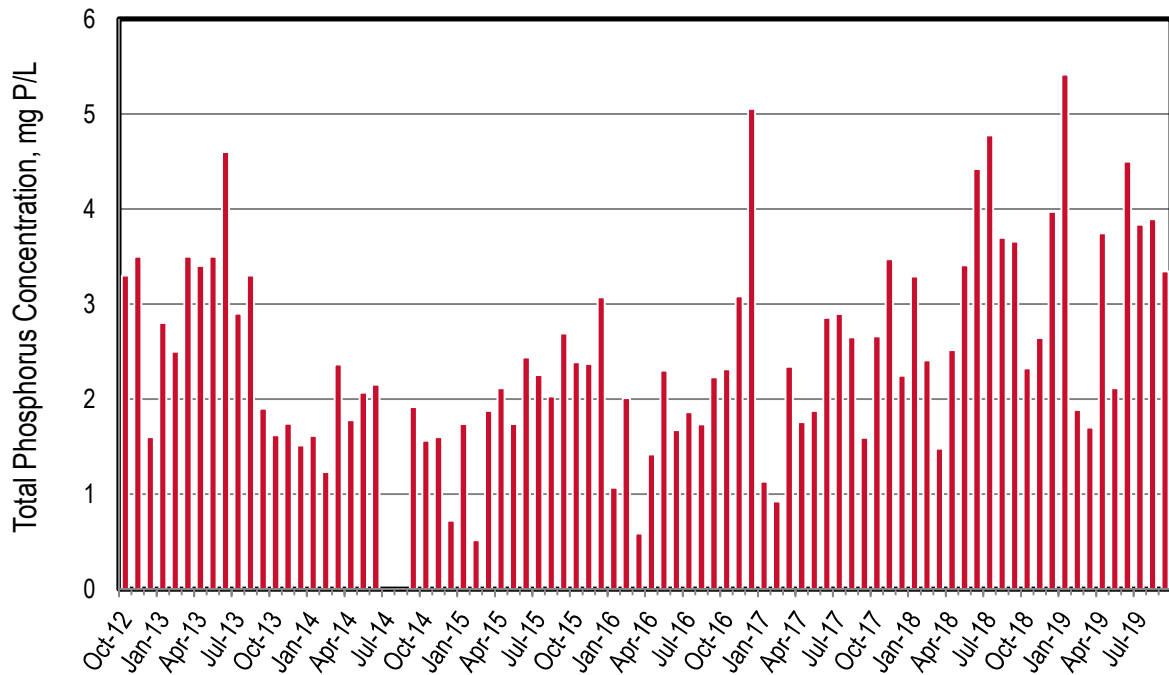


Figure 19-5. Pinole Monthly Phosphorus Concentrations

Table 19-1. Pinole Monthly Flows and Loads

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-12	2.85	226	54.0	280	35.6
Nov-12	2.63	250	124	374	34.8
Dec-12	2.73	86.2	100	186	16.5
Jan-13	2.68	203	28.4	232	28.4
Feb-13	2.50	113	123	236	23.6
Mar-13	2.46	177	171	348	32.5
Apr-13	2.45	139	102	241	31.5
May-13	2.47	224	134	358	32.7
Jun-13	2.48	234	146	381	43.1
Jul-13	2.51	152	74.0	226	27.5
Aug-13	2.52	210	84.8	294	31.4
Sep-13	2.51	228	226	454	18.0
Oct-13	2.43	230	79.9	310	17.5
Nov-13	2.41	173	171	344	17.3
Dec-13	2.58	198	46.8	245	15.6
Jan-14	2.40	290	65.3	356	16.3
Feb-14	4.46	125	40.5	165	11.6
Mar-14	2.77	251	95.3	347	22.0
Apr-14	2.56	139	123	262	16.5
May-14	2.32	202	86.8	289	19.3
Jun-14	2.32	149	158	307	20.2
Jul-14	2.35	201			
Aug-14	2.33	264			
Sep-14	2.31	201	64.5	265	16.7
Oct-14	2.27	218	70.4	288	13.4
Nov-14	2.35	218	36.8	254	14.2
Dec-14	3.91	302	7.06	309	10.6
Jan-15	2.42	230	64.5	294	15.9
Feb-15	2.72	154	86.2	240	5.28
Mar-15	2.34	262	57.7	320	16.6
Apr-15	2.25	270	22.1	292	18.0
May-15	2.13	210	8.55	218	14.0
Jun-15	2.10	294	22.5	317	19.4
Jul-15	2.07	261	51.4	312	17.7
Aug-15	2.09	237	35.2	272	16.0
Sep-15	2.04	96.4	119	215	20.8

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-15	2.07	124	93.2	217	18.6
Nov-15	2.12	246	25.4	271	19.0
Dec-15	2.30	211	89.1	300	26.7
Jan-16	3.06	203	141	344	12.3
Feb-16	2.31	217	74.4	292	17.5
Mar-16	3.55	121	141	262	7.84
Apr-16	2.38	315	6.65	322	12.8
May-16	2.26	385	4.56	389	19.7
Jun-16	2.20	377	3.36	380	13.9
Jul-16	2.17	313	16.1	329	15.3
Aug-16	2.20	324	10.8	334	14.4
Sep-16	2.15	260	11.0	271	18.1
Oct-16	2.28	312	7.51	319	20.0
Nov-16	2.31	166	67.1	233	26.9
Dec-16	2.82	498	85.7	584	53.8
Jan-17	4.89	295	180	475	20.9
Feb-17	5.11	166	126	292	17.8
Mar-17	3.31	330	117	447	29.3
Apr-17	3.20	186	133	318	21.2
May-17	2.46	193	41.4	235	17.5
Jun-17	2.34	200	44.4	245	25.2
Jul-17	2.27	128	68.5	197	24.8
Aug-17	2.35	192	39.3	232	23.6
Sep-17	2.35	239	27.4	266	14.2
Oct-17	2.29	247	44.3	291	23.0
Nov-17	2.56	221	55.8	277	33.6
Dec-17	2.35	364	4.51	369	19.9
Jan-18	2.81	340	23.6	364	35.0
Feb-18	2.40	301	19.1	320	21.9
Mar-18	3.34	242	49.4	291	18.7
Apr-18	2.86	233	53.5	287	27.2
May-18	2.45	297	25.0	322	31.5
Jun-18	2.29	338	48.9	387	38.3
Jul-18	2.23	230	76.4	306	40.2
Aug-18	2.20	234	80.0	314	30.8
Sep-18	2.19	232	48.7	280	30.3
Oct-18	2.21	135	35.5	170	19.4

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Nov-18	2.34	282	30.6	313	23.4
Dec-18	2.41	176	31.9	208	36.1
Jan-19	3.08	229	183	499	63.1
Feb-19	4.54	151	129	280	32.4
Mar-19	3.62	0.765	144	145	23.3
Apr-19	2.60	107	145	252	36.8
May-19	2.74	107	68.0	175	21.9
Jun-19	2.62	111	131	243	44.5
Jul-19	2.53	38.7	129	168	36.7
Aug-19	2.52	33.5	154	187	37.1
Sep-19	2.11	14.1	65.2	79.3	26.7
Dry Season Average	2.32	212	69.8	280	24.9
Dry Season Trend	None	None	None	Down	None
Wet Season Average	2.80	218	79.7	299	23.1
Average Annual	2.60	215	75.7	292	23.8

* The Total Inorganic Nitrogen value is calculated by adding the "Ammonia" and "Nitrate + Nitrite" values.

** Refer to the Section 3.5 in the main body for a description on the statistical analysis.

20 Rodeo Sanitary District

Rodeo discharges to San Pablo Bay. The plant services approximately 8,900 people and it has a permitted capacity of 1.14 mgd ADWF. The current plant flows are approximately 0.5 mgd. The plant performs nitrification and phosphorus removal using an activated sludge process.

The following observations are made based upon the figures and table in the subsequent pages:

- ◆ Based on the table with the average monthly values, no emerging dry season trends emerge.
- ◆ Total nitrogen loads generally increase with flow during wet weather events.
- ◆ NO_x is the majority of the nitrogen species discharged as would be expected since this plant nitrifies. A portion of ammonia occasionally bleeds through year round.
- ◆ Total phosphorus concentrations range from 0.3 to 7.5 mg P/L. This suggests occasional P removal as typical effluent TP concentrations are 4 to 6 mg P/L. The removal mechanism is thought to be the anaerobic selector in the activated sludge process.

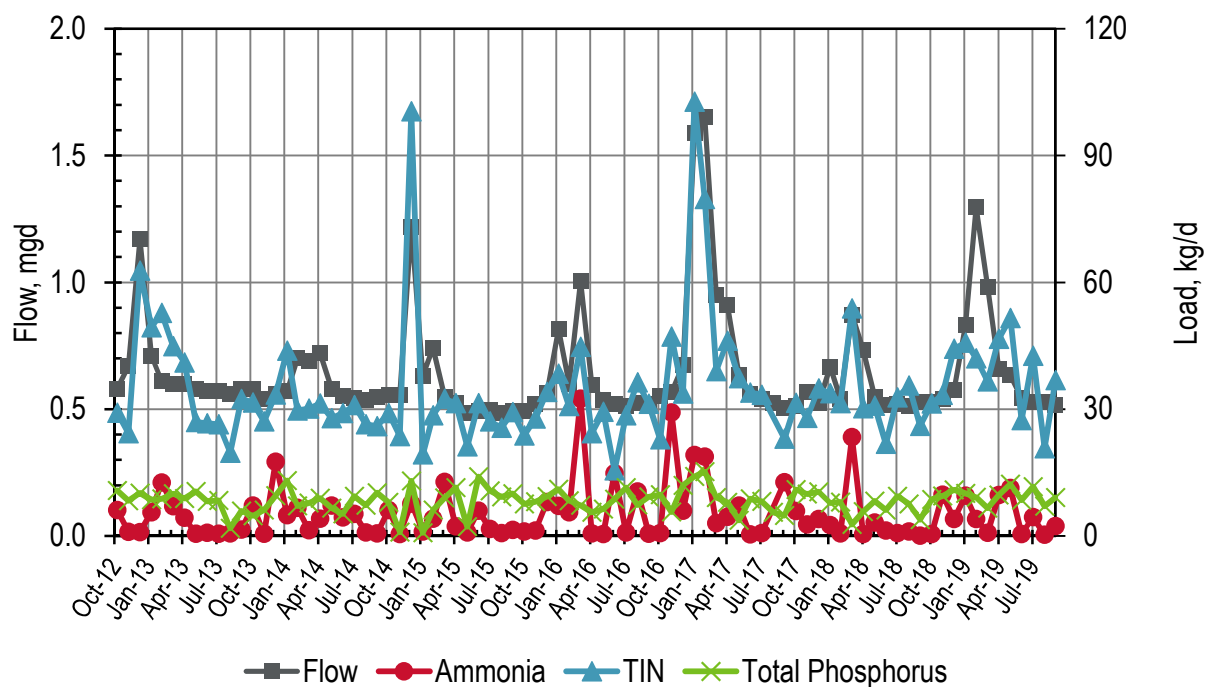


Figure 20-1. Rodeo Monthly Flows and Loads

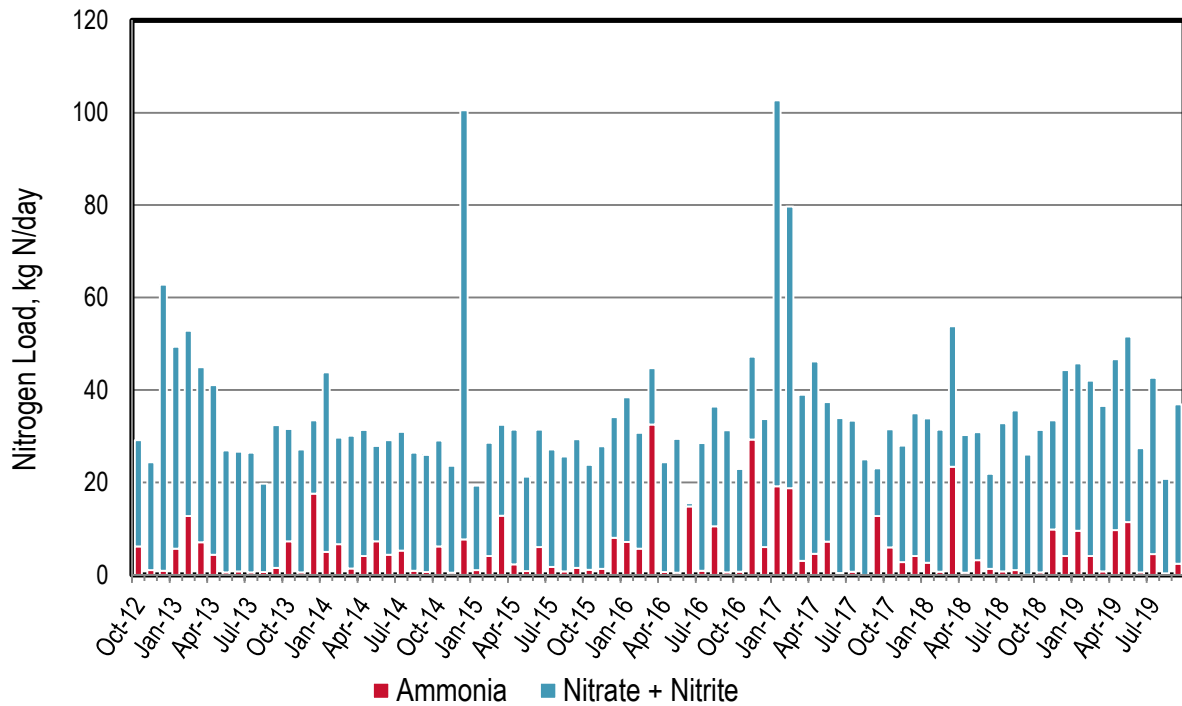


Figure 20-2. Rodeo Monthly Nitrogen Loads

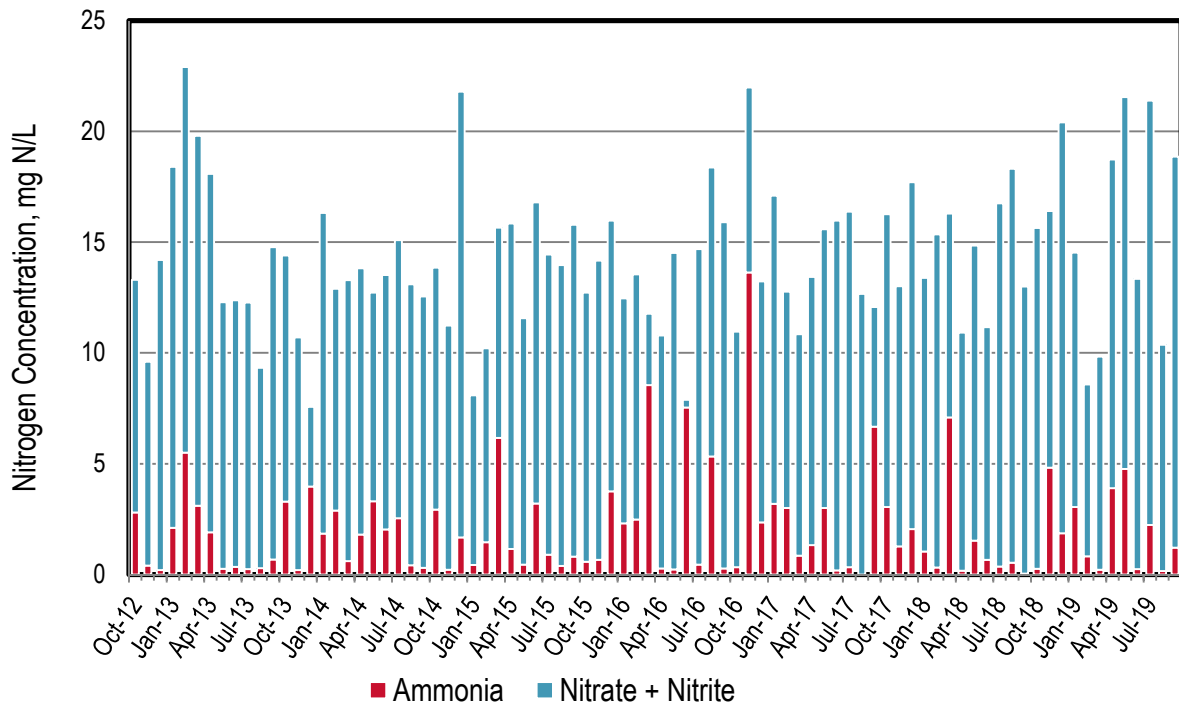


Figure 20-3. Rodeo Monthly Nitrogen Concentrations

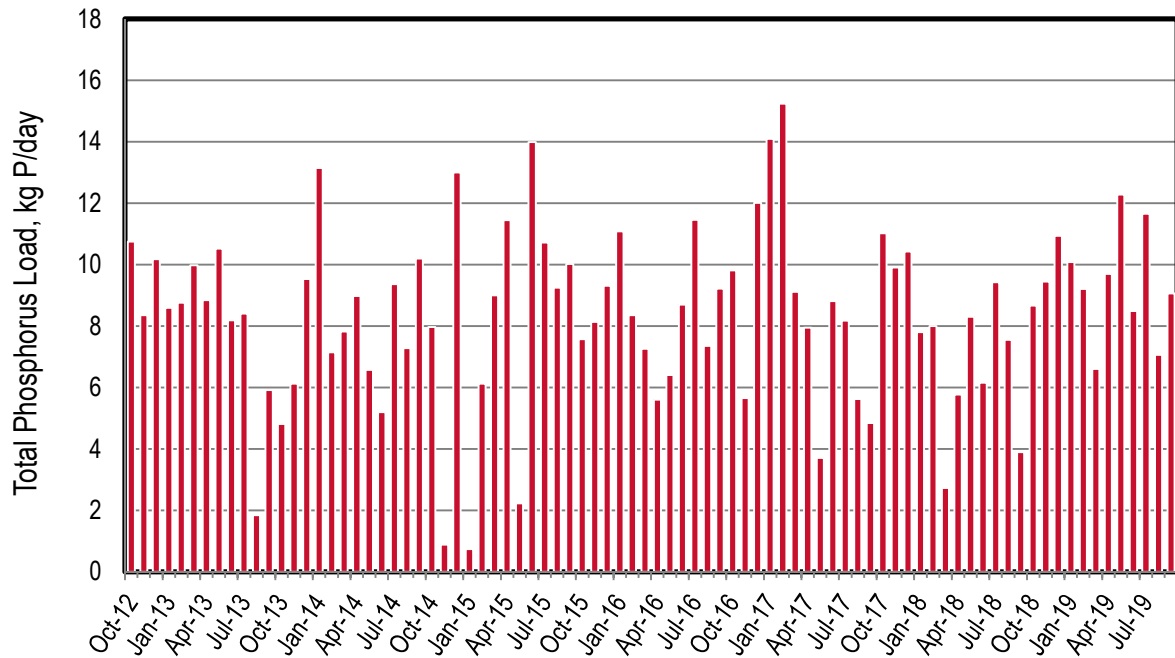


Figure 20-4. Rodeo Monthly Phosphorus Loads

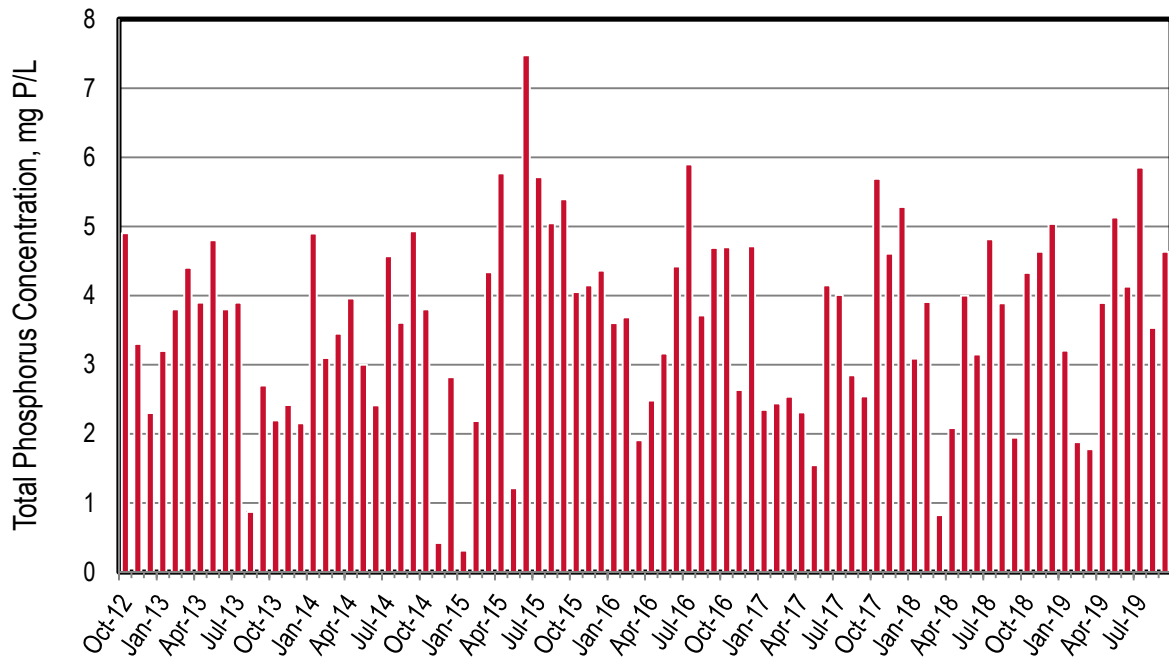


Figure 20-5. Rodeo Monthly Phosphorus Concentrations

Table 20-1. Rodeo Monthly Flows and Loads

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-12	0.580	6.14	23.0	29.2	10.7
Nov-12	0.670	1.01	23.3	24.3	8.36
Dec-12	1.17	0.885	61.9	62.8	10.2
Jan-13	0.710	5.64	43.7	49.4	8.59
Feb-13	0.610	12.7	40.1	52.8	8.76
Mar-13	0.600	7.03	37.9	44.9	9.98
Apr-13	0.600	4.31	36.7	41.0	8.85
May-13	0.580	0.548	26.4	26.9	10.5
Jun-13	0.570	0.733	25.9	26.7	8.19
Jul-13	0.570	0.517	25.9	26.4	8.40
Aug-13	0.560	0.614	19.1	19.7	1.84
Sep-13	0.580	1.49	30.9	32.4	5.92
Oct-13	0.580	7.21	24.3	31.6	4.81
Nov-13	0.540	0.510	26.6	27.1	6.12
Dec-13	0.560	17.6	15.9	33.4	9.53
Jan-14	0.570	4.96	38.8	43.8	13.1
Feb-14	0.700	6.65	23.1	29.7	7.14
Mar-14	0.690	1.36	28.8	30.1	7.82
Apr-14	0.720	4.08	27.3	31.4	8.98
May-14	0.580	7.23	20.7	27.9	6.58
Jun-14	0.550	4.37	24.7	29.1	5.20
Jul-14	0.543	5.20	25.8	31.0	9.37
Aug-14	0.535	0.846	25.6	26.4	7.28
Sep-14	0.547	0.625	25.3	26.0	10.2
Oct-14	0.555	6.13	22.9	29.0	7.97
Nov-14	0.556	0.444	23.2	23.6	0.888
Dec-14	1.22	7.68	92.8	100	13.0
Jan-15	0.631	1.04	18.2	19.3	0.739
Feb-15	0.741	4.08	24.5	28.6	6.12
Mar-15	0.549	12.8	19.7	32.5	9.00
Apr-15	0.525	2.29	29.1	31.4	11.4
May-15	0.485	0.816	20.4	21.2	2.23
Jun-15	0.495	6.00	25.4	31.4	14.0
Jul-15	0.496	1.67	25.4	27.1	10.7
Aug-15	0.485	0.712	24.9	25.6	9.25
Sep-15	0.491	1.48	27.8	29.3	10.0

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-15	0.494	1.06	22.7	23.8	7.57
Nov-15	0.519	1.31	26.5	27.8	8.14
Dec-15	0.565	8.01	26.1	34.1	9.31
Jan-16	0.815	7.11	31.3	38.4	11.1
Feb-16	0.600	5.64	25.1	30.7	8.36
Mar-16	1.01	32.5	12.2	44.7	7.26
Apr-16	0.597	0.625	23.7	24.3	5.60
May-16	0.536	0.475	28.9	29.4	6.41
Jun-16	0.520	14.8	0.692	15.5	8.69
Jul-16	0.514	0.869	27.7	28.5	11.5
Aug-16	0.524	10.5	25.8	36.4	7.35
Sep-16	0.520	0.527	30.7	31.3	9.22
Oct-16	0.552	0.685	22.2	22.9	9.81
Nov-16	0.568	29.2	17.9	47.2	5.65
Dec-16	0.674	6.00	27.7	33.7	12.0
Jan-17	1.59	19.1	83.6	103	14.1
Feb-17	1.65	18.8	61.0	79.7	15.2
Mar-17	0.950	3.04	35.9	39.0	9.12
Apr-17	0.910	4.54	41.6	46.2	7.95
May-17	0.634	7.19	30.2	37.4	3.71
Jun-17	0.562	0.377	33.6	33.9	8.81
Jul-17	0.539	0.675	32.7	33.4	8.18
Aug-17	0.522	--***	25.0	--***	5.62
Sep-17	0.504	12.7	10.3	23.0	4.84
Oct-17	0.512	5.91	25.6	31.5	11.0
Nov-17	0.569	2.72	25.2	28.0	9.90
Dec-17	0.522	4.05	30.9	34.9	10.4
Jan-18	0.668	2.60	31.2	33.8	7.80
Feb-18	0.542	0.636	30.8	31.4	8.00
Mar-18	0.874	23.4	30.4	53.8	2.73
Apr-18	0.733	0.456	29.8	30.2	5.78
May-18	0.549	3.16	27.7	30.8	8.30
Jun-18	0.518	1.31	20.5	21.8	6.16
Jul-18	0.518	0.702	32.1	32.8	9.43
Aug-18	0.514	1.04	34.5	35.6	7.55
Sep-18	0.530	0.0742	26.0	26.0	3.89
Oct-18	0.530	0.501	30.8	31.3	8.67


Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Nov-18	0.539	9.81	23.6	33.4	9.45
Dec-18	0.574	4.03	40.3	44.3	10.9
Jan-19	0.833	9.57	36.2	45.8	10.1
Feb-19	1.30	4.03	38.0	42.0	9.21
Mar-19	0.983	0.770	35.8	36.5	6.60
Apr-19	0.659	9.70	36.9	46.6	9.70
May-19	0.633	11.4	40.2	51.6	12.3
Jun-19	0.544	0.497	26.9	27.4	8.49
Jul-19	0.527	4.45	38.2	42.6	11.7
Aug-19	0.529	0.297	20.4	20.7	7.06
Sep-19	0.517	2.37	34.5	36.9	9.06
Dry Season Average	0.538	3.13	26.3	29.5	7.94
Dry Season Trend	None	None	None	None	None
Wet Season Average	0.722	6.74	32.3	39.1	8.65
Average Annual	0.646	5.26	29.8	35.1	8.35

* The Total Inorganic Nitrogen value is calculated by adding the "Ammonia" and "Nitrate + Nitrite" values.

** Refer to the Section 3.5 in the main body for a description on the statistical analysis.

*** Missing data due to Caltest missing request for ammonia analysis. (See letter below).

NELAP/ORELAP Certification 4036



ELAP Certification 1664

September 29, 2017

Andrew Alva
Rodeo Sanitary District
800 San Pablo Ave
Rodeo, CA 94572



RE: Missed Ammonia Analysis

Dear Andrew Alva,


On August 14, 2017, Caltest received two water samples from Rodeo Sanitary District. One of the samples had TKN, NH₃, Total Phosphate, and Nitrate/Nitrite analyses clearly requested on the accompanying Chain of Custody form. Unfortunately, the request for NH₃ analysis was missed by Caltest and was not performed on the sample received. This request was not noticed until the client brought it to my attention on September 27, 2017, by then the sample was beyond the method prescribed 28 day holding time.

I apologize for this error; missed analysis requests are quite an anomaly here at Caltest and are something we take very seriously. I've alerted our staff of this unfortunate event to decrease the likelihood of this error occurring again.

Please feel free to contact me if you have any questions or need any further assistance.

Thank you,

Sincerely,
Caltest Analytical Laboratory



Sandra Lyn Luna
Project Manager
Caltest Analytical Laboratory

1885 North Kelly Road • Napa, California 94558
(707) 258-4000 • Fax: (707) 226-1001 • e-mail: info@caltestlabs.com

21 San Jose-Santa Clara Regional Wastewater Facility

The San Jose-Santa Clara Regional Wastewater Facility discharges to the Lower South Bay, and serves an estimated population of 1.5 million with approximately 17,000 commercial and industrial connections. The plant has a permitted ADWF capacity of 167 mgd and a peak wet weather capacity of 261 mgd. The current flows are approximately 79.5 mgd ADWF. The process includes advanced treatment with a Biological Nutrient Removal (BNR) activated sludge system for N and P removal.

The following observations are made based upon the figures and table in the subsequent pages:

- ◆ The flows reduce 10 to 20 mgd from the wet to the dry season due to a combination of recycled water demand and a lack of inflow and infiltration during the dry season.
- ◆ There appears to be no statistically significant dry season trend for flow or nutrient loads.
- ◆ Both total nitrogen and total phosphorus loads generally increase with flow during wet weather events.
- ◆ Wet season loads are greater and more variable than the dry season loads.
- ◆ NO_x is the majority of the nitrogen species discharged, regardless of season. This would be expected since the plant fully nitrifies year-round and discharges very little ammonia.
- ◆ Since April 2017, the facility has enhanced the total phosphorus load reduction capabilities as evidenced by total phosphorus concentrations below 1 mg P/L.

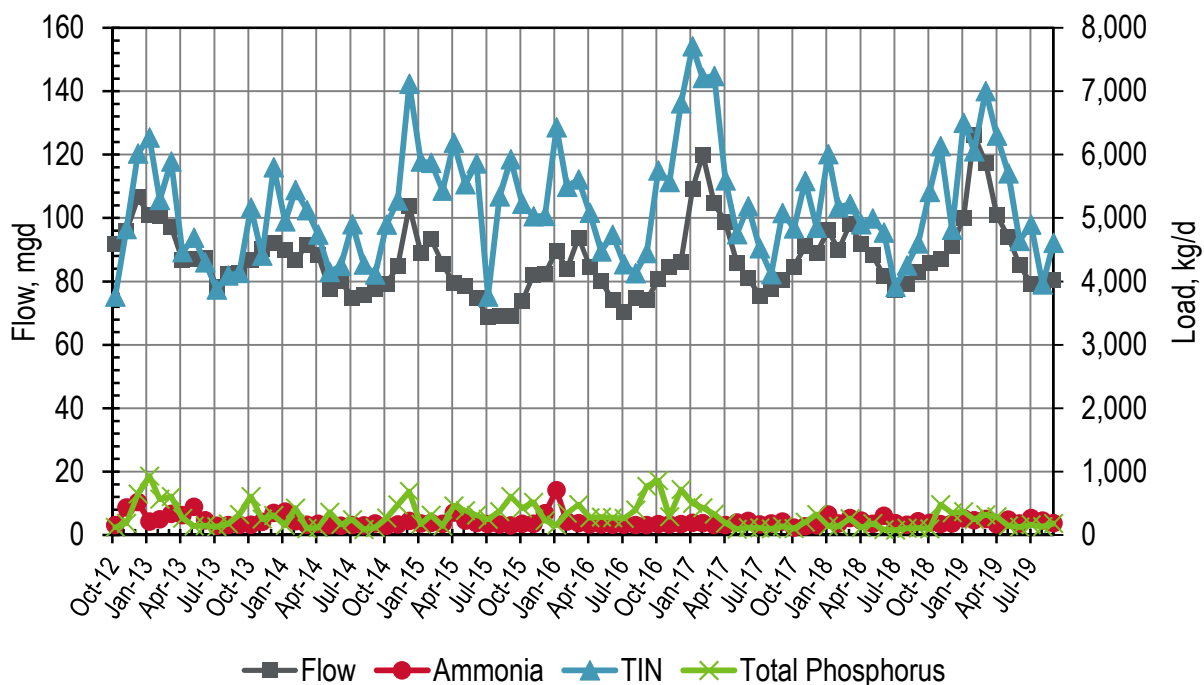


Figure 21-1. San Jose Monthly Flows and Loads

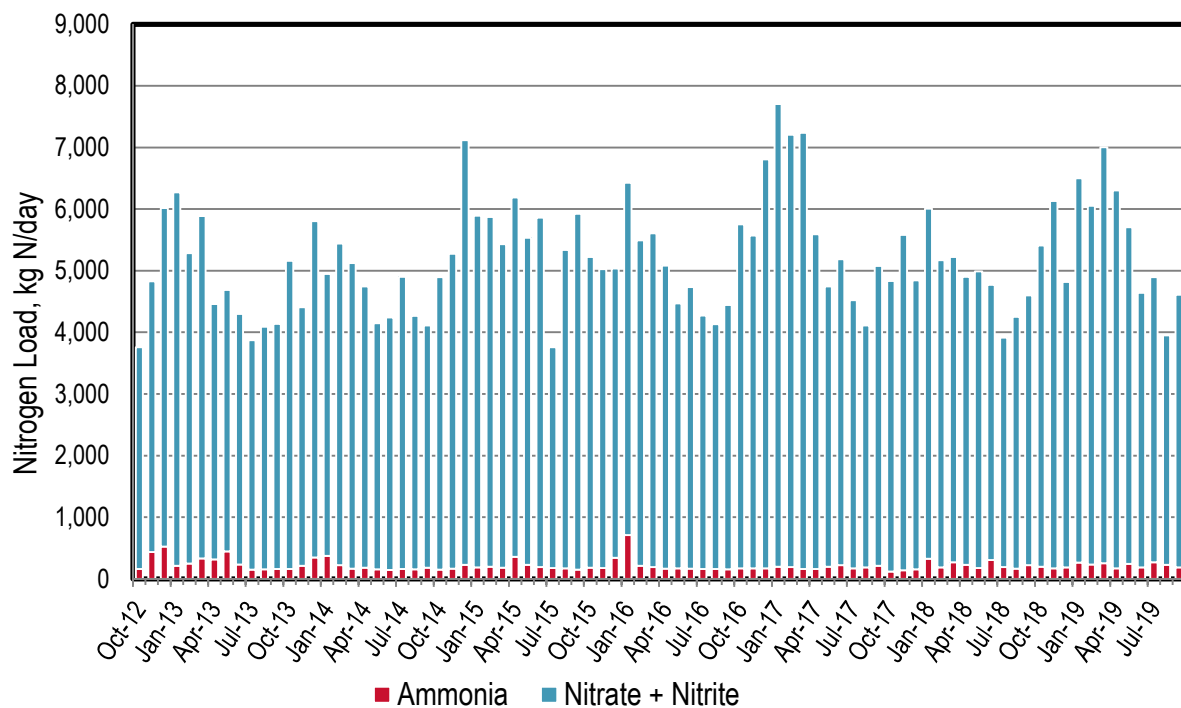


Figure 21-2. San Jose Monthly Nitrogen Loads

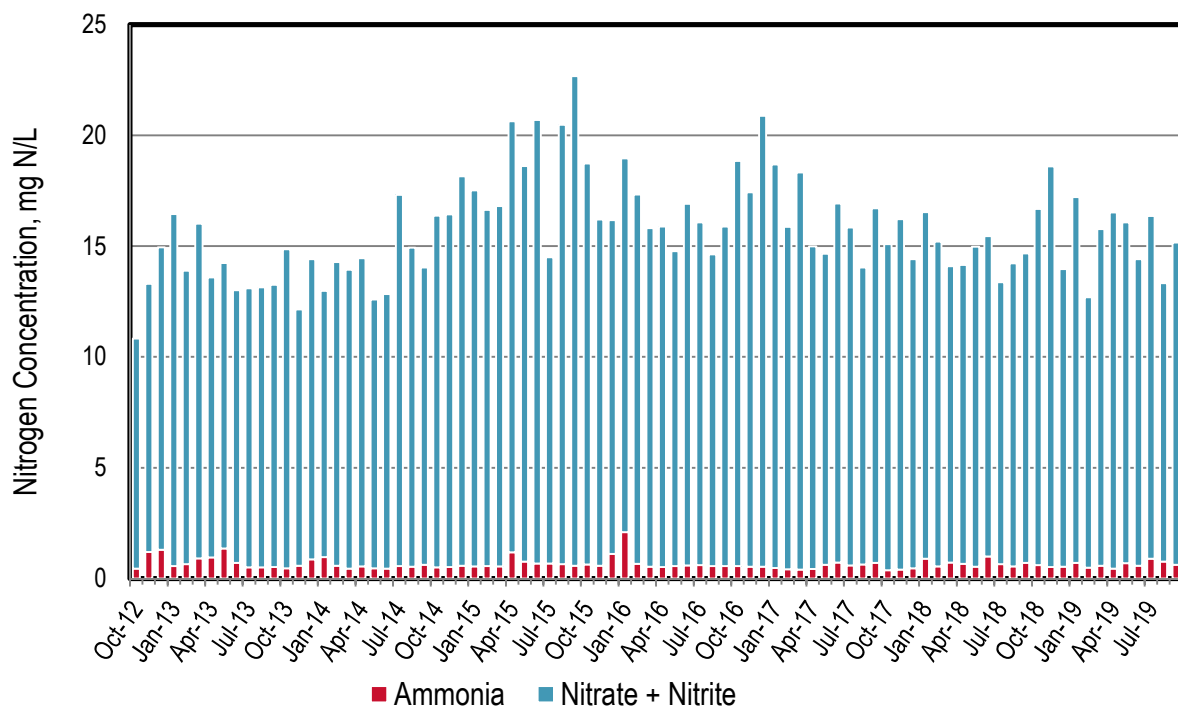


Figure 21-3. San Jose Monthly Nitrogen Concentrations

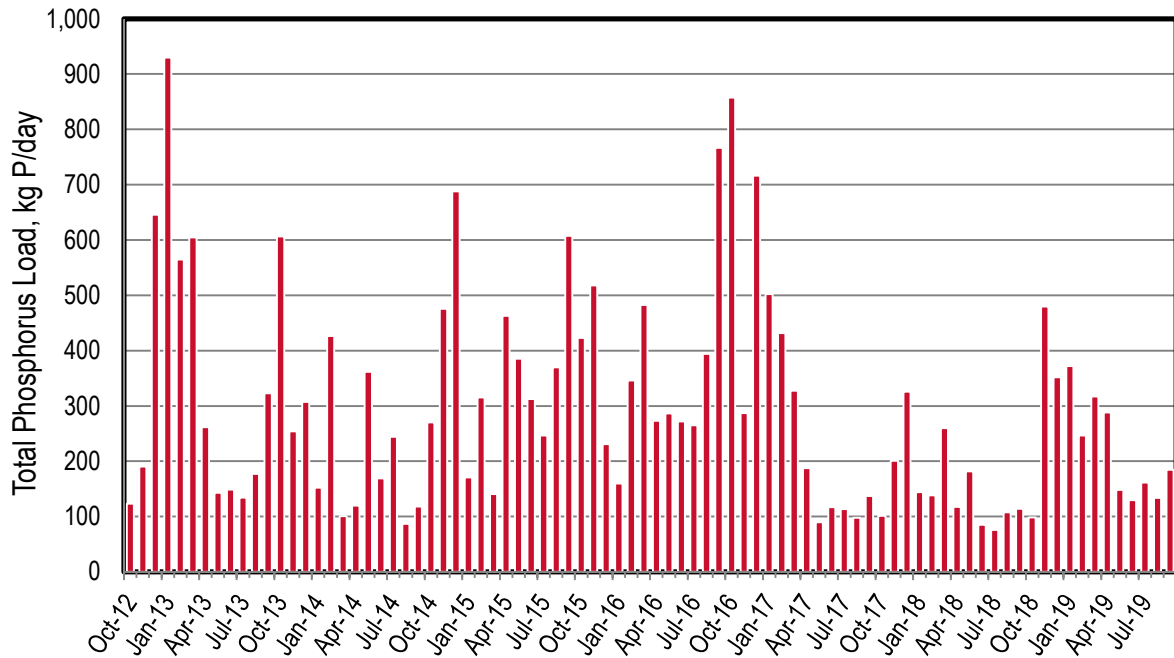


Figure 21-4. San Jose Monthly Phosphorus Loads

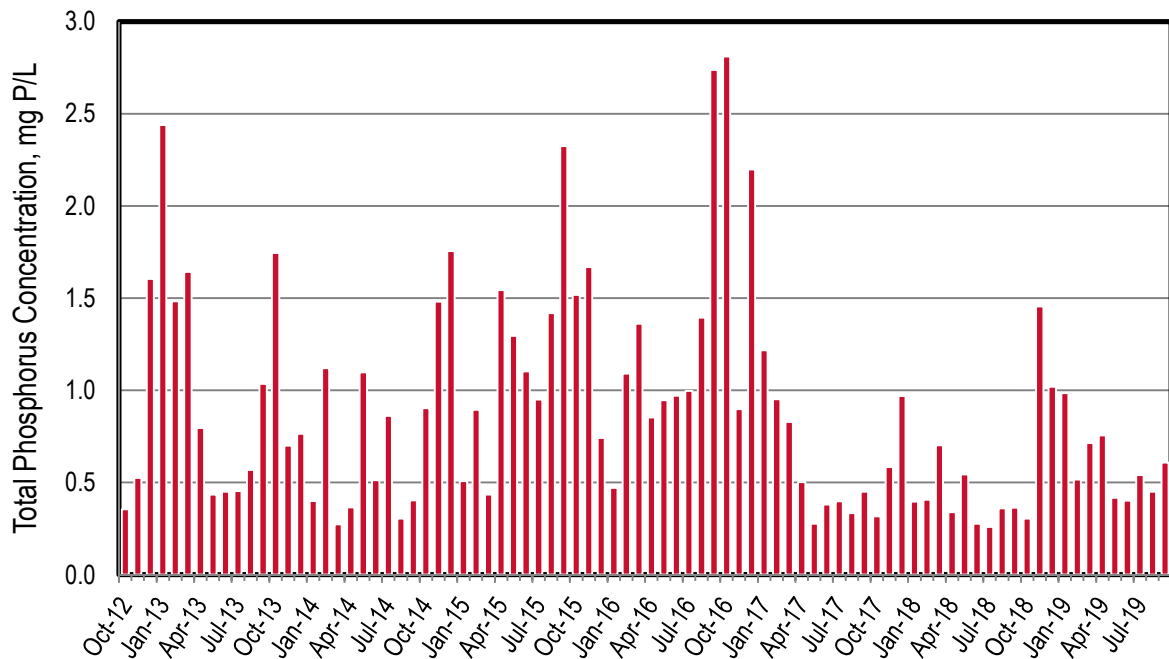


Figure 21-5. San Jose Monthly Phosphorus Concentrations

Table 21-1. San Jose Monthly Flows and Loads

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-12	91.9	157	3,600	3,760	124
Nov-12	96.0	433	4,390	4,830	190
Dec-12	107	523	5,490	6,020	646
Jan-13	101	211	6,060	6,270	930
Feb-13	101	247	5,040	5,290	565
Mar-13	97.3	332	5,560	5,890	605
Apr-13	86.9	313	4,150	4,460	261
May-13	87.2	446	4,240	4,690	143
Jun-13	87.5	232	4,070	4,300	149
Jul-13	78.3	148	3,730	3,870	134
Aug-13	82.4	156	3,940	4,090	177
Sep-13	82.6	161	3,970	4,140	323
Oct-13	86.8	161	5,000	5,160	606
Nov-13	90.4	211	4,190	4,410	254
Dec-13	92.3	347	5,450	5,800	307
Jan-14	89.9	370	4,580	4,950	152
Feb-14	86.7	220	5,220	5,440	426
Mar-14	91.5	162	4,960	5,120	101
Apr-14	88.4	180	4,560	4,740	120
May-14	77.6	153	4,000	4,150	361
Jun-14	80.2	146	4,100	4,240	169
Jul-14	74.9	160	4,740	4,900	244
Aug-14	75.6	152	4,110	4,270	86.8
Sep-14	77.5	181	3,930	4,110	118
Oct-14	79.1	149	4,750	4,900	270
Nov-14	84.9	166	5,110	5,270	475
Dec-14	104	226	6,890	7,120	688
Jan-15	89.0	184	5,710	5,890	171
Feb-15	93.3	195	5,680	5,870	315
Mar-15	85.5	178	5,250	5,430	141
Apr-15	79.4	356	5,830	6,190	463
May-15	78.7	227	5,310	5,530	385
Jun-15	74.9	190	5,670	5,860	312
Jul-15	68.6	175	3,580	3,760	246
Aug-15	69.0	167	5,170	5,340	370
Sep-15	69.2	151	5,770	5,920	608

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-15	73.8	178	5,050	5,220	423
Nov-15	82.1	177	4,850	5,030	518
Dec-15	82.4	343	4,690	5,030	231
Jan-16	89.8	710	5,720	6,430	160
Feb-16	83.8	212	5,280	5,490	346
Mar-16	93.8	190	5,420	5,610	483
Apr-16	84.7	166	4,910	5,080	273
May-16	80.1	170	4,300	4,470	287
Jun-16	74.1	163	4,570	4,740	272
Jul-16	70.3	161	4,110	4,270	265
Aug-16	74.7	159	3,970	4,130	394
Sep-16	74.1	156	4,290	4,450	766
Oct-16	80.7	171	5,580	5,750	857
Nov-16	84.6	169	5,400	5,570	287
Dec-16	86.2	172	6,640	6,810	716
Jan-17	109	196	7,510	7,710	502
Feb-17	120	190	7,020	7,210	432
Mar-17	105	157	7,080	7,240	327
Apr-17	98.7	159	5,430	5,590	187
May-17	85.7	198	4,550	4,750	89.9
Jun-17	81.1	222	4,960	5,190	117
Jul-17	75.5	168	4,360	4,520	114
Aug-17	77.6	185	3,930	4,110	97.8
Sep-17	80.5	214	4,870	5,080	137
Oct-17	84.8	117	4,720	4,840	101
Nov-17	91.1	138	5,440	5,580	201
Dec-17	88.9	154	4,690	4,850	326
Jan-18	96.2	327	5,680	6,010	144
Feb-18	90.0	185	4,990	5,170	139
Mar-18	98.0	269	4,950	5,220	260
Apr-18	91.7	229	4,670	4,900	117
May-18	88.2	177	4,810	4,990	182
Jun-18	81.7	305	4,470	4,770	85.3
Jul-18	77.4	189	3,720	3,910	75.8
Aug-18	79.1	162	4,090	4,250	108
Sep-18	82.9	220	4,380	4,600	114
Oct-18	85.8	195	5,220	5,410	98.7

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Nov-18	87.2	171	5,960	6,130	480
Dec-18	91.3	186	4,630	4,820	352
Jan-19	100.0	265	6,240	6,500	372
Feb-19	126	234	5,820	6,050	247
Mar-19	117	255	6,750	7,000	317
Apr-19	101	168	6,130	6,300	288
May-19	94.0	244	5,460	5,710	148
Jun-19	85.2	185	4,450	4,640	129
Jul-19	79.2	267	4,630	4,900	162
Aug-19	78.5	227	3,720	3,950	134
Sep-19	80.4	186	4,420	4,610	185
Dry Season Average	79.0	194	4,410	4,610	220
Dry Season Trend	None	None	None	None	None
Wet Season Average	92.7	233	5,390	5,620	347
Average Annual	87.0	217	4,980	5,200	294

* The Total Inorganic Nitrogen value is calculated by adding the "Ammonia" and "Nitrate + Nitrite" values.

** Refer to the Section 3.5 in the main body for a description on the statistical analysis.

22 City of San Mateo

San Mateo discharges to the South Bay and it has approximately 41,434 service connections. The plant has a permitted ADWF capacity of 15.7 mgd and a peak wet weather capacity of 60 mgd. The current flows are approximately 9.5 mgd ADWF. The plant performs secondary treatment using activated sludge.

The following observations are made based upon the figures and table in the subsequent pages:

- ◆ Based on the average monthly values table below, there appears to be no emerging trend for dry season flows or loads.
- ◆ Nitrogen species concentrations are typically highest during the dry season.
- ◆ Ammonia is the majority of the nitrogen species discharged, regardless of season. This would be expected since this plant does not nitrify.
- ◆ Total phosphorus concentrations range from 0.5 to 5.6 mg P/L. This suggests a portion of P is removed as typical effluent TP concentrations are 4 to 6 mg P/L. The removal mechanism is most likely from ferrous chloride addition to solids thickening.

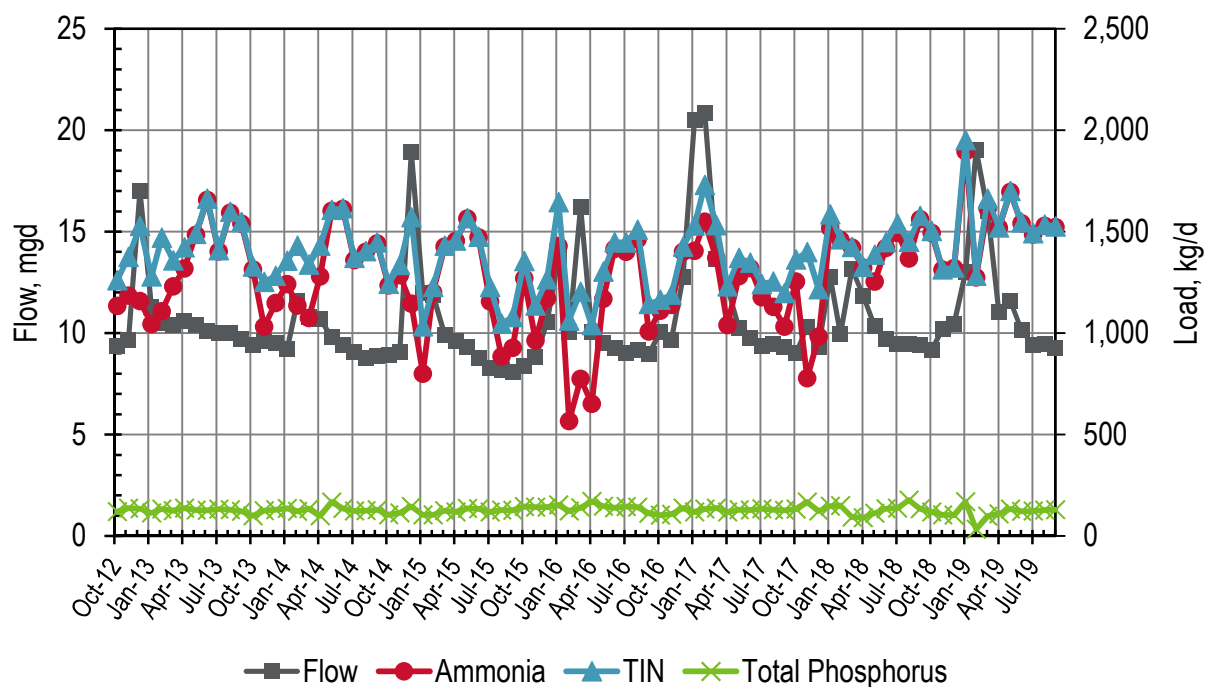


Figure 22-1. San Mateo Monthly Flows and Loads

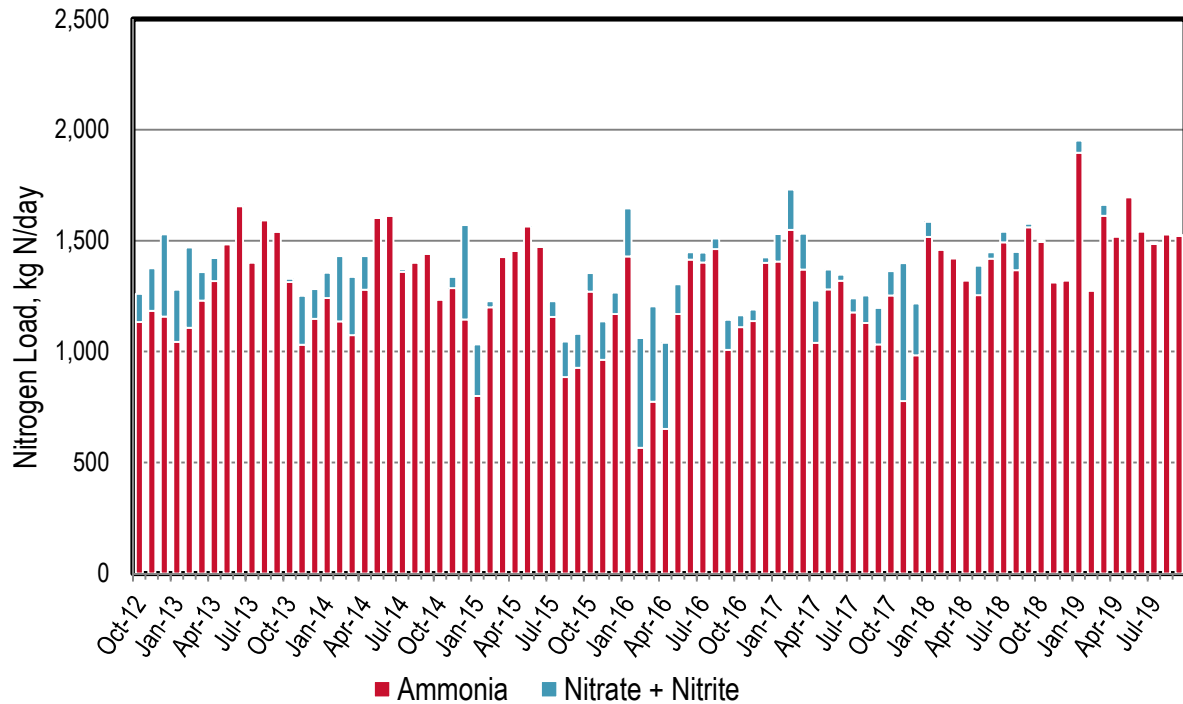


Figure 22-2. San Mateo Monthly Nitrogen Loads

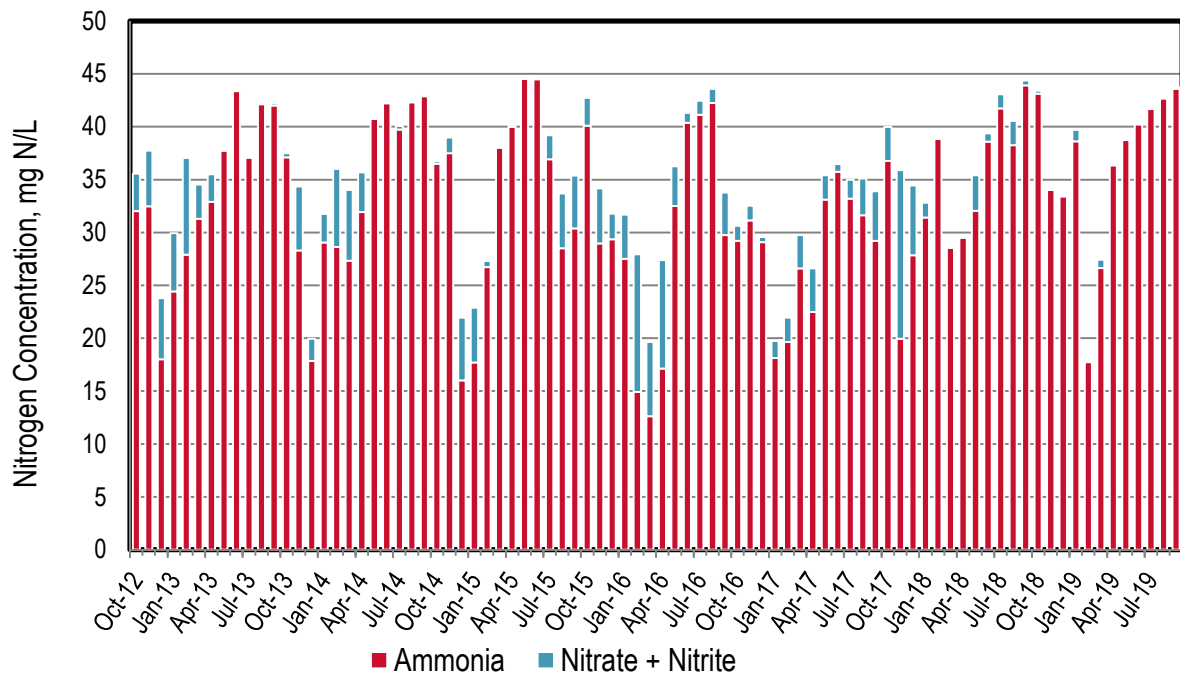


Figure 22-3. San Mateo Monthly Nitrogen Concentrations

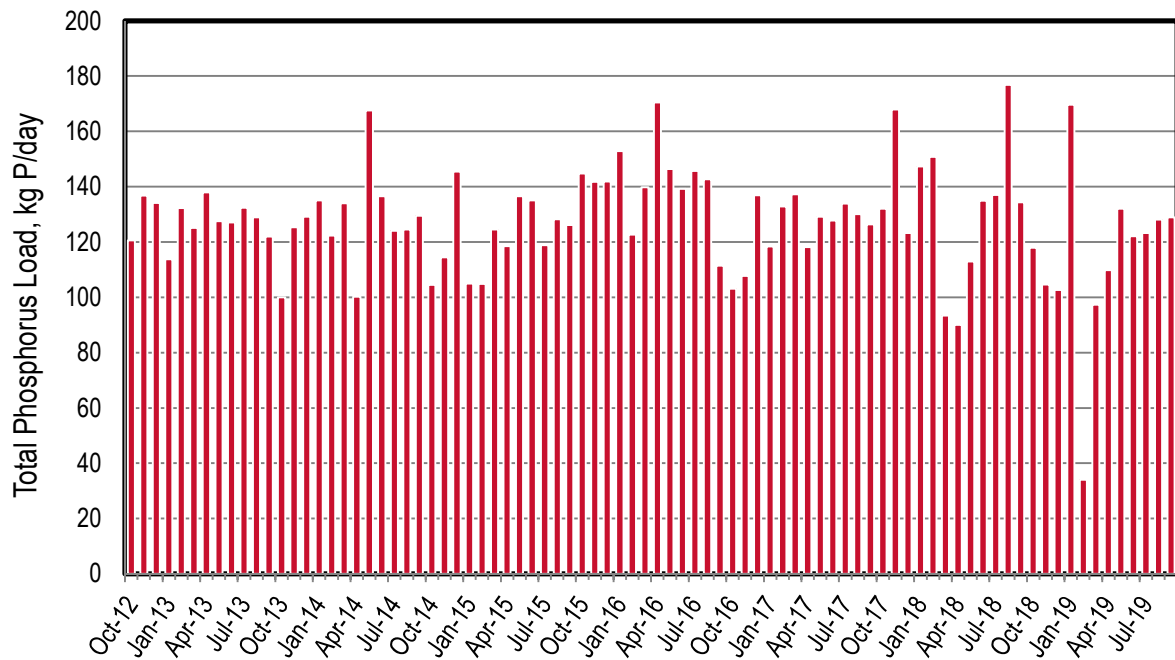


Figure 22-4. San Mateo Monthly Phosphorus Loads

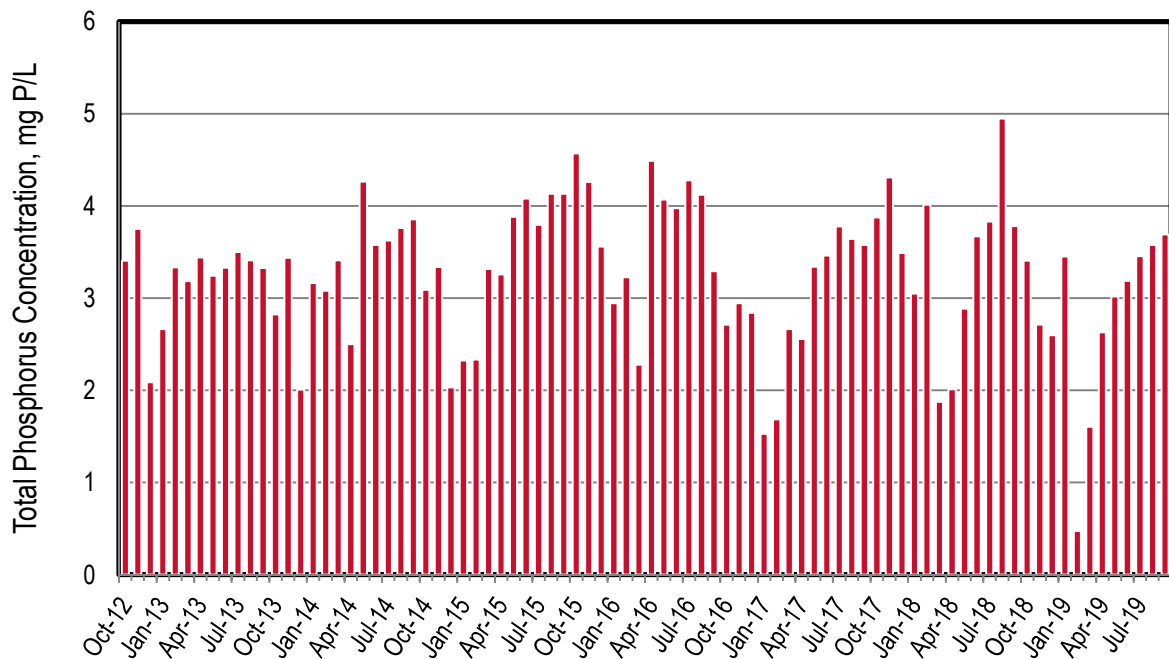


Figure 22-5. San Mateo Monthly Phosphorus Concentrations

Table 22-1. San Mateo Monthly Flows and Loads

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-12	9.37	1,130	126	1,260	121
Nov-12	9.65	1,180	192	1,380	137
Dec-12	17.0	1,160	371	1,530	134
Jan-13	11.3	1,040	235	1,280	114
Feb-13	10.5	1,110	362	1,470	132
Mar-13	10.4	1,230	127	1,360	125
Apr-13	10.6	1,320	104	1,420	138
May-13	10.4	1,480	4.45	1,490	128
Jun-13	10.1	1,660	6.85	1,660	127
Jul-13	10.0	1,400	6.42	1,410	132
Aug-13	10.0	1,590	5.84	1,600	129
Sep-13	9.70	1,540	7.72	1,550	122
Oct-13	9.40	1,310	14.1	1,330	100.0
Nov-13	9.60	1,030	221	1,250	125
Dec-13	9.50	1,150	135	1,280	129
Jan-14	9.20	1,240	115	1,360	135
Feb-14	11.6	1,140	294	1,430	122
Mar-14	10.8	1,070	263	1,340	134
Apr-14	10.7	1,280	151	1,430	100
May-14	9.80	1,600	5.87	1,610	168
Jun-14	9.40	1,610	3.53	1,620	137
Jul-14	9.05	1,360	12.1	1,370	124
Aug-14	8.76	1,400	2.57	1,400	125
Sep-14	8.89	1,440	4.97	1,450	130
Oct-14	8.95	1,230	7.47	1,240	105
Nov-14	9.07	1,290	50.8	1,340	115
Dec-14	18.9	1,150	425	1,570	146
Jan-15	12.0	800	233	1,030	105
Feb-15	11.9	1,200	26.7	1,230	105
Mar-15	9.93	1,430	3.91	1,430	125
Apr-15	9.62	1,450	1.75	1,460	119
May-15	9.30	1,560	1.95	1,570	137
Jun-15	8.75	1,470	2.84	1,470	135
Jul-15	8.28	1,160	71.4	1,230	119
Aug-15	8.21	885	161	1,050	128
Sep-15	8.07	927	153	1,080	126

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-15	8.38	1,270	84.2	1,350	145
Nov-15	8.80	963	173	1,140	142
Dec-15	10.5	1,170	95.8	1,270	142
Jan-16	13.7	1,430	217	1,650	153
Feb-16	10.1	567	495	1,060	123
Mar-16	16.2	775	430	1,200	140
Apr-16	10.0	651	389	1,040	170
May-16	9.51	1,170	134	1,300	146
Jun-16	9.27	1,410	33.1	1,450	139
Jul-16	9.01	1,400	44.4	1,450	146
Aug-16	9.16	1,460	46.7	1,510	143
Sep-16	8.96	1,010	136	1,140	111
Oct-16	10.1	1,110	53.9	1,160	103
Nov-16	9.67	1,140	51.6	1,190	108
Dec-16	12.7	1,400	24.5	1,430	137
Jan-17	20.5	1,410	124	1,530	118
Feb-17	20.9	1,550	182	1,730	133
Mar-17	13.6	1,370	162	1,530	137
Apr-17	12.2	1,040	190	1,230	118
May-17	10.2	1,280	90.0	1,370	129
Jun-17	9.76	1,320	27.1	1,350	128
Jul-17	9.38	1,180	63.4	1,240	134
Aug-17	9.45	1,130	124	1,250	130
Sep-17	9.34	1,030	166	1,200	126
Oct-17	9.02	1,250	109	1,360	132
Nov-17	10.3	778	621	1,400	168
Dec-17	9.34	983	233	1,220	123
Jan-18	12.8	1,520	67.5	1,580	147
Feb-18	9.93	1,460	2.59	1,460	151
Mar-18	13.2	1,420	3.92	1,420	93.4
Apr-18	11.8	1,320	5.13	1,330	90.0
May-18	10.4	1,250	132	1,390	113
Jun-18	9.73	1,420	29.2	1,450	135
Jul-18	9.46	1,490	47.2	1,540	137
Aug-18	9.46	1,370	82.6	1,450	177
Sep-18	9.40	1,560	15.5	1,580	134
Oct-18	9.16	1,490	9.07	1,500	118

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Nov-18	10.2	1,310	2.58	1,310	105
Dec-18	10.4	1,320	2.88	1,320	103
Jan-19	13.0	1,900	54.5	1,950	170
Feb-19	19.0	1,280	6.80	1,280	34.0
Mar-19	16.0	1,610	49.0	1,660	97.3
Apr-19	11.0	1,520	2.96	1,520	110
May-19	11.6	1,700	3.84	1,700	132
Jun-19	10.1	1,540	4.55	1,550	122
Jul-19	9.44	1,490	6.55	1,490	123
Aug-19	9.47	1,530	5.47	1,530	128
Sep-19	9.24	1,520	3.76	1,530	129
Dry Season Average	9.46	1,380	47.0	1,430	132
Dry Season Trend	None	None	None	None	None
Wet Season Average	11.7	1,220	149	1,370	124
Average Annual	10.8	1,290	106	1,400	127

* The Total Inorganic Nitrogen value is calculated by adding the "Ammonia" and "Nitrate + Nitrite" values.

** Refer to the Section 3.5 in the main body for a description on the statistical analysis.

23 Sewerage Agency of Southern Marin (SASM)

SASM discharges to the Central Bay. The plant has approximately 14,800 service connections and it has a permitted capacity of 3.6 mgd ADWF. The current plant flow is approximately 1.8 mgd ADWF. The plant currently performs nitrification using under-loaded trickling filters.

The following observations are made based upon the figures and table in the subsequent pages:

- ◆ Based on the table with the average monthly values, dry season ammonia loads are trending up, while NO_x and total phosphorus loads are trending down.
- ◆ NO_x is the majority of the nitrogen species discharged as would be expected since this plant nitrifies. However, a portion of ammonia occasionally bleeds through year round. The ammonia bleed through is attributed to cold weather and over loading the trickling filters for nitrification.
- ◆ Total phosphorus concentrations range from 1.1 to 11 mg P/L. This suggests occasional P removal as typical effluent TP concentrations are 4 to 6 mg P/L. The removal mechanism is thought to be metal salt addition in the collection system.
- ◆ During the summer of 2018 and 2019, half of the trickling filters and primary clarifiers were under construction. These major changes resulted in atypically high levels of ammonia. The construction period resided between July 2018 to September 2018, and May 2019 to July 2019.

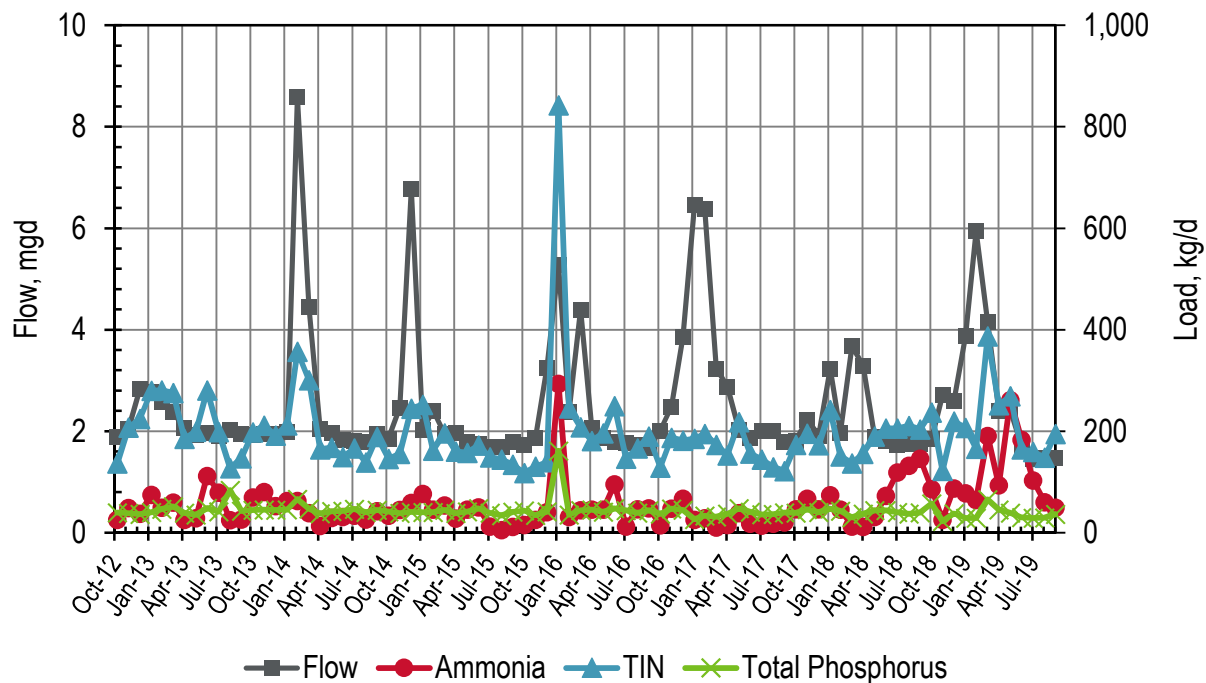


Figure 23-1. SASM Monthly Flows and Loads

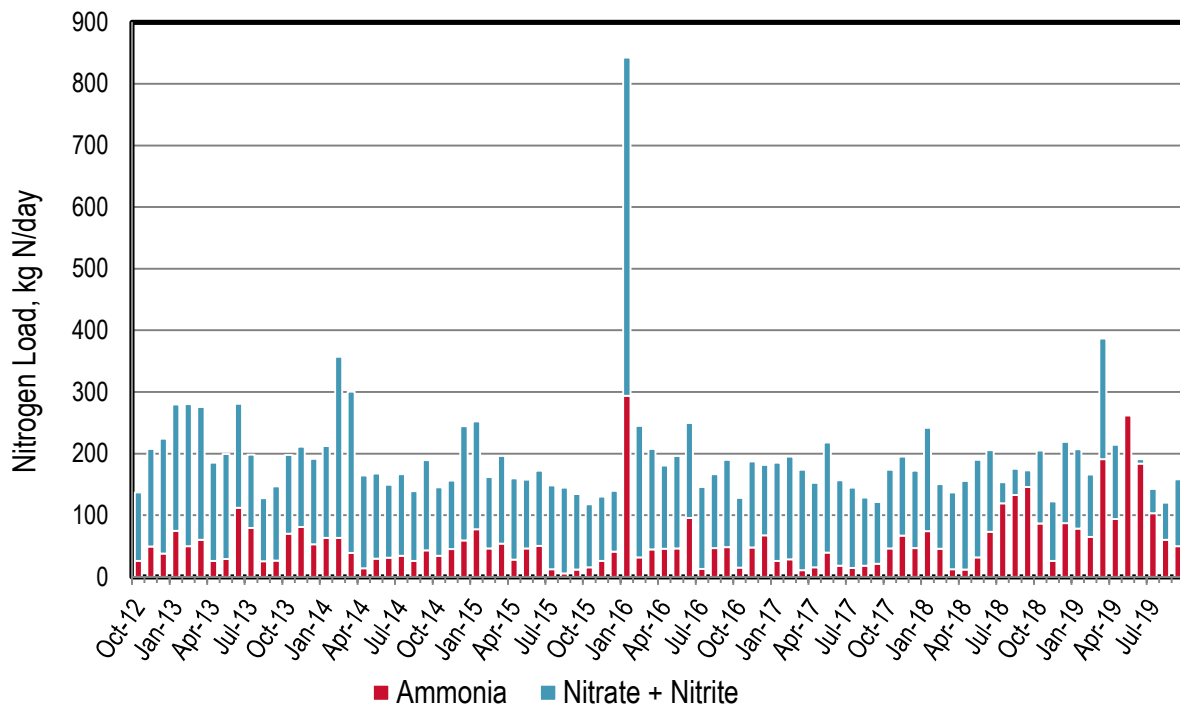


Figure 23-2. SASM Monthly Nitrogen Loads

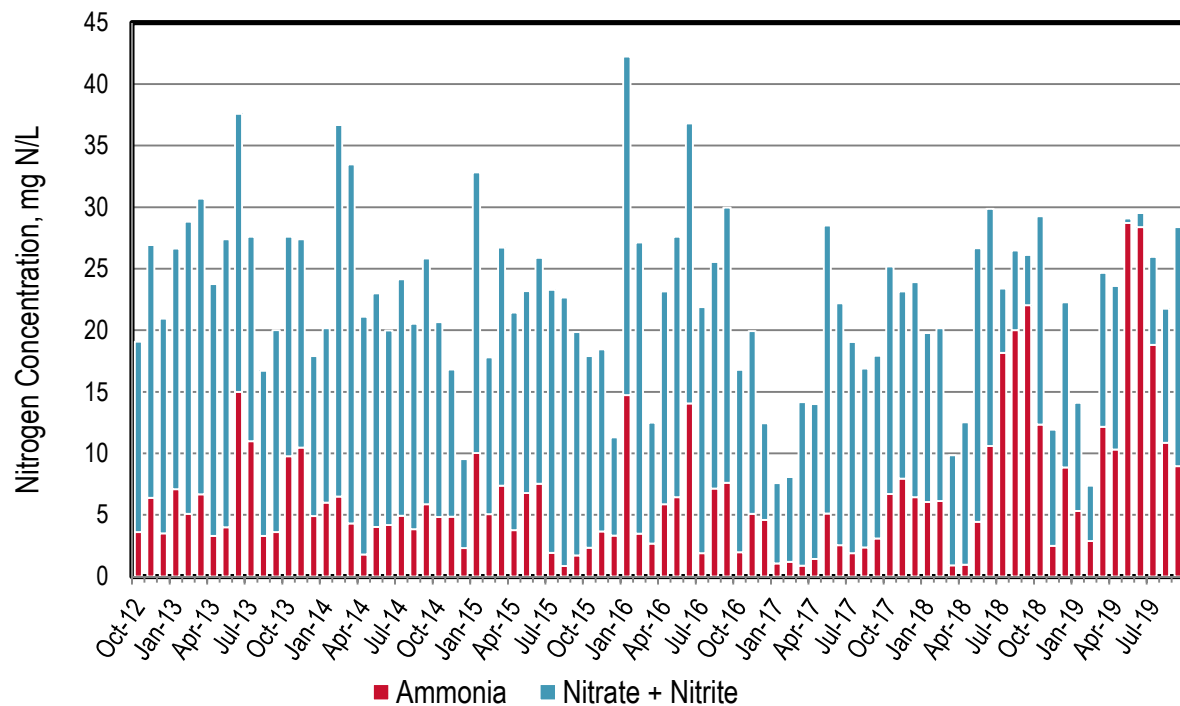


Figure 23-3. SASM Monthly Nitrogen Concentrations

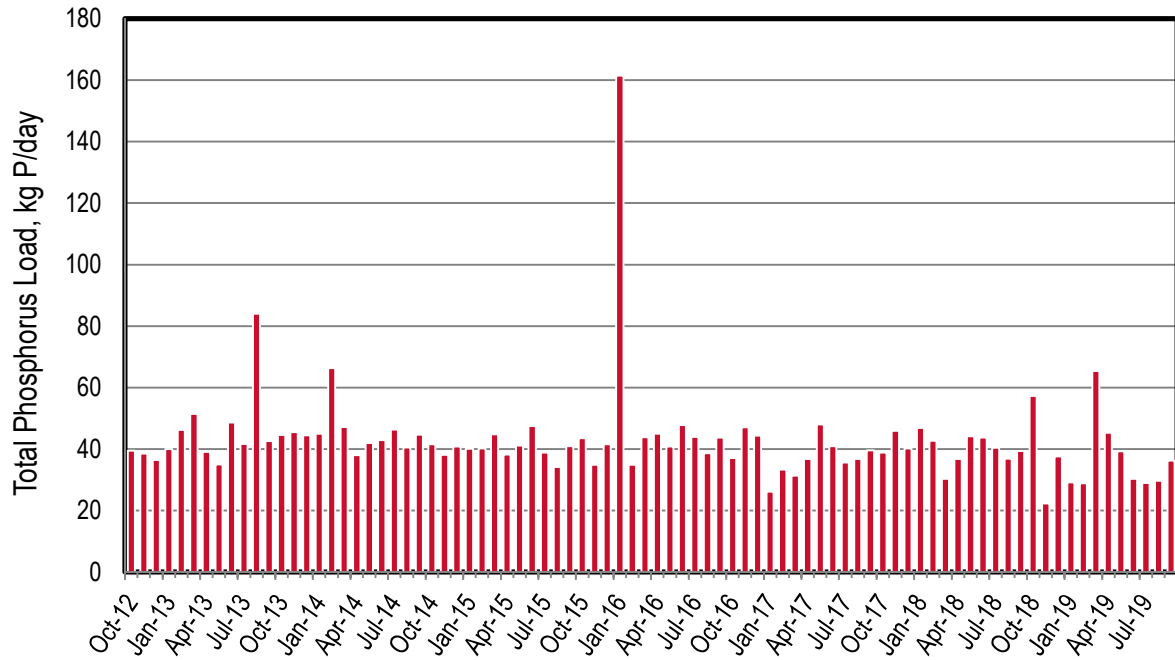


Figure 23-4. SASM Monthly Phosphorus Loads

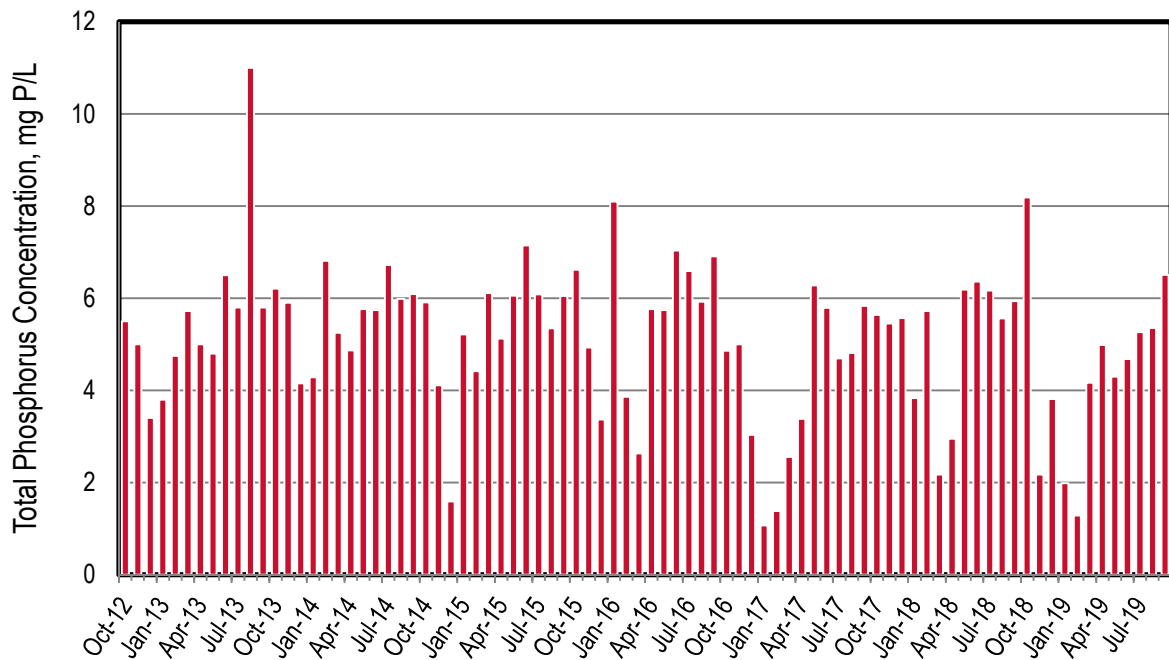


Figure 23-5. SASM Monthly Phosphorus Concentrations

Table 23-1. SASM Monthly Flows and Loads

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-12	1.90	25.8	111	137	39.4
Nov-12	2.04	49.3	158	208	38.5
Dec-12	2.83	37.5	187	224	36.4
Jan-13	2.78	74.6	205	280	39.9
Feb-13	2.58	49.5	231	280	46.3
Mar-13	2.38	60.0	216	276	51.4
Apr-13	2.06	25.7	159	185	39.0
May-13	1.93	29.1	170	199	34.9
Jun-13	1.98	112	169	281	48.6
Jul-13	1.90	79.0	119	198	41.7
Aug-13	2.02	25.2	102	128	84.0
Sep-13	1.94	26.4	120	147	42.5
Oct-13	1.93	70.0	128	198	44.5
Nov-13	1.94	80.7	130	211	45.5
Dec-13	1.96	52.6	139	192	44.5
Jan-14	1.99	63.0	149	212	45.0
Feb-14	8.59	63.1	294	357	66.3
Mar-14	4.46	38.8	262	301	47.2
Apr-14	2.05	13.9	151	165	38.0
May-14	1.98	29.2	138	167	42.0
Jun-14	1.83	31.1	118	149	42.9
Jul-14	1.82	34.0	132	166	46.3
Aug-14	1.79	26.0	113	139	40.5
Sep-14	1.94	43.0	146	189	44.6
Oct-14	1.86	34.0	111	145	41.6
Nov-14	2.46	45.0	111	156	38.1
Dec-14	6.78	59.0	185	244	40.8
Jan-15	2.03	77.0	175	252	40.0
Feb-15	2.41	46.0	116	162	40.2
Mar-15	1.94	54.0	142	196	44.8
Apr-15	1.97	28.0	132	160	38.2
May-15	1.80	46.0	112	158	41.2
Jun-15	1.76	50.0	122	172	47.5
Jul-15	1.69	12.3	136	149	38.8
Aug-15	1.69	5.50	139	145	34.1
Sep-15	1.79	11.6	123	134	40.9

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-15	1.74	15.4	102	118	43.5
Nov-15	1.87	25.8	104	130	34.8
Dec-15	3.26	40.8	98.6	139	41.5
Jan-16	5.28	294	549	843	161
Feb-16	2.39	31.5	214	245	34.9
Mar-16	4.40	44.5	163	208	43.8
Apr-16	2.06	45.7	135	181	45.0
May-16	1.88	45.8	150	196	40.8
Jun-16	1.80	95.5	154	250	47.7
Jul-16	1.76	12.7	133	146	44.0
Aug-16	1.73	46.6	120	167	38.6
Sep-16	1.68	48.3	142	190	43.8
Oct-16	2.02	15.1	113	128	37.1
Nov-16	2.49	47.7	140	187	47.0
Dec-16	3.86	67.3	114	182	44.4
Jan-17	6.46	25.7	159	185	26.1
Feb-17	6.38	28.5	166	195	33.3
Mar-17	3.24	10.7	163	174	31.3
Apr-17	2.88	15.4	137	152	36.8
May-17	2.02	39.1	179	218	48.0
Jun-17	1.87	18.0	139	157	40.9
Jul-17	2.01	14.4	130	145	35.6
Aug-17	2.02	18.0	111	129	36.7
Sep-17	1.79	20.9	101	122	39.6
Oct-17	1.82	46.2	127	174	38.9
Nov-17	2.23	67.0	128	195	46.0
Dec-17	1.91	46.5	126	172	40.2
Jan-18	3.23	74.0	168	242	46.9
Feb-18	1.98	45.7	105	151	42.7
Mar-18	3.68	12.5	125	137	30.2
Apr-18	3.29	12.0	144	156	36.7
May-18	1.88	31.5	158	190	44.1
Jun-18	1.82	72.9	132	205	43.7
Jul-18	1.74	119	34.3	206	40.4
Aug-18	1.75	133	42.9	210	36.8
Sep-18	1.75	146	27.1	203	39.3
Oct-18	1.85	86.3	119	237	57.3

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Nov-18	2.71	25.6	96.6	122	22.3
Dec-18	2.60	87.2	132	219	37.5
Jan-19	3.88	78.2	129	207	29.1
Feb-19	5.95	64.9	101	166	28.8
Mar-19	4.15	191	196	387	65.4
Apr-19	2.40	93.6	121	252	45.3
May-19	2.41	262	3.29	269	39.2
Jun-19	1.71	184	7.27	165	30.3
Jul-19	1.45	103	39.2	159	28.9
Aug-19	1.46	60.1	60.4	148	29.6
Sep-19	1.47	49.9	108	195	36.3
Dry Season Average	1.82	59.4	112	177	41.6
Dry Season Trend	None	Up	Down	None	Down
Wet Season Average	3.04	54.8	156	213	43.5
Average Annual	2.53	56.7	138	198	42.7

* The Total Inorganic Nitrogen value is calculated by adding the "Ammonia" and "Nitrate + Nitrite" values.

** Refer to the Section 3.5 in the main body for a description on the statistical analysis.

24 San Francisco International Airport – MLTP (SFO)

SFO discharges to the South Bay. The plant has a permitted capacity of 3.4 mgd ADWF. The current flow is approximately 1.1 mgd ADWF. The process includes two separate treatment processes. Domestic water from the airport facilities are collected through the sanitary sewer collection system and treated with a sequential batch reactor (SBR). Industrial wastewater and storm run-off is treated in the Industrial plant, which includes a trickling filter.

The following observations are made based upon the figures and table in the subsequent pages:

- ◆ The facility made numerous process changes over the last few months (completed in 2018) to accomplish ammonia/total nitrogen load reduction (limited to the dry season).
- ◆ Based on the average monthly values table below, there appears to be an emerging dry season upward trend for total phosphorus loads.
- ◆ Phosphorus loads generally increase with flow during wet weather events.
- ◆ Ammonia loads have been decreasing since 2018.
- ◆ Total nitrogen concentrations occasionally reach upwards of 100 mg N/L, which is higher than most of the other plants. The plant receives concentrated waste from landed planes which most likely increases the concentrations.
- ◆ Total phosphorus concentrations range from <1 to 14.1 mg P/L. This wide range is attributed to a combination of highly variable industrial waste and/or occasional P removal (typical municipal discharge TP concentrations are 4 to 6 mg P/L).

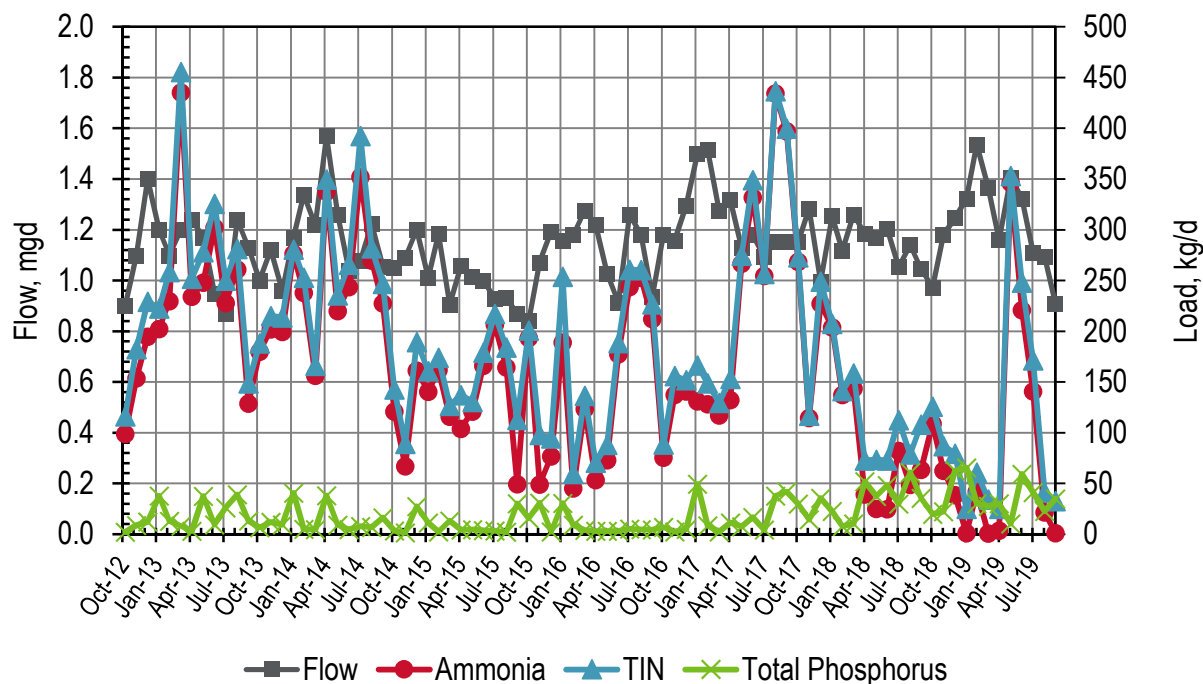


Figure 24-1. SFO Airport Monthly Flows and Loads

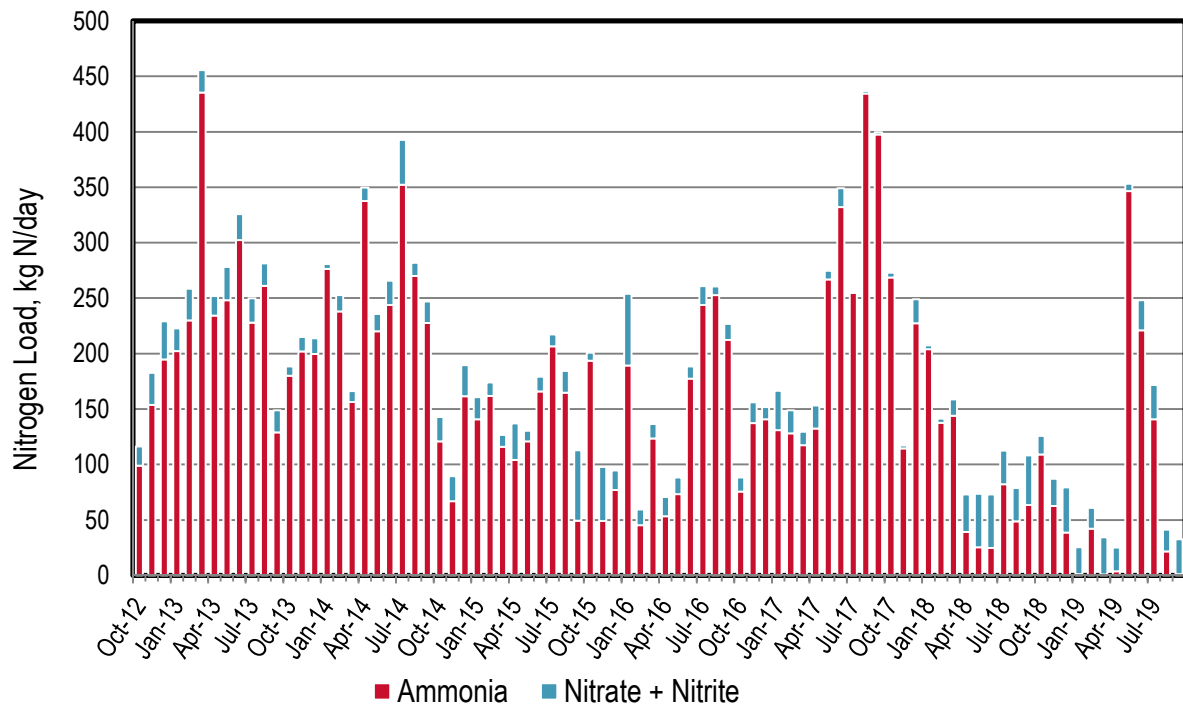


Figure 24-2. SFO Airport Monthly Nitrogen Loads

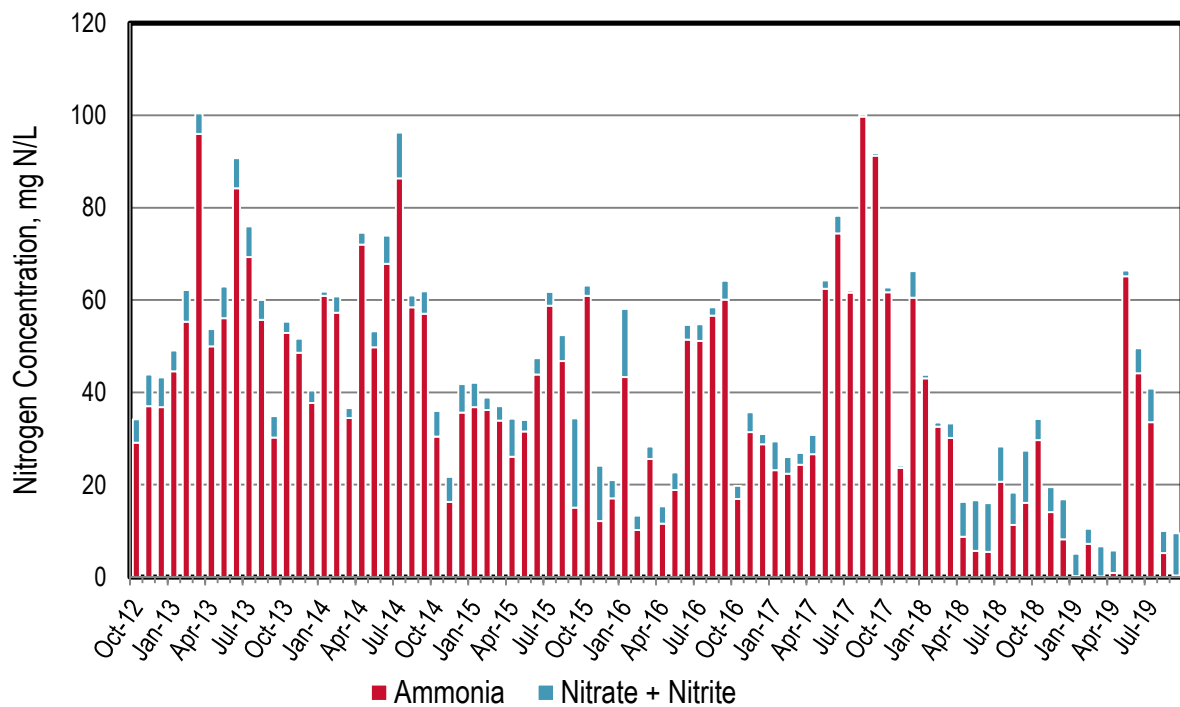


Figure 24-3. SFO Airport Monthly Nitrogen Concentrations

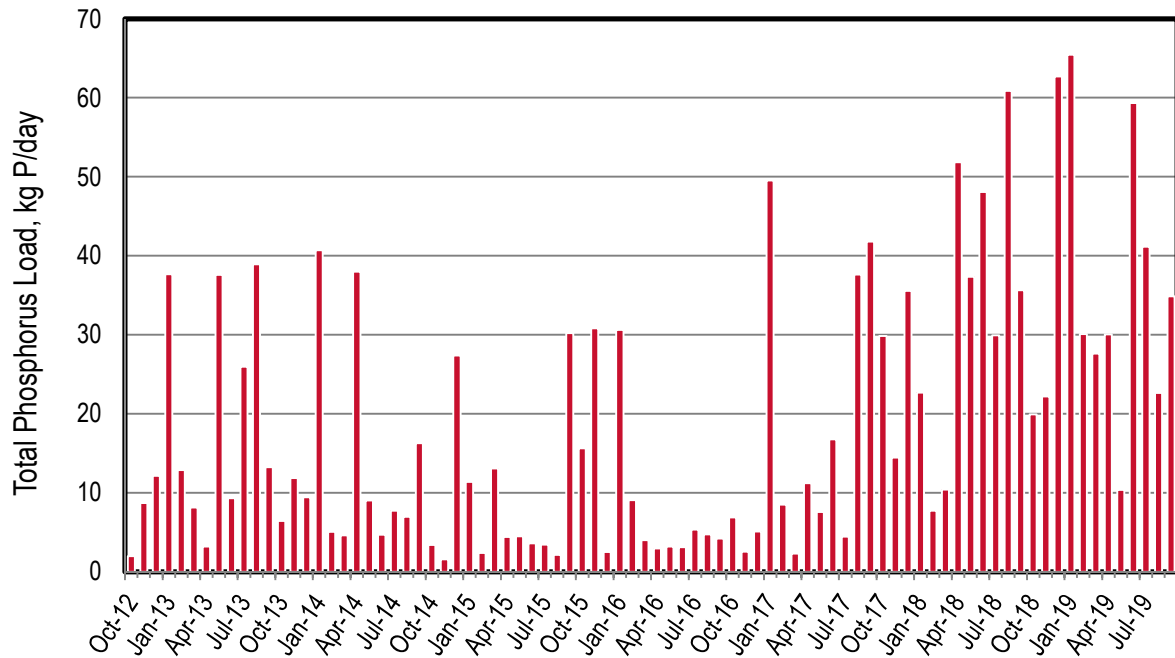


Figure 24-4. SFO Airport Monthly Phosphorus Loads

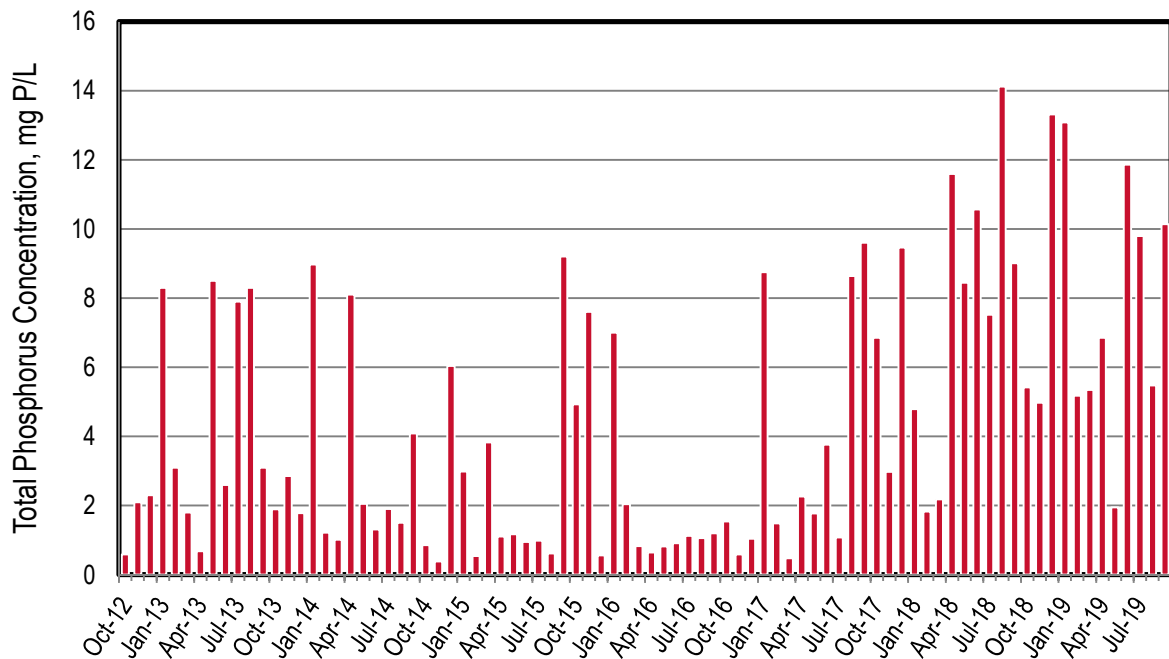


Figure 24-5. SFO Airport Monthly Phosphorus Concentrations

Table 24-1. SFO Airport Monthly Flows and Loads

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-12	0.900	99.0	17.3	116	2.01
Nov-12	1.10	154	28.7	183	8.73
Dec-12	1.40	195	34.3	229	12.2
Jan-13	1.20	202	20.4	223	37.6
Feb-13	1.10	230	28.6	259	12.9
Mar-13	1.20	435	20.2	456	8.16
Apr-13	1.24	234	17.5	252	3.19
May-13	1.17	248	30.1	278	37.6
Jun-13	0.950	302	23.4	326	9.34
Jul-13	0.870	228	22.0	250	26.0
Aug-13	1.24	261	20.2	281	38.9
Sep-13	1.13	129	19.9	149	13.2
Oct-13	1.00	180	8.32	188	6.43
Nov-13	1.12	202	12.9	215	11.9
Dec-13	0.960	200	14.3	214	9.43
Jan-14	1.17	276	4.16	281	40.7
Feb-14	1.34	238	14.7	253	5.07
Mar-14	1.22	156	9.78	166	4.61
Apr-14	1.57	338	11.9	350	38.0
May-14	1.26	220	15.5	236	9.05
Jun-14	1.04	244	22.0	266	4.72
Jul-14	1.08	352	40.3	393	7.74
Aug-14	1.22	270	12.1	282	6.96
Sep-14	1.06	228	19.3	247	16.3
Oct-14	1.05	121	21.9	143	3.40
Nov-14	1.09	67.0	22.3	89.3	1.60
Dec-14	1.20	162	28.0	190	27.4
Jan-15	1.01	141	20.1	161	11.4
Feb-15	1.18	162	12.0	174	2.40
Mar-15	0.906	116	10.8	127	13.1
Apr-15	1.06	104	33.2	137	4.40
May-15	1.01	121	9.52	131	4.50
Jun-15	1.00	166	13.2	179	3.60
Jul-15	0.930	207	10.5	217	3.45
Aug-15	0.930	165	19.6	184	2.17
Sep-15	0.868	49.3	63.4	113	30.2

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-15	0.841	194	7.19	201	15.7
Nov-15	1.07	49.1	48.7	97.9	30.8
Dec-15	1.19	77.0	17.5	94.5	2.51
Jan-16	1.16	189	64.7	254	30.6
Feb-16	1.18	45.4	14.0	59.4	9.08
Mar-16	1.28	124	12.8	136	4.00
Apr-16	1.22	53.4	17.1	70.5	2.96
May-16	1.03	73.2	15.0	88.2	3.19
Jun-16	0.913	178	11.0	189	3.14
Jul-16	1.26	244	17.2	261	5.34
Aug-16	1.18	253	7.79	261	4.72
Sep-16	0.934	212	14.5	227	4.22
Oct-16	1.18	75.7	12.7	88.4	6.88
Nov-16	1.16	137	18.7	156	2.57
Dec-16	1.30	141	11.1	152	5.09
Jan-17	1.50	131	35.5	166	49.6
Feb-17	1.51	128	20.7	149	8.49
Mar-17	1.27	117	12.1	129	2.31
Apr-17	1.32	132	20.8	153	11.2
May-17	1.13	267	7.76	275	7.57
Jun-17	1.18	332	17.0	349	16.8
Jul-17	1.09	255	1.99	257	4.47
Aug-17	1.15	434	2.30	437	37.6
Sep-17	1.15	397	2.26	400	41.8
Oct-17	1.15	268	4.41	273	29.8
Nov-17	1.28	115	2.37	117	14.4
Dec-17	0.995	227	21.6	249	35.6
Jan-18	1.25	204	3.47	208	22.7
Feb-18	1.12	137	3.82	141	7.72
Mar-18	1.26	144	14.9	159	10.4
Apr-18	1.18	39.2	33.7	72.9	51.9
May-18	1.17	25.2	48.3	73.6	37.3
Jun-18	1.20	24.8	48.1	72.9	48.1
Jul-18	1.05	82.2	30.4	113	29.9
Aug-18	1.14	48.8	29.9	78.8	60.9
Sep-18	1.05	63.6	44.5	108	35.6
Oct-18	0.972	109	17.0	126	19.9

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Nov-18	1.18	62.7	24.4	87.1	22.2
Dec-18	1.25	38.7	40.7	79.4	62.7
Jan-19	1.32	1.13	24.1	25.2	65.4
Feb-19	1.54	42.0	18.7	60.7	30.1
Mar-19	1.37	0.866	33.6	34.4	27.6
Apr-19	1.16	3.83	21.3	25.1	30.0
May-19	1.41	346	6.74	353	10.4
Jun-19	1.32	221	27.1	248	59.3
Jul-19	1.11	141	30.7	172	41.2
Aug-19	1.09	21.6	19.6	41.2	22.6
Sep-19	0.910	1.18	31.5	32.7	34.9
Dry Season Average	1.09	195	21.6	216	20.7
Dry Season Trend	None	None	None	None	Up
Wet Season Average	1.19	143	19.8	163	17.9
Average Annual	1.15	164	20.5	185	19.0

* The Total Inorganic Nitrogen value is calculated by adding the "Ammonia" and "Nitrate + Nitrite" values.

** Refer to the Section 3.5 in the main body for a description on the statistical analysis.

25 SFPUC Southeast Plant

SFPUC has a combined collection system, discharges to the South Bay, and serves approximately 450,000 service connections. The plant has a permitted ADFW capacity of 85.4 mgd and a peak wet weather capacity of 250 mgd (150 mgd secondary, 100 mgd primary). The plant currently flows at approximately 53.5 mgd ADFW and performs secondary treatment using a high purity oxygen system.

The following observations are made based upon the figures and table in the subsequent pages:

- ◆ Based on the average monthly loads since 2012, there appears to be a dry season upward trend for total phosphorus, and a downward trend for NO_x loads.
- ◆ Ammonia and Total Nitrogen loads do not always increase with elevated flows typically associated with rain events during the wet season.
- ◆ Ammonia is the majority of the nitrogen species discharged, regardless of season. This is expected because this plant does not nitrify.

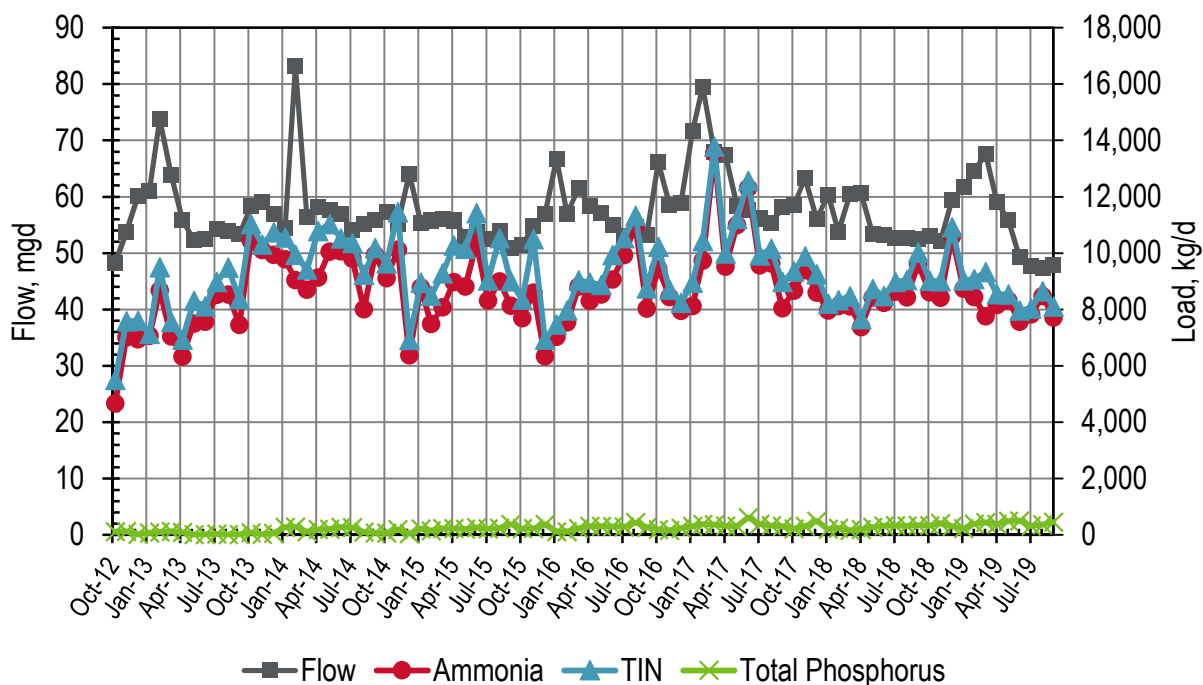


Figure 25-1. SFPUC Southeast Monthly Flows and Loads

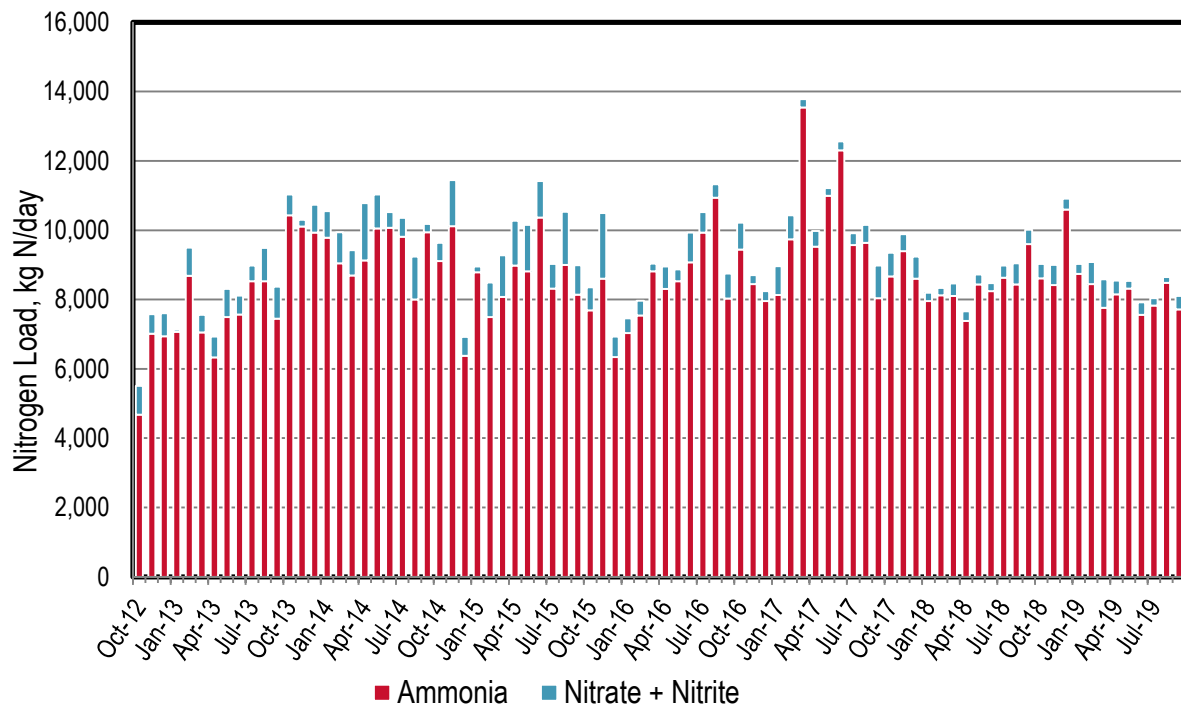


Figure 25-2. SFPUC Southeast Monthly Nitrogen Loads

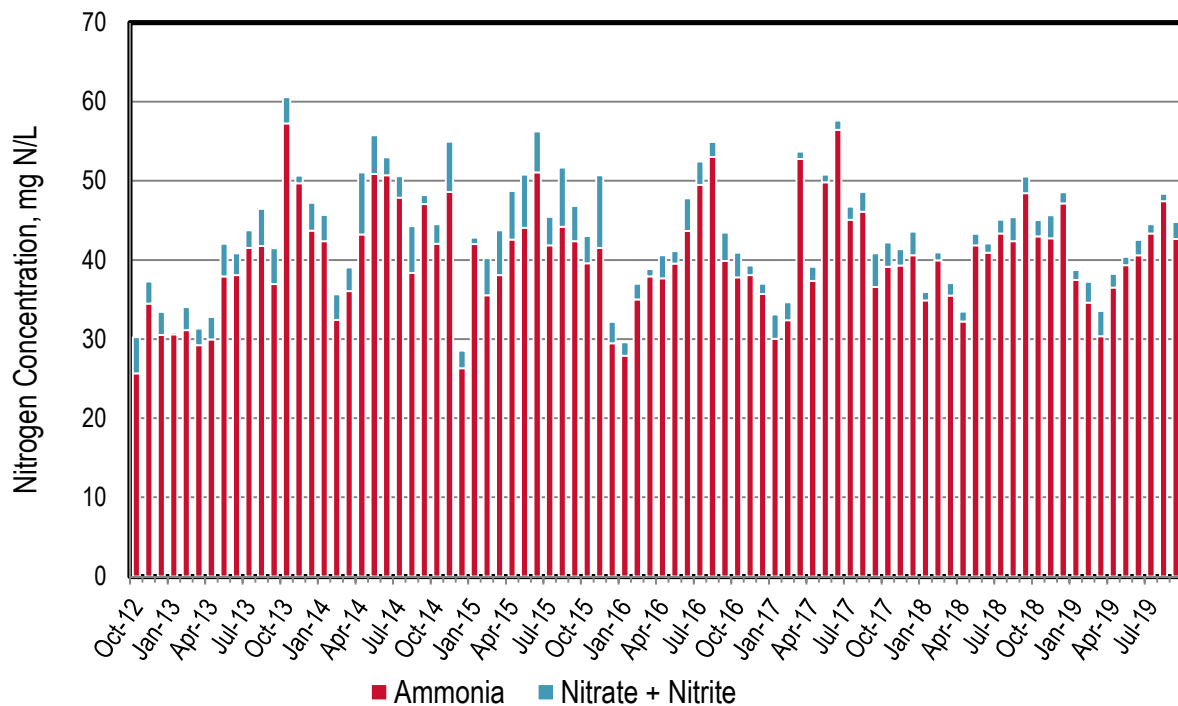


Figure 25-3. SFPUC Southeast Monthly Nitrogen Concentrations

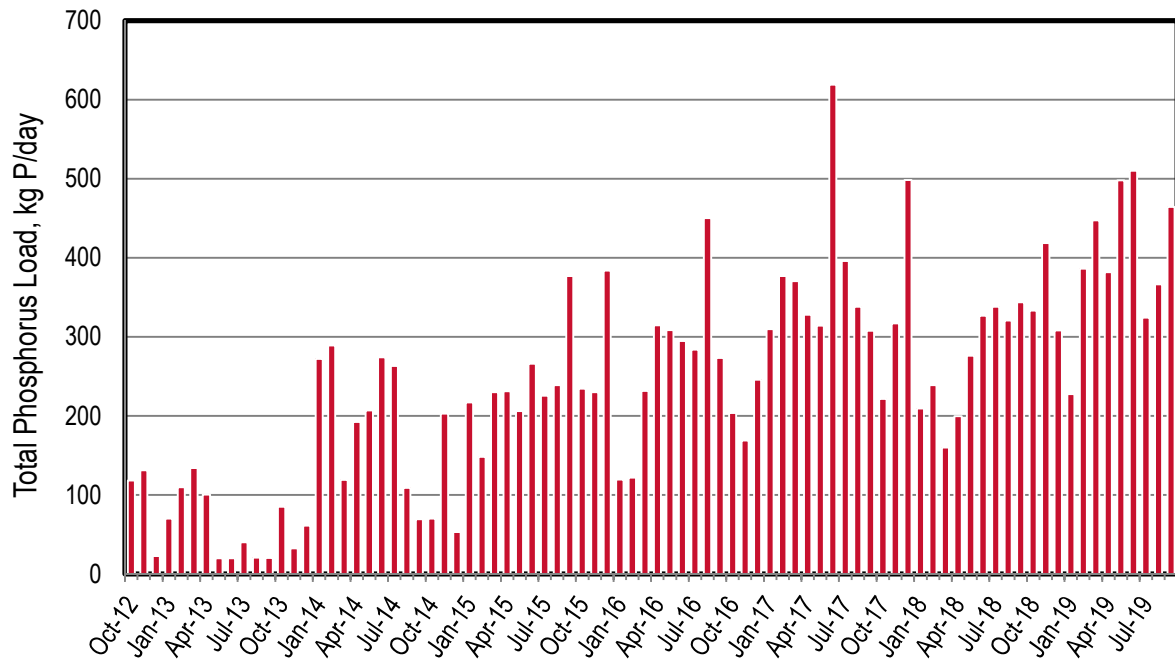


Figure 25-4. SFPUC Southeast Monthly Phosphorus Loads

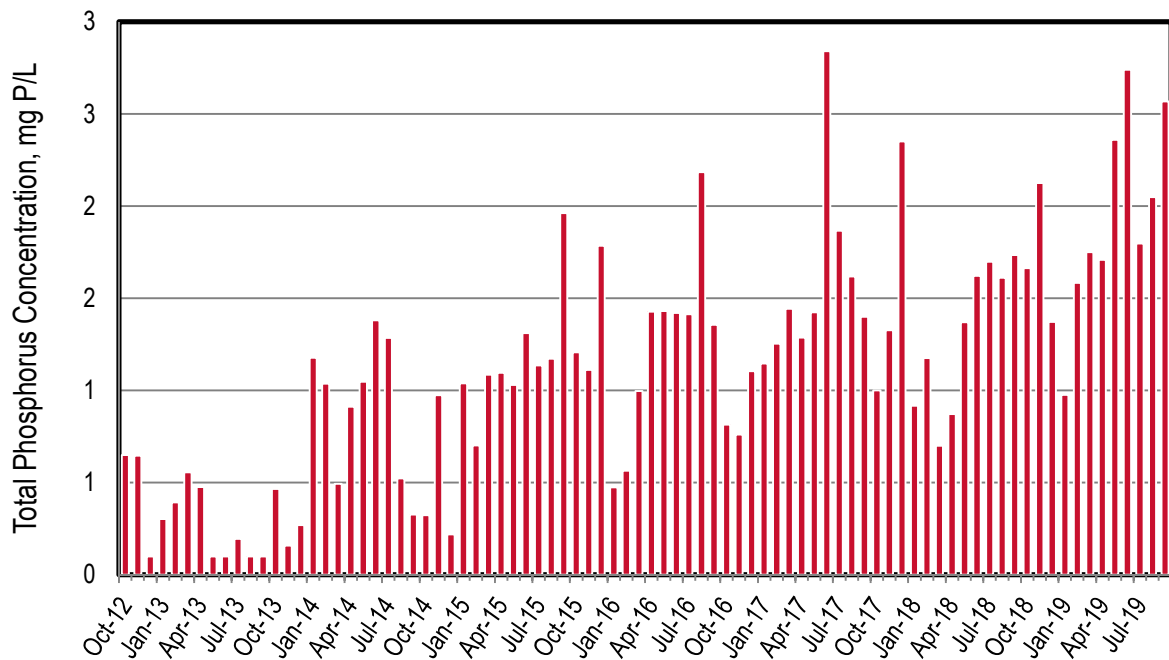


Figure 25-5. SFPUC Southeast Monthly Phosphorus Concentrations

Table 25-1. SFPUC Southeast Monthly Flows and Loads

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-12	48.2	4,670	832	5,510	118
Nov-12	53.8	7,010	570	7,580	131
Dec-12	60.2	6,940	663	7,600	22.7
Jan-13	61.1	7,070	65.0	7,130	69.9
Feb-13	73.8	8,680	810	9,490	110
Mar-13	63.8	7,050	506	7,560	134
Apr-13	55.9	6,330	600	6,930	100
May-13	52.3	7,500	813	8,310	19.8
Jun-13	52.6	7,560	550	8,110	19.9
Jul-13	54.3	8,530	451	8,980	39.9
Aug-13	54.0	8,530	956	9,480	20.4
Sep-13	53.4	7,450	920	8,370	20.2
Oct-13	58.4	10,400	600	11,000	84.9
Nov-13	59.1	10,100	194	10,300	32.2
Dec-13	57.1	9,930	804	10,700	61.1
Jan-14	54.5	9,780	769	10,600	272
Feb-14	83.2	9,040	895	9,940	289
Mar-14	56.4	8,700	726	9,420	119
Apr-14	58.2	9,130	1,650	10,800	192
May-14	57.7	10,100	973	11,000	207
Jun-14	56.9	10,100	452	10,500	274
Jul-14	54.2	9,810	549	10,400	263
Aug-14	55.2	8,010	1,230	9,240	109
Sep-14	55.9	9,940	235	10,200	69.0
Oct-14	57.3	9,110	528	9,640	70.0
Nov-14	55.1	10,100	1,330	11,400	203
Dec-14	64.1	6,370	544	6,920	53.0
Jan-15	55.3	8,780	168	8,950	217
Feb-15	55.8	7,490	997	8,490	148
Mar-15	56.1	8,070	1,210	9,280	230
Apr-15	55.8	8,980	1,300	10,300	231
May-15	52.9	8,810	1,340	10,200	206
Jun-15	53.7	10,400	1,050	11,400	266
Jul-15	52.6	8,310	714	9,030	226
Aug-15	53.9	9,000	1,520	10,500	239

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Sep-15	50.8	8,140	856	8,990	377
Oct-15	51.4	7,690	668	8,360	234
Nov-15	54.8	8,600	1,900	10,500	230
Dec-15	56.9	6,340	591	6,930	384
Jan-16	66.7	7,040	425	7,460	120
Feb-16	57.0	7,540	427	7,970	122
Mar-16	61.5	8,810	217	9,030	232
Apr-16	58.3	8,310	643	8,950	315
May-16	57.1	8,530	344	8,870	309
Jun-16	55.0	9,070	856	9,930	295
Jul-16	53.1	9,930	591	10,500	284
Aug-16	54.6	10,900	388	11,300	450
Sep-16	53.3	8,030	723	8,750	273
Oct-16	66.1	9,440	777	10,200	204
Nov-16	58.6	8,440	263	8,710	169
Dec-16	58.9	7,950	287	8,240	246
Jan-17	71.6	8,130	828	8,960	310
Feb-17	79.6	9,740	686	10,400	377
Mar-17	67.9	13,500	236	13,800	370
Apr-17	67.5	9,520	458	9,980	328
May-17	58.4	11,000	213	11,200	314
Jun-17	57.7	12,300	253	12,600	619
Jul-17	56.1	9,570	349	9,920	396
Aug-17	55.3	9,630	524	10,200	338
Sep-17	58.2	8,040	938	8,980	308
Oct-17	58.6	8,670	680	9,350	221
Nov-17	63.3	9,390	495	9,890	317
Dec-17	56.1	8,600	641	9,240	498
Jan-18	60.4	7,960	239	8,200	209
Feb-18	53.8	8,120	211	8,330	239
Mar-18	60.4	8,110	359	8,470	160
Apr-18	60.6	7,380	284	7,660	200
May-18	53.3	8,430	291	8,730	276
Jun-18	53.3	8,240	235	8,470	327
Jul-18	52.7	8,630	346	8,980	338
Aug-18	52.7	8,440	607	9,040	321
Sep-18	52.4	9,590	423	10,000	344

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-18	53.0	8,610	419	9,030	333
Nov-18	52.1	8,420	579	9,000	419
Dec-18	59.5	10,600	317	10,900	308
Jan-19	61.7	8,740	290	9,030	228
Feb-19	64.5	8,440	636	9,080	386
Mar-19	67.7	7,760	825	9,320	448
Apr-19	59.1	8,150	388	8,540	382
May-19	55.9	8,310	222	8,530	498
Jun-19	49.3	7,560	357	7,970	510
Jul-19	47.8	7,830	207	8,030	324
Aug-19	47.3	8,480	167	8,650	366
Sep-19	47.8	7,720	384	8,100	464
Dry Season Average	53.8	8,920	601	9,530	277
Dry Season Trend	None	None	Down	None	Up
Wet Season Average	60.2	8,450	623	9,080	222
Average Annual	57.5	8,650	614	9,270	245

* The Total Inorganic Nitrogen value is calculated by adding the "Ammonia" and "Nitrate + Nitrite" values.

** Refer to the Section 3.5 in the main body for a description on the statistical analysis.

26 Sausalito-Marin City Sanitary District (SMCSD)

SMCSD discharges to the Central Bay. The plant has approximately 6,500 service connections and permitted capacity of 1.8 mgd ADWF. The current flows are approximately 1.1 mgd ADWF. The plant performs partial nitrification using a trickling filter.

The following observations are made based upon the figures and table in the subsequent pages:

- ◆ Based on the table with the average monthly values, there appears to be an emerging downward trend for NO_x and total phosphorus loads, and an upward trend for ammonia and TIN loads.
- ◆ The plant was under construction from May 2017 to July 2018 with upgrades to improve treatment capacity and performance. During this period, the plant used one of two sedimentation tanks and fixed film reactors which compromised the overall treatment performance. As a result, no statistical trending analysis on discharge loads was performed as the May and June 2017 data is not reflective of plant treatment capacity and performance.
- ◆ Nitrogen and phosphorus loads do not appear to track with flows during wet weather events.
- ◆ NO_x is the majority of the nitrogen species discharged as would be expected since this plant nitrifies. A portion of ammonia bleeds through year round due to the trickling filters inability to reliably remove all the ammonia.
- ◆ Total phosphorus concentrations range from 0.8 to 6.3 mg P/L. This suggests occasional P removal as typical effluent TP concentrations are 4 to 6 mg P/L. The removal mechanism is most likely from metal salt addition at the front of the plant with removal in the primary clarifiers.

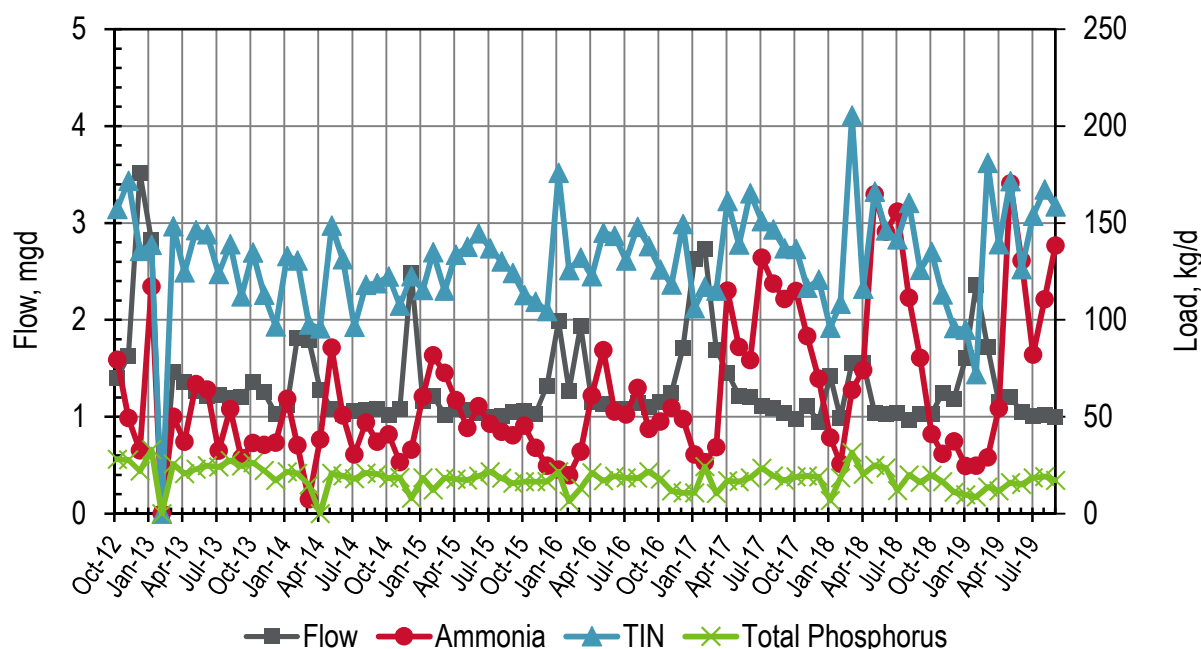


Figure 26-1. SMCSD Monthly Flows and Loads

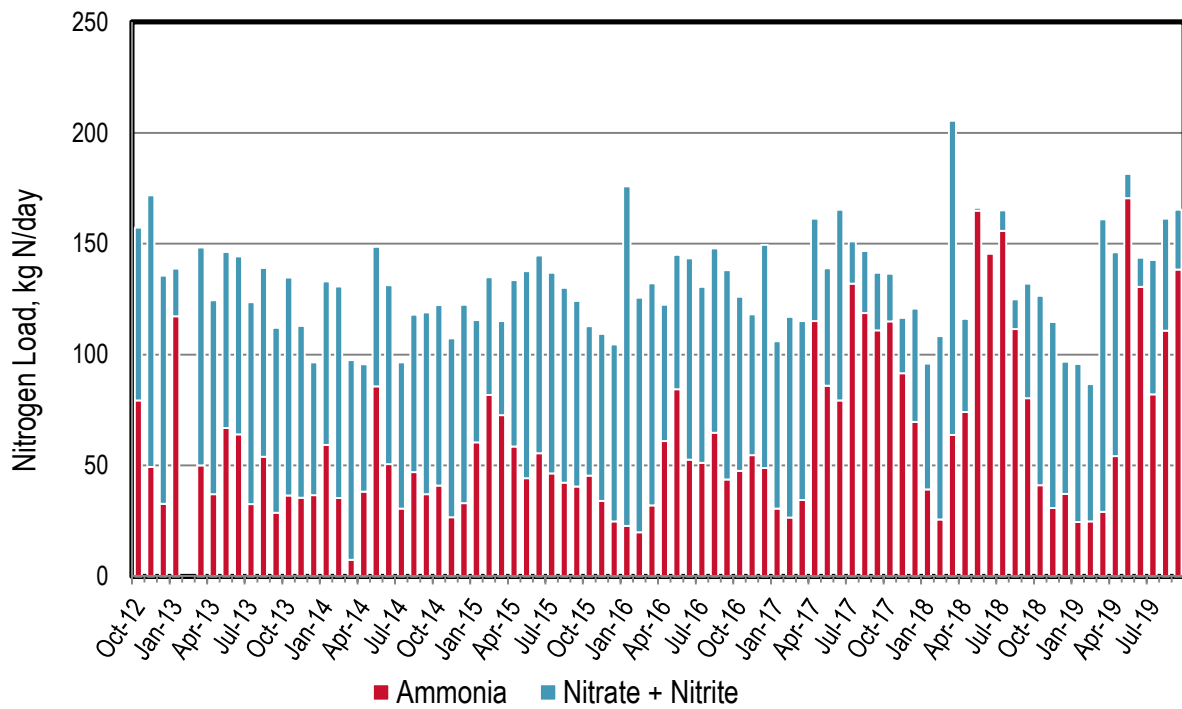


Figure 26-2. SMCSD Monthly Nitrogen Loads

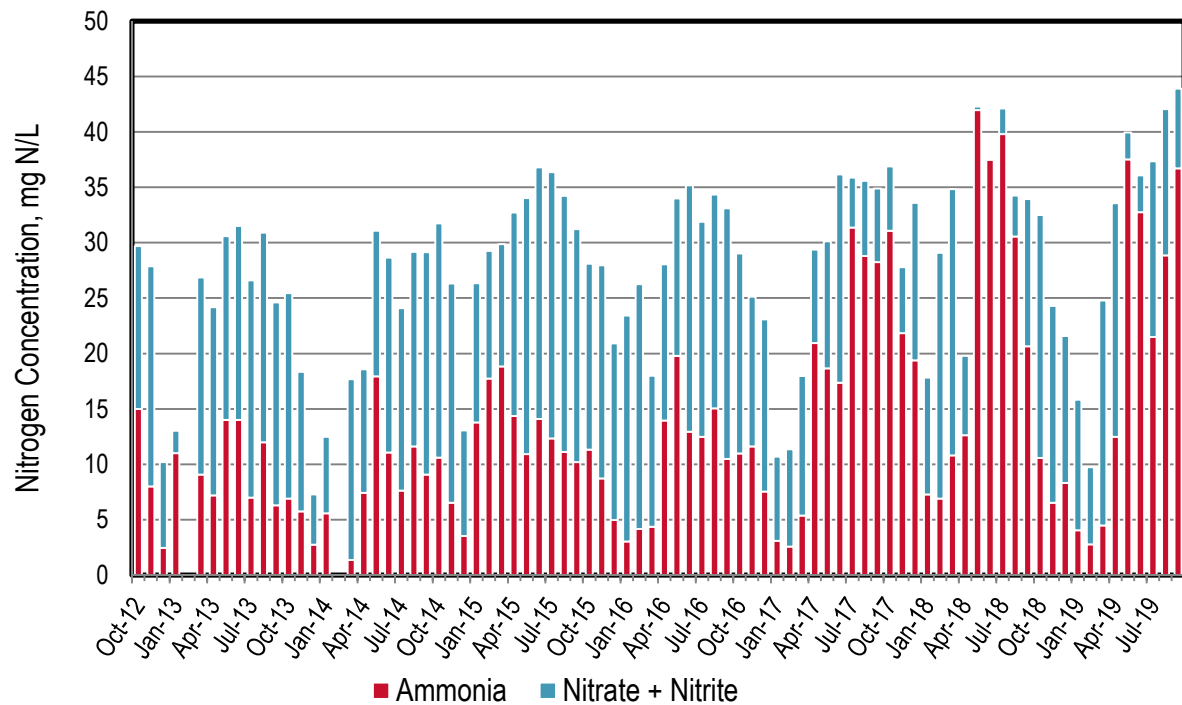


Figure 26-3. SMCSD Monthly Nitrogen Concentrations

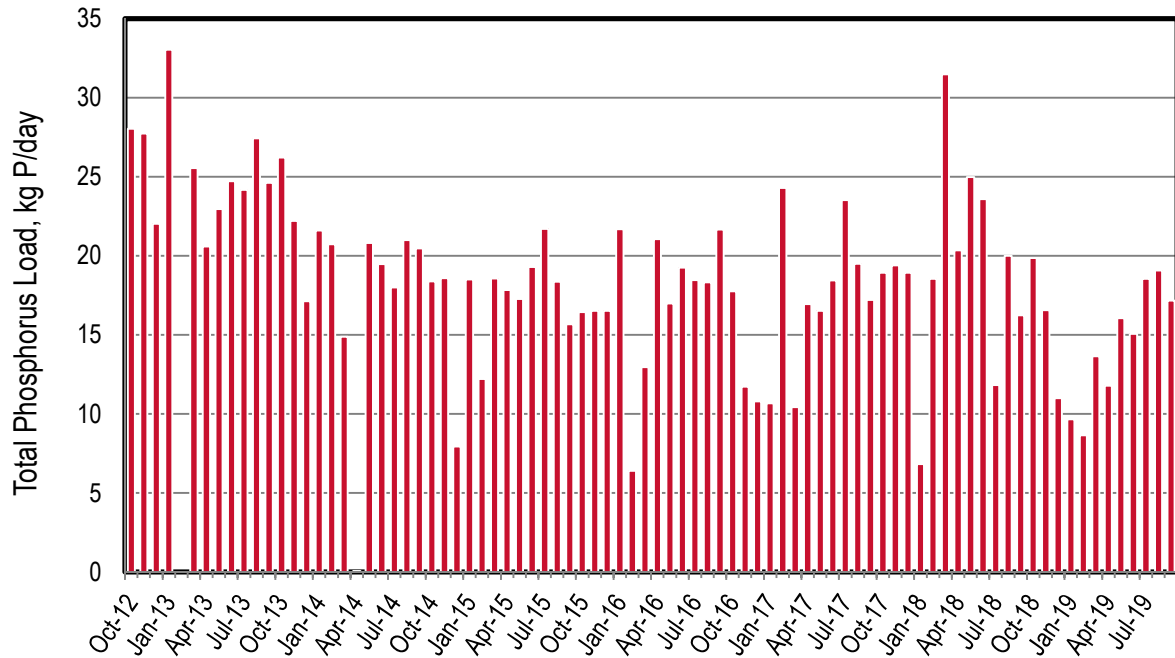


Figure 26-4. SMCS Monthly Phosphorus Loads

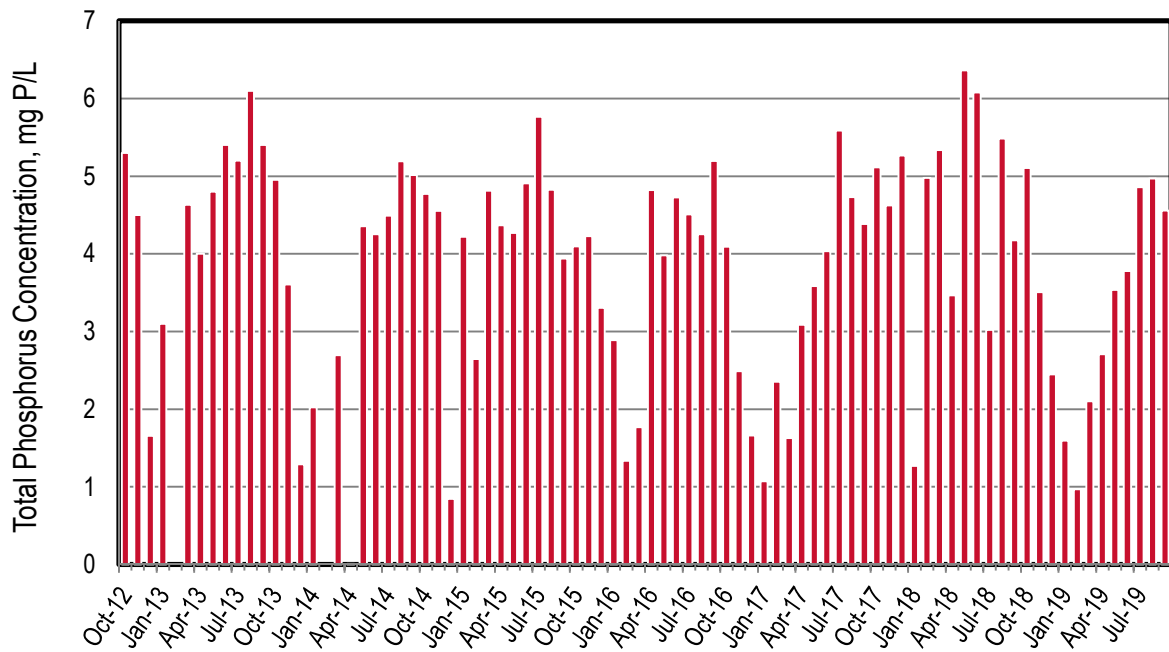


Figure 26-5. SMCS Monthly Phosphorus Concentrations

Table 26-1. SMCS D Monthly Flows and Loads

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-12	1.40	79.4	77.8	157	28.0
Nov-12	1.63	49.3	122	172	27.7
Dec-12	3.52	32.7	103	136	22.0
Jan-13	2.82	117	21.5	139	33.0
Feb-13	0	0	0	0	0
Mar-13	1.46	50.0	98.3	148	25.6
Apr-13	1.36	37.1	87.4	124	20.6
May-13	1.27	66.9	79.4	146	23.0
Jun-13	1.21	64.1	80.1	144	24.7
Jul-13	1.23	32.5	91.1	124	24.2
Aug-13	1.19	54.0	85.0	139	27.4
Sep-13	1.21	28.7	83.4	112	24.6
Oct-13	1.36	36.5	98.2	135	26.2
Nov-13	1.25	35.4	77.5	113	22.2
Dec-13	1.03	36.6	60.0	96.6	17.1
Jan-14	1.12	59.3	73.7	133	21.6
Feb-14	1.82	35.3	95.4	131	20.7
Mar-14	1.79	7.44	90.1	97.6	14.9
Apr-14	1.28	38.2	57.4	95.7	0.0484
May-14	1.08	85.7	62.9	149	20.8
Jun-14	1.03	50.6	80.6	131	19.5
Jul-14	1.06	30.5	66.0	96.5	18.0
Aug-14	1.07	47.0	71.0	118	21.0
Sep-14	1.08	37.1	81.9	119	20.5
Oct-14	1.02	40.9	81.4	122	18.4
Nov-14	1.08	26.6	80.8	107	18.6
Dec-14	2.48	33.1	89.4	123	7.94
Jan-15	1.16	60.5	55.0	115	18.5
Feb-15	1.22	81.8	53.1	135	12.2
Mar-15	1.02	72.6	42.5	115	18.6
Apr-15	1.08	58.6	75.0	134	17.8
May-15	1.07	44.2	93.5	138	17.3
Jun-15	1.04	55.5	89.2	145	19.3
Jul-15	0.996	46.5	90.4	137	21.7
Aug-15	1.01	42.2	87.9	130	18.4
Sep-15	1.05	40.5	83.7	124	15.7

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-15	1.06	45.5	67.3	113	16.4
Nov-15	1.03	34.0	75.3	109	16.5
Dec-15	1.32	24.8	79.7	105	16.5
Jan-16	1.99	22.7	153	176	21.7
Feb-16	1.27	19.9	106	126	6.40
Mar-16	1.94	32.1	100	132	13.0
Apr-16	1.16	60.9	61.6	123	21.1
May-16	1.13	84.4	60.5	145	17.0
Jun-16	1.08	52.7	90.7	143	19.2
Jul-16	1.08	51.1	79.4	131	18.5
Aug-16	1.14	64.8	83.1	148	18.3
Sep-16	1.10	43.7	94.3	138	21.7
Oct-16	1.15	47.6	78.4	126	17.8
Nov-16	1.24	54.6	63.5	118	11.7
Dec-16	1.71	48.9	101	150	10.8
Jan-17	2.63	30.5	75.5	106	10.7
Feb-17	2.73	26.5	90.5	117	24.3
Mar-17	1.69	34.4	80.7	115	10.4
Apr-17	1.45	115	46.3	161	16.9
May-17	1.22	86.0	52.9	139	16.5
Jun-17	1.21	79.3	86.1	165	18.4
Jul-17	1.11	132	19.0	151	23.5
Aug-17	1.09	119	28.0	147	19.5
Sep-17	1.04	111	26.0	137	17.2
Oct-17	0.979	115	21.5	137	18.9
Nov-17	1.11	91.6	24.9	117	19.4
Dec-17	0.951	69.7	51.1	121	18.9
Jan-18	1.42	39.2	56.6	95.9	6.83
Feb-18	0.986	25.7	82.7	108	18.5
Mar-18	1.56	63.7	142	205	31.5
Apr-18	1.55	74.2	42.0	116	20.4
May-18	1.04	165	1.29	166	25.0
Jun-18	1.03	146	0.669	146	23.6
Jul-18	1.04	156	9.16	142	11.8
Aug-18	0.965	111	13.5	160	20.0
Sep-18	1.03	80.3	51.7	126	16.2
Oct-18	1.03	41.1	85.3	135	19.9

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Nov-18	1.25	30.8	83.9	113	16.6
Dec-18	1.19	37.2	59.5	95.8	11.0
Jan-19	1.60	24.5	71.2	94.9	9.66
Feb-19	2.36	24.7	62.0	72.0	8.64
Mar-19	1.72	29.1	132	181	13.7
Apr-19	1.15	54.3	91.9	139	11.8
May-19	1.20	170	11.0	172	16.1
Jun-19	1.05	131	13.2	126	15.1
Jul-19	1.01	82.1	60.6	154	18.5
Aug-19	1.01	111	50.6	167	19.1
Sep-19	0.997	138	27.0	159	17.2
Dry Season Average	1.09	81.1	59.6	140	19.7
Dry Season Trend	Down	Up***	Down***	Up***	Down***
Wet Season Average	1.47	47.1	76.0	123	17.0
Average Annual	1.31	61.3	69.2	130	18.1

* The Total Inorganic Nitrogen value is calculated by adding the "Ammonia" and "Nitrate + Nitrite" values.

** Refer to the Section 3.5 in the main body for a description on the statistical analysis.

*** The plant was under construction May 2017 to July 2018 with upgrades to improve treatment capacity and performance. During this period, the plant has been using one of two sedimentation tanks and fixed film reactors which has compromised the overall treatment performance. As a result, no statistical trending analysis on discharge loads was performed as data collected after May 2017 is not reflective of plant treatment capacity and performance.

27 Sonoma Valley County Sanitation District

Sonoma Valley discharges to Schell Slough which is connected to San Pablo Bay. The plant has approximately 17,200 service connections and a permitted capacity of 3.0 mgd ADWF. The plant has a wet weather discharge to Schell Slough at a capacity of 11 mgd. Discharge to Schell Slough is prohibited May 1 through October 31. The plant performs nitrogen removal using an activated sludge process.

The following observations are made based upon the figures and table in the subsequent pages:

- ◆ There are no emerging dry season trends as Sonoma Valley is prohibited from discharging to Schell Slough during the dry season. There is one exception in May 2017, where discharge was for 3 days due to the relatively wet month. Sonoma Valley is only allowed to discharge if flows entering the plant exceed 6 mgd and storage is 50 % or more full.
- ◆ Wet season trends analyzed (data not shown) and there are no emerging trends.
- ◆ There are only 23 out of 84 months in which they discharged to Schell Slough. The water was all recycled during the other months.
- ◆ Both nitrogen and phosphorus loads increase with flow during wet weather events.
- ◆ NO_x is the majority of the nitrogen species discharged, as would be expected since this plant fully nitrifies. The highest average monthly effluent ammonia concentration was 0.6 mg N/L.
- ◆ The plant meets Level 2 total nitrogen concentration limits (i.e., 15 mg N/L) developed under the Scoping and Evaluation Plan for all but four months. Three of these months are in the July 2016 through June 2017 dataset due to the relatively high levels of precipitation during that wet season.
- ◆ Total phosphorus concentrations range from 1.3 to 4.5 mg P/L, which suggests a portion of P is removed as typical effluent TP concentrations are 4 to 6 mg P/L. The removal mechanism is unclear at this stage.

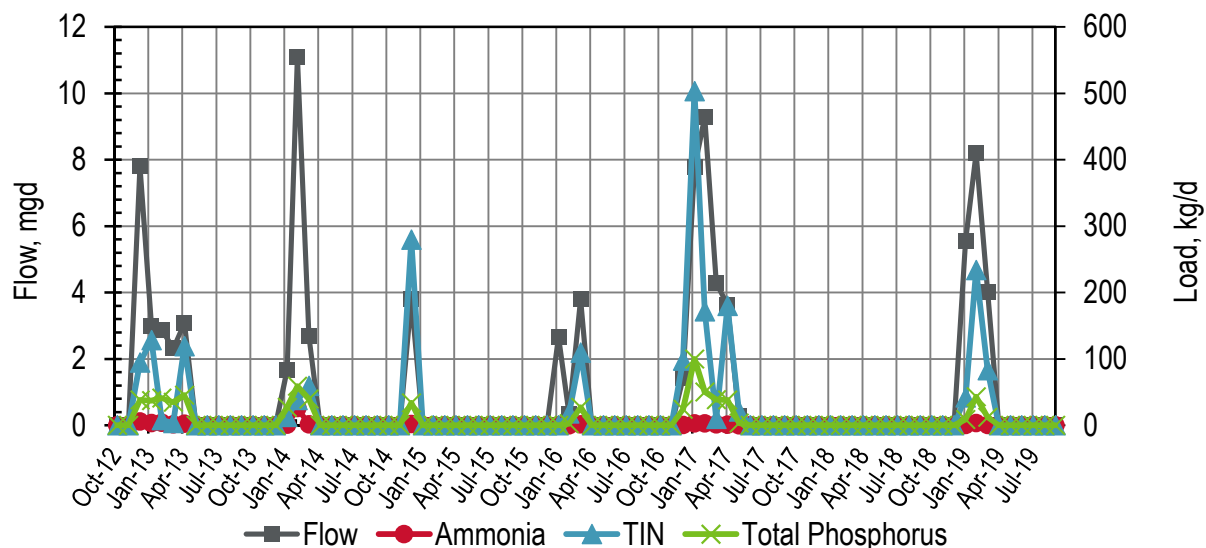


Figure 27-1. Sonoma Valley Monthly Flows and Loads

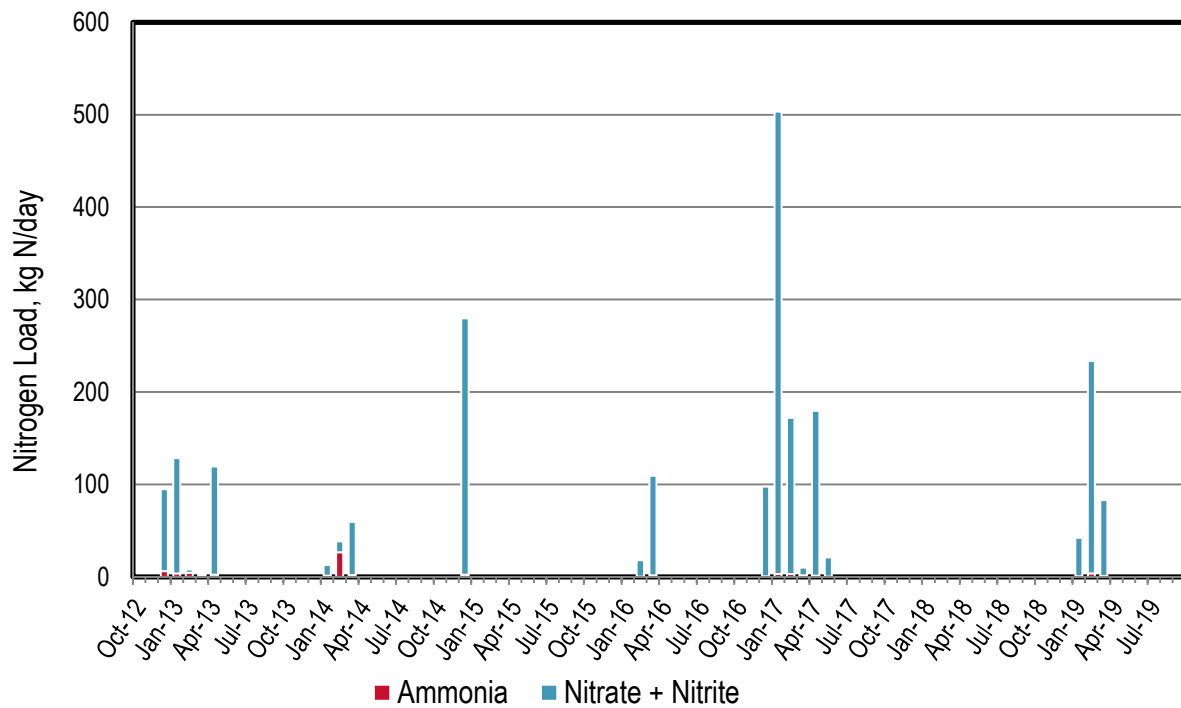


Figure 27-2. Sonoma Valley Monthly Nitrogen Loads

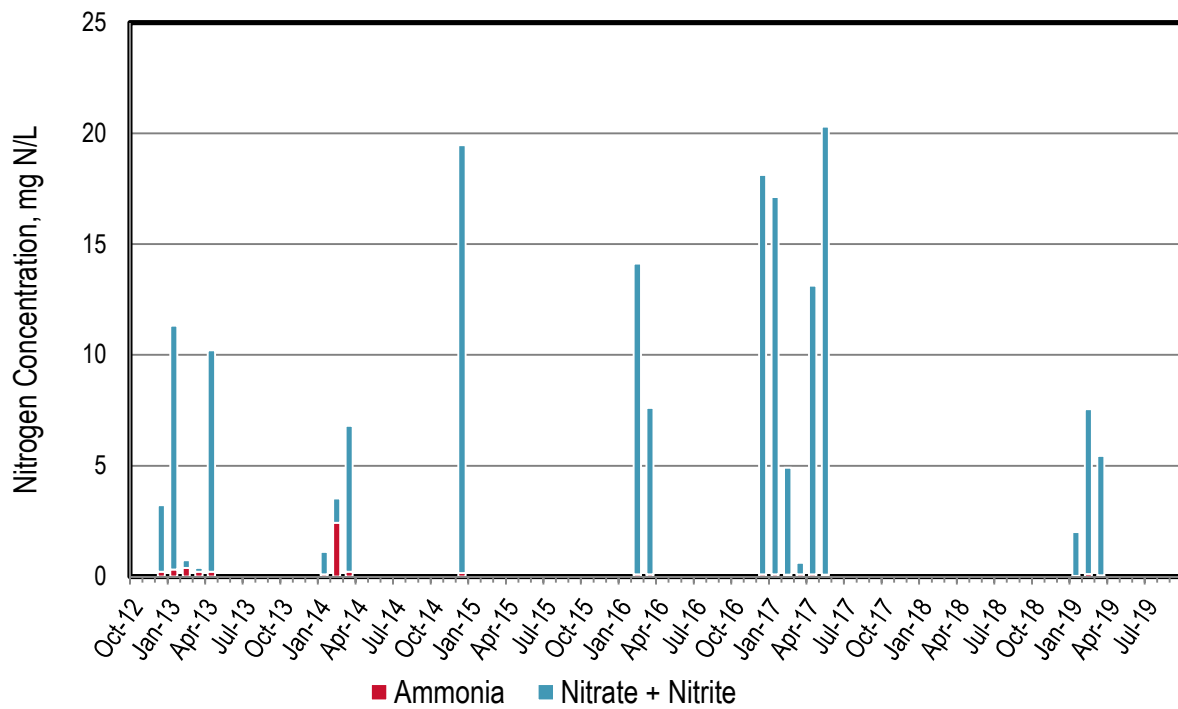


Figure 27-3. Sonoma Valley Monthly Nitrogen Concentrations

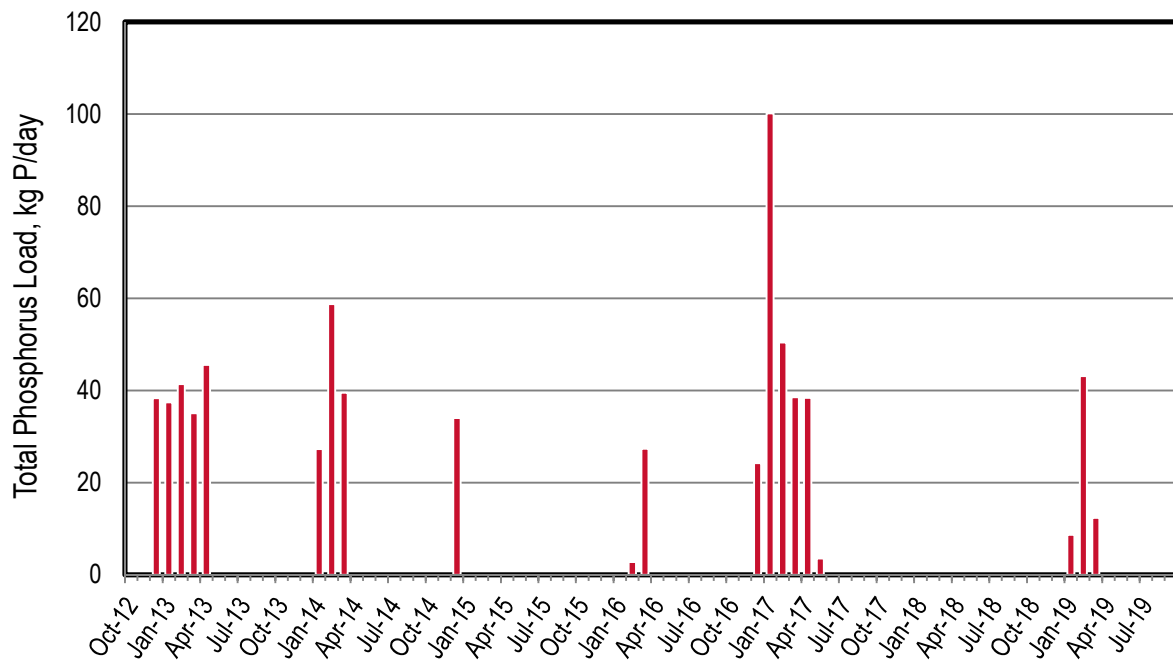


Figure 27-4. Sonoma Valley Monthly Phosphorus Loads

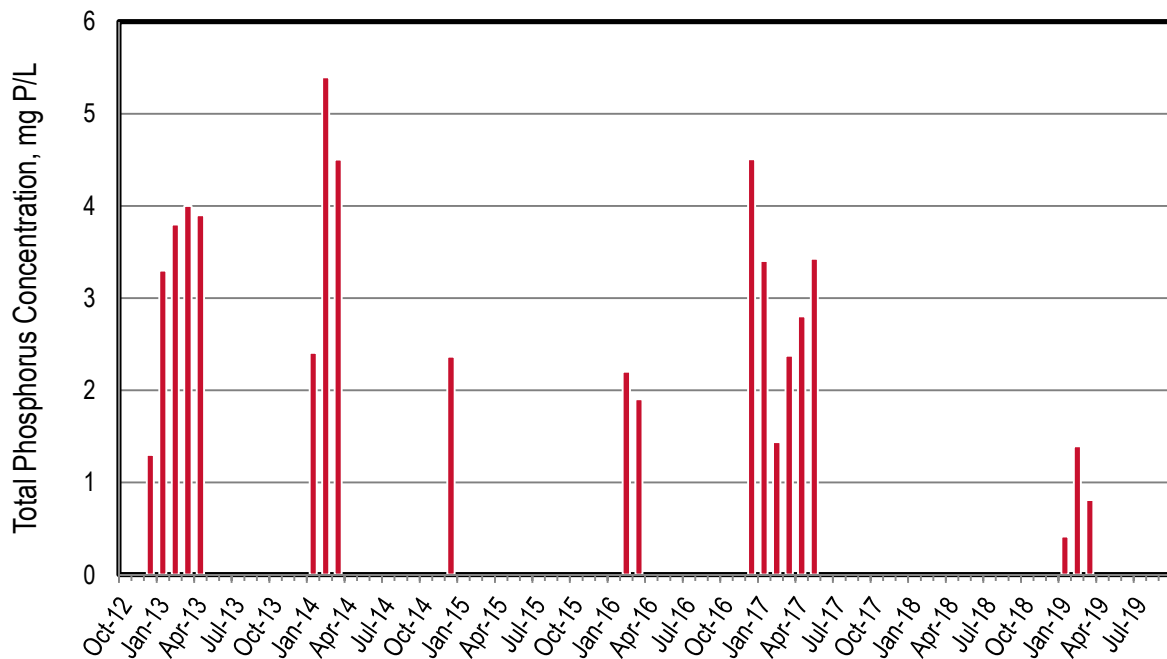


Figure 27-5. Sonoma Valley Monthly Phosphorus Concentrations

Table 27-1. Sonoma Valley Monthly Flows and Loads

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-12	0	0	0	0	0
Nov-12	0	0	0	0	0
Dec-12	7.80	6.19	88.5	94.7	38.3
Jan-13	3.00	3.63	125	128	37.4
Feb-13	2.88	4.25	3.67	7.92	41.4
Mar-13	2.32	1.84	1.55	3.39	35.1
Apr-13	3.09	2.45	117	119	45.6
May-13	0	0	0	0	0
Jun-13	0	0	0	0	0
Jul-13	0	0	0	0	0
Aug-13	0	0	0	0	0
Sep-13	0	0	0	0	0
Oct-13	0	0	0	0	0
Nov-13	0	0	0	0	0
Dec-13	0	0	0	0	0
Jan-14	1.68	1.14	11.5	12.6	27.3
Feb-14	11.1	26.4	11.9	38.3	58.7
Mar-14	2.68	1.82	57.8	59.6	39.5
Apr-14	0	0	0	0	0
May-14	0	0	0	0	0
Jun-14	0	0	0	0	0
Jul-14	0	0	0	0	0
Aug-14	0	0	0	0	0
Sep-14	0	0	0	0	0
Oct-14	0	0	0	0	0
Nov-14	0	0	0	0	0
Dec-14	3.80	2.14	278	280	34.0
Jan-15	0	0	0	0	0
Feb-15	0	0	0	0	0
Mar-15	0	0	0	0	0
Apr-15	0	0	0	0	0
May-15	0	0	0	0	0
Jun-15	0	0	0	0	0
Jul-15	0	0	0	0	0
Aug-15	0	0	0	0	0
Sep-15	0	0	0	0	0

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-15	0	0	0	0	0
Nov-15	0	0	0	0	0
Dec-15	0	0	0	0	0
Jan-16	2.67	--	--	--	--
Feb-16	0.335	0.127	17.8	17.9	2.79
Mar-16	3.80	1.44	108	109	27.3
Apr-16	0	0	0	0	0
May-16	0	0	0	0	0
Jun-16	0	0	0	0	0
Jul-16	0	0	0	0	0
Aug-16	0	0	0	0	0
Sep-16	0	0	0	0	0
Oct-16	0	0	0	0	0
Nov-16	0	0	0	0	0
Dec-16	1.42	0.539	96.9	97.5	24.2
Jan-17	7.78	2.94	500	503	100
Feb-17	9.27	2.96	169	172	50.4
Mar-17	4.29	1.54	8.48	10.0	38.6
Apr-17	3.62	1.37	178	180	38.4
May-17	0.275	0.0912	21.0	21.1	3.56
Jun-17	0	0	0	0	0
Jul-17	0	0	0	0	0
Aug-17	0	0	0	0	0
Sep-17	0	0	0	0	0
Oct-17	0	0	0	0	0
Nov-17	0	0	0	0	0
Dec-17	0	0	0	0	0
Jan-18	0	0	0	0	0
Feb-18	0	0	0	0	0
Mar-18	0	0	0	0	0
Apr-18	0	0	0	0	0
May-18	0	0	0	0	0
Jun-18	0	0	0	0	0
Jul-18	0	0	0	0	0
Aug-18	0	0	0	0	0
Sep-18	0	0	0	0	0
Oct-18	0	0	0	0	0

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Nov-18	0	0	0	0	0
Dec-18	0	0	0	0	0
Jan-19	5.55	0.458	41.7	42.1	8.70
Feb-19	8.19	3.60	230	234	43.1
Mar-19	4.03	0.881	82.0	82.9	12.3
Apr-19	0	0	0	0	0
May-19	0	0	0	0	0
Jun-19	0	0	0	0	0
Jul-19	0	0	0	0	0
Aug-19	0	0	0	0	0
Sep-19	0	0	0	0	0
Dry Season Average	--	--	--	--	--
Dry Season Trend	--	--	--	--	--
Wet Season Average	1.82	1.34	43.4	44.7	14.4
Average Annual	1.07	0.784	25.6	26.3	8.41

* The Total Inorganic Nitrogen value is calculated by adding the "Ammonia" and "Nitrate + Nitrite" values.

** No dry season trending analysis was performed on SVCSD as the facility does not discharge during most dry season months.

28 South San Francisco-San Bruno

South SF-San Bruno discharges to Lower San Francisco Bay (referred to as South Bay in the Group Annual Report). The plant has a permitted capacity of 13 mgd ADWF and a peak wet weather capacity of 30 mgd, with blending above 30 mgd allowable. The current flow is approximately 7.6 mgd ADWF. The process includes a conventional activated sludge system.

The following observations are made based upon the figures and table in the subsequent pages:

- ◆ Based on the average monthly values table below, there is a dry season downward trend for flows.
- ◆ Nitrogen loads generally increase with flow during wet weather events.
- ◆ Ammonia is the majority of the nitrogen species discharged, regardless of season. This would be expected since they do not nitrify.
- ◆ Ammonia loads are occasionally greater than TIN loads, and TIN monthly loads occasionally differ from the sum of Ammonia and NO_x monthly loads. This is attributed to sampling frequency, whereby ammonia is sampled daily and other nitrogen species bimonthly.
- ◆ Total phosphorus concentrations range from 1.3 to 9 mg P/L, which suggests a portion of P might be removed as typical effluent TP concentrations are 4 to 6 mg P/L. The majority of the samples fall within the typical effluent TP concentrations though so the occasional lower concentrations might be sampling artifacts.

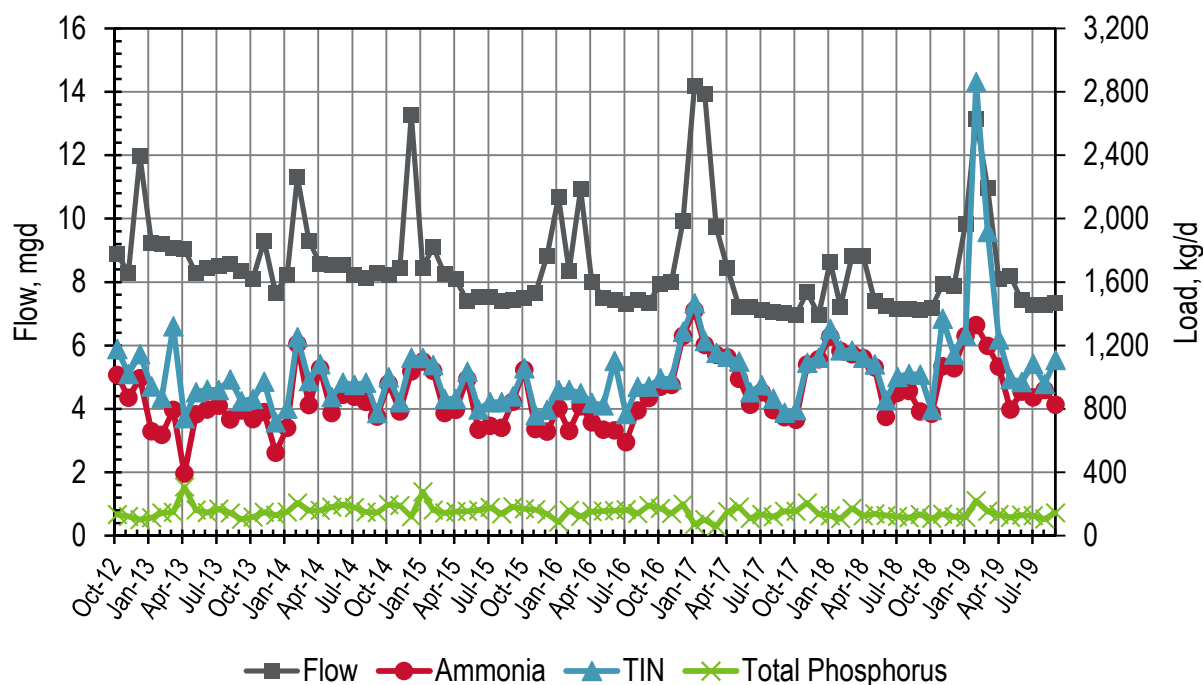


Figure 28-1. South SF-San Bruno Monthly Flows and Loads

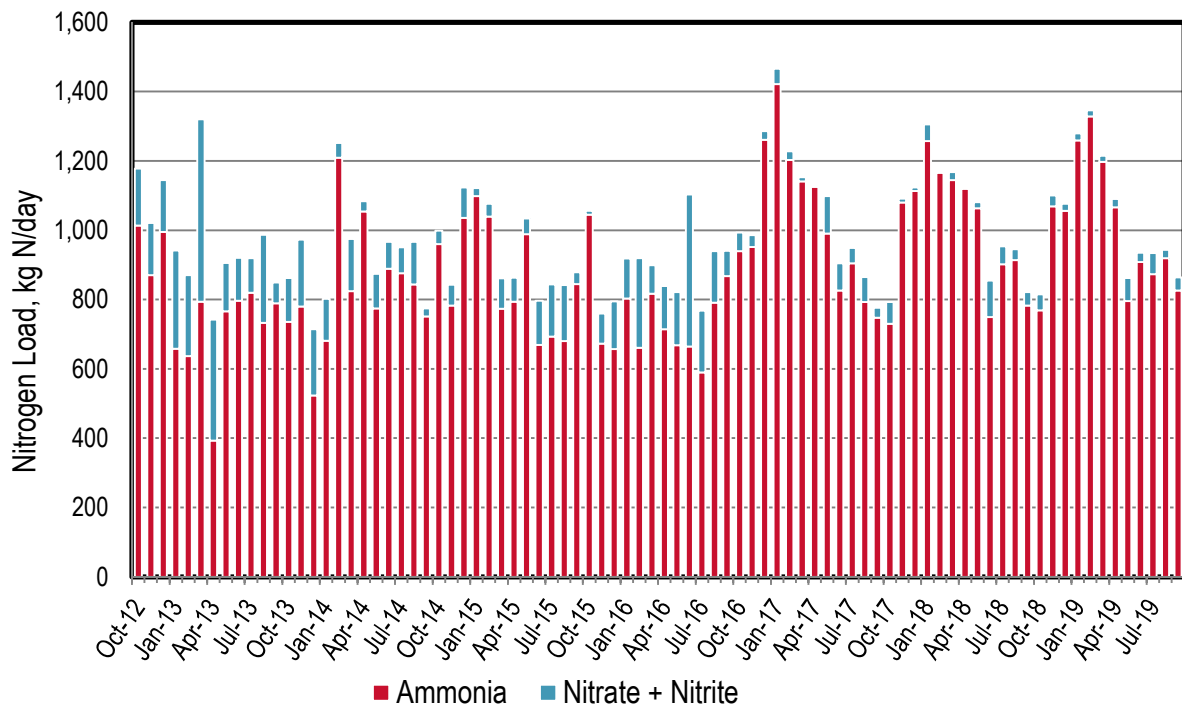


Figure 28-2. South SF-San Bruno Monthly Nitrogen Loads

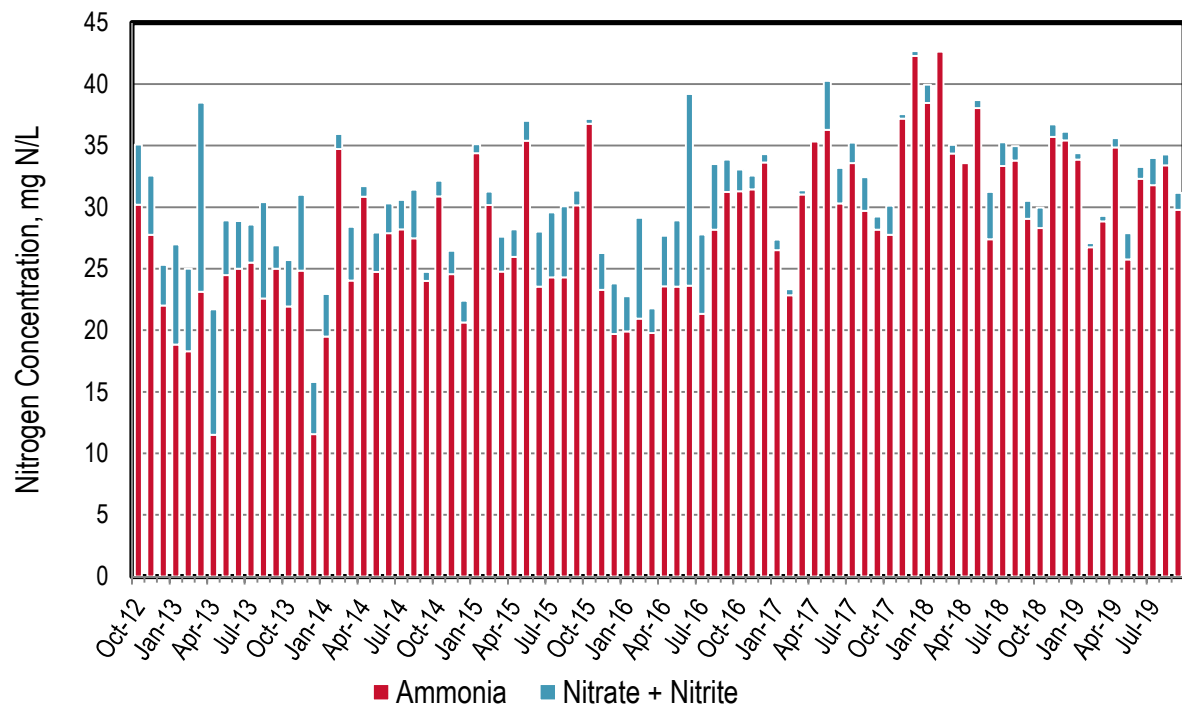


Figure 28-3. South SF-San Bruno Monthly Nitrogen Concentrations

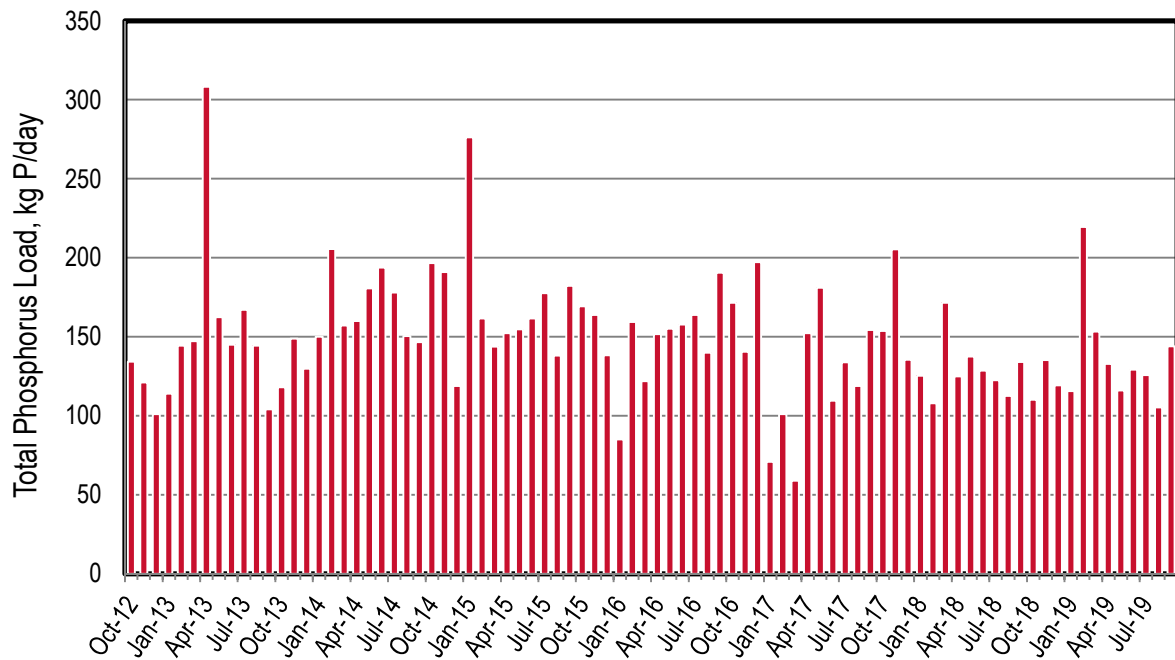


Figure 28-4. South SF-San Bruno Monthly Phosphorus Loads

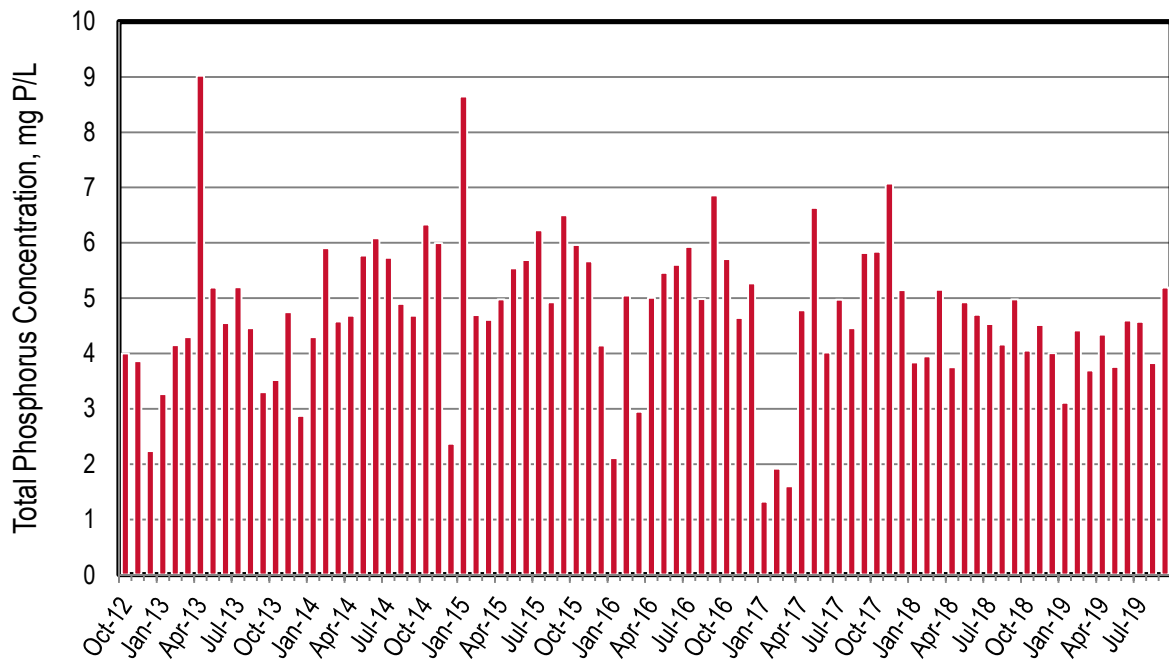


Figure 28-5. South SF-San Bruno Monthly Phosphorus Concentrations

Table 28-1. South SF-San Bruno Monthly Flows and Loads

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-12	8.88	1,010	164	1,180	134
Nov-12	8.30	870	151	1,020	121
Dec-12	12.0	995	149	1,140	101
Jan-13	9.24	658	284	942	114
Feb-13	9.21	637	233	870	144
Mar-13	9.08	793	527	1,320	147
Apr-13	9.04	393	349	742	308
May-13	8.28	766	139	905	162
Jun-13	8.43	797	124	920	145
Jul-13	8.51	820	99.6	919	167
Aug-13	8.58	733	254	986	144
Sep-13	8.35	789	59.9	849	104
Oct-13	8.11	736	127	862	118
Nov-13	9.29	779	193	972	149
Dec-13	7.65	523	191	714	130
Jan-14	8.21	681	121	802	150
Feb-14	11.3	1,210	42.7	1,250	206
Mar-14	9.31	824	150	975	157
Apr-14	8.56	1,050	29.4	1,080	160
May-14	8.53	774	100	874	181
Jun-14	8.55	889	77.4	966	194
Jul-14	8.22	876	74.4	950	178
Aug-14	8.13	844	122	966	151
Sep-14	8.28	752	22.8	774	147
Oct-14	8.22	960	39.2	999	197
Nov-14	8.43	783	59.7	843	191
Dec-14	13.3	1,040	87.7	1,120	119
Jan-15	8.45	1,100	23.5	1,120	276
Feb-15	9.11	1,040	36.8	1,080	162
Mar-15	8.26	774	88.0	861	144
Apr-15	8.09	794	68.5	863	152
May-15	7.39	989	45.2	1,030	155
Jun-15	7.52	669	127	796	162
Jul-15	7.54	693	150	843	178
Aug-15	7.41	680	161	842	138
Sep-15	7.42	845	34.1	879	182

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-15	7.52	1,050	10.9	1,060	169
Nov-15	7.64	673	86.8	759	164
Dec-15	8.83	657	137	794	138
Jan-16	10.7	803	115	919	85.0
Feb-16	8.35	661	258	919	159
Mar-16	10.9	817	82.8	899	122
Apr-16	8.02	714	125	839	152
May-16	7.51	668	153	822	155
Jun-16	7.44	665	438	1,100	158
Jul-16	7.31	590	178	768	164
Aug-16	7.42	791	149	940	140
Sep-16	7.35	868	73.0	940	191
Oct-16	7.95	940	53.3	993	171
Nov-16	8.01	951	34.1	986	140
Dec-16	9.92	1,260	25.5	1,290	197
Jan-17	14.2	1,420	44.9	1,470	70.8
Feb-17	13.9	1,200	24.9	1,230	101
Mar-17	9.73	1,140	11.9	1,150	58.9
Apr-17	8.43	1,130	2.79	1,130	152
May-17	7.22	990	108	1,100	181
Jun-17	7.21	826	78.7	904	110
Jul-17	7.12	904	44.6	949	134
Aug-17	7.06	793	72.4	865	119
Sep-17	7.02	748	28.4	776	154
Oct-17	6.96	730	62.2	792	154
Nov-17	7.68	1,080	10.9	1,090	205
Dec-17	6.96	1,110	10.1	1,120	135
Jan-18	8.64	1,260	48.2	1,310	125
Feb-18	7.23	1,170	3.93	1,170	108
Mar-18	8.81	1,140	23.5	1,170	172
Apr-18	8.82	1,120	3.25	1,120	125
May-18	7.39	1,060	17.7	1,080	138
Jun-18	7.24	749	105	855	129
Jul-18	7.15	901	51.9	1,000	122
Aug-18	7.15	913	31.7	1,020	113
Sep-18	7.12	783	39.0	1,020	134
Oct-18	7.19	769	45.7	794	110

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Nov-18	7.92	1,070	30.6	1,370	135
Dec-18	7.88	1,060	20.7	1,140	119
Jan-19	9.84	1,260	20.0	1,270	116
Feb-19	13.1	1,330	17.4	2,860	220
Mar-19	11.0	1,200	18.0	1,920	153
Apr-19	8.10	1,070	23.3	1,240	133
May-19	8.17	795	66.4	987	116
Jun-19	7.44	909	26.8	969	129
Jul-19	7.27	873	61.1	1,080	126
Aug-19	7.28	919	24.5	957	105
Sep-19	7.34	826	38.3	1,110	144
Dry Season Average	7.64	814	96.5	936	147
Dry Season Trend	Down	None	Down	None	Down
Wet Season Average	9.11	947	91.1	1,090	148
Average Annual	8.49	892	93.4	1,030	148

* The Total Inorganic Nitrogen value is calculated by adding the "Ammonia" and "Nitrate + Nitrite" values.

** Refer to the Section 3.5 in the main body for a description on the statistical analysis.

29 City of Sunnyvale

Sunnyvale discharges to a tributary of the Lower South Bay. It has approximately 28,300 service connections with a permitted ADWF capacity of 29.5 mgd and a peak wet weather flow capacity of 40 mgd. The permitted ADWF capacity will be reduced to 19.5 mgd as part of the ongoing plant upgrades design. The current flows are approximately 8.6 mgd ADWF. This value excludes effluent that is diverted to Sunnyvale's recycling water network. The plant currently nitrifies using oxidation ponds followed by nitrifying trickling filters and has filtration. Significant denitrification occurs in the oxidation ponds primarily during the ADWF period.

The following observations are made based upon the figures and table in the subsequent pages:

- ◆ Based on the average monthly values table below, there do not appear to be any emerging dry season trends for any of the parameters considered. Seasonal flow variation is attributed to rainfall inputs to and evaporation from the oxidation ponds and recycled water production.
- ◆ Nitrogen and phosphorus loads typically increase with flow during wet weather events and are typically greater and more variable than the dry season loads.
- ◆ The trickling filters typically experience a decline in performance during colder months as evidenced by occasional ammonia spikes. This is a common phenomenon for nitrifying trickling filters exacerbated by occasional cold temperatures in the oxidation ponds.
- ◆ The plant has seasonal denitrification as evidenced by ADWF TIN values that typically range from 10 to 20 mg N/L as compared with the 50 to 60 mg N/L measured in the influent. Denitrification occurs in the oxidation ponds during the summer months.
- ◆ NO_x is the majority of the nitrogen species discharged, regardless of season. This would be expected since this plant nitrifies year round (except for colder months, when only partial nitrification occurs).
- ◆ Total phosphorus concentrations are wide ranging, from approximately 2.3 to 10.2 mg P/L.

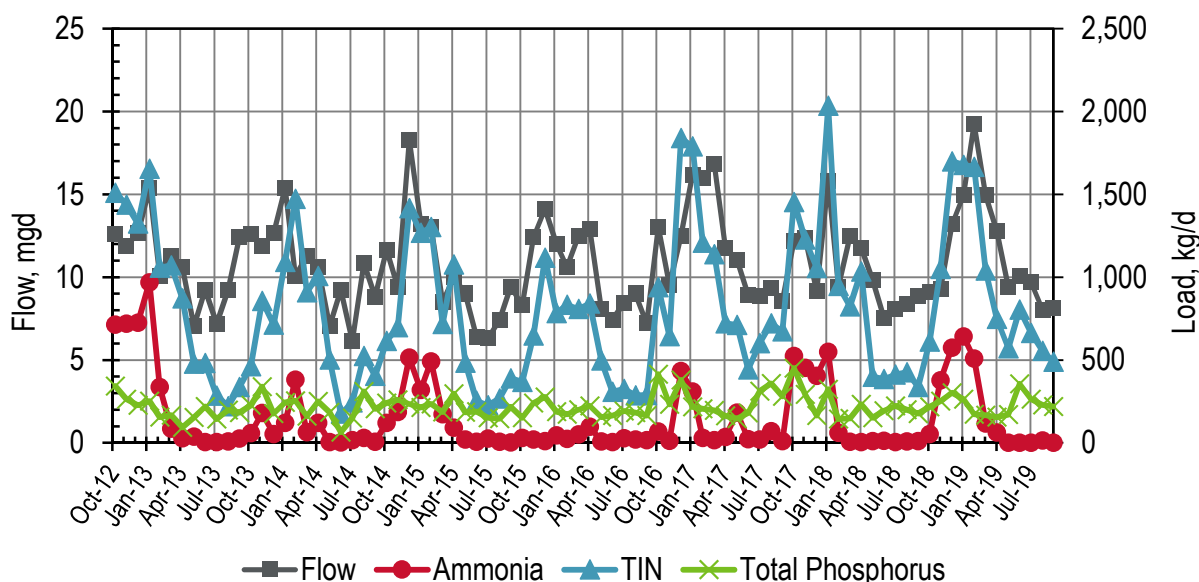


Figure 29-1. Sunnyvale Monthly Flows and Loads

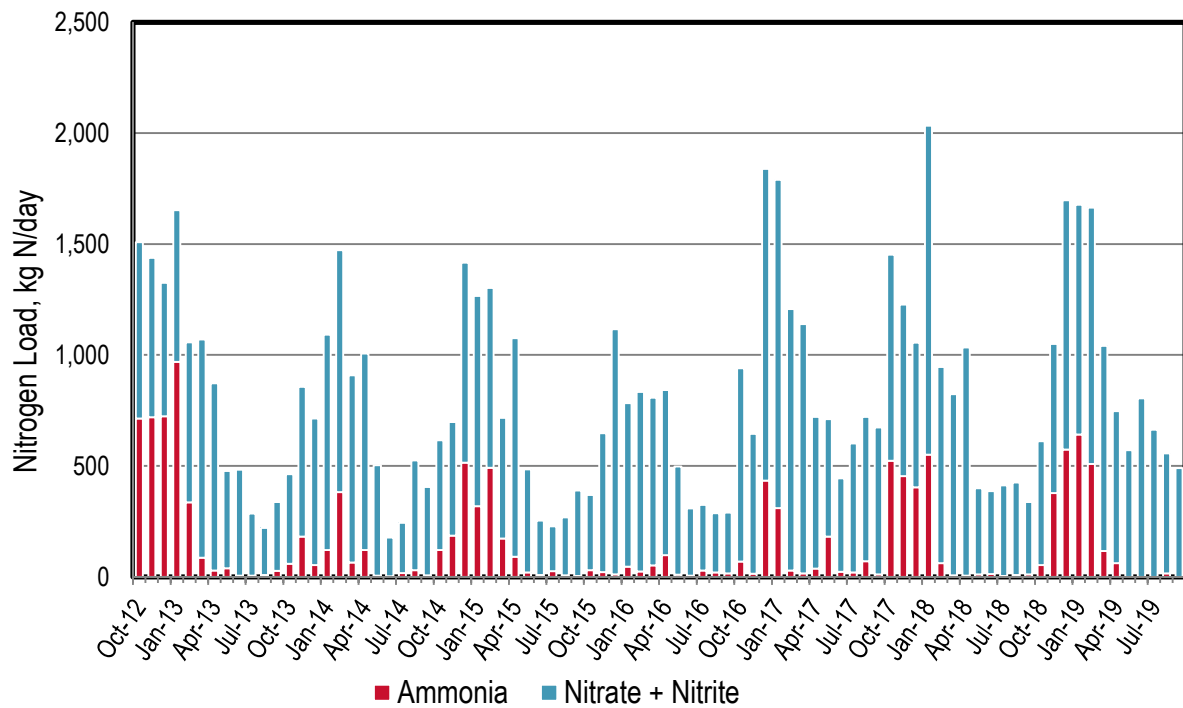


Figure 29-2. Sunnyvale Monthly Nitrogen Loads

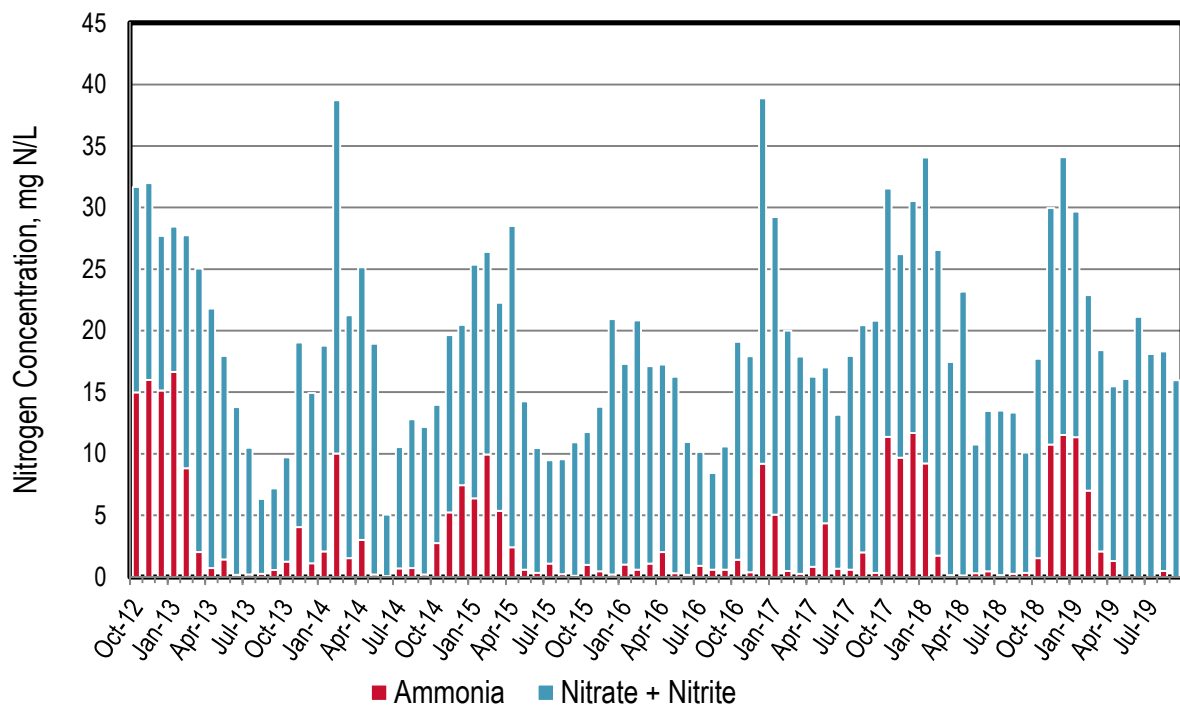


Figure 29-3. Sunnyvale Monthly Nitrogen Concentrations

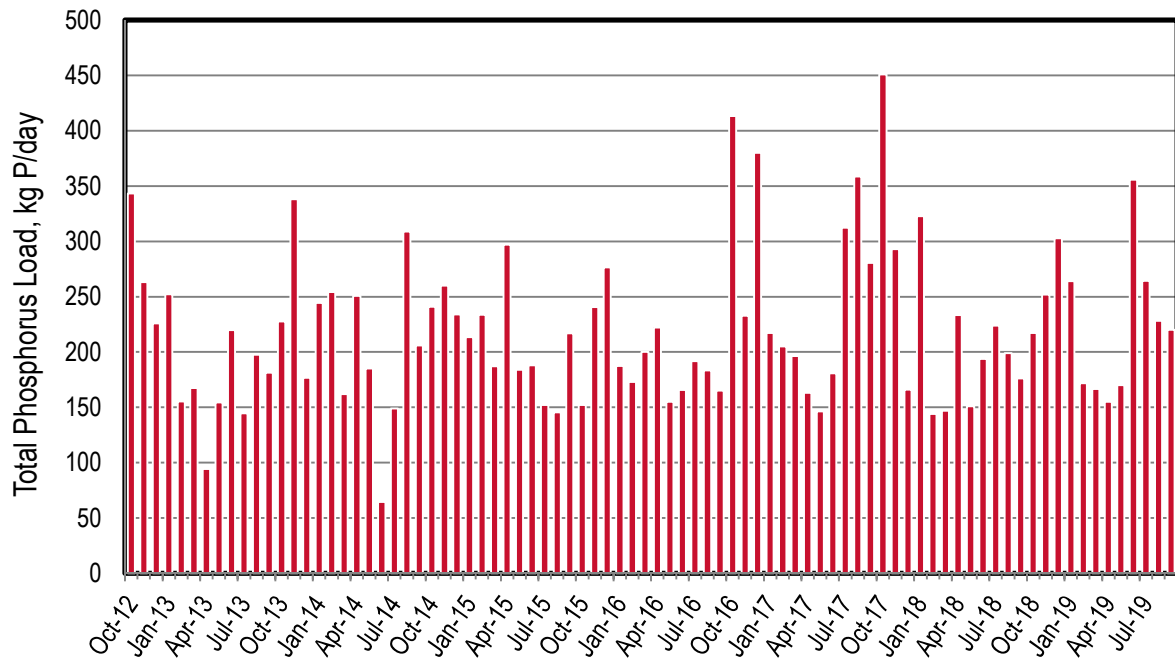


Figure 29-4. Sunnyvale Monthly Phosphorus Loads

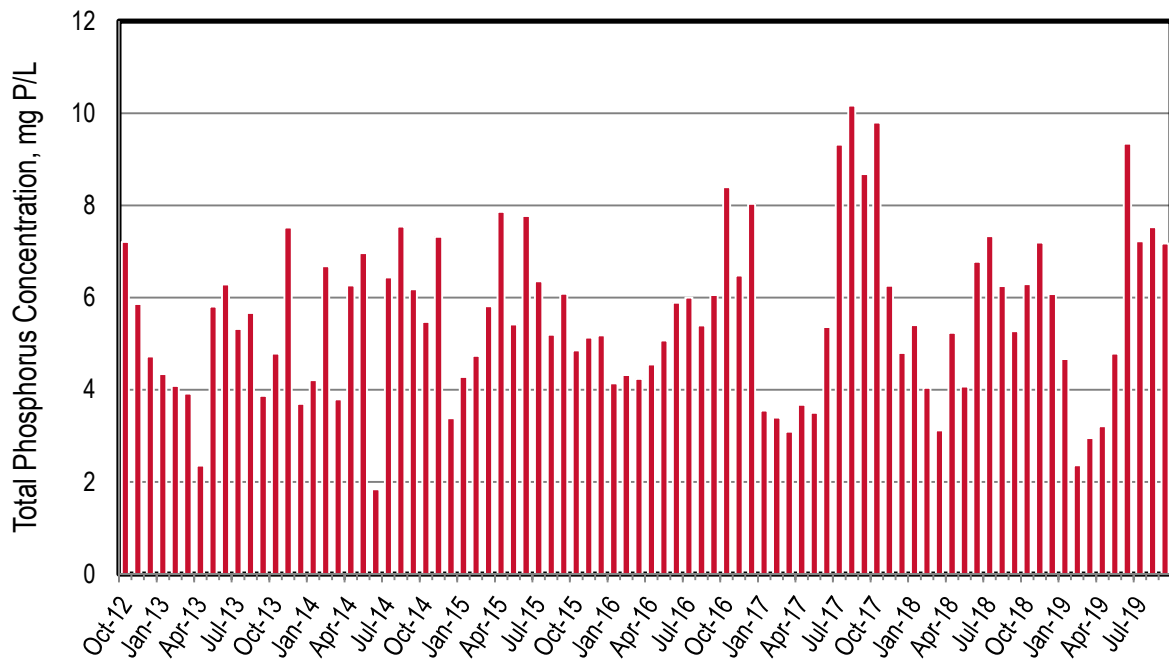


Figure 29-5. Sunnyvale Monthly Phosphorus Concentrations

Table 29-1. Sunnyvale Monthly Flows and Loads

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-12	12.6	714	795	1,510	343
Nov-12	11.9	719	718	1,440	263
Dec-12	12.6	724	600	1,320	226
Jan-13	15.4	968	685	1,650	252
Feb-13	10.1	336	720	1,060	155
Mar-13	11.3	86.3	983	1,070	167
Apr-13	10.6	28.8	844	872	94.3
May-13	7.04	37.9	439	477	154
Jun-13	9.25	5.51	477	482	220
Jul-13	7.19	5.62	279	285	145
Aug-13	9.23	8.30	212	220	198
Sep-13	12.4	26.7	310	337	181
Oct-13	12.6	58.5	404	463	228
Nov-13	11.9	181	675	856	338
Dec-13	12.6	52.4	661	714	177
Jan-14	15.4	121	971	1,090	244
Feb-14	10.1	382	1,090	1,470	254
Mar-14	11.3	64.7	843	908	162
Apr-14	10.6	120	887	1,010	251
May-14	7.04	5.24	498	503	185
Jun-14	9.25	1.91	175	177	64.4
Jul-14	6.12	16.2	228	244	149
Aug-14	10.8	29.5	495	524	309
Sep-14	8.81	6.36	399	405	206
Oct-14	11.7	120	495	615	241
Nov-14	9.40	186	512	698	260
Dec-14	18.3	515	901	1,420	234
Jan-15	13.2	319	948	1,270	214
Feb-15	13.1	491	811	1,300	234
Mar-15	8.52	173	544	717	187
Apr-15	9.99	91.1	985	1,080	297
May-15	8.99	19.9	465	485	184
Jun-15	6.40	7.57	246	253	188
Jul-15	6.33	25.5	201	227	152
Aug-15	7.41	6.27	262	268	145
Sep-15	9.43	3.37	386	390	217

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-15	8.29	30.5	338	368	152
Nov-15	12.4	21.0	627	648	241
Dec-15	14.1	10.9	1,110	1,120	276
Jan-16	12.0	45.8	737	783	188
Feb-16	10.6	23.8	810	834	173
Mar-16	12.5	51.5	756	808	200
Apr-16	12.9	97.9	744	842	222
May-16	8.08	9.09	488	497	155
Jun-16	7.44	4.69	303	308	166
Jul-16	8.45	28.3	296	324	192
Aug-16	8.99	20.0	267	287	183
Sep-16	7.22	16.0	273	289	165
Oct-16	13.0	68.1	872	940	413
Nov-16	9.51	13.2	631	644	233
Dec-16	12.5	434	1,400	1,840	380
Jan-17	16.2	310	1,480	1,790	217
Feb-17	16.0	29.0	1,180	1,210	205
Mar-17	16.8	15.8	1,120	1,140	196
Apr-17	11.7	36.4	685	721	163
May-17	11.1	182	530	711	146
Jun-17	8.91	22.4	421	444	181
Jul-17	8.87	19.7	582	602	312
Aug-17	9.33	69.8	651	721	359
Sep-17	8.55	10.7	663	673	281
Oct-17	12.2	524	928	1,450	451
Nov-17	12.4	453	774	1,230	293
Dec-17	9.15	404	652	1,060	166
Jan-18	15.8	550	1,480	2,030	323
Feb-18	9.43	61.5	885	946	144
Mar-18	12.5	7.03	816	823	147
Apr-18	11.8	4.99	1,030	1,030	233
May-18	9.82	11.0	388	399	151
Jun-18	7.57	13.2	372	385	194
Jul-18	8.07	4.20	408	412	224
Aug-18	8.42	7.67	417	425	199
Sep-18	8.83	11.1	326	337	176
Oct-18	9.12	52.2	559	611	217

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Nov-18	9.27	377	673	1,050	252
Dec-18	13.2	574	1,120	1,700	303
Jan-19	15.0	641	1,040	1,680	264
Feb-19	19.2	509	1,160	1,660	172
Mar-19	14.9	116	924	1,040	167
Apr-19	12.8	62.1	685	747	155
May-19	9.39	0	571	571	170
Jun-19	10.1	0	804	804	356
Jul-19	9.68	0	663	663	264
Aug-19	8.03	14.9	541	556	228
Sep-19	8.11	0	490	490	220
Dry Season Average	8.59	18.6	415	434	201
Dry Season Trend	None	None	None	None	None
Wet Season Average	12.4	244	843	1,090	232
Average Annual	10.8	150	664	815	219

* The Total Inorganic Nitrogen value is calculated by adding the "Ammonia" and "Nitrate + Nitrite" values.

** Refer to the Section 3.5 in the main body for a description on the statistical analysis.

30 Silicon Valley Clean Water (SVCW)

SVCW discharges to the South Bay. The plant services a population of approximately 200,000 and has a permitted ADWF capacity of 29 mgd. The current flows are approximately 12.3 mgd ADWF. The plant performs tertiary treatment using a trickling filter complemented with an activated sludge system followed by mono-media or dual-media filtration.

The following observations are made based upon the figures and table in the subsequent pages:

- ◆ Based on the table with the average monthly values, there is an emerging slight upward dry season trend for Ammonia, TIN, and total phosphorus. There is a slight downward trend for NOx loads.
- ◆ Nitrogen loads typically increases with flow during wet weather events.
- ◆ Nitrogen wet season loads are typically greater and more variable than the dry season loads. The plant is subjected to lower loads in the dry season and the warmer temperature lends itself to nitrifying a portion of the ammonia load.
- ◆ Ammonia is the majority of the nitrogen species discharged, regardless of season. This would be expected since this plant does not nitrify.
- ◆ There was an analytical sampling issue for the July 2015 phosphorus species samples (data not shown).
- ◆ Total phosphorus concentrations are wide ranging, from approximately 1.7 to 7.0 mg P/L. Typical effluent TP concentrations range from 4 to 6 mg P/L.

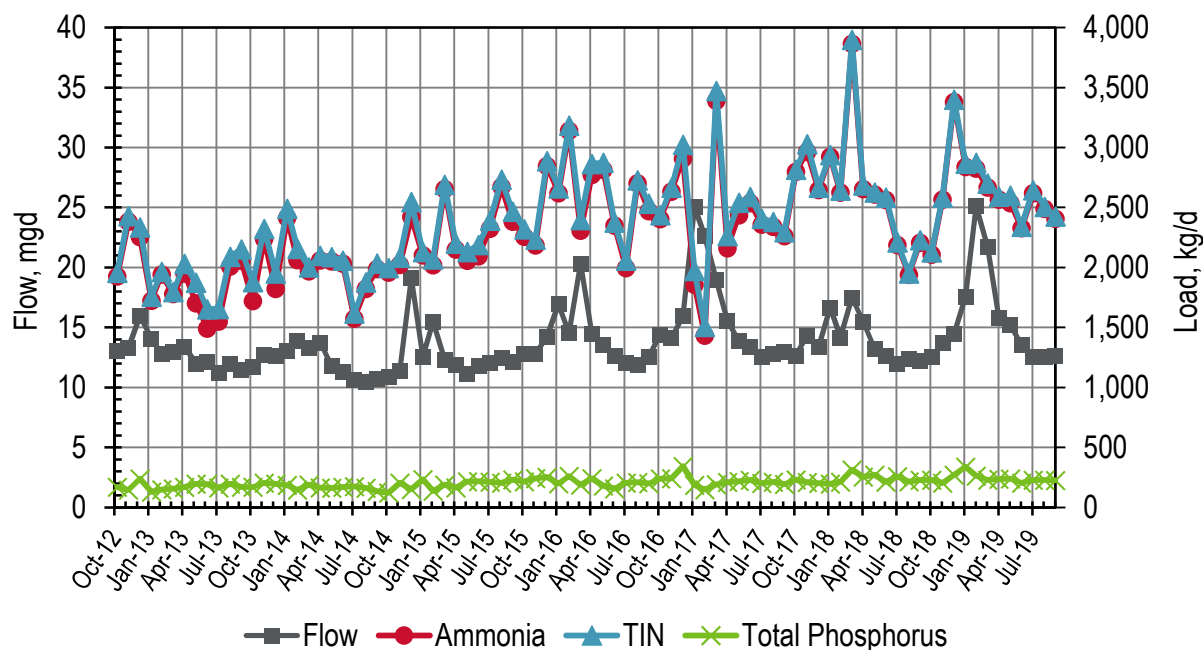


Figure 30-1. SVCW Monthly Flows and Loads

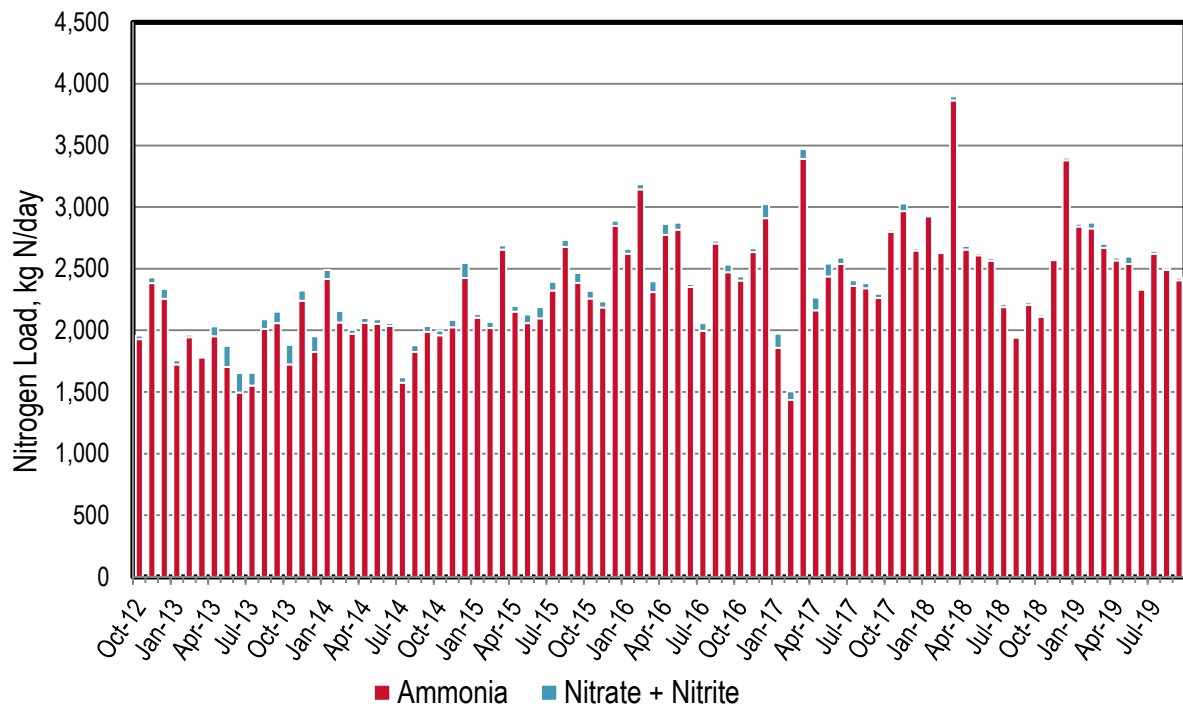


Figure 30-2. SVCW Monthly Nitrogen Loads

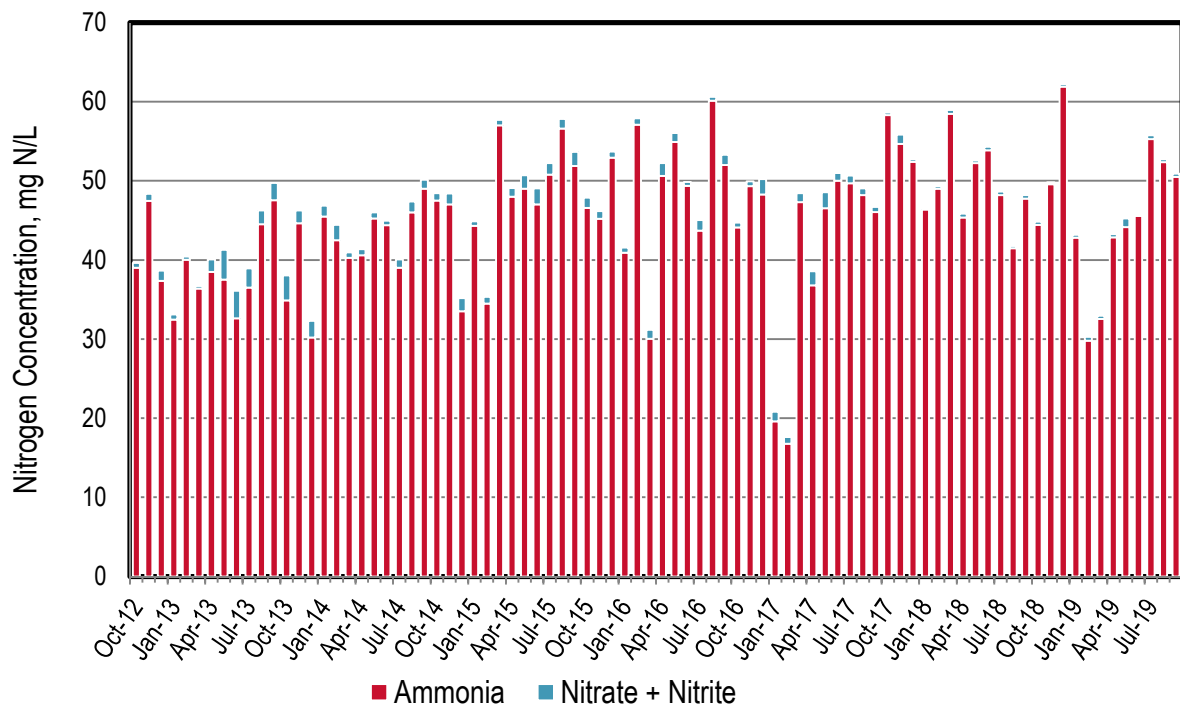


Figure 30-3. SVCW Monthly Nitrogen Concentrations

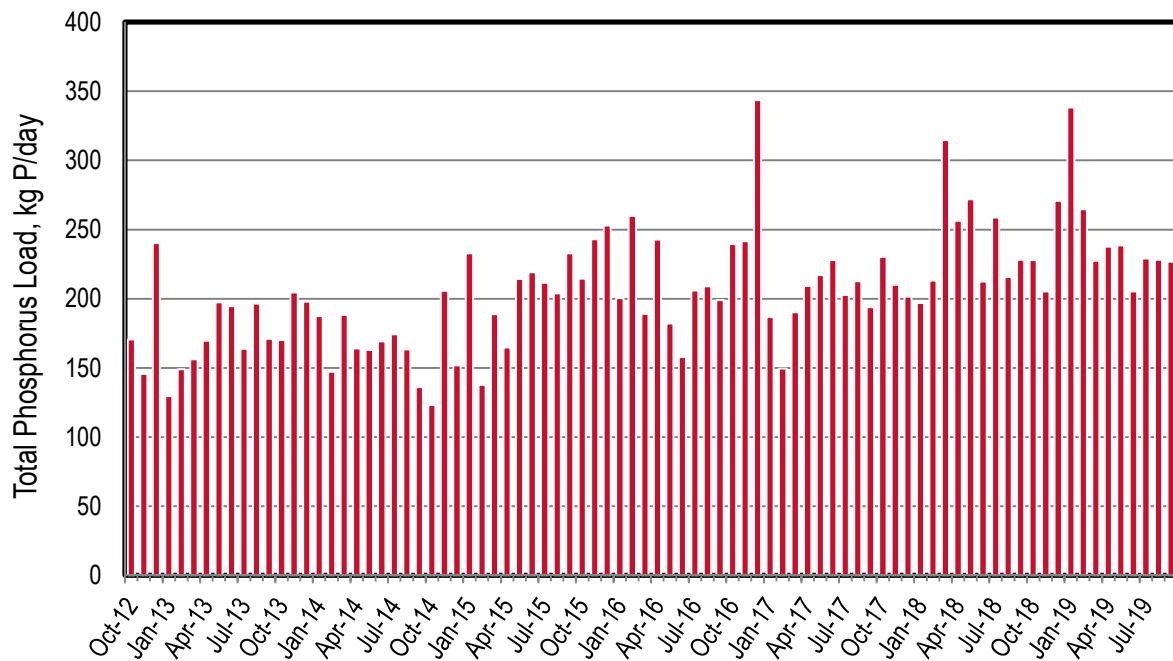


Figure 30-4. SVCW Monthly Phosphorus Loads

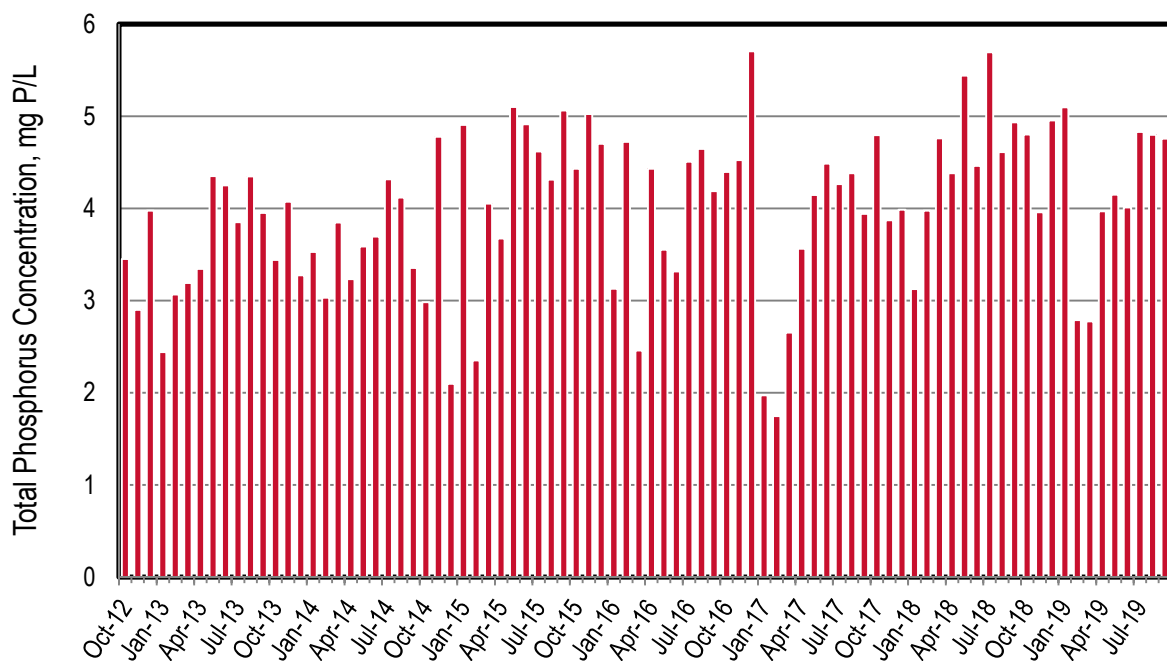


Figure 30-5. SVCW Monthly Phosphorus Concentrations

Table 30-1. SVCW Monthly Flows and Loads

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-12	13.1	1,930	30.2	1,960	171
Nov-12	13.3	2,380	44.2	2,430	146
Dec-12	16.0	2,260	80.0	2,340	240
Jan-13	14.1	1,720	33.4	1,760	130
Feb-13	12.9	1,940	19.4	1,960	149
Mar-13	13.0	1,780	14.6	1,800	156
Apr-13	13.4	1,950	81.0	2,030	170
May-13	12.0	1,700	171	1,870	197
Jun-13	12.1	1,490	159	1,650	195
Jul-13	11.3	1,550	103	1,660	164
Aug-13	12.0	2,010	77.7	2,090	196
Sep-13	11.5	2,060	94.7	2,150	171
Oct-13	11.7	1,720	157	1,880	170
Nov-13	12.8	2,240	81.6	2,320	204
Dec-13	12.7	1,820	127	1,950	198
Jan-14	13.0	2,420	74.1	2,490	187
Feb-14	13.9	2,060	94.0	2,160	147
Mar-14	13.3	1,970	32.4	2,000	188
Apr-14	13.8	2,060	38.7	2,100	164
May-14	11.8	2,050	35.4	2,090	163
Jun-14	11.3	2,030	24.4	2,060	169
Jul-14	10.7	1,580	43.4	1,620	174
Aug-14	10.5	1,820	54.2	1,880	163
Sep-14	10.7	1,990	45.4	2,030	136
Oct-14	10.9	1,960	38.9	2,000	123
Nov-14	11.4	2,020	59.4	2,080	206
Dec-14	19.1	2,420	122	2,550	152
Jan-15	12.6	2,100	28.0	2,130	233
Feb-15	15.5	2,020	48.6	2,070	138
Mar-15	12.3	2,660	32.8	2,690	189
Apr-15	11.9	2,150	47.7	2,200	165
May-15	11.1	2,060	71.8	2,130	214
Jun-15	11.8	2,100	91.6	2,190	219
Jul-15	12.1	2,320	67.9	2,390	211
Aug-15	12.5	2,680	57.2	2,730	204
Sep-15	12.2	2,380	81.9	2,470	233

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-15	12.8	2,260	62.6	2,320	215
Nov-15	12.8	2,190	46.9	2,230	243
Dec-15	14.2	2,850	39.8	2,890	253
Jan-16	16.9	2,620	40.3	2,660	200
Feb-16	14.6	3,140	42.5	3,190	260
Mar-16	20.3	2,310	87.8	2,400	189
Apr-16	14.5	2,770	89.3	2,860	243
May-16	13.6	2,820	57.8	2,870	182
Jun-16	12.6	2,350	23.6	2,370	158
Jul-16	12.1	2,000	61.0	2,060	206
Aug-16	11.9	2,700	23.1	2,730	209
Sep-16	12.6	2,470	60.9	2,530	199
Oct-16	14.4	2,400	32.6	2,440	239
Nov-16	14.1	2,630	32.1	2,670	242
Dec-16	15.9	2,910	115	3,020	344
Jan-17	25.1	1,860	115	1,970	187
Feb-17	22.6	1,430	72.1	1,510	149
Mar-17	19.0	3,390	80.6	3,470	190
Apr-17	15.5	2,160	103	2,270	209
May-17	13.9	2,440	106	2,540	217
Jun-17	13.4	2,540	49.6	2,590	228
Jul-17	12.6	2,360	46.8	2,410	203
Aug-17	12.8	2,340	41.8	2,380	213
Sep-17	13.0	2,260	31.7	2,300	194
Oct-17	12.7	2,800	15.9	2,820	230
Nov-17	14.4	2,970	62.0	3,030	210
Dec-17	13.4	2,650	16.5	2,670	202
Jan-18	16.7	2,920	14.2	2,940	197
Feb-18	14.2	2,630	16.6	2,640	213
Mar-18**	17.5	3,870	33.7	3,900	315
Apr-18	15.5	2,660	29.2	2,690	256
May-18	13.2	2,610	16.7	2,630	272
Jun-18	12.6	2,570	20.0	2,590	212
Jul-18	12.0	2,190	21.4	2,210	259
Aug-18	12.4	1,940	12.3	1,950	216
Sep-18	12.2	2,210	21.5	2,230	228
Oct-18	12.6	2,110	17.6	2,130	228

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Nov-18	13.7	2,570	13.8	2,580	205
Dec-18	14.5	3,380	18.8	3,400	271
Jan-19	17.6	2,840	24.4	2,870	338
Feb-19	25.1	2,830	46.9	2,870	265
Mar-19	21.7	2,670	32.9	2,700	228
Apr-19	15.8	2,570	23.7	2,590	238
May-19	15.2	2,540	61.4	2,600	238
Jun-19	13.5	2,330	11.8	2,340	205
Jul-19	12.5	2,620	23.2	2,640	229
Aug-19	12.6	2,490	17.5	2,510	228
Sep-19	12.6	2,410	19.0	2,430	227
Dry Season Average	12.3	2,230	54.4	2,280	204
Dry Season Trend	None	Up	Down	Up	Up
Wet Season Average	15.1	2,410	53.3	2,460	208
Average Annual	13.9	2,330	53.8	2,390	206

* The Total Inorganic Nitrogen value is calculated by adding the "Ammonia" and "Nitrate + Nitrite" values.

** One of the monthly nutrient sampling events (n=2) occurred during the maximum daily flow for that month. The loads are atypically high for this particular day due to a likely flushing phenomenon in the collection system.

*** Refer to the Section 3.5 in the main body for a description on the statistical analysis.

31 Sanitary District No. 5 of Marin County – Tiburon Treatment Plant

The Tiburon Treatment Plant discharges to the Central Bay. The service area has a population of approximately 8,400. The plant has a permitted ADWF capacity of 0.98 mgd and a peak wet weather capacity of 2.3 mgd. It has current flows of approximately 0.54 mgd ADWF. The plant performs secondary treatment using an activated sludge treatment process.

The plant is classified as a minor discharger (<1 mgd permitted capacity) and thus not required to sample as frequently as the major dischargers (>1 mgd permitted capacity). The minor dischargers are required to sample twice per year under the Nutrient Watershed Permit. As a result, there are several months of nutrient data gaps.

The following observations are made based upon the figures and table in the subsequent pages:

- ◆ Flow values are provided over the entire study period. The remaining nutrient species only have monthly sampling for the first year of sampling, followed by occasional sampling thereafter.
- ◆ Based on the table with the average monthly values, there appears to be no emerging trend for flows or nutrient loads.
- ◆ With the exception of January 2013, ammonia is the majority of the nitrogen species discharged, regardless of season. This would be expected since this plant does not nitrify.
- ◆ Total phosphorus concentrations are wide ranging from approximately 1.4 to 6.5 mg P/L. Typical effluent TP concentrations range from 4 to 6 mg P/L.

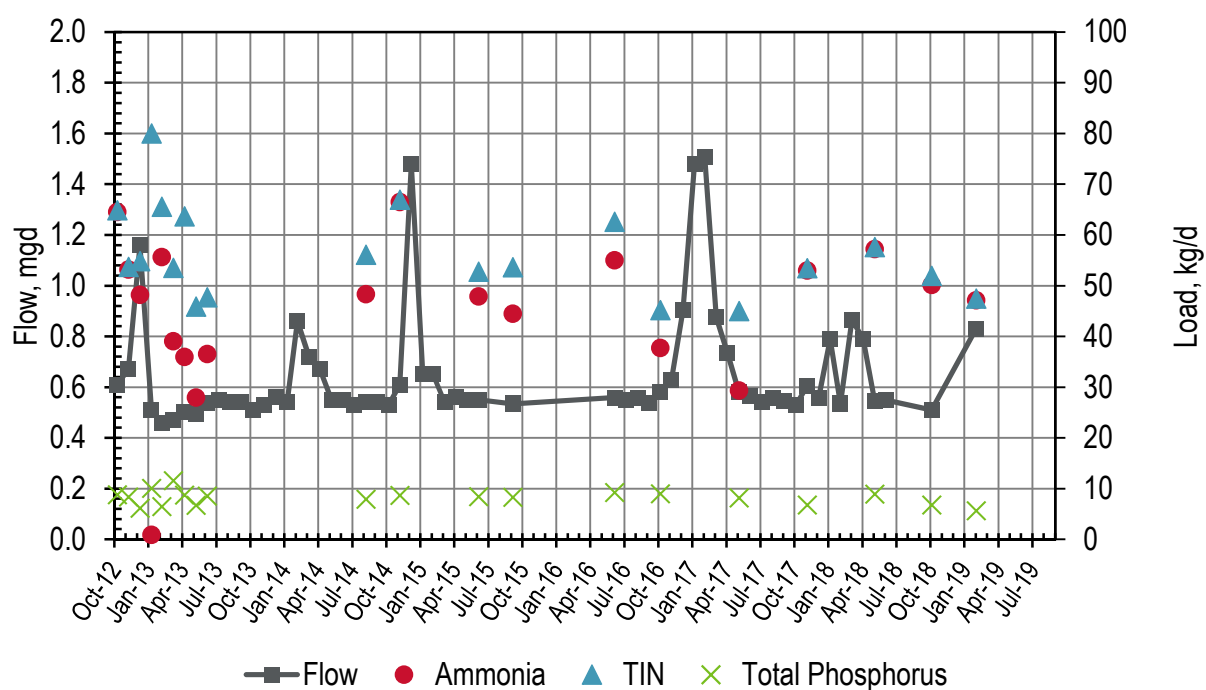


Figure 31-1. Tiburon Monthly Flows and Loads

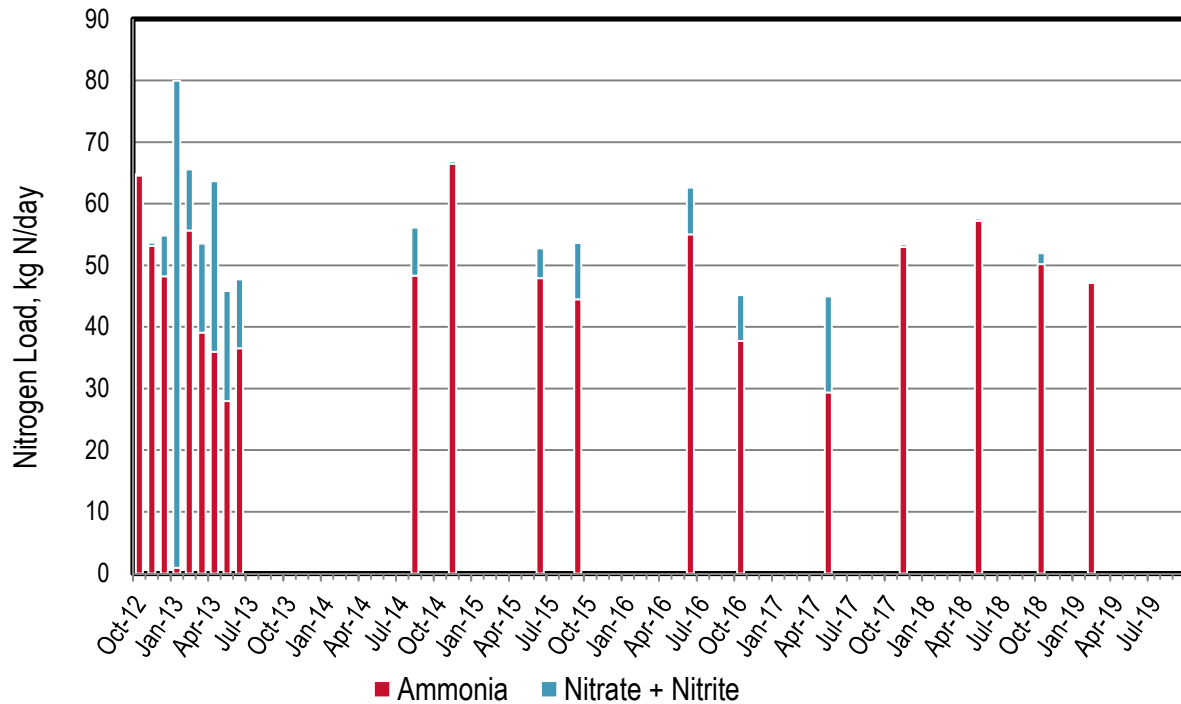


Figure 31-2. Tiburon Monthly Nitrogen Loads

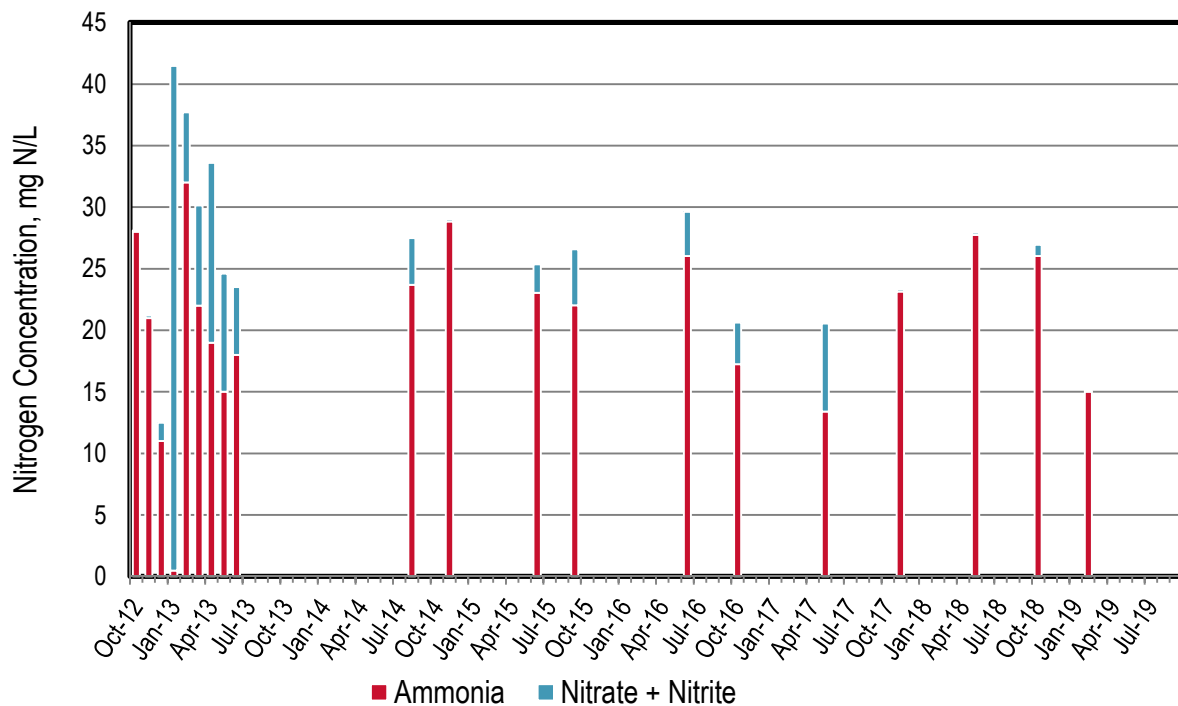


Figure 31-3. Tiburon Monthly Nitrogen Concentrations

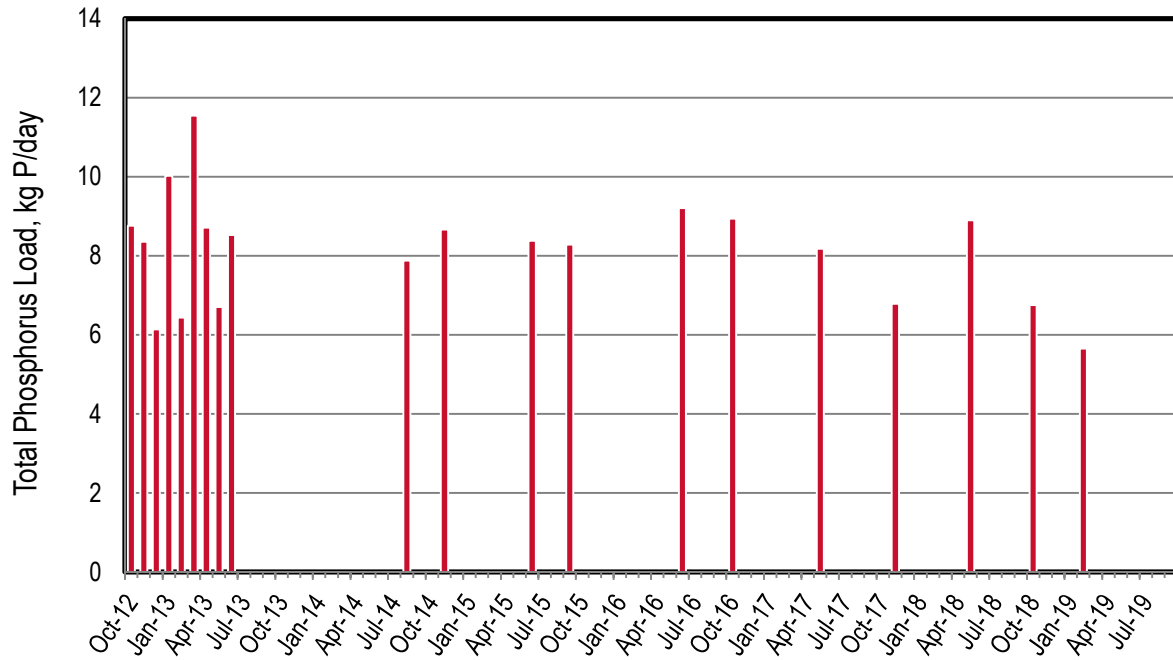


Figure 31-4. Tiburon Monthly Phosphorus Loads

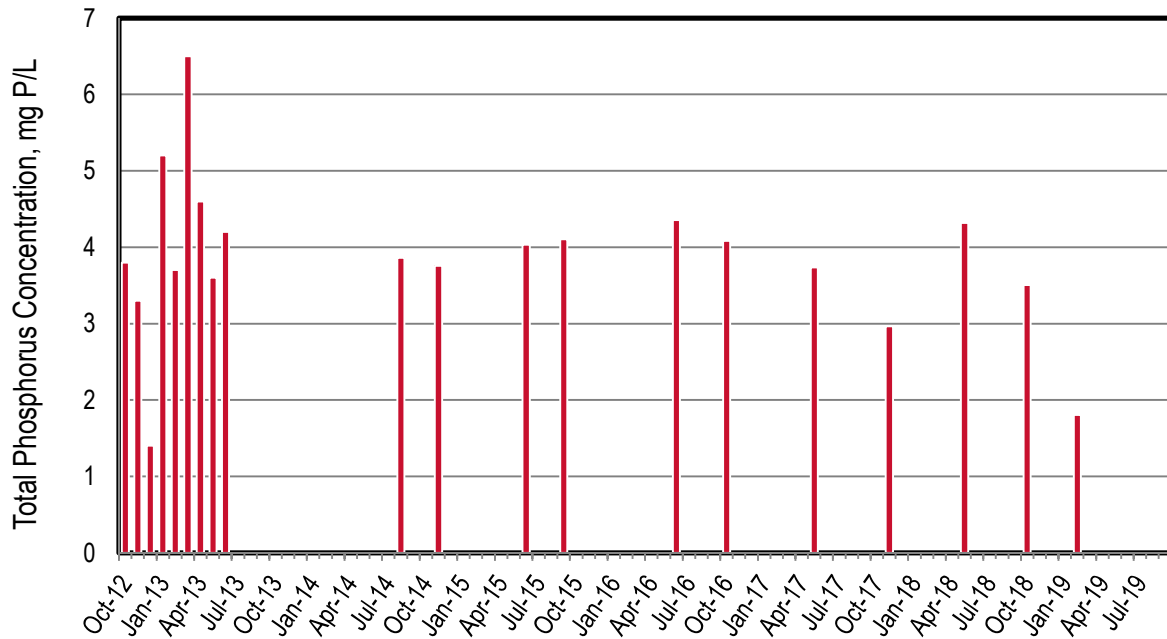


Figure 31-5. Tiburon Monthly Phosphorus Concentrations

Table 31-1. Tiburon Monthly Flows and Loads

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-12	0.610	64.6	0.284	64.8	8.76
Nov-12	0.670	53.2	0.484	53.7	8.36
Dec-12	1.16	48.2	6.58	54.8	6.14
Jan-13	0.510	0.906	79.1	80.0	10.0
Feb-13	0.460	55.6	9.91	65.6	6.43
Mar-13	0.470	39.1	14.4	53.5	11.5
Apr-13	0.501	36.0	27.6	63.6	8.71
May-13	0.493	28.0	17.9	45.8	6.71
Jun-13	0.537	36.5	11.2	47.7	8.53
Jul-13	0.550				
Aug-13	0.540				
Sep-13	0.540				
Oct-13	0.510				
Nov-13	0.530				
Dec-13	0.560				
Jan-14	0.540				
Feb-14	0.860				
Mar-14	0.720				
Apr-14	0.670				
May-14	0.550				
Jun-14	0.550				
Jul-14	0.530				
Aug-14	0.540	48.3	7.78	56.1	7.88
Sep-14	0.540				
Oct-14	0.530				
Nov-14	0.610	66.5	0.455	66.9	8.66
Dec-14	1.48				
Jan-15	0.650				
Feb-15	0.650				
Mar-15	0.540				
Apr-15	0.560				
May-15	0.550				
Jun-15	0.550	47.9	4.83	52.7	8.38
Jul-15					
Aug-15					
Sep-15	0.534	44.5	9.16	53.6	8.29

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-15					
Nov-15					
Dec-15					
Jan-16					
Feb-16					
Mar-16					
Apr-16					
May-16					
Jun-16	0.559	55.0	7.60	62.6	9.20
Jul-16	0.550				
Aug-16	0.557				
Sep-16	0.536				
Oct-16	0.579	37.8	7.41	45.2	8.94
Nov-16	0.628				
Dec-16	0.904				
Jan-17	1.48				
Feb-17	1.51				
Mar-17	0.876				
Apr-17	0.735				
May-17	0.579	29.4	15.6	45.0	8.18
Jun-17	0.566				
Jul-17	0.540				
Aug-17	0.559				
Sep-17	0.546				
Oct-17	0.529				
Nov-17	0.606	53.0	0.424	53.4	6.78
Dec-17	0.558				
Jan-18	0.788				
Feb-18	0.534				
Mar-18	0.866				
Apr-18	0.790				
May-18	0.545	57.2	0.339	57.6	8.90
Jun-18	0.549				
Jul-18					
Aug-18					
Sep-18					
Oct-18	0.510	50.2	1.76	51.9	6.76

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Nov-18					
Dec-18					
Jan-19					
Feb-19	0.830	47.1	0.314	47.4	5.65
Mar-19					
Apr-19					
May-19					
Jun-19					
Jul-19					
Aug-19					
Sep-19					
Dry Season Average	0.545	43.4	9.30	52.6	8.26
Dry Season Trend	None	***	***	***	***
Wet Season Average	0.716	46.0	12.4	58.4	8.06
Average Annual	0.649	44.9	11.2	56.1	8.14

* The Total Inorganic Nitrogen value is calculated by adding the "Ammonia" and "Nitrate + Nitrite" values.

** Refer to the Section 3.5 in the main body for a description on the statistical analysis.

*** No statistical dry season trending analysis was performed on nutrient species due to the limited number of samples required for minor dischargers.

32 Treasure Island

Treasure Island discharges to the Central Bay. The plant has a permitted capacity of 2.0 mgd ADWF and a peak wet weather capacity of 4.4 mgd. The current plant flow is approximately 0.29 mgd ADWF. The plant currently nitrifies using trickling filters.

The following observations are made based upon the figures and table in the subsequent pages:

- ◆ Based on the average monthly values table below, flow and nitrogen loads have no statistical trend. Total phosphorus is trending up.
- ◆ The plant fully nitrified through April 2014 at which time one of the plant's two trickling arm filters became inoperable, resulting in increased effluent ammonia concentrations.
- ◆ Prior to April 2014, NO_x was the majority of the nitrogen species discharged as would be expected since this plant nitrifies. Since then, the proportion of ammonia relative to NO_x has increased.

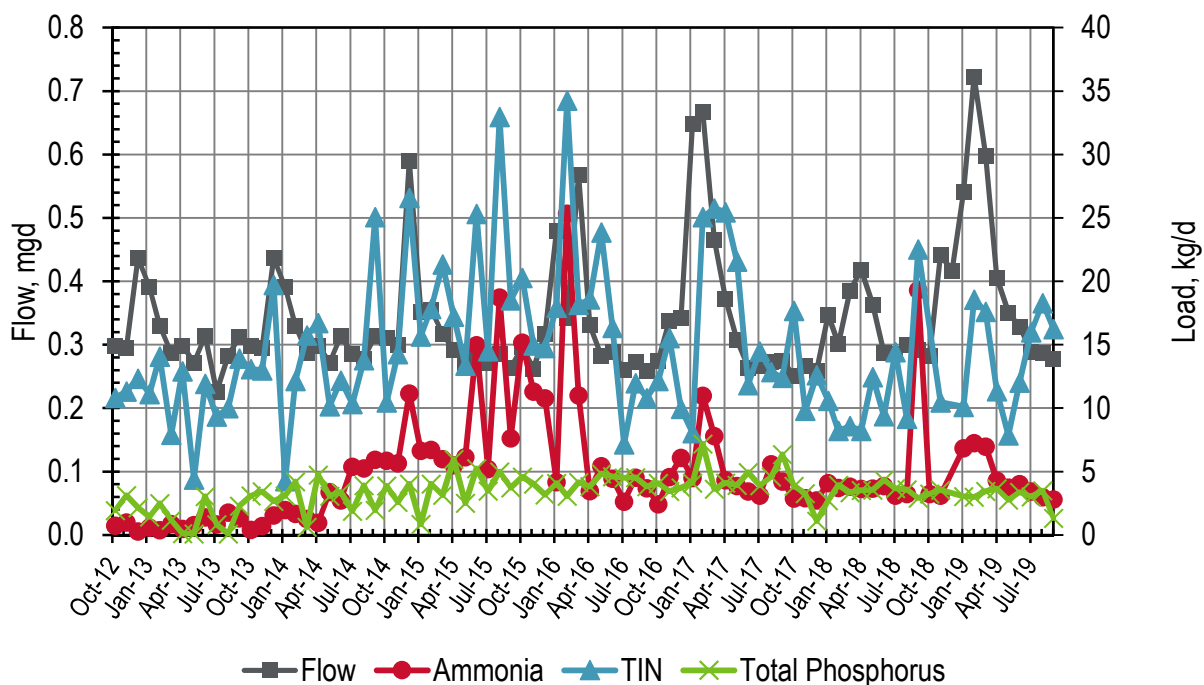


Figure 32-1. Treasure Island Monthly Flows and Loads

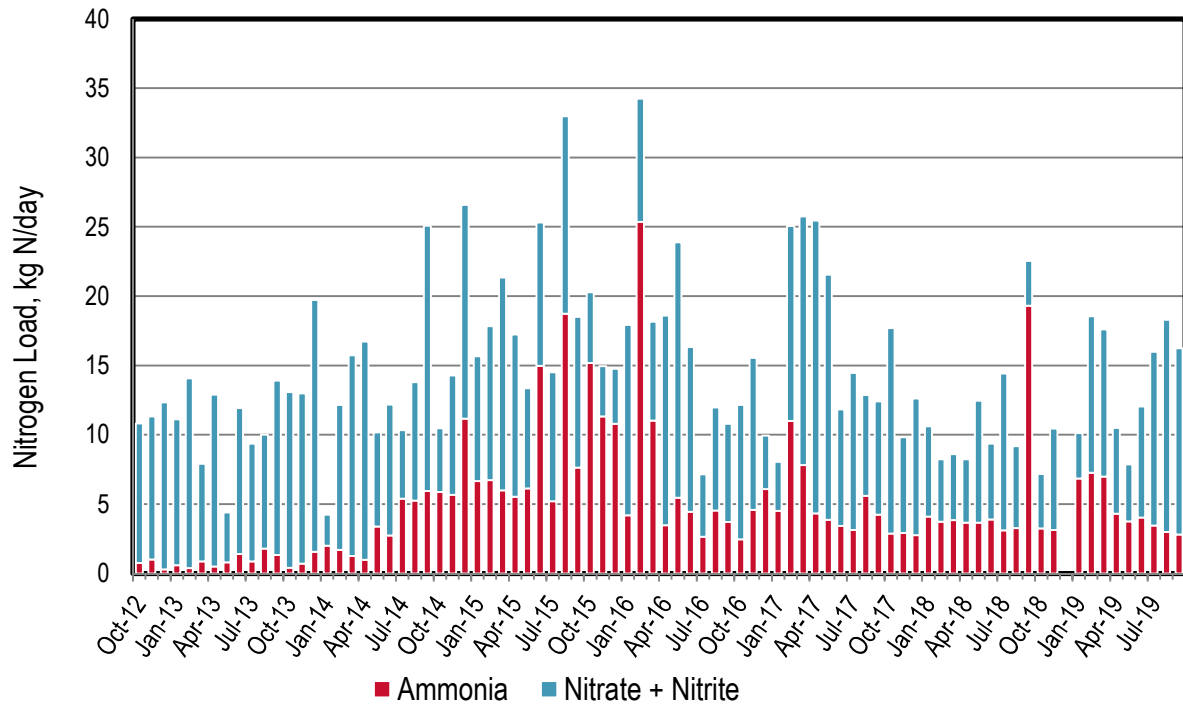


Figure 32-2. Treasure Island Monthly Nitrogen Loads

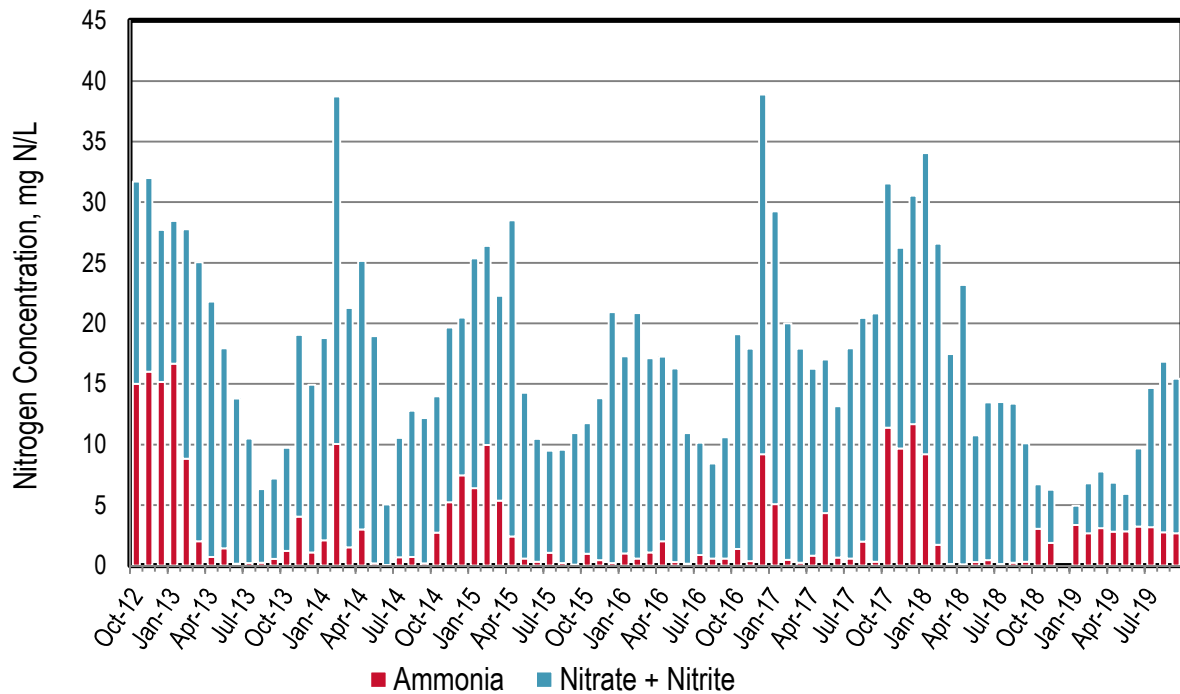


Figure 32-3. Treasure Island Monthly Nitrogen Concentrations

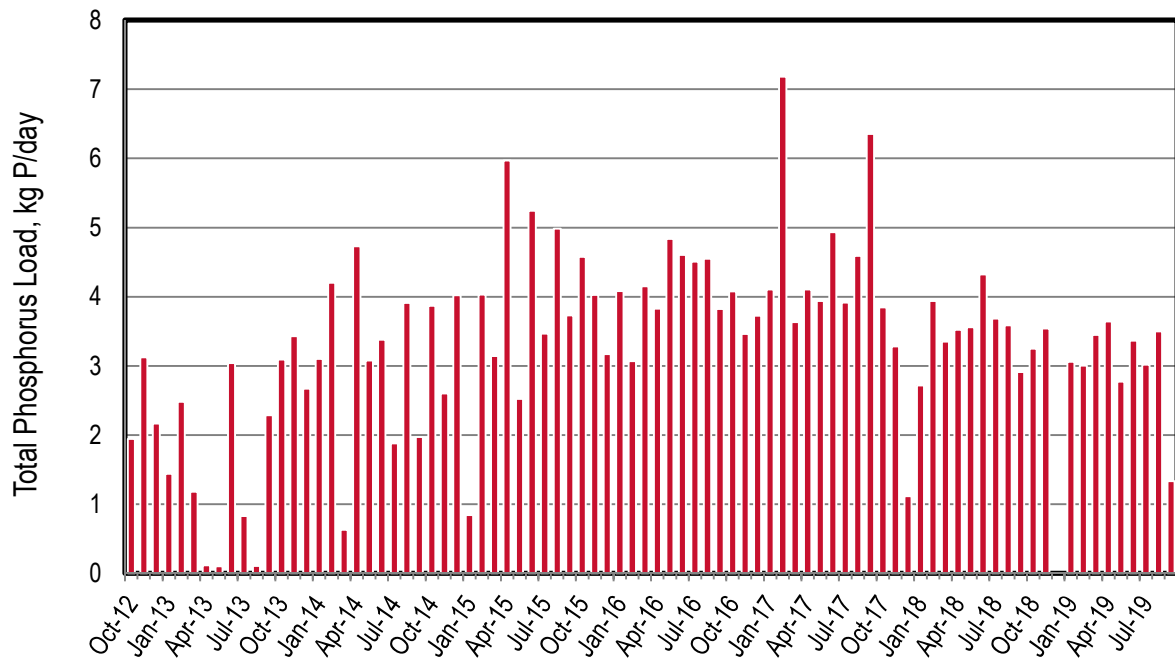


Figure 32-4. Treasure Island Monthly Phosphorus Loads

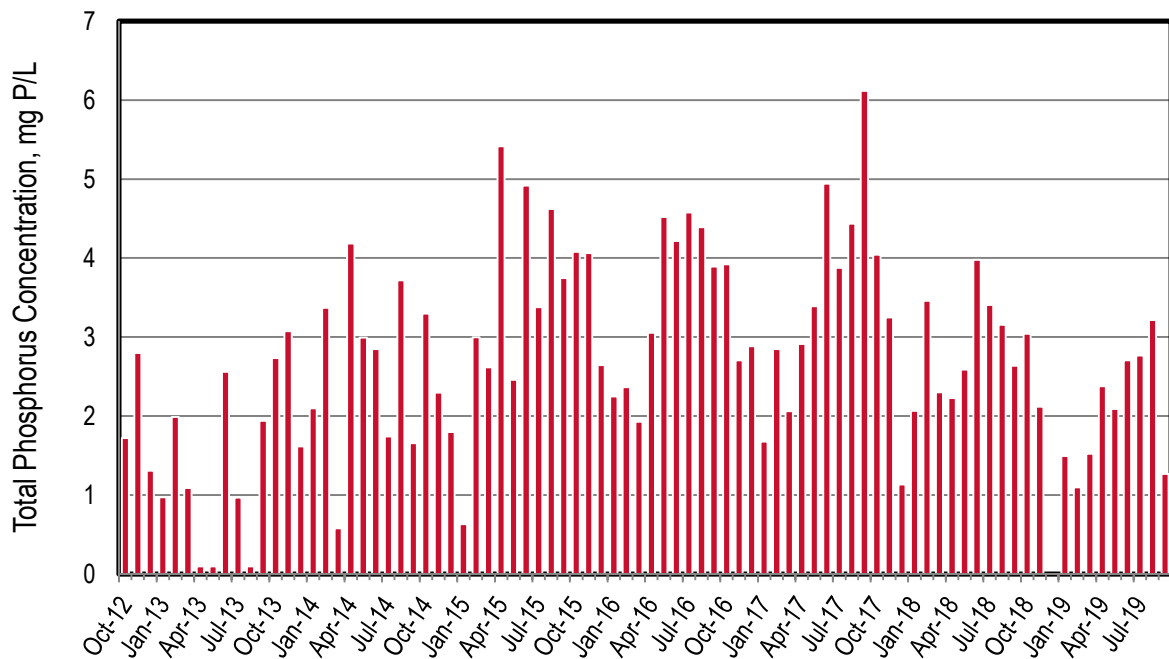


Figure 32-5. Treasure Island Monthly Phosphorus Concentrations

Table 32-1. Treasure Island Monthly Flows and Loads

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-12	0.299	0.757	10.1	10.8	1.94
Nov-12	0.295	1.00	10.3	11.3	3.12
Dec-12	0.437	0.297	12.0	12.3	2.16
Jan-13	0.391	0.602	10.5	11.1	1.44
Feb-13	0.330	0.387	13.7	14.1	2.48
Mar-13	0.287	0.872	7.04	7.91	1.18
Apr-13	0.299	0.509	12.4	12.9	0.113
May-13	0.272	0.802	3.59	4.40	0.103
Jun-13	0.314	1.40	10.5	11.9	3.04
Jul-13	0.226	0.863	8.49	9.35	0.829
Aug-13	0.283	1.79	8.23	10.0	0.107
Sep-13	0.312	1.32	12.6	13.9	2.29
Oct-13	0.299	0.411	12.7	13.1	3.09
Nov-13	0.295	0.713	12.3	13.0	3.43
Dec-13	0.437	1.55	18.2	19.7	2.67
Jan-14	0.391	1.99	2.25	4.25	3.10
Feb-14	0.330	1.69	10.5	12.2	4.20
Mar-14	0.287	1.27	14.5	15.7	0.630
Apr-14	0.299	0.976	15.7	16.7	4.73
May-14	0.272	3.39	6.77	10.2	3.08
Jun-14	0.314	2.75	9.43	12.2	3.38
Jul-14	0.286	5.40	4.94	10.3	1.88
Aug-14	0.278	5.26	8.53	13.8	3.91
Sep-14	0.314	5.94	19.1	25.1	1.97
Oct-14	0.311	5.87	4.60	10.5	3.87
Nov-14	0.299	5.66	8.62	14.3	2.60
Dec-14	0.591	11.2	15.4	26.6	4.02
Jan-15	0.352	6.66	9.01	15.7	0.840
Feb-15	0.356	6.72	11.1	17.8	4.03
Mar-15	0.317	6.00	15.4	21.4	3.14
Apr-15	0.292	5.52	11.7	17.2	5.97
May-15	0.271	6.14	7.22	13.4	2.52
Jun-15	0.282	15.0	10.3	25.3	5.24
Jul-15	0.271	5.20	9.30	14.5	3.47
Aug-15	0.285	18.7	14.2	33.0	4.98

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Sep-15	0.263	7.63	10.9	18.5	3.73
Oct-15	0.297	15.2	5.09	20.3	4.58
Nov-15	0.262	11.3	3.62	15.0	4.03
Dec-15	0.317	10.8	3.98	14.8	3.17
Jan-16	0.480	4.19	13.7	17.9	4.08
Feb-16	0.343	25.3	8.90	34.2	3.07
Mar-16	0.569	11.0	7.14	18.2	4.15
Apr-16	0.331	3.48	15.1	18.6	3.83
May-16	0.283	5.45	18.4	23.9	4.84
Jun-16	0.289	4.45	11.9	16.3	4.60
Jul-16	0.260	2.65	4.51	7.16	4.51
Aug-16	0.274	4.55	7.42	12.0	4.55
Sep-16	0.260	3.71	7.09	10.8	3.82
Oct-16	0.275	2.45	9.70	12.2	4.07
Nov-16	0.338	4.58	11.0	15.5	3.46
Dec-16	0.342	6.10	3.85	9.95	3.73
Jan-17	0.648	4.52	3.52	8.04	4.10
Feb-17	0.668	11.0	14.1	25.1	7.18
Mar-17	0.466	7.81	17.9	25.7	3.63
Apr-17	0.373	4.34	21.1	25.5	4.11
May-17	0.307	3.87	17.7	21.6	3.94
Jun-17	0.264	3.44	8.38	11.8	4.93
Jul-17	0.267	3.12	11.3	14.5	3.91
Aug-17	0.274	5.61	7.26	12.9	4.59
Sep-17	0.275	4.23	8.17	12.4	6.35
Oct-17	0.252	2.88	14.8	17.7	3.85
Nov-17	0.267	2.92	6.90	9.82	3.28
Dec-17	0.259	2.76	9.85	12.6	1.11
Jan-18	0.347	4.09	6.50	10.6	2.71
Feb-18	0.301	3.72	4.49	8.22	3.94
Mar-18	0.385	3.84	4.75	8.59	3.35
Apr-18	0.418	3.66	4.57	8.23	3.52
May-18	0.364	3.67	8.79	12.5	3.56
Jun-18	0.287	3.88	5.49	9.37	4.32
Jul-18	0.286	3.11	11.3	14.4	3.68
Aug-18	0.301	3.26	5.92	9.18	3.58
Sep-18	0.292	19.3	3.21	22.5	2.91

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-18	0.283	3.26	3.92		3.25
Nov-18	0.442	3.13	7.32	10.5	3.54
Dec-18	0.416				
Jan-19	0.541	6.85	3.27	10.1	3.06
Feb-19	0.723	7.27	11.3	18.6	3.00
Mar-19	0.599	6.98	10.6	17.6	3.45
Apr-19	0.405	4.31	6.19	11.3	3.64
May-19	0.351	3.75	4.12	7.87	2.77
Jun-19	0.329	4.02	8.01	12.0	3.36
Jul-19	0.288	3.45	12.5	16.0	3.01
Aug-19	0.288	3.00	15.3	18.3	3.50
Sep-19	0.278	2.82	13.4	16.2	1.33
Dry Season Average	0.287	4.94	9.56	14.5	3.39
Dry Season Trend	None	None	None	None	Up
Wet Season Average	0.378	4.97	9.82	15.0	3.28
Average Annual	0.341	4.96	9.71	14.8	3.33

* The Total Inorganic Nitrogen value is calculated by adding the "Ammonia" and "Nitrate + Nitrite" values.

** Refer to the Section 3.5 in the main body for a description on the statistical analysis.

33 Vallejo Flood and Wastewater District

Vallejo discharges to San Pablo Bay and it has approximately 37,845 service connections. The plant has a permitted ADWF capacity of 15.5 mgd and a peak wet weather capacity of 60 mgd. The current flows are approximately 8.41 mgd ADWF. The plant performs secondary treatment using a trickling filter/solids contact process.

The following observations are made based upon the figures and table in the subsequent pages:

- ◆ Previous year's data indicated a downward trend for flows in the dry season, which may be attributed to increased water conservation.
- ◆ There appears to be an upward dry season trend for all nitrogen species except for NO_x, which is downward trending.
- ◆ TIN was comprised of approximately even parts Ammonia and NO_x during the first two years of data. In subsequent years, ammonia makes up the majority of the nitrogen species. It appears that the plant performed partial nitrification up until the influent loads exceeded any nitrification capacity was exceeded.
- ◆ Phosphorus loads had remained relatively flat over the years, but recent data indicates a downward trend.
- ◆ The phosphorus concentrations range from 1.3 to 5.3 mg P/L, which suggests some total phosphorus load reduction at the plant.

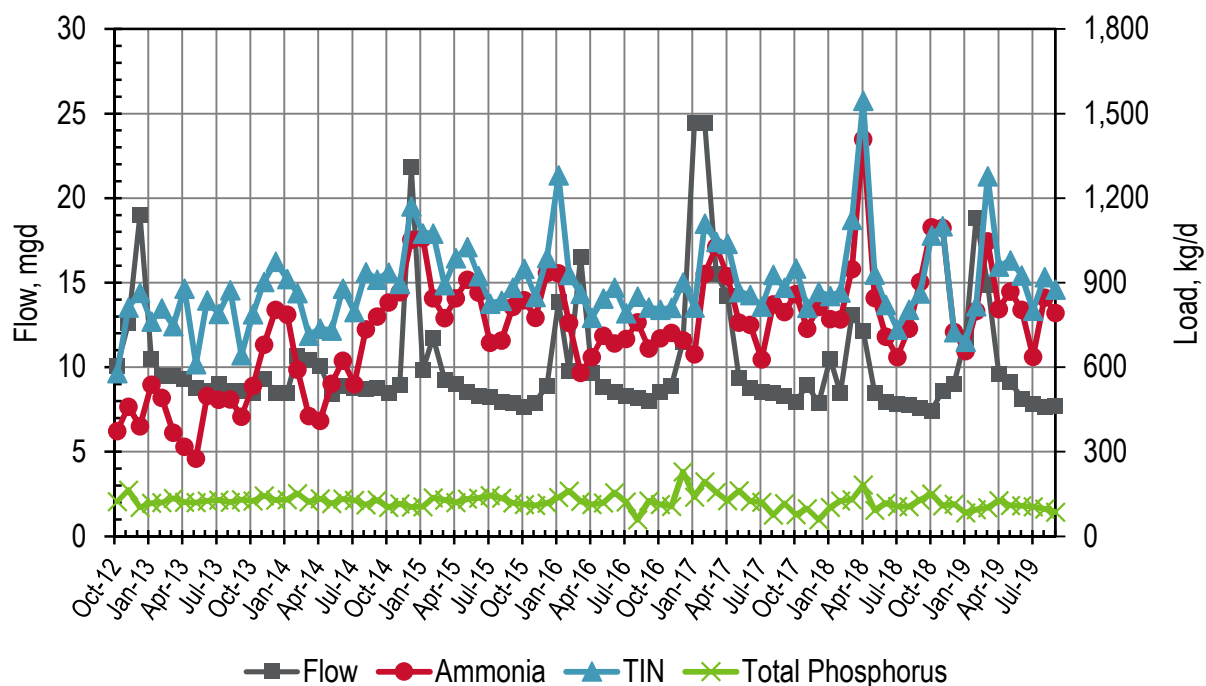


Figure 33-1. Vallejo Monthly Flows and Loads

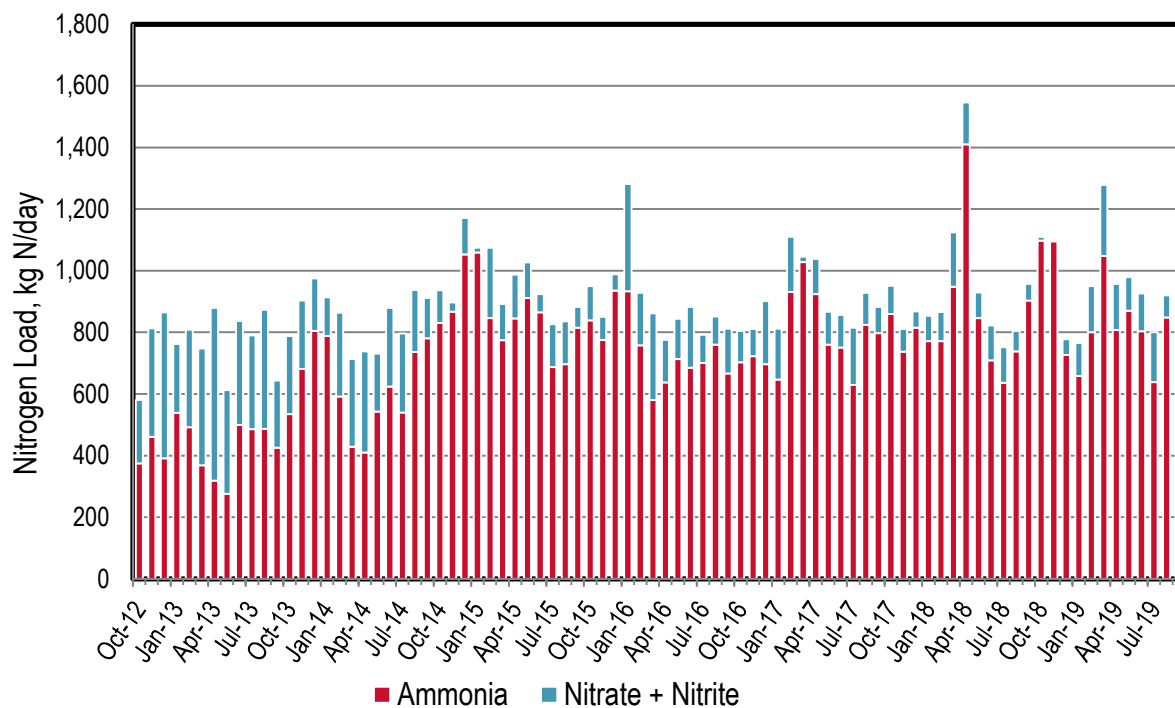


Figure 33-2. Vallejo Monthly Nitrogen Loads

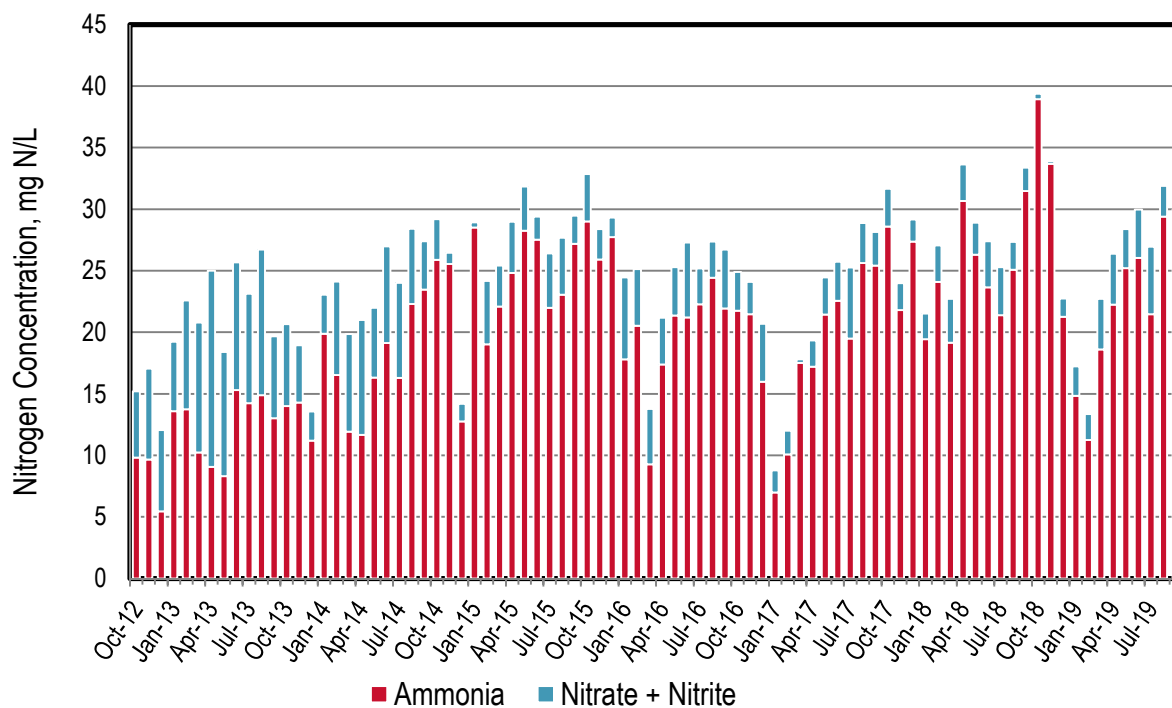


Figure 33-3. Vallejo Monthly Nitrogen Concentrations

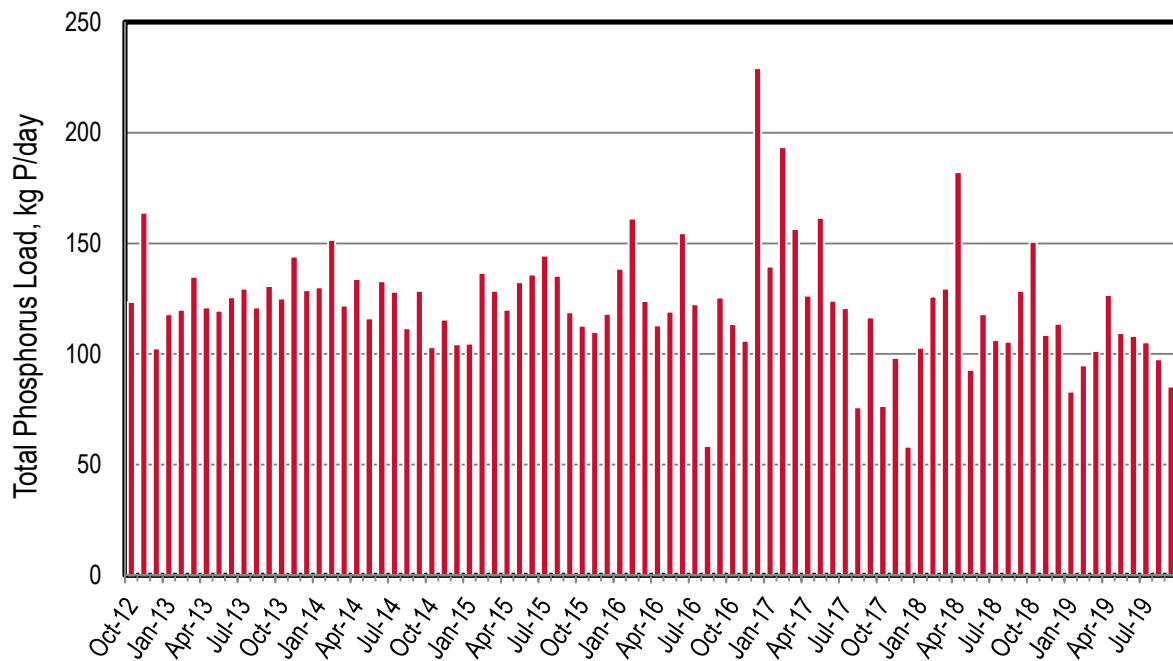


Figure 33-4. Vallejo Monthly Phosphorus Loads

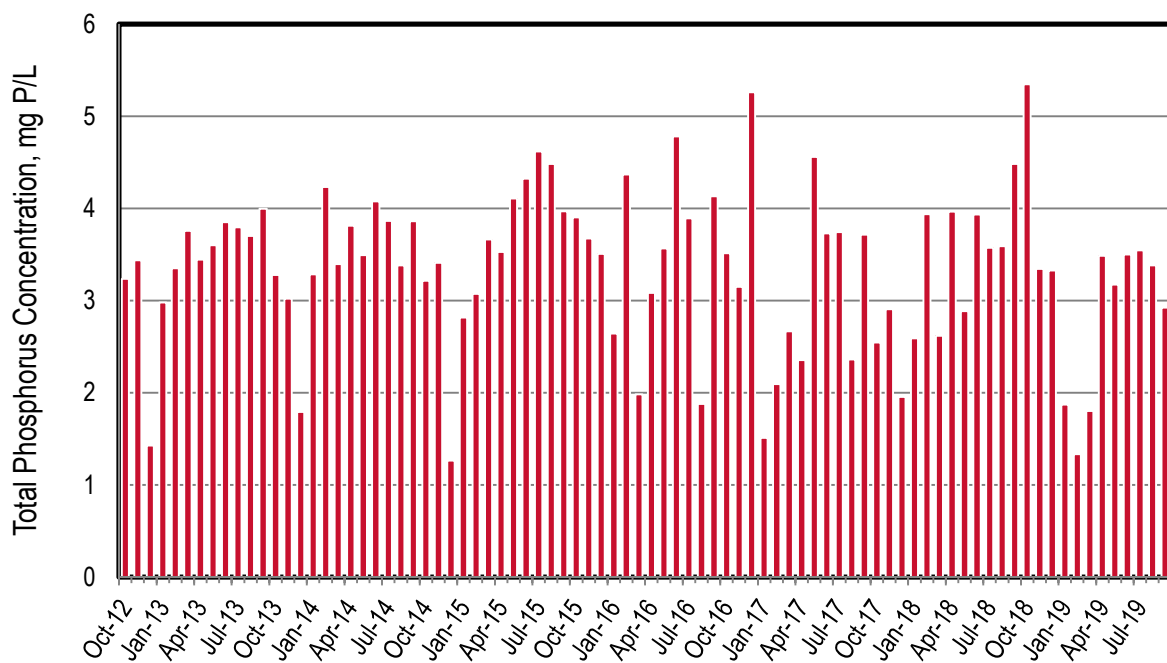


Figure 33-5. Vallejo Monthly Phosphorus Concentrations

Table 33-1. Vallejo Monthly Flows and Loads

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-12	10.1	374	206	580	123
Nov-12	12.6	461	352	813	164
Dec-12	19.0	391	474	865	103
Jan-13	10.5	539	224	762	118
Feb-13	9.48	492	317	809	120
Mar-13	9.51	368	379	747	135
Apr-13	9.30	318	561	879	121
May-13	8.80	276	336	612	120
Jun-13	8.63	499	338	837	126
Jul-13	9.04	486	304	790	130
Aug-13	8.65	486	387	873	121
Sep-13	8.65	426	218	643	131
Oct-13	8.49	535	253	788	125
Nov-13	9.31	681	222	903	144
Dec-13	8.52	804	171	975	129
Jan-14	8.51	788	126	913	130
Feb-14	10.7	592	272	864	152
Mar-14	10.4	428	285	713	122
Apr-14	10.1	410	327	738	134
May-14	8.43	542	188	731	116
Jun-14	8.92	624	256	880	133
Jul-14	8.77	540	256	796	128
Aug-14	8.73	736	201	937	112
Sep-14	8.81	781	131	912	129
Oct-14	8.49	831	105	936	103
Nov-14	8.97	867	30.4	897	116
Dec-14	21.8	1,050	118	1,170	104
Jan-15	9.83	1,060	15.9	1,080	105
Feb-15	11.8	846	229	1,070	137
Mar-15	9.28	775	117	892	129
Apr-15	9.01	846	142	987	120
May-15	8.53	911	115	1,030	132
Jun-15	8.32	865	58.6	924	136
Jul-15	8.28	688	138	826	144
Aug-15	7.99	696	140	836	135
Sep-15	7.93	815	68.0	883	119

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Oct-15	7.65	839	111	950	113
Nov-15	7.92	776	74.3	850	110
Dec-15	8.92	935	52.9	988	118
Jan-16	13.9	934	348	1,280	138
Feb-16	9.77	758	170	928	161
Mar-16	16.6	580	281	862	124
Apr-16	9.69	637	139	776	113
May-16	8.84	713	131	844	119
Jun-16	8.56	686	197	883	155
Jul-16	8.32	701	91.8	793	122
Aug-16	8.23	760	91.1	851	58.4
Sep-16	8.04	667	145	812	126
Oct-16	8.55	703	102	805	114
Nov-16	8.90	722	88.4	811	106
Dec-16	11.5	696	205	901	229
Jan-17	24.5	646	166	812	140
Feb-17	24.4	931	178	1,110	193
Mar-17	15.5	1,030	16.8	1,050	157
Apr-17	14.2	924	114	1,040	126
May-17	9.37	760	107	867	161
Jun-17	8.81	751	106	856	124
Jul-17	8.54	629	187	815	121
Aug-17	8.51	824	104	928	76.0
Sep-17	8.30	797	86.0	883	117
Oct-17	7.95	860	91.7	951	76.5
Nov-17	8.94	737	73.7	811	98.2
Dec-17	7.87	815	53.5	868	58.2
Jan-18	10.5	771	82.3	853	103
Feb-18	8.46	771	94.5	865	126
Mar-18	13.1	948	176	1,120	130
Apr-18	12.2	1,410	136	1,550	182
May-18	8.51	846	83.4	930	92.8
Jun-18	7.94	709	113	822	118
Jul-18	7.87	636	116	734	106
Aug-18	7.78	738	66.6	805	106
Sep-18	7.59	903	54.0	863	129
Oct-18	7.45	1,100	12.7	1,070	151

Month, Year	Flow	Ammonia	Nitrate + Nitrite	TIN	Total P
	mgd	kg N/day	kg N/day	kg N/day	kg P/day
Nov-18	8.60	1,100	6.07	1,100	109
Dec-18	9.05	727	50.6	725	114
Jan-19	11.8	659	106	691	83.1
Feb-19	18.8	800	150	817	94.9
Mar-19	14.9	1,050	230	1,280	101
Apr-19	9.61	807	151	958	127
May-19	9.13	870	109	979	109
Jun-19	8.17	804	122	926	108
Jul-19	7.86	638	163	801	105
Aug-19	7.63	848	72.1	920	97.5
Sep-19	7.72	793	82.6	876	85.3
Dry Season Average	8.40	698	153	848	118
Dry Season Trend	Down	Up	Down	Up	Down
Wet Season Average	11.4	757	171	922	125
Average Annual	10.1	733	164	892	122

* The Total Inorganic Nitrogen value is calculated by adding the "Ammonia" and "Nitrate + Nitrite" values.

** Refer to the Section 3.5 in the main body for a description on the statistical analysis.

34 West County Agency Outfall

West County is a common outfall and discharge permit between West County and the City of Richmond which discharges to the Central Bay. They have a combined permitted capacity of 28.5 mgd ADWF (12.5 mgd ADWF for West County and 16.0 mgd ADWF for the City of Richmond) and a combined wet weather capacity of 41 mgd (21.0 mgd for West County and 20.0 mgd for the City of Richmond). The Richmond plant has wet weather capacity greater than 20 mgd though only 20 mgd for full secondary treatment. The current discharge flows are approximately 7.8 mgd ADWF. The Richmond plant performs secondary treatment using activated sludge, whereas the West County plant recently completed a Modified Ludzack-Ettinger (MLE) activated sludge process upgrade.

The following observations are made based upon the figures and table in the subsequent pages:

- ◆ The Richmond Plant represents the majority of the discharge flow and load (data not shown). The West County Plant recycles a majority of their flows year-round.
- ◆ Based on the table with the average monthly values, there appears to be an emerging dry season upward trend for flow and all nutrient loads.
- ◆ Wet season nitrogen and phosphorus loads are typically greater and more variable than the dry season loads.
- ◆ Ammonia is the majority of the nitrogen species discharged, regardless of season. This would be expected since the Richmond Plant represents the majority of the discharge load and they do not nitrify. Additionally, West County sends landfill leachate rich in ammonia from their plant to the City of Richmond plant which contributes to the discharge loading.
- ◆ Total phosphorus concentrations vary between 0.6 to 5.8 mg P/L. Such values suggest P removal as typical effluent TP concentrations range from 4 to 6 mg P/L. There are no P removal facilities at the Richmond Plant so additional sampling is recommended to confirm where P removal is occurring.

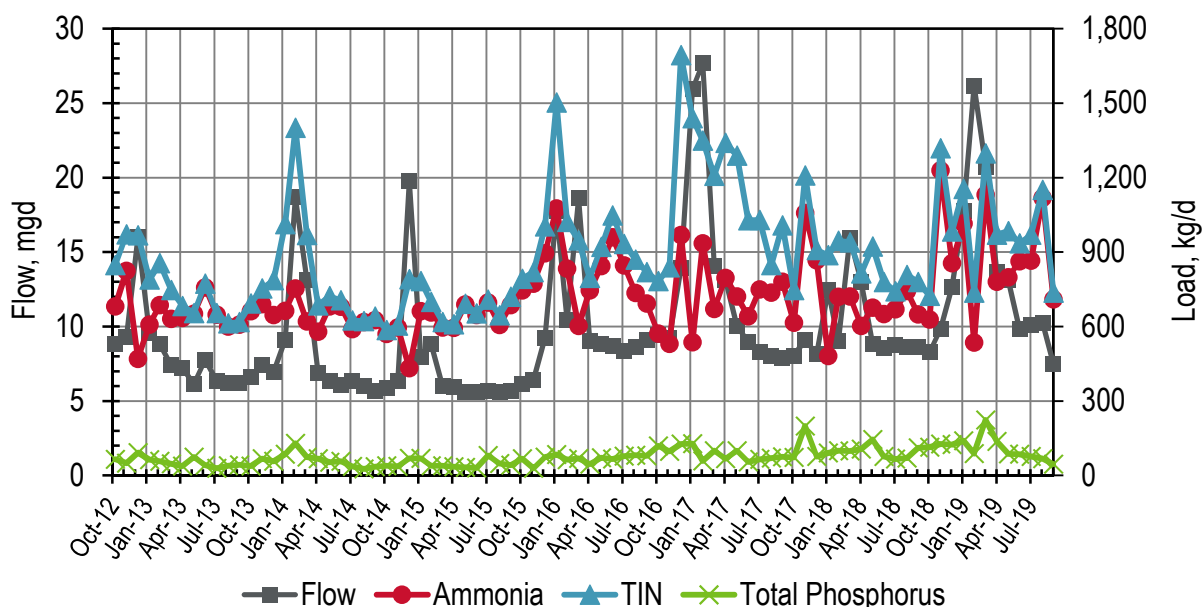


Figure 34-1. West County Monthly Flows and Loads

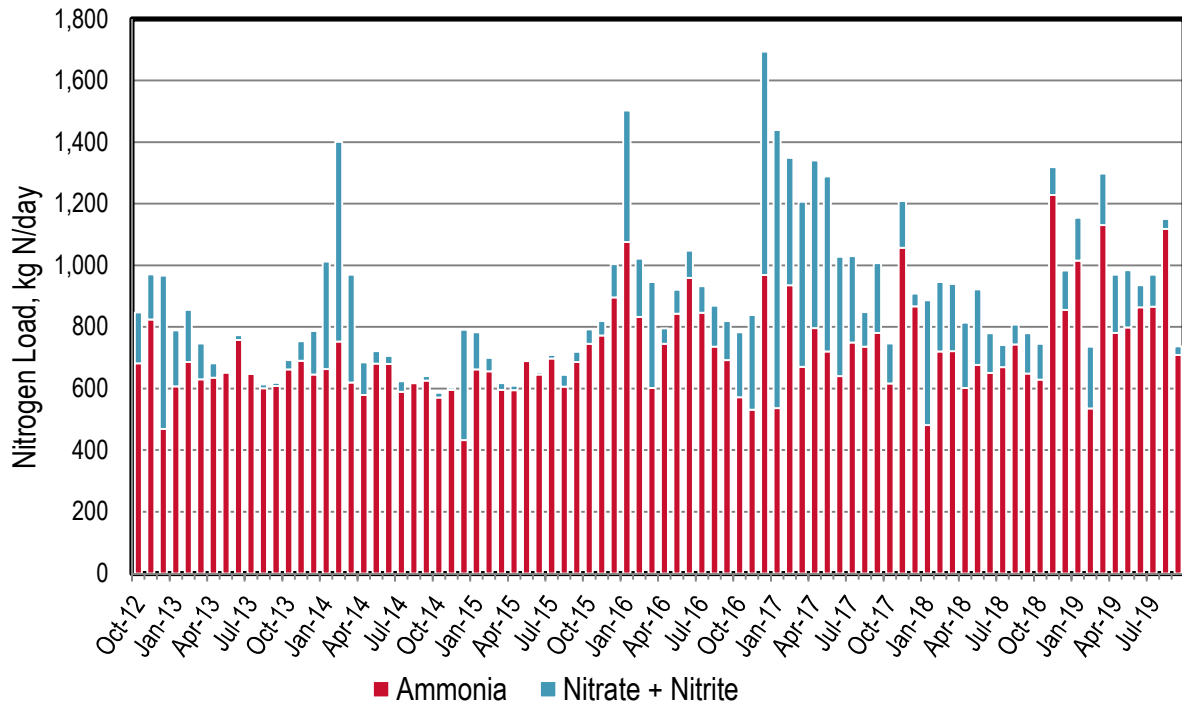


Figure 34-2. West County Monthly Nitrogen Loads

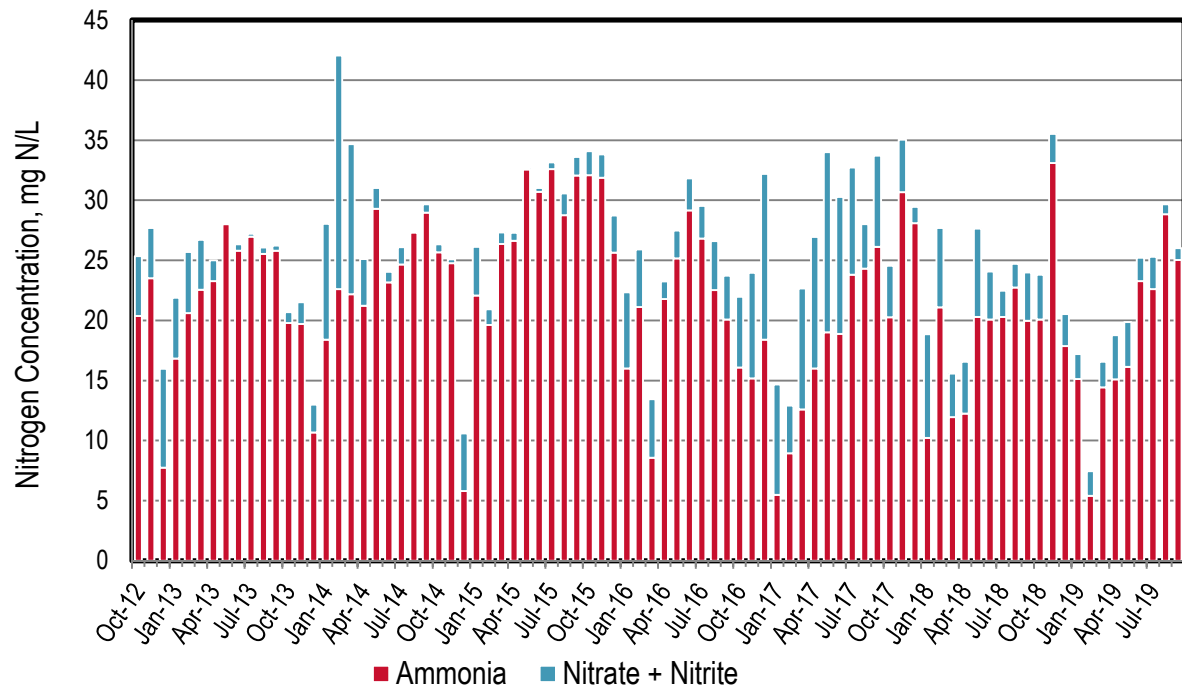


Figure 34-3. West County Monthly Nitrogen Concentrations

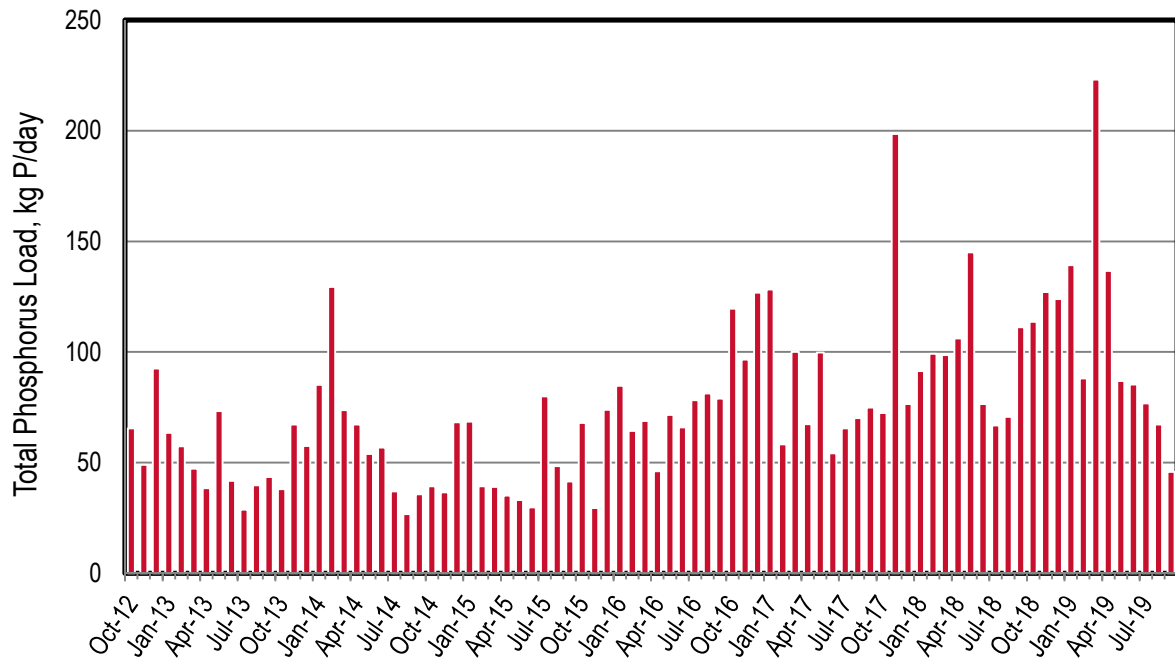


Figure 34-4. West County Monthly Phosphorus Loads

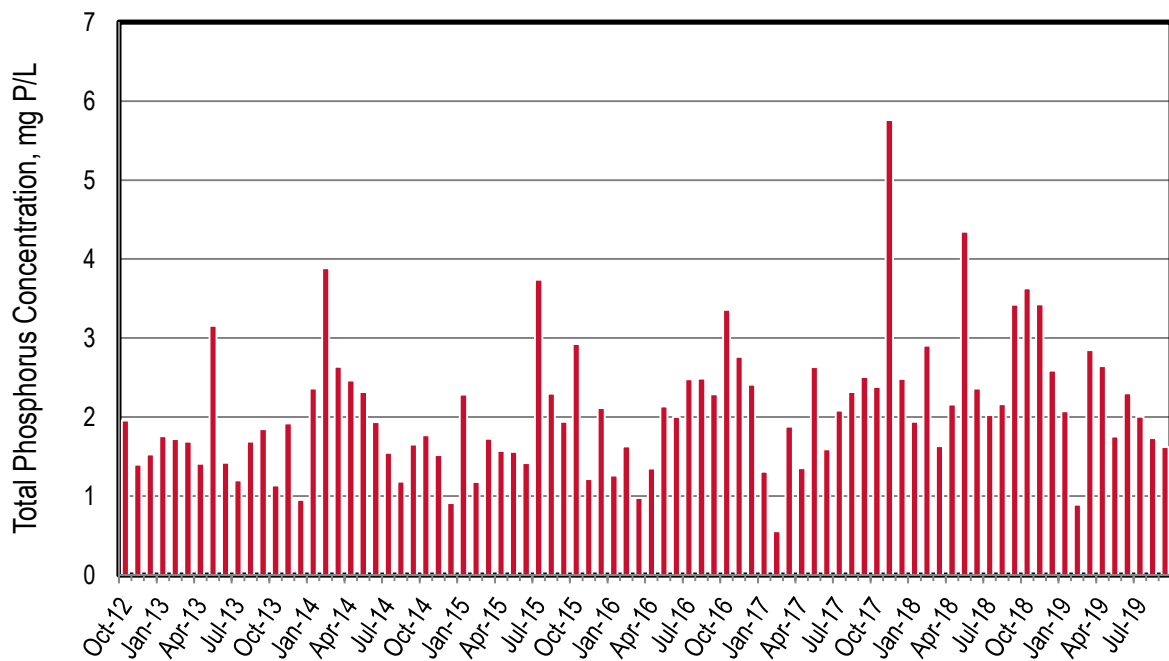


Figure 34-5. West County Monthly Phosphorus Concentrations

Table 34-1. West County Monthly Flows and Loads

Month, Year	Flow mgd	Ammonia kg N/day	Nitrate + Nitrite kg N/day	TIN kg N/day	Total P kg P/day
Oct-12	8.85	682	166	848	65.5
Nov-12	9.27	824	147	971	49.0
Dec-12	16.0	470	497	967	92.6
Jan-13	9.55	607	182	789	63.4
Feb-13	8.81	686	169	856	57.4
Mar-13	7.40	631	116	747	47.3
Apr-13	7.22	635	47.0	682	38.5
May-13	6.16	652	3.26	655	73.4
Jun-13	7.77	758	15.3	773	41.7
Jul-13	6.36	648	6.13	654	28.8
Aug-13	6.23	601	12.7	613	39.8
Sep-13	6.24	608	10.4	618	43.6
Oct-13	6.60	662	30.3	692	38.0
Nov-13	7.42	690	63.6	754	67.3
Dec-13	6.93	646	141	787	57.6
Jan-14	9.09	664	348	1,010	85.2
Feb-14	18.7	753	647	1,400	129
Mar-14	13.1	620	349	969	73.7
Apr-14	6.89	579	106	685	67.3
May-14	6.16	681	40.4	722	53.9
Jun-14	7.77	680	25.6	706	56.9
Jul-14	6.33	590	34.5	624	37.0
Aug-14	5.98	618	3.84	622	26.8
Sep-14	5.71	626	15.0	641	35.7
Oct-14	5.88	571	15.0	586	39.4
Nov-14	6.37	596	7.47	604	36.5
Dec-14	19.8	433	358	791	68.3
Jan-15	7.93	662	121	783	68.5
Feb-15	8.85	656	43.2	700	39.4
Mar-15	5.98	596	21.9	617	39.0
Apr-15	5.91	595	14.7	610	35.1
May-15	5.60	689	1.51	691	33.1
Jun-15	5.57	646	6.68	653	29.8
Jul-15	5.66	697	11.6	709	79.9
Aug-15	5.58	606	38.2	645	48.4
Sep-15	5.66	686	32.9	719	41.5

Month, Year	Flow mgd	Ammonia kg N/day	Nitrate + Nitrite kg N/day	TIN kg N/day	Total P kg P/day
Oct-15	6.15	745	46.5	792	67.9
Nov-15	6.41	772	47.0	819	29.5
Dec-15	9.24	896	108	1,000	73.9
Jan-16	17.8	1,080	427	1,500	84.8
Feb-16	10.4	833	189	1,020	64.3
Mar-16	18.6	602	344	946	68.8
Apr-16	9.06	745	50.2	795	46.2
May-16	8.87	843	77.4	921	71.6
Jun-16	8.71	960	88.0	1,050	66.0
Jul-16	8.35	846	86.0	932	78.2
Aug-16	8.64	736	134	869	81.2
Sep-16	9.12	693	126	819	78.9
Oct-16	9.42	572	210	782	120
Nov-16	9.25	531	308	839	96.7
Dec-16	13.9	968	725	1,690	127
Jan-17	25.9	536	903	1,440	128
Feb-17	27.7	935	414	1,350	58.3
Mar-17	14.1	671	536	1,210	100
Apr-17	13.2	796	544	1,340	67.4
May-17	10.0	721	567	1,290	99.8
Jun-17	8.99	641	388	1,030	54.2
Jul-17	8.32	749	280	1,030	65.6
Aug-17	8.01	736	112	848	70.1
Sep-17	7.91	781	226	1,010	75.0
Oct-17	8.04	616	131	747	72.4
Nov-17	9.12	1,060	151	1,210	199
Dec-17	8.16	867	41.8	908	76.5
Jan-18	12.5	481	406	887	91.3
Feb-18	9.04	720	226	946	99.1
Mar-18	16.0	722	218	939	98.6
Apr-18	13.0	602	211	814	106
May-18	8.83	677	245	922	145
Jun-18	8.57	651	129	780	76.5
Jul-18	8.73	670	71.9	741	66.9
Aug-18	8.65	744	64.3	808	70.7
Sep-18	8.60	649	131	780	111
Oct-18	8.29	629	117	724	114

Month, Year	Flow mgd	Ammonia kg N/day	Nitrate + Nitrite kg N/day	TIN kg N/day	Total P kg P/day
Nov-18	9.82	1,230	89.8	1,320	127
Dec-18	12.7	855	128	983	124
Jan-19	17.8	1,020	139	1,150	139
Feb-19	26.2	536	201	736	88.1
Mar-19	20.7	1,130	167	1,300	223
Apr-19	13.7	780	190	970	137
May-19	13.1	799	186	984	86.9
Jun-19	9.82	864	71.7	935	85.3
Jul-19	10.1	866	104	969	76.8
Aug-19	10.3	1,120	32.0	1,150	67.3
Sep-19	7.49	709	28.1	737	45.9
Dry Season Average	7.78	721	97.3	818	64.1
Dry Season Trend	Up	Up	Up	Up	Up
Wet Season Average	11.7	718	222	939	83.4
Average Annual	10.1	719	170	889	75.3

* The Total Inorganic Nitrogen value is calculated by adding the "Ammonia" and "Nitrate + Nitrite" values.

** Refer to the Section 3.5 in the main body for a description on the statistical analysis.